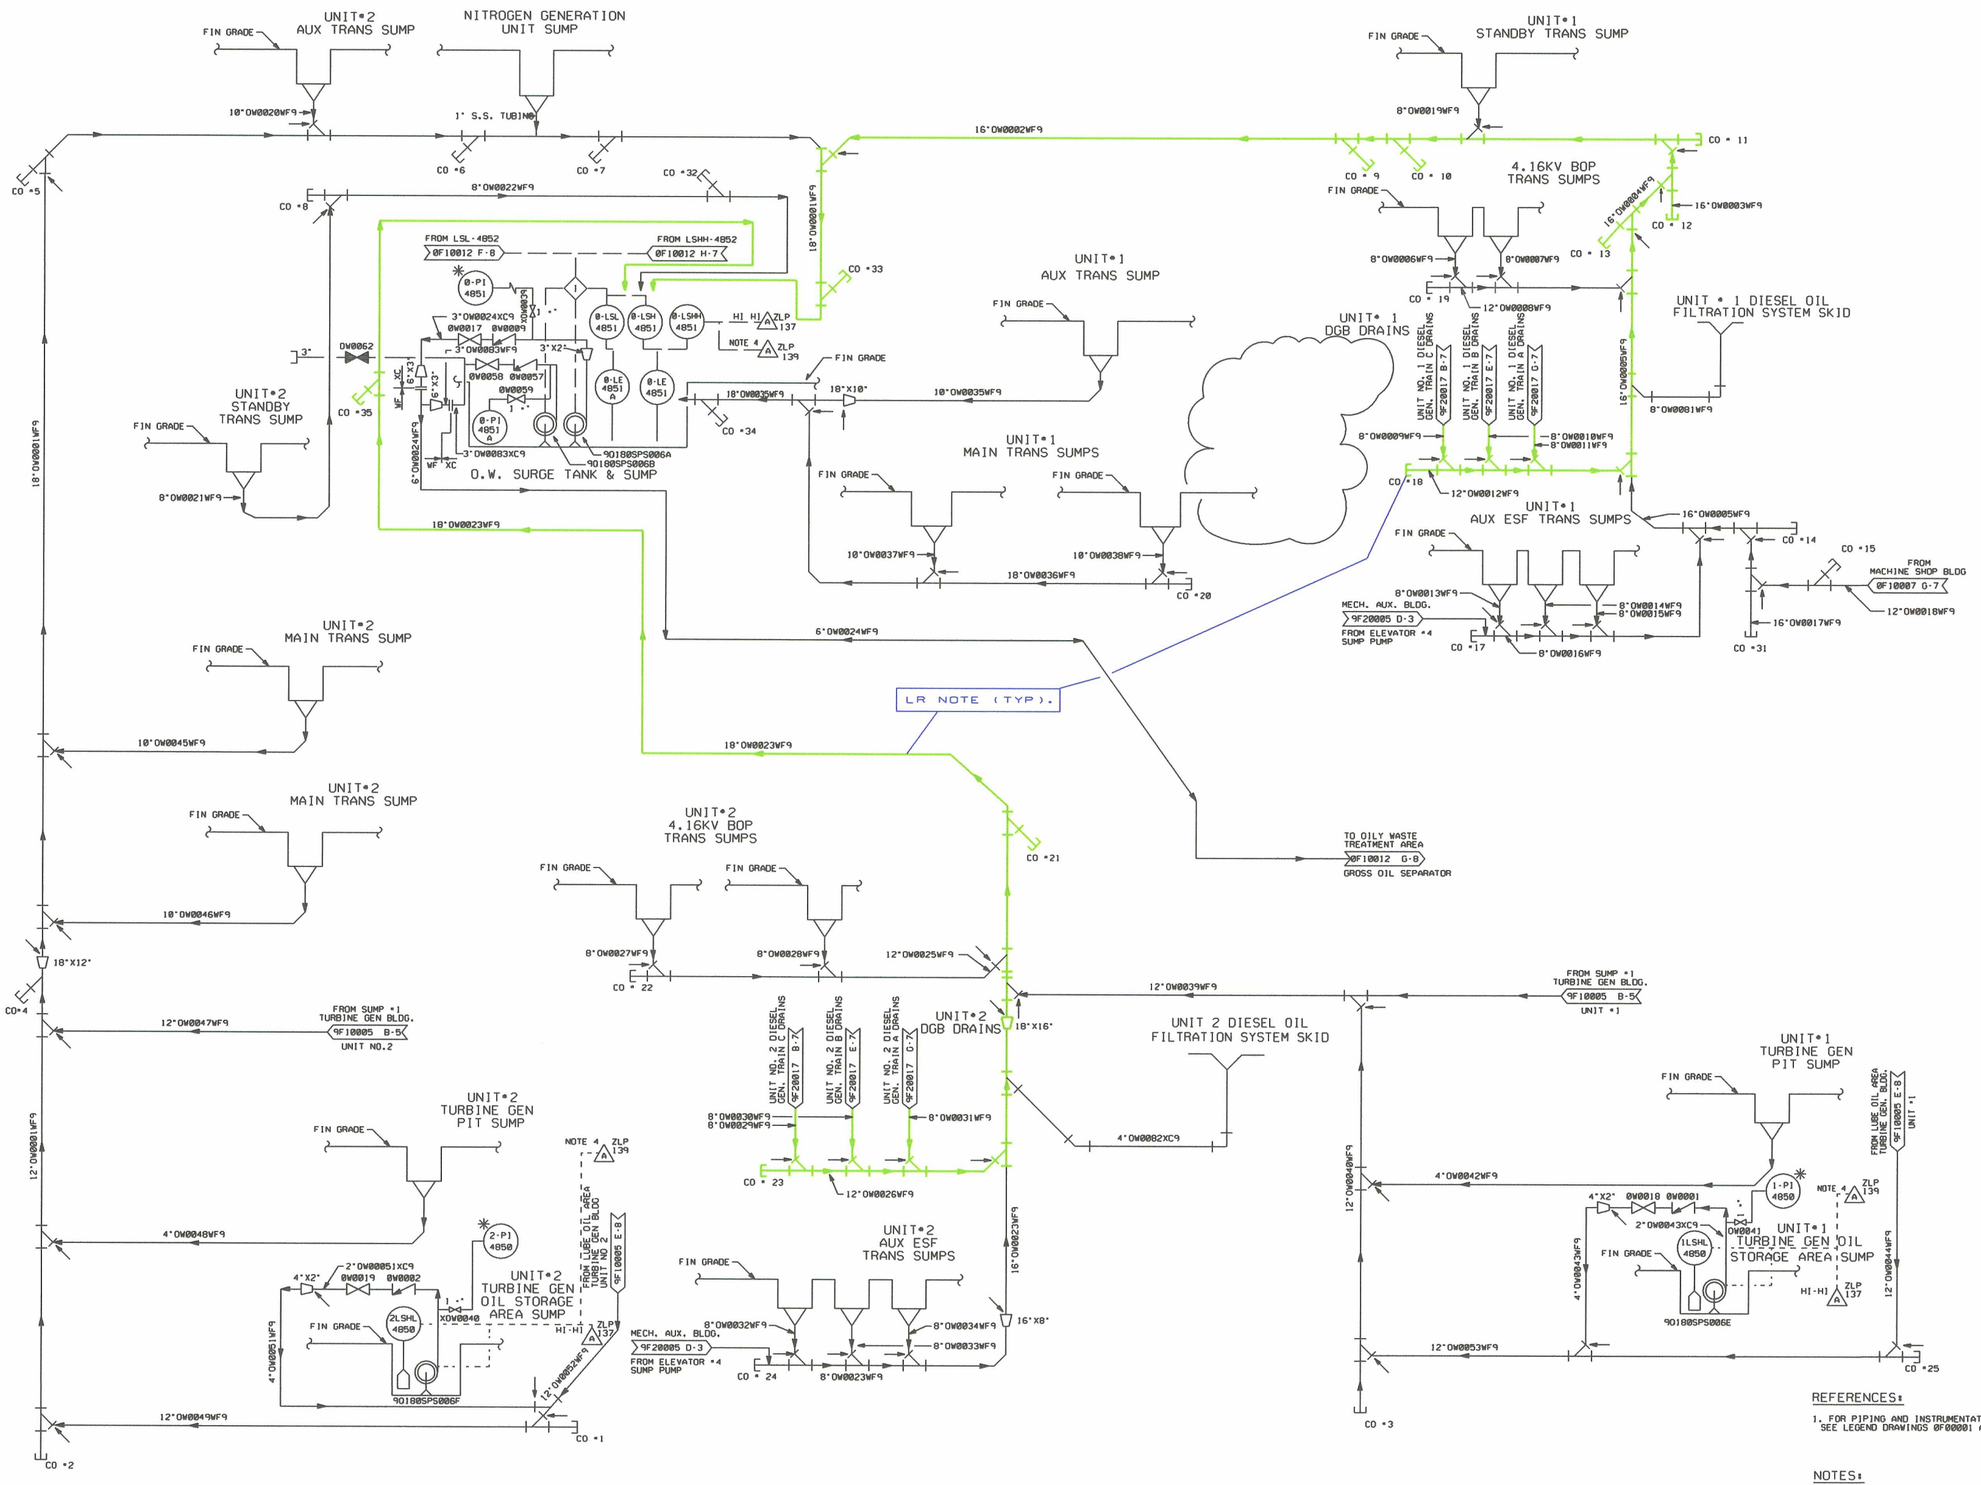

LR NOTE:
GREEN HIGHLIGHTED COMPONENTS ARE CREDITED FOR FIRE WATER REMOVAL PER 10 CFR 54.4(a)(3), AND ARE NOT SAFETY-RELATED PER 10 CFR 54.4(a)(1).

00234

REFERENCES:

1. FOR PIPING AND INSTRUMENTATION SYMBOLS SEE LEGEND DRAWINGS 0F00001 AND 0F00002.

NOTES:

1. ALL INSTRUMENTS ON THIS P&ID HAVE SYSTEM DESIGNATOR OW.
2. ALL INSTRUMENTS ON THIS P&ID HAVE SEPARATION GROUP N.
3. ALL PIPING ON THIS DWG IS BURIED EXCEPT AT PUMPS.
4. COMMON OILY WASTE SYSTEM TROUBLE ALARM

LR BOUNDARY DRAWING NO.	REV.
LR-STP-OW-9G060F10011	0A

NO.	ISSUE DATE	REVISION	ORIG	CKR	RE	DV	SE
16		INCORP. DCN 0001745.	JSH				
15	4-25-00	INCORP. DCN 9800731.	SIGNATURES ON FILE				
0-14	11-19-83	ISSUED FOR CONSTRUCTION.	SIGNATURES ON FILE				

ESSEED DCN

SOUTH TEXAS PROJECT NUCLEAR OPERATING COMPANY

PIPING AND INSTRUMENTATION DIAGRAM
YARD OILY WASTE SUMPS AND DRAINS

PRIORITY	CADD FILE NO.	FSUG. NO.	STI. NO.	SCALE	DWG. NO.	SHT.	REV.
1	FJA041.161	D070928		NONE	9G060F10011		16