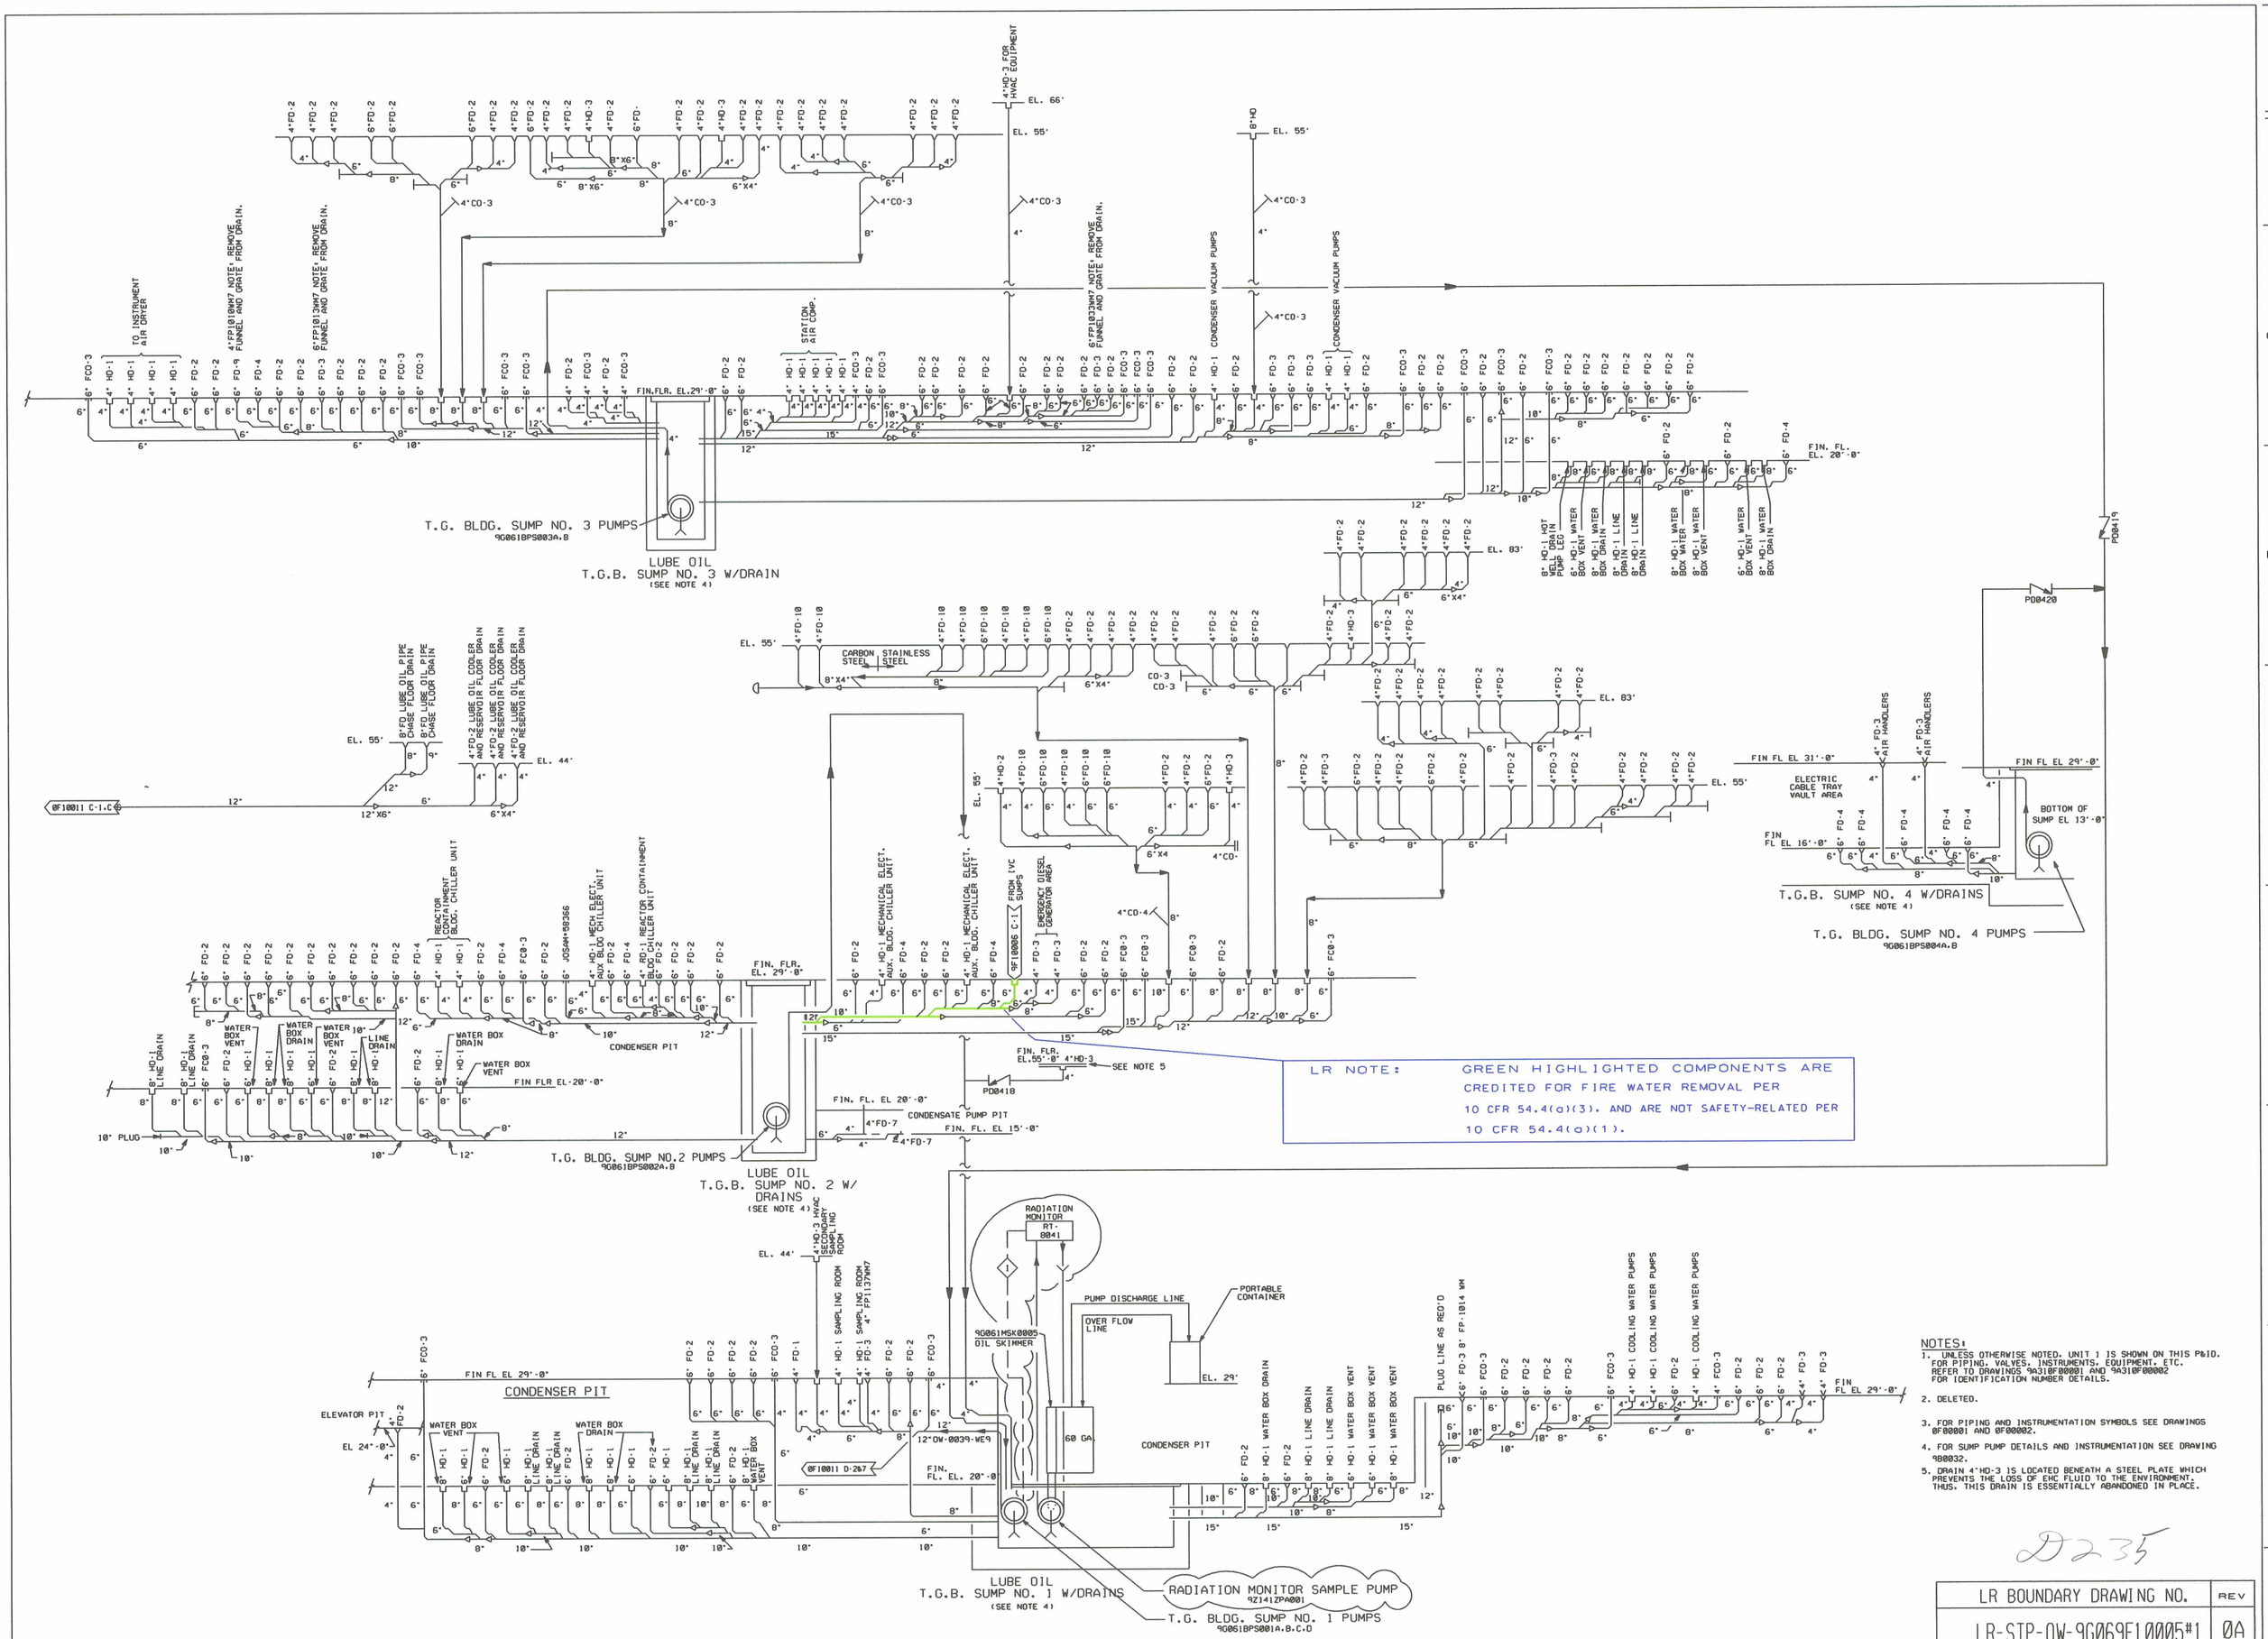

NOTES:

1. UNLESS OTHERWISE NOTED, UNIT 1 IS SHOWN ON THIS P&ID. FOR PIPING, VALVES, INSTRUMENTS, EQUIPMENT, ETC. REFER TO DRAWINGS 9A310F00001 AND 9A310F00002 FOR IDENTIFICATION NUMBER DETAILS.
2. DELETED.
3. FOR PIPING AND INSTRUMENTATION SYMBOLS SEE DRAWINGS 0F00001 AND 0F00002.
4. FOR SUMP PUMP DETAILS AND INSTRUMENTATION SEE DRAWING 9B0032.
5. DRAIN 4"HD-3 IS LOCATED BENEATH A STEEL PLATE WHICH PREVENTS THE LOSS OF EHC FLUID TO THE ENVIRONMENT. THUS, THIS DRAIN IS ESSENTIALLY ABANDONED IN PLACE.

D235

LR BOUNDARY DRAWING NO.	REV
LR-STP-OW-9G069F10005#1	0A

NO.	ISSUE DATE	REVISION	ORIG	CKR	RE	DV	SE
10		REVISED PER CR 00-14061-2	KS				
0-9	11/19/82	ISSUED FOR CONSTRUCTION	SIGNATURES ON FILE				

NO.	ISSUE DATE	REVISION	ORIG	CKR	RE	DV	SE

SOUTH TEXAS PROJECT
NUCLEAR OPERATING COMPANY

PIPING AND INSTRUMENTATION DIAGRAM
TURBINE BLDG SUMPS AND DRAINS
FOR OILY WASTE SYSTEM

PRIORITY	CADD FILE NO.	FSUG. NO.	STI. NO.	SCALE	DWG. NO.	SHT.	REV.
1	FJA122.101	D070928		NONE	9G069F10005#1		10

ESEED.DGN