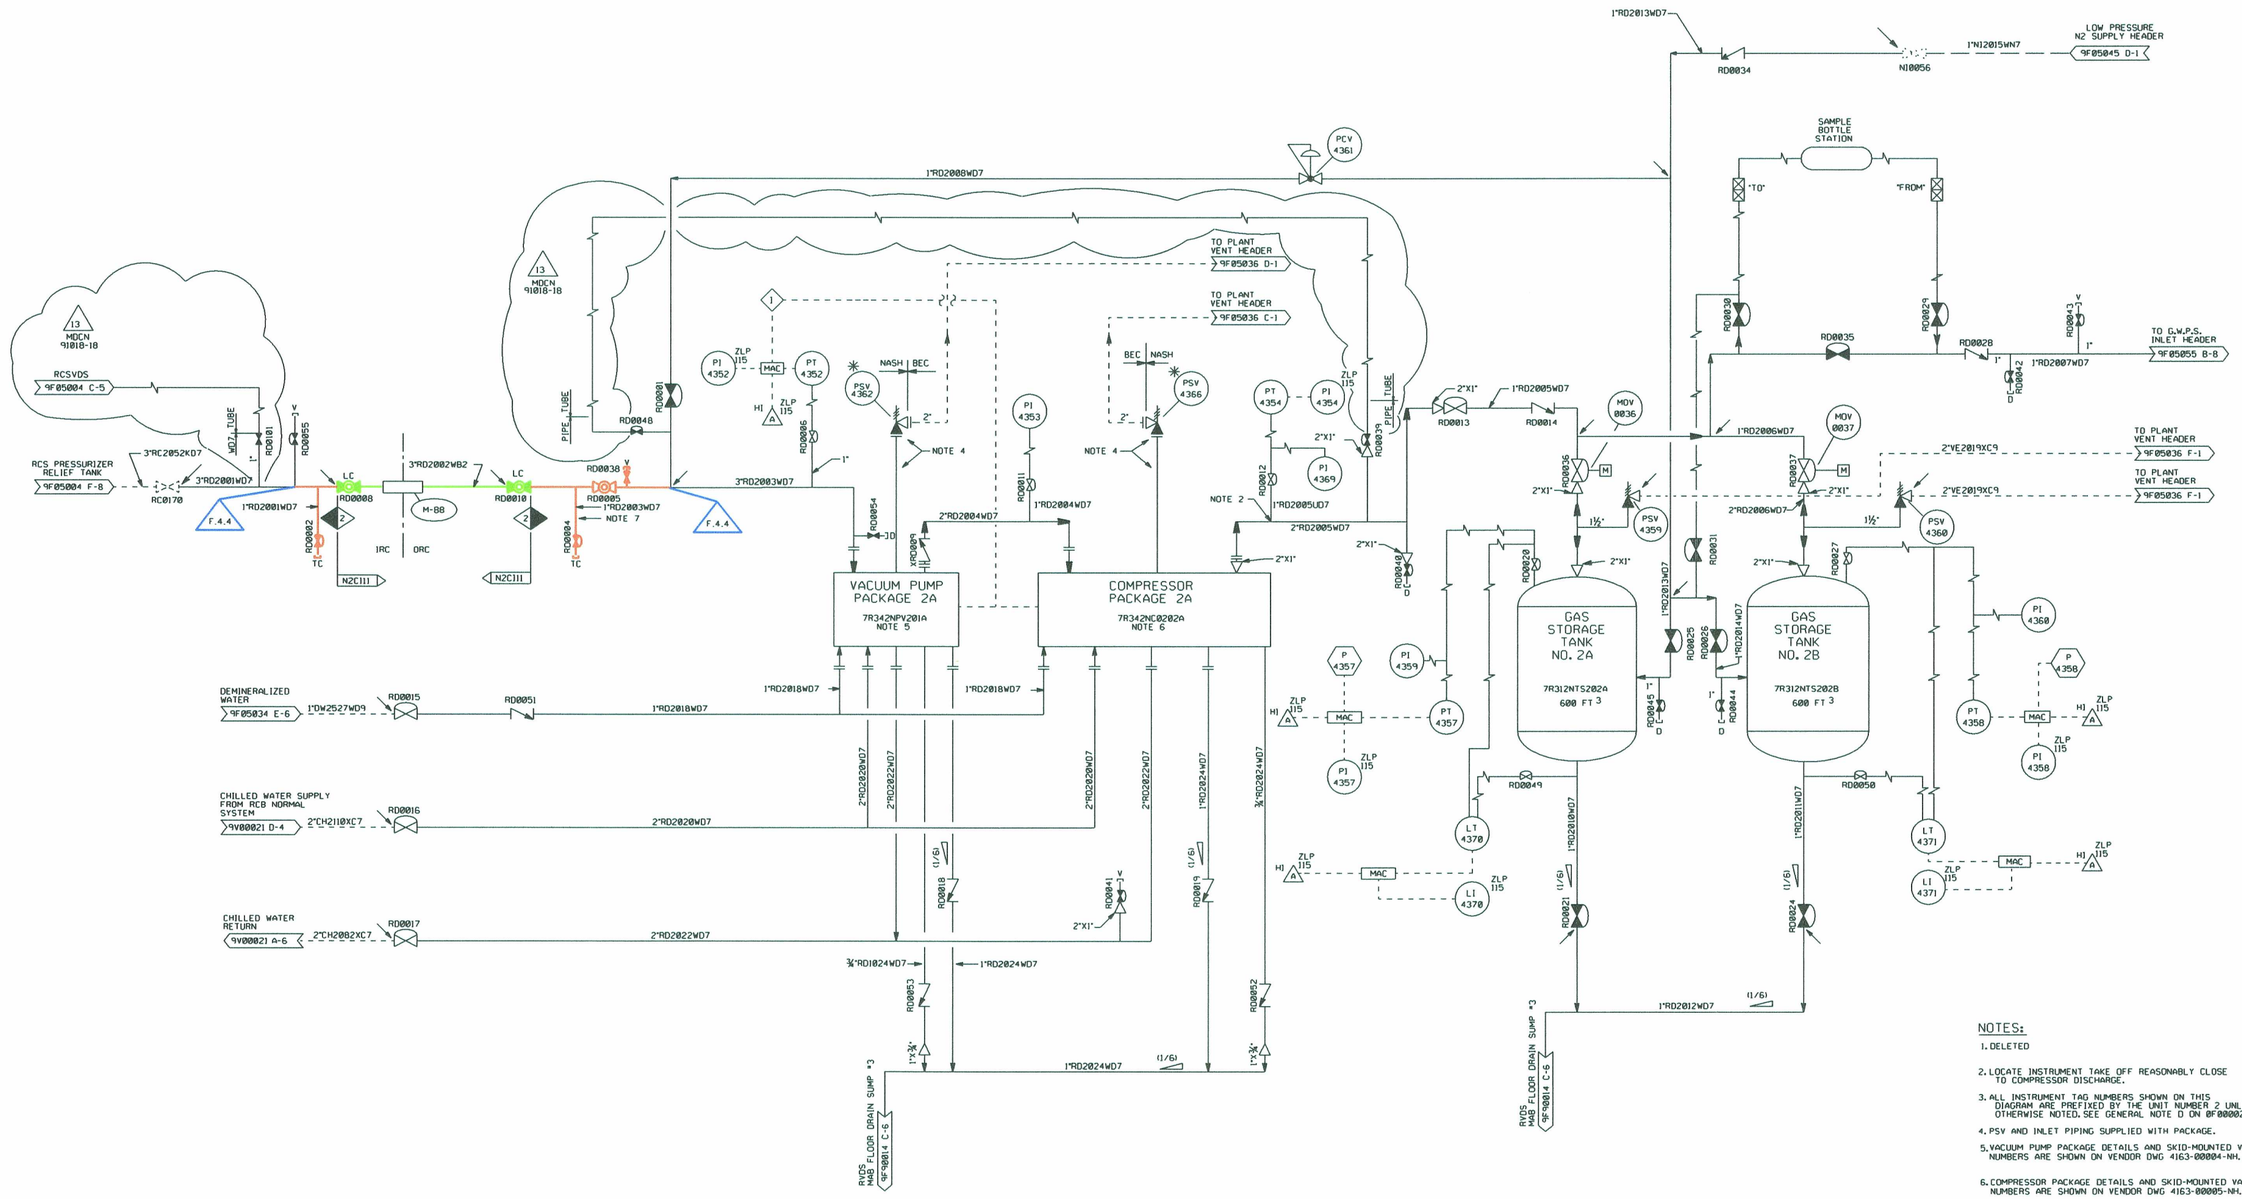

NOTES:

1. DELETED
2. LOCATE INSTRUMENT TAKE OFF REASONABLY CLOSE TO COMPRESSOR DISCHARGE.
3. ALL INSTRUMENT TAG NUMBERS SHOWN ON THIS DIAGRAM ARE PREFIXED BY THE UNIT NUMBER 2 UNLESS OTHERWISE NOTED. SEE GENERAL NOTE D ON 0F00002.
4. PSV AND INLET PIPING SUPPLIED WITH PACKAGE.
5. VACUUM PUMP PACKAGE DETAILS AND SKID-MOUNTED VALVE NUMBERS ARE SHOWN ON VENDOR DWG 4163-00004-NH.
6. COMPRESSOR PACKAGE DETAILS AND SKID-MOUNTED VALVE NUMBERS ARE SHOWN ON VENDOR DWG 4163-00005-NH.
7. LOCATE TEST CONNECTION REASONABLY CLOSE TO VALVE RD0010.
8. ALL INSTRUMENTS ON THIS P&ID HAVE SYSTEM DESIGNATOR RD, UNLESS OTHERWISE NOTED.
9. ALL INSTRUMENTS ON THIS P&ID HAVE SEPARATION GROUP N, UNLESS OTHERWISE NOTED.
10. REFER TO DWGS 9A310F00001 AND 9A310F00002 FOR IDENTIFICATION NUMBER DETAILS.

13 EDITORIAL

11. DELETED

REFERENCES:

1. FOR PIPING & INSTRUMENT SYMBOLS SEE DRAWINGS 0F00001 & 0F00002.

263

LR BOUNDARY DRAWING NO.	REV.
LR-STP-RC-5R349F05046#2	0

NO.	ISSUE DATE	REVISION	ORIG	CKR	RE	DV	SE
13		INCORP. MDCN 91018-18 AND EDITORIAL	LDD				
12	10-12-93	INCORP. DCN MD-01705	SIGNATURES ON FILE				
11	9-09-93	INCORP. DCN MD-02843	SIGNATURES ON FILE				
10	7-24-92	INCORP. DCN MD-02532	SIGNATURES ON FILE				
9	5-14-91	HL&P ASSUMES DESIGN CHANGE CONTROL & INC. DCN MD-1388	SIGNATURES ON FILE				
8-8	5-13-83	ISSUED FOR CONSTRUCTION	SIGNATURES ON FILE				

NO.	ISSUE DATE	REVISION	ORIG	CKR	RE	DV	SE

SOUTH TEXAS PROJECT
NUCLEAR OPERATING COMPANY

PIPING & INSTRUMENTATION DIAGRAM
RCS VACUUM DEGASSING SYSTEM

PRIORITY	CADD FILE NO.	FSUG. NO.	STI. NO.	SCALE	DWG. NO.	SHT.	REV.
1	FJA565.131			NONE	5R349F05046 #2		13

8 | 7 | 6 | 5 | 4 | 3 | 2 LDD | 1 FJA565.131