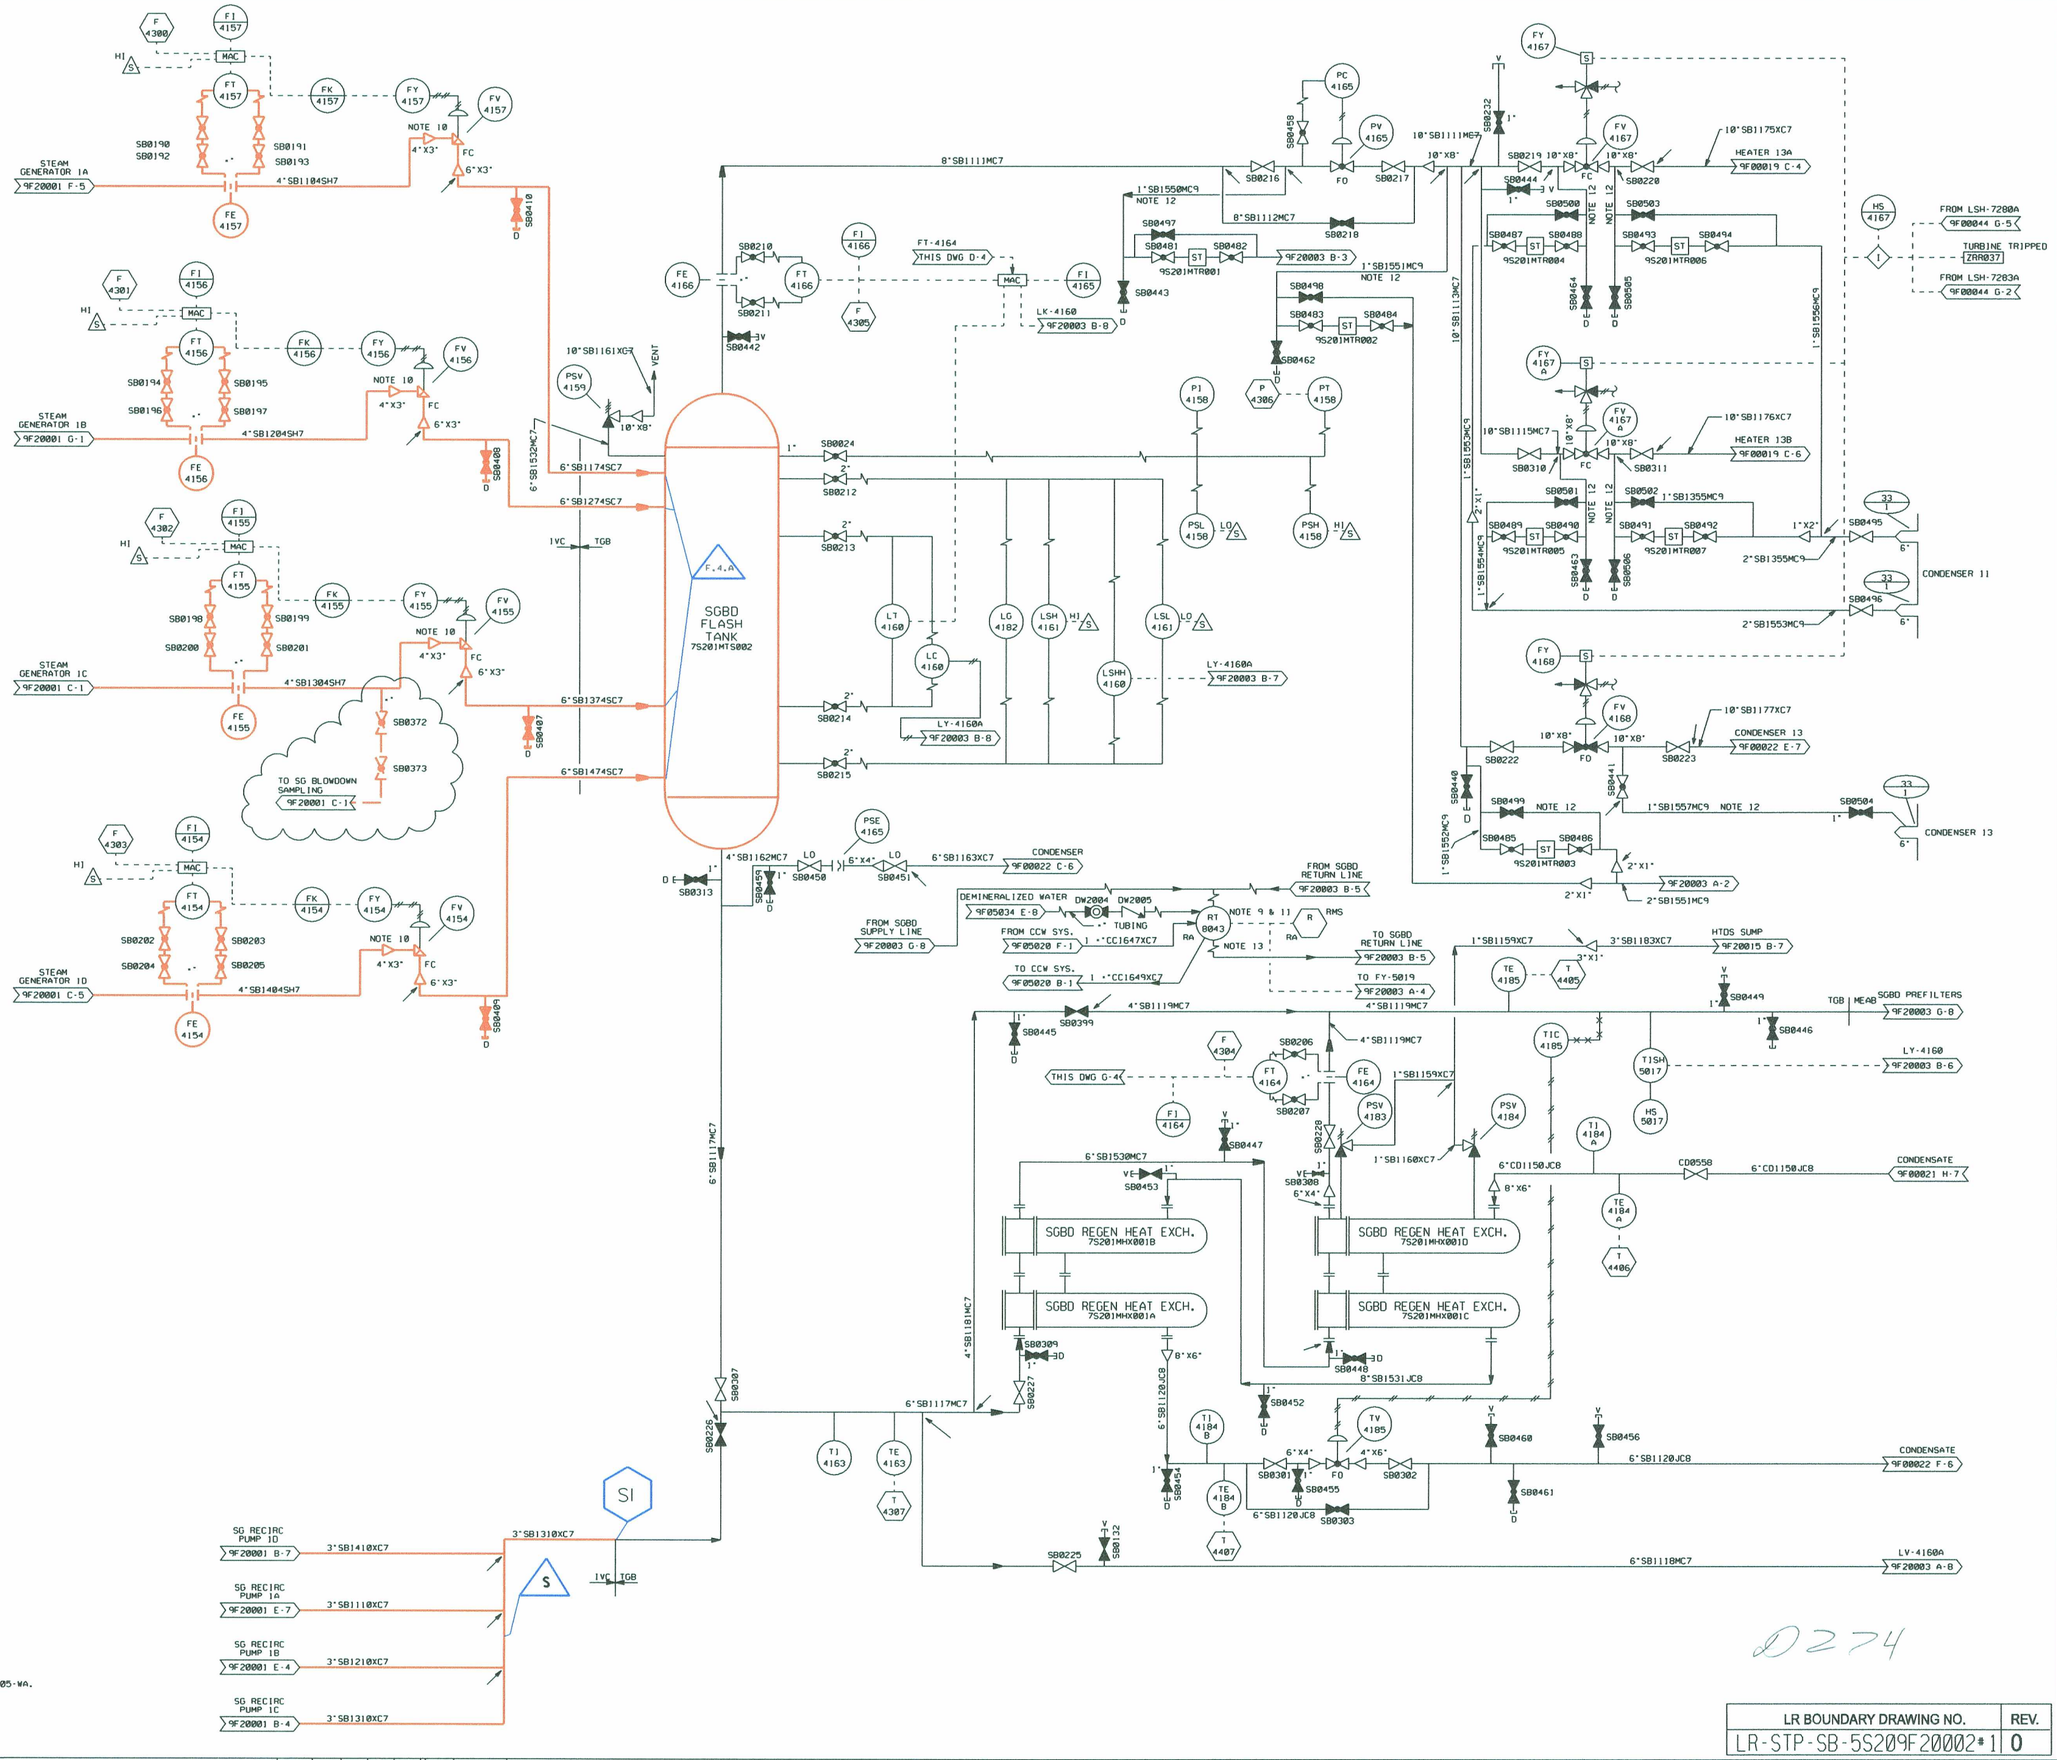

NOTES:

1. DELETED
2. SYSTEM DESIGNATOR FOR THIS DRAWING IS SB. UNLESS OTHERWISE NOTED.
3. THIS DWG. SUPERSEDES B&R DWGS. 1-F-0038 & 2-F-0038.
4. ALL INSTRUMENTS SHOWN ON THIS DIAGRAM HAVE SEPARATION GROUP N, EXCEPT WHERE NOTED OTHERWISE.
5. FOR P&ID STANDARDS AND SYMBOLS, REFER TO 0F00001 & 0F00002.
6. DELETED.
7. SEQUENCE CONTROL REF. DWG - LATER.
8. RCU IS THE REMOTE CONTROL UNIT FOR JE RITS. IT IS LOCATED IN RMS CONTROL ROOM CABINET.
9. RT-8043 PROVIDES LOCAL ALARM AND INDICATION.
10. VALVE TO BE LOCATED AT LOW POINT.
11. RT-8043 INCLUDES HEAT EXCHANGER
12. PIPING TO BE HORIZONTAL & DOWN IN THE DIRECTION OF FLOW. THE PIPING ARRANGEMENT SHALL NOT INCLUDE LOOPS OR POCKETS.
13. TAG NUMBERS OF VALVES FURNISHED BY GENERAL ATOMIC IS SHOWN ON REF * 2.

REFERENCES:

1. CONDENSER OUTLINE DRAWINGS, LOG NUMBERS 14926-01001-WA THRU -01005-WA,4001-01001-WA THRU 01005-WA.
2. GENERAL ATOMIC DWG NO. 0392-1001 (LIQ W/HX), SHT 22. (4301-00279-0W, 0301-00271-OW).

D274

LR BOUNDARY DRAWING NO.	REV.
LR-STP-SB-5S209F20002#1	0

NO.	ISSUE DATE	REVISION	ORIG	CKR	RE	DV	SE
16		INCORP. DCN 0701051.	JSH				
15	12-9-98	INCORP. DCN 9704268.	LNB	ON FILE			
0-14	9-16-97	ISSUED FOR CONSTRUCTION	SIGNATURES ON FILE				

ISSEED DCN

SOUTH TEXAS PROJECT NUCLEAR OPERATING COMPANY

PIPING AND INSTRUMENTATION DIAGRAM STEAM GENERATOR BLOWDOWN SYSTEM

PRIORITY	CADD FILE NO.	FSUG. NO.	STI. NO.	SCALE	DWG. NO.	SHT.	REV.
1	FJA172.161	D070928		NONE	5S209F20002#1		16