NOTES:

1. ALL MOTOR OPERATED VALVES SHALL HAVE MANUAL OPERATION HANDWHEELS.

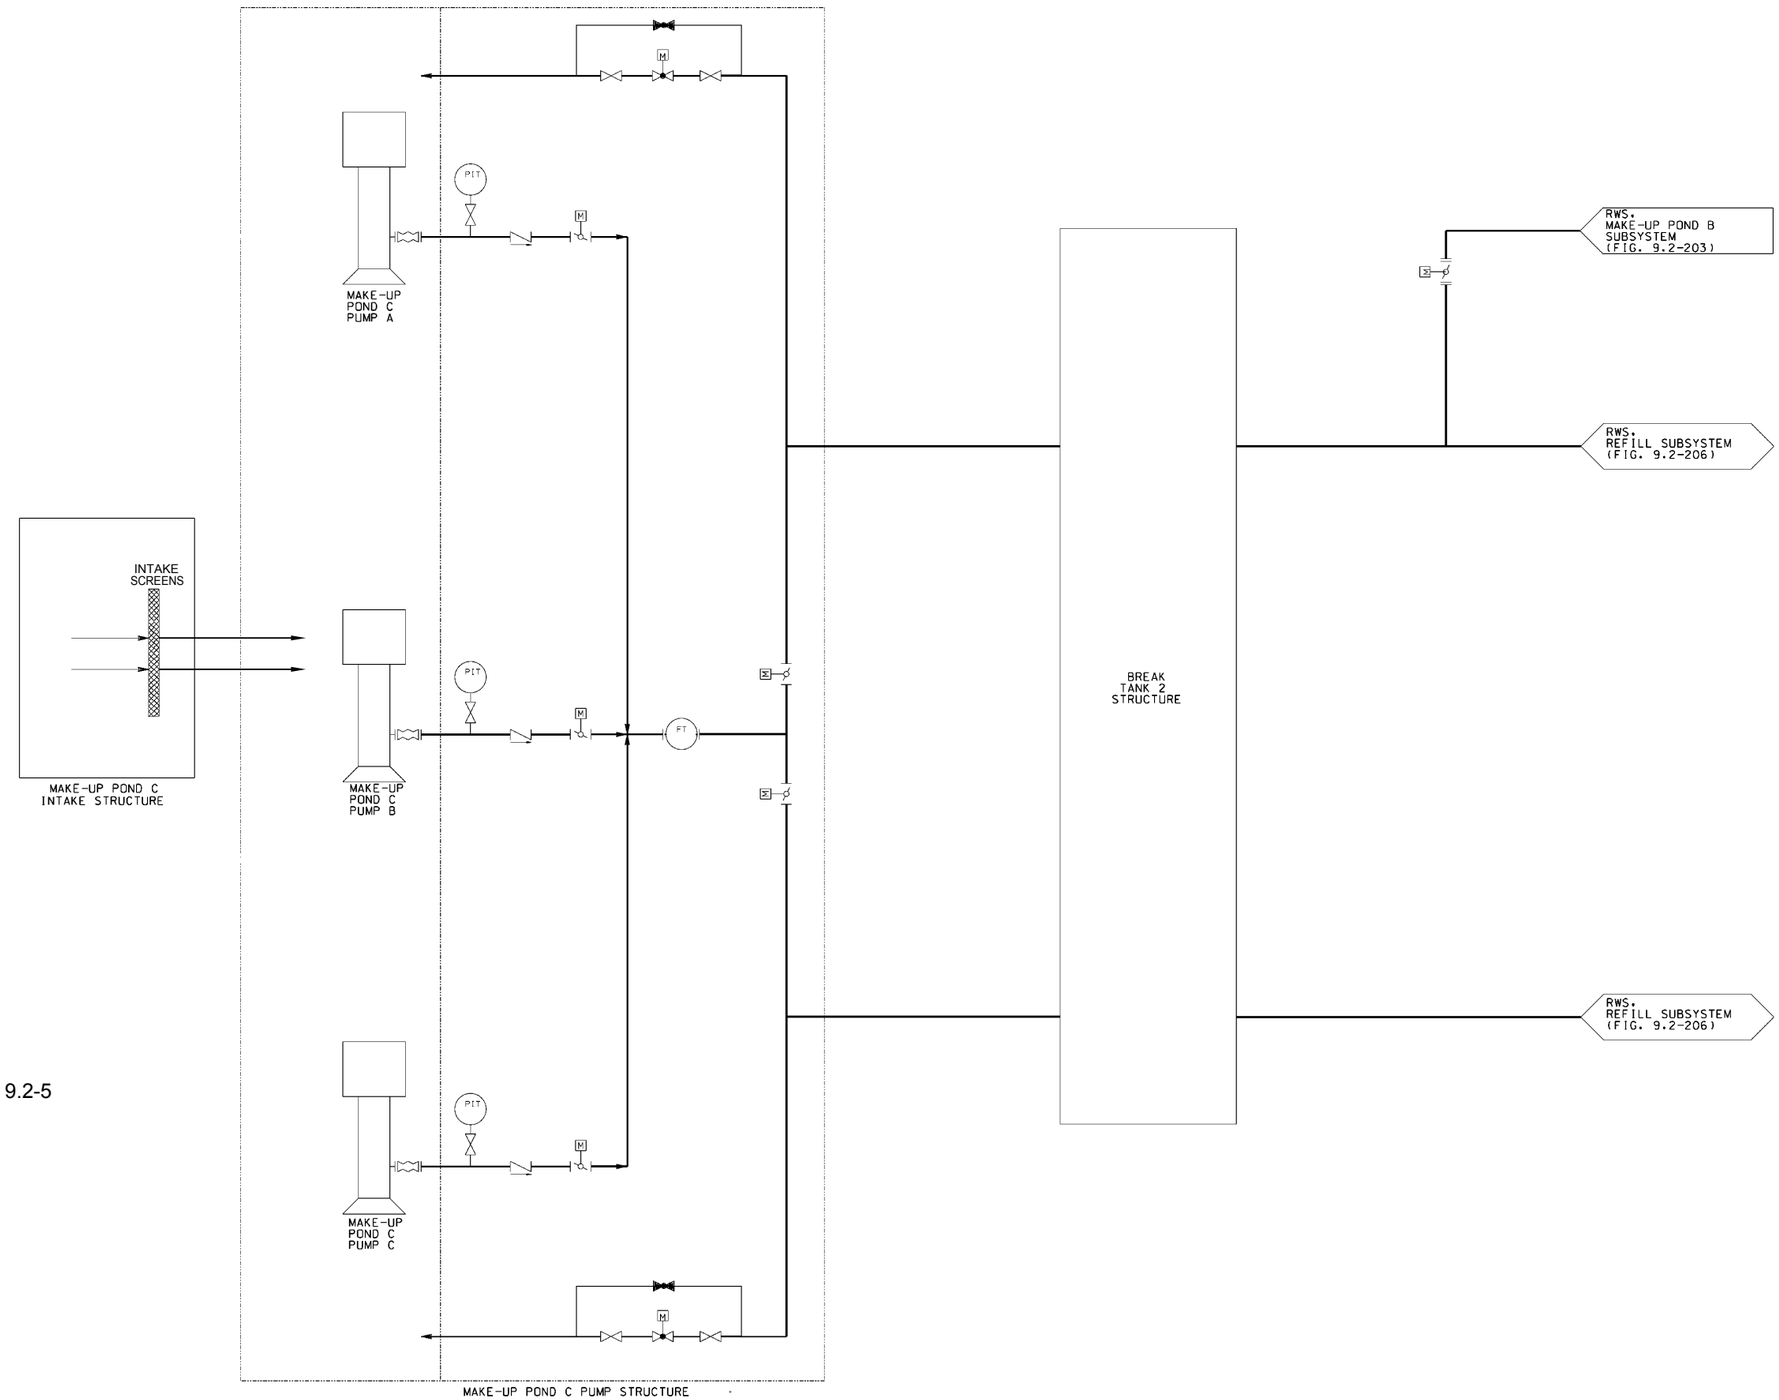

WLS SUP 9.2-5

WILLIAM STATES LEE III NUCLEAR STATION UNITS 1 & 2

Raw Water System, Make-Up Pond C Subsystem

FIGURE 9.2-207 Rev 3