

1042

Jan. 17, 2011

HARD COPY DISTRIBUTION
DOCUMENT TRANSMITTAL 2011-2403

USER INFORMATION:

Name: GERLACH*ROSE M EMPL#: 028401 CA#: 0363
Address: NUCSA2
Phone#: 254-3194

TRANSMITTAL INFORMATION:

TO: GERLACH*ROSE M 01/14/2011
LOCATION: USNRC
FROM: NUCLEAR RECORDS DOCUMENT CONTROL CENTER (NUCSA-2)
THE FOLLOWING CHANGES HAVE OCCURRED TO THE HARDCOPY OR ELECTRONIC MANUAL ASSIGNED TO YOU.
HARDCOPY USERS MUST ENSURE THE DOCUMENTS PROVIDED MATCH THE INFORMATION ON THIS
TRANSMITTAL. WHEN REPLACING THIS MATERIAL IN YOUR HARDCOPY MANUAL, ENSURE THE UPDATE
DOCUMENT ID IS THE SAME DOCUMENT ID YOU'RE REMOVING FROM YOUR MANUAL. TOOLS FROM THE
HUMAN PERFORMANCE TOOL BAG SHOULD BE UTILIZED TO ELIMINATE THE CHANCE OF ERRORS.
ATTENTION: "REPLACE" directions do not affect the Table of Contents, Therefore no TOC
will be issued with the updated material.

TRM2 - TECHNICAL REQUIREMENTS MANUAL UNIT 2

REMOVE MANUAL TABLE OF CONTENTS DATE: 01/12/2011

ADD MANUAL TABLE OF CONTENTS DATE: 01/13/2011

CATEGORY: DOCUMENTS TYPE: TRM2
ID: TEXT 2.2
REMOVE: REV: 9

ADD: REV: 10

CATEGORY: DOCUMENTS TYPE: TRM2
ID: TEXT 3.3.6
REMOVE: REV: 2

ADD: REV: 3

CATEGORY: DOCUMENTS TYPE: TRM2
ID: TEXT B3.3.6
ADD: REV: 4

REMOVE: REV: 3

4001
NRR

2 of 2

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT LOES

REMOVE: REV:65

ADD: REV: 66

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT TOC

ADD: REV: 19

REMOVE: REV:18

ANY DISCREPANCIES WITH THE MATERIAL PROVIDED, CONTACT DCS @ X3107 OR X3136 FOR ASSISTANCE. UPDATES FOR HARDCOPY MANUALS WILL BE DISTRIBUTED WITHIN 3 DAYS IN ACCORDANCE WITH DEPARTMENT PROCEDURES. PLEASE MAKE ALL CHANGES AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX UPON COMPLETION OF UPDATES. FOR ELECTRONIC MANUAL USERS, ELECTRONICALLY REVIEW THE APPROPRIATE DOCUMENTS AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX.

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

Table Of Contents

Issue Date: 01/13/2011

<u>Procedure Name</u>	<u>Rev</u>	<u>Issue Date</u>	<u>Change ID</u>	<u>Change Number</u>
TEXT LOES Title: LIST OF EFFECTIVE SECTIONS	66	01/13/2011		
TEXT TOC Title: TABLE OF CONTENTS	19	01/13/2011		
TEXT 1.1 Title: USE AND APPLICATION DEFINITIONS	0	11/19/2002		
TEXT 2.1 Title: PLANT PROGRAMS AND SETPOINTS PLANT PROGRAMS	1	02/04/2005		
TEXT 2.2 Title: PLANT PROGRAMS AND SETPOINTS INSTRUMENT TRIP SETPOINT TABLE	10	01/13/2011		
TEXT 3.0 Title: APPLICABILITY TECHNICAL REQUIREMENT FOR OPERATION (TRO) APPLICABILITY	4	05/23/2008		
TEXT 3.1.1 Title: REACTIVITY CONTROL SYSTEMS ANTICIPATED TRANSIENT WITHOUT SCRAM ALTERNATE ROD INJECTION (ATWS-ARI) INSTRUMENTATION	1	11/09/2007		
TEXT 3.1.2 Title: REACTIVITY CONTROL SYSTEMS CONTROL ROD DRIVE (CRD) HOUSING SUPPORT	0	11/19/2002		
TEXT 3.1.3 Title: REACTIVITY CONTROL SYSTEMS CONTROL ROD BLOCK INSTRUMENTATION	4	05/14/2009		
TEXT 3.1.4 Title: REACTIVITY CONTROL SYSTEMS CONTROL ROD SCRAM ACCUMULATORS INSTRUMENTATION AND CHECK VALVE	0	11/19/2002		
TEXT 3.2.1 Title: CORE OPERATING LIMITS CORE OPERATING LIMITS REPORT (COLR)	8	05/14/2009		

LDCN

4712

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.3.1 0 11/19/2002

Title: INSTRUMENTATION RADIATION MONITORING INSTRUMENTATION

TEXT 3.3.2 2 11/09/2007

Title: INSTRUMENTATION SEISMIC MONITORING INSTRUMENTATION

TEXT 3.3.3 2 11/09/2007

Title: INSTRUMENTATION METEOROLOGICAL MONITORING INSTRUMENTATION

TEXT 3.3.4 6 07/09/2010

Title: INSTRUMENTATION TRM POST-ACCIDENT MONITORING INSTRUMENTATION

TEXT 3.3.5 0 11/19/2002

Title: INSTRUMENTATION THIS PAGE INTENTIONALLY LEFT BLANK

TEXT 3.3.6 3 01/13/2011

Title: INSTRUMENTATION TRM ISOLATION ACTUATION INSTRUMENTATION

TEXT 3.3.7 1 11/09/2007

Title: INSTRUMENTATION MAIN TURBINE OVERSPEED PROTECTION SYSTEM

TEXT 3.3.8 1 10/22/2003

Title: INSTRUMENTATION TRM RPS INSTRUMENTATION

TEXT 3.3.9 3 05/14/2009

Title: INSTRUMENTATION LPRM UPSCALE ALARM INSTRUMENTATION

TEXT 3.3.10 1 12/14/2004

Title: INSTRUMENTATION REACTOR RECIRCULATION PUMP MG SET STOPS

TEXT 3.3.11 1 10/22/2003

Title: INSTRUMENTATION MVP ISOLATION INSTRUMENTATION

TEXT 3.3.12 0 04/16/2009

Title: WATER MONITORING INSTRUMENTATION

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.4.1 1 04/26/2006

Title: REACTOR COOLANT SYSTEM REACTOR COOLANT SYSTEM CHEMISTRY

TEXT 3.4.2 1 04/16/2009

Title: REACTOR COOLANT SYSTEM STRUCTURAL INTEGRITY

TEXT 3.4.3 1 11/09/2007

Title: REACTOR COOLANT SYSTEM REACTOR COOLANT SYSTEM (RCS)

TEXT 3.4.4 2 05/14/2009

Title: REACTOR COOLANT SYSTEM REACTOR RECIRCULATION FLOW AND ROD LINE LIMIT

TEXT 3.4.5 1 04/26/2006

Title: REACTOR COOLANT SYSTEM REACTOR VESSEL MATERIALS

TEXT 3.4.6 0 07/20/2010

Title: REACTOR RECIRCULATION SINGLE LOOP OPERATION SLO FLOW RATE RESTRICTION

TEXT 3.5.1 1 02/04/2005

Title: ECCS AND RCIC ADS MANUAL INHIBIT

TEXT 3.5.2 1 11/09/2007

Title: ECCS AND RCIC ECCS AND RCIC SYSTEM MONITORING INSTRUMENTATION

TEXT 3.5.3 0 11/19/2002

Title: ECCS AND RCIC LONG TERM NITROGEN SUPPLY TO ADS

TEXT 3.6.1 0 11/19/2002

Title: CONTAINMENT VENTING OR PURGING

TEXT 3.6.2 0 11/19/2002

Title: CONTAINMENT SUPPRESSION CHAMBER-TO-DRYWELL VACUUM BREAKER POSITION INDICATION

TEXT 3.6.3 0 11/19/2002

Title: CONTAINMENT SUPPRESSION POOL ALARM INSTRUMENTATION

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.6.4 0 11/19/2002
Title: CONTAINMENT PRIMARY CONTAINMENT CLOSED SYSTEM BOUNDARIES

TEXT 3.7.1 0 11/19/2002
Title: PLANT SYSTEMS EMERGENCY SERVICE WATER SYSTEM (ESW) SHUTDOWN

TEXT 3.7.2 0 11/19/2002
Title: PLANT SYSTEMS ULTIMATE HEAT SINK (UHS) AND GROUND WATER LEVEL

TEXT 3.7.3.1 2 04/16/2009
Title: PLANT SYSTEMS FIRE SUPPRESSION WATER SUPPLY SYSTEM

TEXT 3.7.3.2 3 04/16/2009
Title: PLANT SYSTEMS SPRAY AND SPRINKLER SYSTEMS

TEXT 3.7.3.3 3 04/16/2009
Title: PLANT SYSTEMS CO2 SYSTEMS

TEXT 3.7.3.4 2 04/16/2009
Title: PLANT SYSTEMS HALON SYSTEMS

TEXT 3.7.3.5 2 04/16/2009
Title: PLANT SYSTEMS FIRE HOSE STATIONS

TEXT 3.7.3.6 2 04/16/2009
Title: PLANT SYSTEMS YARD FIRE HYDRANTS AND HYDRANT HOSE HOUSES

TEXT 3.7.3.7 1 04/26/2006
Title: PLANT SYSTEMS FIRE RATED ASSEMBLIES

TEXT 3.7.3.8 9 09/21/2010
Title: PLANT SYSTEMS FIRE DETECTION INSTRUMENTATION

TEXT 3.7.4 1 04/26/2006
Title: PLANT SYSTEMS SOLID RADWASTE SYSTEM

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.7.5.1 0 11/19/2002

Title: PLANT SYSTEMS MAIN CONDENSER OFFGAS HYDROGEN MONITOR

TEXT 3.7.5.2 0 11/19/2002

Title: PLANT SYSTEMS MAIN CONDENSER OFFGAS EXPLOSIVE GAS MIXTURE

TEXT 3.7.5.3 1 04/26/2006

Title: PLANT SYSTEMS LIQUID HOLDUP TANKS

TEXT 3.7.6 2 06/27/2008

Title: PLANT SYSTEMS ESSW PUMPHOUSE VENTILATION

TEXT 3.7.7 2 09/05/2008

Title: PLANT SYSTEMS MAIN CONDENSER OFFGAS PRETREATMENT LOGARITHMIC RADIATION
MONITORING INSTRUMENTATION

TEXT 3.7.8 7 12/03/2010

Title: PLANT SYSTEMS SNUBBERS

TEXT 3.7.9 1 08/28/2006

Title: PLANT SYSTEMS CONTROL STRUCTURE HVAC

TEXT 3.7.10 1 12/14/2004

Title: PLANT SYSTEMS SPENT FUEL STORAGE POOLS (SFSPS)

TEXT 3.7.11 1 10/02/2009

Title: PLANT SYSTEMS

TEXT 3.8.1 2 02/04/2005

Title: ELECTRICAL POWER PRIMARY CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT
PROTECTIVE DEVICES

TEXT 3.8.2.1 2 11/09/2007

Title: ELECTRICAL POWER MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION -
CONTINUOUS

TEXT 3.8.2.2 2 12/14/2004

Title: ELECTRICAL POWER MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION -
AUTOMATIC

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.8.3 1 04/05/2010

Title: ELECTRICAL POWER DIESEL GENERATOR (DG) MAINTENANCE ACTIVITIES

TEXT 3.8.4 1 02/04/2005

Title: ELECTRICAL POWER 24 VDC ELECTRICAL SUBSYSTEM

TEXT 3.8.5 0 11/19/2002

Title: ELECTRICAL POWER DEGRADED VOLTAGE PROTECTION

TEXT 3.8.6 0 11/19/2002

Title: ELECTRICAL POWER EMERGENCY SWITCHGEAR ROOM COOLING

TEXT 3.8.7 2 10/22/2009

Title: BATTERY MAINTENANCE AND MONITORING PROGRAM

TEXT 3.9.1 0 11/19/2002

Title: REFUELING OPERATIONS DECAY TIME

TEXT 3.9.2 0 11/19/2002

Title: REFUELING OPERATIONS COMMUNICATIONS

TEXT 3.9.3 0 11/19/2002

Title: REFUELING OPERATIONS REFUELING PLATFORM

TEXT 3.10.1 1 04/26/2006

Title: MISCELLANEOUS SEALED SOURCE CONTAMINATION

TEXT 3.10.2 1 04/09/2007

Title: MISCELLANEOUS SHUTDOWN MARGIN TEST RPS INSTRUMENTATION

TEXT 3.10.3 2 06/15/2010

Title: MISCELLANEOUS INDEPENDENT SPENT FUEL STORAGE INSTALLATION (ISFSI)

TEXT 3.11.1.1 1 04/26/2006

Title: RADIOACTIVE EFFLUENTS LIQUID EFFLUENTS CONCENTRATION

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.11.1.2 1 04/26/2006

Title: RADIOACTIVE EFFLUENTS LIQUID EFFLUENTS DOSE

TEXT 3.11.1.3 1 04/26/2006

Title: RADIOACTIVE EFFLUENTS LIQUID WASTE TREATMENT SYSTEM

TEXT 3.11.1.4 1 12/14/2004

Title: RADIOACTIVE EFFLUENTS LIQUID RADWASTE EFFLUENT MONITORING INSTRUMENTATION

TEXT 3.11.1.5 2 05/02/2007

Title: RADIOACTIVE EFFLUENTS RADIOACTIVE LIQUID PROCESS MONITORING INSTRUMENTATION

TEXT 3.11.2.1 3 04/26/2006

Title: RADIOACTIVE EFFLUENTS DOSE RATE

TEXT 3.11.2.2 1 04/26/2006

Title: RADIOACTIVE EFFLUENTS DOSE - NOBLE GASES

TEXT 3.11.2.3 1 04/26/2006

Title: RADIOACTIVE EFFLUENTS DOSE - IODINE, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM

TEXT 3.11.2.4 0 11/19/2002

Title: RADIOACTIVE EFFLUENTS GASEOUS RADWASTE TREATMENT SYSTEM

TEXT 3.11.2.5 3 11/14/2006

Title: RADIOACTIVE EFFLUENTS VENTILATION EXHAUST TREATMENT SYSTEM

TEXT 3.11.2.6 4 09/16/2009

Title: RADIOACTIVE EFFLUENTS RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

TEXT 3.11.3 1 04/26/2006

Title: RADIOACTIVE EFFLUENTS TOTAL DOSE

TEXT 3.11.4.1 3 04/26/2006

Title: RADIOACTIVE EFFLUENTS MONITORING PROGRAM

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.11.4.2 2 04/26/2006

Title: RADIOACTIVE EFFLUENTS LAND USE CENSUS

TEXT 3.11.4.3 1 04/26/2006

Title: RADIOACTIVE EFFLUENTS INTERLABORATORY COMPARISON PROGRAM

TEXT 3.12.1 0 11/19/2002

Title: LOADS CONTROL PROGRAM CRANE TRAVEL-SPENT FUEL STORAGE POOL

TEXT 3.12.2 4 04/17/2008

Title: LOADS CONTROL PROGRAM HEAVY LOADS REQUIREMENTS

TEXT 3.12.3 0 11/19/2002

Title: LOADS CONTROL PROGRAM LIGHT LOADS REQUIREMENTS

TEXT 4.1 0 09/27/2003

Title: ADMINISTRATIVE CONTROLS ORGANIZATION

TEXT 4.2 0 09/27/2003

Title: ADMINISTRATIVE CONTROLS REPORTABLE EVENT ACTION

TEXT 4.3 0 09/27/2003

Title: ADMINISTRATIVE CONTROLS SAFETY LIMIT VIOLATION

TEXT 4.4 1 12/18/2008

Title: ADMINISTRATIVE CONTROLS PROCEDURES & PROGRAMS

TEXT 4.5 0 09/27/2003

Title: ADMINISTRATIVE CONTROLS REPORTING REQUIREMENTS

TEXT 4.6 0 09/27/2003

Title: ADMINISTRATIVE CONTROLS RADIATION PROTECTION PROGRAM

TEXT 4.7 0 09/27/2003

Title: ADMINISTRATIVE CONTROLS TRAINING

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.0 4 05/23/2008

Title: APPLICABILITY BASES TECHNICAL REQUIREMENT FOR OPERATION (TRO) APPLICABILITY

TEXT B3.1.1 1 11/09/2007

Title: REACTIVITY CONTROL SYSTEM BASES ANTICIPATED TRANSIENT WITHOUT SCRAM ALTERNATE ROD INJECTION (ATWS-ARI) INSTRUMENTATION

TEXT B3.1.2 0 11/19/2002

Title: REACTIVITY CONTROL SYSTEM BASES CONTROL ROD DRIVE (CRD) HOUSING SUPPORT

TEXT B3.1.3 3 04/10/2007

Title: REACTIVITY CONTROL SYSTEM BASES CONTROL ROD BLOCK INSTRUMENTATION

TEXT B3.1.4 0 11/19/2002

Title: REACTIVITY CONTROL SYSTEM BASES CONTROL ROD SCRAM ACCUMULATORS INSTRUMENTATION AND CHECK VALVE

TEXT B3.2.1 0 11/19/2002

Title: CORE OPERATING LIMITS BASES CORE OPERATING LIMITS REPORT (COLR)

TEXT B3.3.1 0 11/19/2002

Title: INSTRUMENTATION BASES RADIATION MONITORING INSTRUMENTATION

TEXT B3.3.2 1 11/09/2007

Title: INSTRUMENTATION BASES SEISMIC MONITORING INSTRUMENTATION

TEXT B3.3.3 2 11/09/2007

Title: INSTRUMENTATION BASES METEOROLOGICAL MONITORING INSTRUMENTATION

TEXT B3.3.4 4 07/09/2010

Title: INSTRUMENTATION BASES TRM POST ACCIDENT MONITORING (PAM) INSTRUMENTATION

TEXT B3.3.5 2 11/09/2007

Title: INSTRUMENTATION BASES THIS PAGE INTENTIONALLY LEFT BLANK

TEXT B3.3.6 4 01/13/2011

Title: INSTRUMENTATION BASES TRM ISOLATION ACTUATION INSTRUMENTATION

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.3.7	1	11/09/2007
Title: INSTRUMENTATION BASES MAIN TURBINE OVERSPEED PROTECTION SYSTEM		
TEXT B3.3.8	1	10/22/2003
Title: INSTRUMENTATION BASES TRM RPS INSTRUMENTATION		
TEXT B3.3.9	3	05/14/2009
Title: INSTRUMENTATION BASES LPRM UPSCALE ALARM INSTRUMENTATION		
TEXT B3.3.10	2	08/09/2010
Title: INSTRUMENTATION BASES REACTOR RECIRCULATION PUMP MG SET STOPS		
TEXT B3.3.11	1	10/22/2003
Title: INSTRUMENTATION BASES MVP ISOLATION INSTRUMENTATION		
TEXT B3.3.12	0	04/16/2009
Title: WATER MONITORING INSTRUMENTATION		
TEXT B3.4.1	0	11/19/2002
Title: REACTOR COOLANT SYSTEM BASES REACTOR COOLANT SYSTEM CHEMISTRY		
TEXT B3.4.2	1	04/16/2009
Title: REACTOR COOLANT SYSTEM BASES STRUCTURAL INTEGRITY		
TEXT B3.4.3	1	11/09/2007
Title: REACTOR COOLANT SYSTEM BASES HIGH/LOW PRESSURE INTERFACE LEAKAGE MONITOR		
TEXT B3.4.4	0	11/19/2002
Title: REACTOR COOLANT SYSTEM BASES REACTOR RECIRCULATION FLOW AND ROD LINE LIMIT		
TEXT B3.4.5	0	11/19/2002
Title: REACTOR COOLANT SYSTEM BASES REACTOR VESSEL MATERIALS		
TEXT B3.4.6	0	07/20/2010
Title: REACTOR RECIRCULATION SINGLE LOOP OPERATION SLO FLOW RATE RESTRICTION		

SSSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.5.1 0 11/19/2002

Title: ECCS AND RCIC BASES ADS MANUAL INHIBIT

TEXT B3.5.2 1 11/09/2007

Title: ECCS AND RCIC BASES ECCS AND RCIC SYSTEM MONITORING INSTRUMENTATION

TEXT B3.5.3 1 11/09/2007

Title: ECCS AND RCIC BASES LONG TERM NITROGEN SUPPLY TO ADS

TEXT B3.6.1 0 11/19/2002

Title: CONTAINMENT BASES VENTING OR PURGING

TEXT B3.6.2 0 11/19/2002

Title: CONTAINMENT BASES SUPPRESSION CHAMBER-TO-DRYWELL VACUUM BREAKER POSITION INDICATION

TEXT B3.6.3 1 04/19/2007

Title: CONTAINMENT BASES SUPPRESSION POOL ALARM INSTRUMENTATION

TEXT B3.6.4 1 12/14/2004

Title: CONTAINMENT BASES PRIMARY CONTAINMENT CLOSED SYSTEM BOUNDARIES

TEXT B3.7.1 0 11/19/2002

Title: PLANT SYSTEMS BASES EMERGENCY SERVICE WATER SYSTEM (SHUTDOWN)

TEXT B3.7.2 0 11/19/2002

Title: PLANT SYSTEMS BASES ULTIMATE HEAT SINK (UHS) GROUND WATER LEVEL

TEXT B3.7.3.1 3 06/15/2010

Title: PLANT SYSTEMS BASES FIRE SUPPRESSION WATER SUPPLY SYSTEM

TEXT B3.7.3.2 2 04/26/2006

Title: PLANT SYSTEMS BASES SPRAY AND SPRINKLER SYSTEMS

TEXT B3.7.3.3 0 11/19/2002

Title: PLANT SYSTEMS BASES CO2 SYSTEMS

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.7.3.4 1 04/26/2006

Title: PLANT SYSTEMS BASES HALON SYSTEMS

TEXT B3.7.3.5 1 04/26/2006

Title: PLANT SYSTEMS BASES FIRE HOSE STATIONS

TEXT B3.7.3.6 1 04/26/2006

Title: PLANT SYSTEMS BASES YARD FIRE HYDRANTS AND HYDRANT HOSE HOUSES

TEXT B3.7.3.7 0 11/19/2002

Title: PLANT SYSTEMS BASES FIRE RATED ASSEMBLIES

TEXT B3.7.3.8 1 01/12/2004

Title: PLANT SYSTEMS BASES FIRE DETECTION INSTRUMENTATION

TEXT B3.7.4 0 11/19/2002

Title: PLANT SYSTEMS BASES SOLID RADWASTE SYSTEM

TEXT B3.7.5.1 0 11/19/2002

Title: PLANT SYSTEMS BASES MAIN CONDENSER OFFGAS HYDROGEN MONITOR

TEXT B3.7.5.2 0 11/19/2002

Title: PLANT SYSTEMS BASES MAIN CONDENSER OFFGAS EXPLOSIVE GAS MIXTURE

TEXT B3.7.5.3 0 11/19/2002

Title: PLANT SYSTEMS BASES LIQUID HOLDUP TANKS

TEXT B3.7.6 2 06/27/2008

Title: PLANT SYSTEMS BASES ESSW PUMPHOUSE VENTILATION

TEXT B3.7.7 2 01/31/2008

Title: PLANT SYSTEMS BASES MAIN CONDENSER OFFGAS PRETREATMENT LOGARITHMIC RADIATION
MONITORING INSTRUMENTATION

TEXT B3.7.8 3 06/21/2007

Title: PLANT SYSTEMS BASES SNUBBERS

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.7.9 1 12/14/2004

Title: PLANT SYSTEMS BASES CONTROL STRUCTURE HVAC

TEXT B3.7.10 1 12/14/2004

Title: PLANT SYSTEMS BASES SPENT FUEL STORAGE POOLS

TEXT B3.7.11 2 04/14/2010

Title: STRUCTURAL INTEGRITY

TEXT B3.8.1 2 03/10/2010

Title: ELECTRICAL POWER BASES PRIMARY CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT PROTECTIVE DEVICES

TEXT B3.8.2.1 0 11/19/2002

Title: ELECTRICAL POWER BASES MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION - CONTINUOUS

TEXT B3.8.2.2 1 09/17/2004

Title: ELECTRICAL POWER BASES MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION - AUTOMATIC

TEXT B3.8.3 0 11/19/2002

Title: ELECTRICAL POWER BASES DIESEL GENERATOR (DG) MAINTENANCE ACTIVITIES

TEXT B3.8.4 0 11/19/2002

Title: ELECTRICAL POWER BASES 24 VDC ELECTRICAL POWER SUBSYSTEM

TEXT B3.8.5 0 11/19/2002

Title: ELECTRICAL POWER BASES DEGRADED VOLTAGE PROTECTION

TEXT B3.8.6 1 02/04/2005

Title: ELECTRICAL POWER BASES EMERGENCY SWITCHGEAR ROOM COOLING

TEXT B3.8.7 1 06/15/2009

Title: BATTERY MAINTENANCE AND MONITORING PROGRAM

TEXT B3.9.1 0 11/19/2002

Title: REFUELING OPERATIONS BASES DECAY TIME

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.9.2 0 11/19/2002

Title: REFUELING OPERATIONS BASES COMMUNICATIONS

TEXT B3.9.3 0 11/19/2002

Title: REFUELING OPERATIONS BASES REFUELING PLATFORM

TEXT B3.10.1 0 11/19/2002

Title: MISCELLANEOUS BASES SEALED SOURCE CONTAMINATION

TEXT B3.10.2 1 04/10/2007

Title: MISCELLANEOUS BASES SHUTDOWN MARGIN TEST RPS INSTRUMENTATION

TEXT B3.10.3 0 11/19/2002

Title: MISCELLANEOUS BASES INDEPENDENT SPENT FUEL STORAGE INSTALLATION (ISFSI)

TEXT B3.11.1.1 0 11/19/2002

Title: RADIOACTIVE EFFLUENTS BASES LIQUID EFFLUENTS CONCENTRATION

TEXT B3.11.1.2 0 11/19/2002

Title: RADIOACTIVE EFFLUENTS BASES LIQUID EFFLUENTS DOSE

TEXT B3.11.1.3 0 11/19/2002

Title: RADIOACTIVE EFFLUENTS BASES LIQUID WASTE TREATMENT SYSTEM

TEXT B3.11.1.4 0 11/19/2002

Title: RADIOACTIVE EFFLUENTS BASES LIQUID RADWASTE EFFLUENT MONITORING INSTRUMENTATION

TEXT B3.11.1.5 0 11/19/2002

Title: RADIOACTIVE EFFLUENTS BASES RADIOACTIVE LIQUID PROCESS MONITORING
INSTRUMENTATION

TEXT B3.11.2.1 1 12/14/2004

Title: RADIOACTIVE EFFLUENTS BASES DOSE RATE

TEXT B3.11.2.2 0 11/19/2002

Title: RADIOACTIVE EFFLUENTS BASES DOSE - NOBLE GASES

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.11.2.3	0	11/19/2002	Title: RADIOACTIVE EFFLUENTS BASES DOSE - IODINE, TRITIUM, AND RADIONUCLIDES IN PARTICULATES FORM
TEXT B3.11.2.4	0	11/19/2002	Title: RADIOACTIVE EFFLUENTS BASES GASEOUS RADWASTE TREATMENT SYSTEM
TEXT B3.11.2.5	4	11/14/2006	Title: RADIOACTIVE EFFLUENTS BASES VENTILATION EXHAUST TREATMENT SYSTEM
TEXT B3.11.2.6	1	01/27/2004	Title: RADIOACTIVE EFFLUENTS BASES RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION
TEXT B3.11.3	0	11/19/2002	Title: RADIOACTIVE EFFLUENTS BASES TOTAL DOSE
TEXT B3.11.4.1	3	07/09/2010	Title: RADIOACTIVE EFFLUENTS BASES MONITORING PROGRAM
TEXT B3.11.4.2	0	11/19/2002	Title: RADIOACTIVE EFFLUENTS BASES LAND USE CENSUS
TEXT B3.11.4.3	0	11/19/2002	Title: RADIOACTIVE EFFLUENTS BASES INTERLABORATORY COMPARISON PROGRAM
TEXT B3.12.1	1	10/04/2007	Title: LOADS CONTROL PROGRAM BASES CRANE TRAVEL-SPENT FUEL STORAGE POOL
TEXT B3.12.2	1	12/03/2010	Title: LOADS CONTROL PROGRAM BASES HEAVY LOADS REQUIREMENTS
TEXT B3.12.3	0	11/19/2002	Title: LOADS CONTROL PROGRAM BASES LIGHT LOADS REQUIREMENTS

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 19

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
1.0	USE AND APPLICATION	1.0-1
1.1	Definitions.....	TRM/1.0-2
2.0	PLANT PROGRAMS	2.0-1
2.1	Plant Programs.....	2.0-1
2.2	Instrument Trip Setpoint Table	TRM/2.0-5
3.0	APPLICABILITY	TRM/3.0-1
3.0	(TRO) - TR for Operation (TRO) Applicability	TRM/3.0-1
3.0	(TRS) - TR Surveillance (TRS) Applicability.....	TRM/3.0-3
3.1	REACTIVITY CONTROL SYSTEMS	TRM/3.1-1
3.1.1	Alternate Rod Injection	TRM/3.1-1
3.1.2	CRD Housing Support	3.1-4
3.1.3	Control Rod Block Instrumentation	3.1-5
3.1.4	Control Rod Scram Accumulators Instrumentation and Check Valve	TRM/3.1-9
3.2	CORE OPERATING LIMITS REPORT	3.2-1
3.2.1	Core Operating Limits Report	3.2-1
3.3	INSTRUMENTATION	TRM/3.3-1
3.3.1	Radiation Monitoring Instrumentation	TRM/3.3-1
3.3.2	Seismic Monitoring Instrumentation	TRM/3.3-4
3.3.3	Meteorological Monitoring Instrumentation	TRM/3.3-7
3.3.4	TRM Post-Accident Monitoring Instrumentation.....	TRM/3.3-9
3.3.5	Section Not Used.....	TRM/3.3-12
3.3.6	TRM Containment Isolation Instrumentation	TRM/3.3-13
3.3.7	Turbine Overspeed Protection System	TRM/3.3-17
3.3.8	Section Not Used.....	TRM/3.3-19
3.3.9	OPRM Instrumentation	TRM/3.3-21
3.3.10	Reactor Recirculation Pump MG Set Electrical and Mechanical Stops	TRM/3.3-22
3.3.11	MVP Isolation Instrumentation	TRM/3.3-24
3.3.12	Water Monitoring Instrumentation.....	TRM/3.3-26
3.4	REACTOR COOLANT SYSTEM	TRM/3.4-1
3.4.1	Reactor Coolant System Chemistry	3.4-1
3.4.2	Not Used.....	TRM/3.4-6
3.4.3	High/Low Pressure Interface Leakage Monitors	3.4-9
3.4.4	Reactor Recirculation Flow and Rod Line Limit	TRM/3.4-12
3.4.5	Reactor Vessel Material Surveillances Program	TRM/3.4-13
3.4.6	Reactor Recirculation Single Loop Operation (SLO) Flow Rate Restriction.....	TRM/3.4-14

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
3.5	EMERGENCY CORE COOLING AND RCIC	TRM/3.5-1
3.5.1	ADS Manual Inhibit	TRM/3.5-1
3.5.2	ECCS and RCIC System Monitoring Instrumentation	3.5-3
3.5.3	Long Term Nitrogen Supply to ADS	3.5-6
3.6	CONTAINMENT	3.6-1
3.6.1	VENTING or PURGING	3.6-1
3.6.2	Suppression Chamber-to-Drywell Vacuum Breaker Position Indication	3.6-3
3.6.3	Suppression Pool Alarm Instrumentation.....	3.6-4
3.6.4	Primary Containment Closed System Boundaries	TRM/3.6-7
3.7	PLANT SYSTEMS	TRM/3.7-1
3.7.1	Emergency Service Water System (Shutdown).....	TRM/3.7-1
3.7.2	Ultimate Heat Sink and Ground Water Level.....	3.7-3
3.7.3.1	Fire Suppression Water Supply System	TRM/3.7-4
3.7.3.2	Spray and Sprinkler Systems	TRM/3.7-8
3.7.3.3	CO2 systems	TRM/3.7-12
3.7.3.4	Halon Systems	TRM/3.7-16
3.7.3.5	Fire Hose Stations	TRM/3.7-18
3.7.3.6	Yard Fire Hydrants and Hydrant Hose Houses.....	TRM/3.7-22
3.7.3.7	Fire Rated Assemblies.....	TRM/3.7-24
3.7.3.8	Fire Detection Instrumentation.....	TRM/3.7-26
3.7.4	Solid Radwaste System.....	TRM/3.7-34
3.7.5.1	Main Condenser Offgas Hydrogen Monitor	3.7-37
3.7.5.2	Main Condenser Explosive Gas Mixture	TRM/3.7-38
3.7.5.3	Liquid Holdup Tanks	TRM/3.7-39
3.7.6	ESSW Pumphouse Ventilation	3.7-40
3.7.7	Main Condenser Offgas Pretreatment Logarithmic Radiation Monitoring Instrumentation	TRM/3.7-41
3.7.8	Snubbers	TRM/3.7-43
3.7.9	Control Structure HVAC.....	TRM/3.7-49
3.7.10	Spent Fuel Storage Pools (SFSPs)	TRM/3.7-51
3.7.11	Structural Integrity.....	TRM/3.7-54
3.8	ELECTRICAL POWER.....	TRM/3.8-1
3.8.1	Primary Containment Penetration Conductor Overcurrent Protective Devices	TRM/3.8-1
3.8.2.1	Motor Operated Valves Thermal Overload Protection - Continuous	TRM/3.8-5
3.8.2.2	Motor Operated Valves Thermal Overload Protection - Automatic.....	TRM/3.8-11
3.8.3	Diesel Generator (DG) Maintenance Activities	TRM/3.8-13

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 19

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
3.8.4	24VDC Electrical Power Subsystem.....	TRM/3.8-15
3.8.5	Degraded Voltage Protection	TRM/3.8-21
3.8.6	Emergency Switchgear Room Cooling	3.8-24
3.8.7	Battery Monitoring and Maintenance Program.....	TRM/3.8-26
3.9	REFUELING OPERATIONS.....	3.9-1
3.9.1	Decay Time	3.9-1
3.9.2	Communications	3.9-2
3.9.3	Refueling Platform	3.9-3
3.10	MISCELLANEOUS	TRM/3.10-1
3.10.1	Sealed Source Contamination	TRM/3.10-1
3.10.2	MODE 5 Shutdown Margin Test RPS Instrumentation	3.10-4
3.10.3	Independent Spent Fuel Storage Installation (ISFSI).....	TRM/3.10-7
3.10.4	Section Not Used.....	TRM/3.10-8
3.11	RADIOACTIVE EFFLUENTS.....	TRM/3.11-1
3.11.1	Liquid Effluents.....	TRM/3.11-1
3.11.1.1	Liquid Effluents Concentration.....	TRM/3.11-1
3.11.1.2	Liquid Effluents Dose	TRM/3.11-4
3.11.1.3	Liquid Waste Treatment System	TRM/3.11-6
3.11.1.4	Liquid Radwaste Effluent Monitoring Instrumentation.....	3.11-8
3.11.1.5	Radioactive Liquid Process Monitoring Instrumentation	TRM/3.11-13
3.11.2	Gaseous Effluents	TRM/3.11-17
3.11.2.1	Dose Rate.....	TRM/3.11-17
3.11.2.2	Dose - Noble Gases	TRM/3.11-20
3.11.2.3	Dose - Iodine, Tritium, and Radionuclides in Particulate Form	TRM/3.11-21
3.11.2.4	Gaseous Radwaste Treatment System	TRM/3.11-22
3.11.2.5	Ventilation Exhaust Treatment System.....	TRM/3.11-23
3.11.2.6	Radioactive Gaseous Effluent Monitoring Instrumentation.....	TRM/3.11-25
3.11.3	Total Dose	TRM/3.11-33
3.11.4	Radiological Environmental Monitoring.....	TRM/3.11-35
3.11.4.1	Monitoring Program	TRM/3.11-35
3.11.4.2	Land Use Census.....	TRM/3.11-45
3.11.4.3	Interlaboratory Comparison Program.....	TRM/3.11-47
3.12	LOADS CONTROL PROGRAM.....	TRM/3.12-1
3.12.1	Crane Travel - Spent Fuel Storage Pool.....	TRM/3.12-1
3.12.2	Heavy Loads Requirements	TRM/3.12-3
3.12.3	Light Loads Requirements.....	TRM/3.12-5

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 19

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
4.0	ADMINISTRATIVE CONTROLS	4.0-1
4.1	Organization	4.0-1
4.2	Reportable Event Action	4.0-2
4.3	Safety Limit Violation	4.0-3
4.4	Procedures and Programs	4.0-4
4.5	Reporting Requirements	4.0-5
4.6	Radiation Protection Program	4.0-7
4.7	Training	4.0-8

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 19

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
B 3.0	(TRO) - TR for Operation (TRO) Applicability	B 3.0-1
B 3.0	(TRS) - TR Surveillance (TRS) Applicability	B 3.0-9
B 3.1.1	Alternate Rod Injection	TRM/B 3.1-1
B 3.1.2	CRD Housing Support	B 3.1-4
B 3.1.3	Control Rod Block Instrumentation	TRM/B 3.1-5
B 3.1.4	Control Rod Scram Accumulators Instrumentation and Check Valve	TRM/B 3.1-8
B 3.2.1	Core Operating Limits Report (COLR)	B 3.2-1
B 3.3.1	Radiation Monitoring Instrumentation	TRM/B 3.3-1
B 3.3.2	Seismic Monitoring Instrumentation	TRM/B 3.3-2
B 3.3.3	Meteorological Monitoring Instrumentation	TRM/B 3.3-3
B 3.3.4	TRM Post-Accident Monitoring Instrumentation	TRM/B 3.3-4
B 3.3.5	Section Not Used	TRM/B 3.3-9
B 3.3.6	TRM Containment Isolation Instrumentation	TRM/B 3.3-10
B 3.3.7	Turbine Overspeed Protection System	TRM/B 3.3-14
B 3.3.8	Section Not Used	TRM/B 3.3-15
B 3.3.9	OPRM Instrumentation	TRM/B 3.3-18
B 3.3.10	Reactor Recirculation Pump MG Set Electrical and Mechanical Stops	TRM/B 3.3-20
B 3.3.11	MVP Isolation Instrumentation	TRM/B 3.3-22
B 3.3.12	Water Monitoring Instrumentation	TRM/B 3.3-24
B 3.4.1	Reactor Coolant System Chemistry	B 3.4-1
B 3.4.2	Not Used	TRM/B 3.4-2
B 3.4.4	Reactor Recirculation Flow and Rod Line Limit	TRM/B 3.4-5
B 3.4.5	Reactor Vessel Material Surveillances Program	B 3.4-6
B 3.4.6	Reactor Recirculation Single Loop Operation (SLO) Flow Rate Restriction	TRM/B3.4-7
B 3.5.1	ADS Manual Inhibit	B 3.5-1
B 3.5.2	ECCS and RCIC System Monitoring Instrumentation	TRM/B 3.5-3
B 3.5.3	Long Term Nitrogen Supply to ADS	B 3.5-4
B 3.6.1	VENTING or PURGING	TRM/B 3.6-1
B 3.6.2	Suppression Chamber-to-Drywell Vacuum Breaker Position Indication	B 3.6-3
B 3.6.3	Suppression Pool Alarm Instrumentation	B 3.6-4
B 3.6.4	Primary Containment Closed System Boundaries	TRM/B 3.6-6
B 3.7.1	Emergency Service Water System (Shutdown)	B 3.7-1
B 3.7.2	Ultimate Heat Sink and Ground Water Level	B 3.7-2
B 3.7.3.1	Fire Suppression Water Supply System	TRM/B 3.7-3

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 19

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
B 3.7.3.2	Spray and Sprinkler Systems	TRM/B 3.7-5
B 3.7.3.3	CO2 Systems	TRM/B 3.7-7
B 3.7.3.4	Halon Systems	TRM/B 3.7-8
B 3.7.3.5	Fire Hose Stations	TRM/B 3.7-10
B 3.7.3.6	Yard Fire Hydrants and Hydrant Hose Houses	TRM/B 3.7-11
B 3.7.3.7	Fire Rated Assemblies	TRM/B 3.7-12
B 3.7.3.8	Fire Detection Instrumentation	TRM/B 3.7-14
B 3.7.4	Solid Radwaste System	TRM/B 3.7-15
B 3.7.5.1	Main Condenser Offgas Hydrogen Monitor	B 3.7-17
B 3.7.5.2	Main Condenser Explosive Gas Mixture	B 3.7-19
B 3.7.5.3	Liquid Holdup Tanks	B 3.7-20
B 3.7.6	ESSW Pumphouse Ventilation	TRM/B 3.7-21
B 3.7.7	Main Condenser Offgas Pretreatment Logarithmic Radiation Monitoring Instrumentation	TRM/B 3.7-22
B 3.7.8	Snubbers	TRM/B 3.7-24
B 3.7.9	Control Structure HVAC	TRM/B 3.7-31
B 3.7.10	Spent Fuel Storage Pools	TRM/B 3.7-33
B 3.7.11	Structural Integrity	TRM/B 3.7-36
B 3.8.1	Primary Containment Penetration Conductor Overcurrent Protective Devices	TRM/B 3.8-1
B 3.8.2.1	Motor Operated Valves Thermal Overload Protection - Continuous	TRM/B 3.8-3
B 3.8.2.2	Motor Operated Valves Thermal Overload Protection - Automatic	TRM/B 3.8-4
B 3.8.3	Diesel Generator (DG) Maintenance Activities	TRM/B 3.8-5
B 3.8.4	24VDC Electrical Power Subsystem	TRM/B 3.8-6
B 3.8.5	Degraded Voltage Protection	TRM/B 3.8-16
B 3.8.6	Emergency Switchgear Room Cooling	TRM/B 3.8-17
B 3.8.7	Battery Monitoring and Maintenance Program	TRM/B 3.8-18
B 3.9.1	Decay Time	B 3.9-1
B 3.9.2	Communications	B 3.9-2
B 3.9.3	Refueling Platform	B 3.9-3
B 3.10.1	Sealed Source Contamination	B 3.10-1
B 3.10.2	MODE 5 Shutdown Margin Test RPS Instrumentation	B 3.10-2
B 3.10.3	Independent Spent Fuel Storage Installation (ISFSI)	TRM/B 3.10-4
B 3.10.4	Section Not Used	TRM/B 3.10-6
B 3.11.1.1	Liquid Effluents Concentration	B 3.11-1
B 3.11.1.2	Liquid Effluents Dose	B 3.11-4
B 3.11.1.3	Liquid Waste Treatment System	B 3.11-6
B 3.11.1.4	Liquid Radwaste Effluent Monitoring Instrumentation	B 3.11-7
B 3.11.1.5	Radioactive Liquid Process Monitoring Instrumentation	TRM/B 3.11-10

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 19

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
B 3.11.2.1	Dose Rate.....	TRM/B 3.11-12
B 3.11.2.2	Dose - Noble Gases	B 3.11-16
B 3.11.2.3	Dose - Iodine, Tritium, and Radionuclides in Particulate Form	B 3.11-18
B 3.11.2.4	Gaseous Radwaste Treatment System	TRM/B 3.11-20
B 3.11.2.5	Ventilation Exhaust Treatment System.....	TRM/B 3.11-21
B 3.11.2.6	Radioactive Gaseous Effluent Monitoring Instrumentation.....	TRM/B 3.11-24
B 3.11.3	Total Dose	B 3.11-26
B 3.11.4.1	Monitoring Program	TRM/B 3.11-28
B 3.11.4.2	Land Use Census	B 3.11-34
B 3.11.4.3	Interlaboratory Comparison Program.....	TRM/B 3.11-36
B 3.12	LOADS CONTROL PROGRAM.....	TRM/B 3.12-1
B.3.12.1	Crane Travel - Spent Fuel Storage Pool	TRM/B 3.12-1
B.3.12.2	Heavy Loads Requirements	TRM/B 3.12-2
B.3.12.3	Light Loads Requirements.....	TRM/B 3.12-3

TRM2 Text TOC
1/12/2011

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
TOC	TABLE OF CONTENTS	01/07/2011
1.0	USE AND APPLICATION	
	Page TRM / 1.0-1	08/31/1998
	Page TRM / 1.0-2	10/04/2002
	Page TRM / 1.0-3	08/31/1998
2.0	PLANT PROGRAMS	
	Page 2.0-1	08/31/1998
	Pages TRM / 2.0-2 and TRM 2.0-3	01/28/2005
	Page TRM / 2.0-4	06/25/2002
	Page TRM / 2.0-5	04/12/1999
	Page TRM / 2.0-6	04/15/2009
	Page TRM / 2.0-7	05/15/2008
	Pages TRM / 2.0-8 and TRM / 2.0-9	01/07/2011
	Page TRM / 2.0-10	02/02/2010
	Page TRM / 2.0-11	11/15/2004
	Page TRM / 2.0-12	04/15/2009
	Pages TRM / 2.0-13 and TRM / 2.0-14	11/15/2004
	Page TRM / 2.0-15	11/15/2005
3.0	APPLICABILITY	
	Pages TRM / 3.0-1 and TRM / 3.0-2	04/14/2008
	Page TRM / 3.0-3	03/15/2002
	Page TRM / 3.0-4	11/30/2005
3.1	REACTIVITY CONTROL SYSTEMS	
	Page TRM / 3.1-1	10/31/2007
	Pages TRM / 3.1-2 through TRM / 3.1-5	08/31/1998
	Page TRM / 3.1-6	03/27/2007
	Page TRM / 3.1-7	04/15/2009
	Page TRM / 3.1-8	03/27/2007
	Pages TRM / 3.1-9 and TRM / 3.1-9a	02/18/1999
	Page TRM / 3.1-10	02/18/1999
3.2	CORE OPERATING LIMITS REPORT	
	Page TRM / 3.2-1	08/31/1998
	Pages TRM / 3.2-2 through TRM / 3.2-54	04/17/2009
3.3	INSTRUMENTATION	
	Pages TRM / 3.3-1 through TRM / 3.3-3	07/16/1999
	Pages TRM / 3.3-4 and TRM / 3.3-5	10/31/2007
	Page 3.3-6	08/31/1998
	Page TRM 3.3-7	10/31/2007
	Page 3.3-8	08/31/1998

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
	Pages TRM / 3.3-9 and TRM / 3.3-9a	06/30/2010
	Page TRM / 3.3-10	10/31/2007
	Pages TRM / 3.3-11 and TRM / 3.3-11a	06/30/2010
	Page TRM / 3.3-12	03/30/2001
	Page TRM / 3.3-13	01/07/2011
	Page TRM / 3.3-14	12/14/1998
	Pages TRM / 3.3-15 and TRM / 3.3-16	01/07/2011
	Page TRM / 3.3-17	06/14/2002
	Page TRM / 3.3-18	10/31/2007
	Pages TRM / 3.3-19 and TRM / 3.3-20	10/22/2003
	Page TRM / 3.3-21	04/15/2009
	Page TRM / 3.3-21a	11/15/2004
	Pages TRM / 3.3-21b through TRM / 3.3-21d	03/27/2007
	Page TRM / 3.3-22	12/03/2004
	Pages TRM / 3.3-23 and TRM / 3.3-24	05/16/2003
	Page TRM / 3.3-25	10/22/2003
	Pages TRM / 3.3-26 and TRM / 3.3-27	04/07/2009
3.4	REACTOR COOLANT SYSTEM	
	Page TRM / 3.4-1	03/31/2006
	Pages 3.4-2 through 3.4-5	10/23/1998
	Pages TRM / 3.4-6 through TRM / 3.4-8	04/01/2009
	Page 3.4-9	08/31/1998
	Page 3.4-10	10/31/2007
	Page 3.4-11	08/31/1998
	Page TRM / 3.4-12	04/17/2009
	Page TRM / 3.4-13	03/31/2006
	Page TRM / 3.4-14	07/15/2010
3.5	EMERGENCY CORE COOLING AND RCIC	
	Page TRM / 3.5-1	01/28/2005
	Pages 3.5-2 and 3.5-3	08/31/1998
	Page TRM / 3.5-4	10/31/2007
	Pages 3.5-5 through 3.5-7	08/31/1998
3.6	CONTAINMENT	
	Pages 3.6-1 through 3.6-4	08/31/1998
	Page TRM / 3.6-5	01/07/2002
	Page 3.6-6	08/31/1998
	Pages TRM / 3.6-7 through TRM / 3.6-9	12/31/2002

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
3.7	PLANT SYSTEMS	
	Pages TRM / 3.7-1 and TRM / 3.7-2	07/29/1999
	Page 3.7-3	08/31/1998
	Page TRM / 3.7-4	03/31/2006
	Page TRM / 3.7-5	04/07/2009
	Pages TRM / 3.7-6 through TRM / 3.7-8	08/02/1999
	Pages TRM / 3.7-9 and TRM / 3.7-10	04/07/2009
	Page TRM / 3.7-11	01/21/2000
	Page TRM / 3.7-12	08/02/1999
	Page TRM / 3.7-13	04/07/2009
	Page TRM / 3.7-14	08/09/2005
	Pages TRM / 3.7-15 and TRM / 3.7-16	08/02/1999
	Page TRM / 3.7-17	04/07/2009
	Page TRM / 3.7-18	08/02/1999
	Page TRM / 3.7-19	04/07/2009
	Pages TRM / 3.7-20 through TRM / 3.7-22	08/02/1999
	Page TRM / 3.7-23	04/07/2009
	Page TRM / 3.7-24	03/31/2006
	Pages TRM / 3.7-25 and TRM / 3.7-26	08/02/1999
	Page TRM / 3.7-27	10/31/2007
	Page TRM / 3.7-28	11/29/2006
	Page TRM / 3.7-29	01/13/2010
	Page TRM / 3.7-30	11/30/2005
	Page TRM / 3.7-31	11/16/2001
	Page TRM / 3.7-32	09/16/2010
	Page TRM / 3.7-33	10/05/2002
	Page TRM / 3.7-34	03/31/2006
	Pages TRM / 3.7-35 and TRM / 3.7-36	02/01/1999
	Pages 3.7-37 through 3.7-38	08/31/1998
	Page TRM / 3.7-39	03/31/2006
	Page TRM / 3.7-40	02/14/2005
	Page TRM / 3.7-40a	06/20/2008
	Page TRM / 3.7-41	09/04/2008
	Page TRM / 3.7-42	08/31/1998
	Pages TRM / 3.7-43 through TRM / 3.7-45	10/05/2006
	Page TRM / 3.7-46	06/07/2007
	Page TRM / 3.7-47	11/29/2010
	Page TRM / 3.7-48	06/07/2007
	Page TRM / 3.7-49	03/09/2001
	Page TRM / 3.7-50	08/16/2006
	Page TRM / 3.7-51	12/03/2004
	Page TRM / 3.7-52	04/15/2003
	Page TRM / 3.7-53	07/29/1999
	Page TRM / 3.7-54	04/01/2009
	Page TRM / 3.7-55	09/25/2009
	Page TRM / 3.7-56	04/01/2009

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
3.8	ELECTRICAL POWER	
	Page TRM / 3.8-1	04/02/2002
	Pages TRM / 3.8-2 and TRM / 3.8-3	01/28/2005
	Page TRM / 3.8-4	01/31/2005
	Pages TRM / 3.8-5 and TRM / 3.8-6	04/02/2002
	Pages TRM / 3.8-7 through TRM / 3.8-10	10/31/2007
	Page TRM / 3.8-11	08/10/2004
	Page TRM / 3.8-12	12/03/2004
	Page TRM / 3.8-13	03/25/2010
	Page TRM / 3.8-14	08/31/1998
	Page TRM / 3.8-15	01/28/2005
	Pages TRM / 3.8-16 and TRM / 3.8-17	04/02/2002
	Page 3.8-18	02/01/1999
	Page TRM / 3.8-19	04/02/2002
	Page TRM / 3.8-20	02/01/1999
	Pages TRM / 3.8-21 through TRM / 3.8-23	06/06/1999
	Pages 3.8-24 and 3.8-25	08/31/1998
	Page TRM / 3.8-26	05/28/2009
	Page TRM / 3.8-27	11/29/2006
	Page TRM / 3.8-28	05/28/2009
	Page TRM / 3.8-29	10/20/2009
3.9	REFUELING OPERATIONS	
	Pages 3.9-1 through 3.9-3	08/31/1998
3.10	MISCELLANEOUS	
	Page TRM / 3.10-1	03/31/2006
	Pages 3.10-2 through 3.10-4	08/30/1998
	Pages TRM / 3.10-5 and TRM / 3.10-6	03/27/2007
	Page TRM / 3.10-7	06/10/2010
3.11	RADIOACTIVE EFFLUENTS	
	Page TRM / 3.11-1	03/31/2006
	Pages 3.11-2 through 3.11-3	08/31/1998
	Page TRM / 3.11-4	03/31/2006
	Page 3.11-5	08/31/1998
	Page TRM / 3.11-6	03/31/2006
	Pages 3.11-7 through 3.11-9	08/31/1998
	Page TRM / 3.11-10	12/03/2004
	Pages 3.11-11 and 3.11-12	08/31/1998
	Page TRM / 3.11-13	04/12/2007
	Page TRM / 3.11-14	12/03/1004
	Pages 3.11-15 and 3.11-16	09/01/1998
	Page TRM / 3.11-17	03/31/2006

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
	Page 3.11-18	08/31/1998
	Page TRM / 3.11-19	08/15/2005
	Pages TRM / 3.11-20 and TRM / 3.11-21	03/31/2006
	Page TRM / 3.11-22	04/02/2002
	Page TRM / 3.11-23	11/14/2006
	Page TRM / 3.11-24	05/13/2005
	Page TRM / 3.11-25	04/12/2007
	Pages TRM / 3.11-26 and TRM / 3.11-27	01/21/2004
	Page TRM / 3.11-28	09/08/2009
	Page TRM / 3.11-29	12/03/2004
	Pages TRM 3.11-30 through TRM / 3.11-32	01/21/2004
	Page TRM / 3.11-33	03/31/2006
	Page 3.11-34	08/31/1998
	Page TRM / 3.11-35	03/31/2006
	Pages TRM / 3.11-36 through TRM / 3.11-39	11/30/2005
	Pages 3.11-40 through 3.11-44	08/31/1998
	Page TRM / 3.11-45	03/31/2006
	Page 3.11-46	08/31/1998
	Page TRM / 3.11-47	03/31/2006
3.12	LOADS CONTROL PROGRAM	
	Pages TRM / 3.12-1 through TRM / 3.12-3	02/05/1999
	Page TRM / 3.12-4	03/14/2008
	Page TRM / 3.12-5	02/05/1999
4.0	ADMINISTRATIVE CONTROLS	
	Pages TRM / 4.0-1 through TRM / 4.0-3	08/31/1998
	Page TRM / 4.0-4	12/11/2008
	Pages TRM / 4.0-5 through TRM / 4.0-8	08/31/1998

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
B 3.0	APPLICABILITY BASES	
	Pages TRM / B 3.0-1 through TRM / B 3.0-3	08/31/1998
	Page TRM / B 3.0-4	01/10/2007
	Page TRM / B 3.0-5	04/14/2008
	Page TRM / B 3.0-6	08/31/1998
	Page TRM / B 3.0-7	04/12/2007
	Pages TRM / B 3.0-8 through TRM / B 3.0-10	08/31/1998
	Pages TRM / B 3.0-11 and TRM / B 3.0-12	03/15/2002
	Pages TRM / B 3.0-13 and TRM / B 3.0-14	11/30/2005
	Page TRM / B 3.0-15	03/15/2002
B 3.1	REACTIVITY CONTROL SYSTEMS BASES	
	Page TRM / B 3.1-1	07/13/1999
	Pages TRM / B 3.1-2 and TRM / B 3.1-3	10/31/2007
	Page B 3.1-4	08/31/1998
	Pages TRM / B 3.1-5 through TRM / B 3.1-7	03/27/2007
	Page TRM / B 3.1-8	02/18/1999
B 3.2	CORE OPERATING LIMITS BASES	
	Page B 3.2-1	08/31/1998
B 3.3	INSTRUMENTATION BASES	
	Page TRM / B 3.3-1	04/07/2000
	Pages TRM / B 3.3-2 and TRM / B-3.3-2a	10/31/2007
	Pages TRM / B 3.3-3 and TRM / B 3.3-3a	10/31/2007
	Page TRM / B 3.3-4	06/30/2010
	Page TRM / B 3.3-5	05/30/2006
	Page TRM / B 3.3-6	06/30/2010
	Page TRM / B 3.3-7	10/31/2007
	Page TRM / B 3.3-8	06/30/2010
	Page TRM / B 3.3-9	10/31/2007
	Pages TRM / B 3.3-10 through TRM / B 3.3-13	01/07/2011
	Page TRM / B 3.3-14	06/25/2002
	Page TRM / B 3.3-14a	10/31/2007
	Page TRM / B 3.3-14b	06/14/2002
	Pages TRM / B 3.3-15 through TRM / B 3.3-17	10/22/2003
	Pages TRM / B 3.3-18 and TRM / B 3.3-19	03/27/2007
	Pages TRM / B 3.3-19a and TRM / B 3.3-19b	03/27/2007
	Page TRM / B 3.3-19c	04/17/2009
	Pages TRM / B 3.3-19d and TRM / B 3.3-19e	03/27/2007
	Pages TRM / B 3.3-20 and TRM / B 3.3-21	08/03/2010
	Page TRM / B 3.3-22	10/22/2003
	Page TRM / B 3.3-23	05/16/2003
	Pages TRM / B 3.3-24 and TRM / B 3.3-25	04/07/2009

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
B 3.4	REACTOR COOLANT SYSTEM BASES	
	Page TRM / B 3.4-1	08/31/1998
	Pages TRM / B 3.4-2 and TRM / B3.4-3	04/01/2009
	Pages TRM / B 3.4-4 and TRM / B 3.4-4a	10/31/2007
	Page TRM / B 3.4-5	10/15/1999
	Page B 3.4-6	08/31/1998
	Page TRM / B 3.4-7	07/15/2010
B 3.5	ECCS AND RCIC BASES	
	Pages B 3.5-1 and B 3.5-2	08/31/1998
	Pages TRM / B 3.5-3 and TRM / B 3.5-3a	10/31/2007
	Page B 3.5-4	08/31/1998
	Page TRM / B 3.5-5	10/31/2007
B 3.6	CONTAINMENT BASES	
	Page TRM / B 3.6-1	07/26/2001
	Page TRM / B 3.6-2	02/01/1999
	Page B 3.6-3	08/31/1998
	Page TRM / B 3.6-4	03/29/2007
	Page TRM / B 3.6-5	04/04/2007
	Page TRM / B 3.6-6	12/03/2004
	Pages TRM / B 3.6-7 through TRM / B 3.6-11	12/31/2002
B 3.7	PLANT SYSTEMS BASES	
	Pages B 3.7-1 and B 3.7-2	08/31/1998
	Page TRM / B 3.7-3	06/10/2010
	Page TRM / B 3.7-3a	12/27/2007
	Page TRM / B 3.7-4	03/31/2006
	Page TRM / B 3.7-5	08/02/1999
	Pages TRM / B 3.7-6 and TRM / B 3.7-6a	03/31/2006
	Pages TRM / B 3.7-7 and TRM / B 3.7-7a	08/02/1999
	Page TRM / B 3.7-8	08/02/1999
	Page TRM / B 3.7-9	03/31/2006
	Page TRM / B 3.7-10	08/02/1999
	Pages TRM / B 3.7-10a through TRM / B 3.7-11a	03/31/2006
	Pages TRM / B 3.7-12 through TRM / B 3.7-14	08/02/1999
	Pages TRM / B 3.7-14a and TRM / B 3.7-14b	01/09/2004
	Pages TRM / B 3.7-15 and TRM / B 3.7-16	02/01/1999
	Pages B 3.7-17 through B 3.7-20	08/31/1998
	Page TRM / B 3.7-21	02/14/2005
	Page TRM / B 3.7-21a	06/20/2008
	Pages TRM / B 3.7-22 and TRM / B 3.7-23	01/30/2008
	Pages TRM / B 3.7-24 through TRM / B 3.7-29	10/05/2006

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
	Page TRM / B 3.7-30	06/07/2007
	Pages TRM / B 3.7-30a and TRM / B 3.7-30b	10/05/2006
	Page TRM / B 3.7-32	03/09/2001
	Page TRM / B 3.7-33	04/15/2003
	Page TRM / B 3.7-34	12/03/2004
	Page TRM / B 3.7-35	07/05/2000
	Pages TRM / B 3.7-36 and TRM / B 3.7-37	04/01/2009
	Page TRM / B 3.7-38	09/25/2009
	Page TRM / B 3.7-39	04/01/2009
	Page TRM / B 3.7-40	04/08/2010
B 3.8	ELECTRICAL POWER BASES	
	Page TRM / B 3.8-1	04/02/2002
	Pages TRM / B 3.8-2 and TRM / B 3.8-2	01/28/2005
	Page TRM / B 3.8-2a	03/01/2010
	Page TRM / B 3.8-3	04/02/2002
	Page TRM / B 3.8-3a	04/02/2002
	Page TRM / B 3.8-4	04/02/2002
	Page TRM / B 3.8-4a	08/10/2004
	Page TRM / B 3.8-5	08/31/1998
	Pages TRM / B 3.8-6 through TRM / B 3.8-16	04/02/2002
	Page TRM / B 3.8-17	01/28/2005
	Pages TRM / B 3.8-18 through TRM / B 3.8-20	11/29/2006
	Pages TRM / B 3.8-21 through TRM / B 3.8-24	05/28/2009
B.3.9	REFUELING OPERATIONS BASES	
	Pages B 3.9-1 and B 3.9-2	08/31/1998
	Pages B 3.9-3 through B 3.9-7	10/23/1998
B 3.10	MISCELLANEOUS BASES	
	Page B 3.10-1	08/31/1998
	Pages TRM / B 3.10-2 and TRM / B 3.10-3	03/27/2007
	Pages TRM / B 3.10-4 and TRM / B 3.10-5	08/23/1999
B 3.11	RADIOACTIVE EFFLUENTS BASES	
	Pages B 3.11-1 through B 3.11-9	08/31/1998
	Page TRM / B 3.11-10	02/01/1999
	Pages TRM/B 3.11-11 and TRM/B 3.11-11a	04/07/2000
	Pages TRM/B 3.11-12 and TRM/B 3.11-13	02/01/1999
	Page TRM / B 3.11-14	12/03/2004
	Page TRM / B 3.11-15	02/01/1999
	Pages B 3.11-16 through B 3.11-19	08/31/1998
	Page TRM / B 3.11-20	04/02/2002
	Page TRM / B 3.11-20a	04/02/2002

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
	Page TRM / B 3.11-21	05/13/2005
	Pages TRM / B 3.11-22 and TRM / B 3.11-23	11/14/2006
	Page TRM / B 3.11-23a	05/13/2005
	Pages TRM / B 3.11-24 and TRM / B 3.11-25	01/21/2004
	Pages B 3.11-26 through B 3.11-27	08/31/1998
	Pages TRM / B 3.11-28 and TRM / B 3.11-29	11/30/2005
	Page TRM / B 3.11-30	06/30/2010
	Pages TRM / B 3.11-31 and TRM / B 3.11-32	08/31/1998
	Page TRM / B 3.11-33	06/30/2010
	Pages TRM / B 3.11-34 and TRM / B 3.11-35	08/31/1998
	Page TRM / B 3.11-36	02/12/1999
B.3.12	LOADS CONTROL PROGRAM BASES	
	Page TRM / B 3.12-1	09/19/2007
	Page TRM / B 3.12-2	11/29/2010
	Page TRM / B 3.12-3	02/05/1999

TRM2 text LOES.doc
1/12/2011

2.0 PLANT PROGRAMS AND SETPOINTS

2.2 Instrument Trip Setpoint Table

The Instrument Trip Setpoint Limits in Table 2.2-1 are the Trip Setpoint value limits that were contained in the Instrumentation Setpoint tables for protection systems and other functions important to safety that were included in the scope of the original Standard Technical Specifications. Actual instrument setpoints are established utilizing the Allowable Values specified in the Technical Specifications and Technical Requirements. Allowable Values are established in the Reference LCOs and TROs identified in this Table. TRO references are enclosed in square brackets.

Instrumentation process setpoints for the listed subsystems and trip functions are set consistent with the Trip Setpoint Limit Column of Table 2.2-1. Actual setpoints are established in accordance with engineering procedures.

Alarm setpoints and other non-protection system trip settings as may be found in the Technical Specifications or in the Technical Requirements are not included in this table.

Reference NDAP-QA-1104 Setpoint Change Control

TABLE 2.2-1 (Page 1 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.1	Reactor Protection		
2.2.1.1	3.3.1.1	Intermediate Range Monitor, Neutron Flux - High	$\leq 120/125$ divisions of full scale
2.2.1.2	3.3.1.1	Average Power Range Monitor, Neutron Flux - High (Setdown)	$\leq 18\%$ of RATED THERMAL POWER
2.2.1.3	3.3.1.1	Average Power Range Monitor, Simulated Thermal Power - High Two Loop Operation	$0.55 W + 58.7\%$
2.2.1.4	3.3.1.1	Average Power Range Monitor, Simulated Thermal Power - High Single Loop Operation	$0.55 (W - \Delta W) + 58.7\%^{(b)}$
2.2.1.5	3.3.1.1	Average Power Range Monitor, Simulated Thermal Power - High Flow Clamp	$\leq 113.5\%$ of RATED THERMAL POWER
2.2.1.6	3.3.1.1	Average Power Range Monitor, Neutron Flux - High	$\leq 118\%$ of RATED THERMAL POWER
2.2.1.7	3.3.1.1	Reactor Vessel Steam Dome Pressure - High	≤ 1087 psig
2.2.1.8	3.3.1.1	Reactor Vessel Water Level - Low, Level 3	≥ 13.0 inches ^(a)
2.2.1.9	3.3.1.1	Main Steam Isolation Valve - Closure	$\leq 10\%$ closed
2.2.1.10		This Section Not Used	
2.2.1.11	3.3.1.1	Drywell Pressure - High	≤ 1.72 psig
2.2.1.12	3.3.1.1	Scram Discharge Volume Water Level - High - Level Transmitter	≤ 65 gallons
2.2.1.13	3.3.1.1	Scram Discharge Volume Water Level - High - Float Switch	≤ 61 gallons
2.2.1.14	3.3.1.1	Turbine Stop Valve - Closure	$\leq 5.5\%$ closed
2.2.1.15	3.3.1.1	Turbine Control Valve Fast Closure, Trip Oil Pressure - Low	≥ 500 psig

(continued)

^(a) See Figure 2.2-1.^(b) For single loop operation, the value of $\Delta W = 8.7$.

TABLE 2.2-1 (Page 2 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.1.16 OPRM Instrumentation			
2.2.1.16.1	3.3.1.1	Sp PBA Amplitude Trip	See COLR – TRO 3.2
2.2.1.16.2	3.3.1.1	Np PBA Successive Confirmation Count Trip	See COLR – TRO 3.2
2.2.1.16.3	[3.3.9]	TOL (ε) Period Tolerance	0.10 sec
2.2.1.16.4	[3.3.9]	fc Conditioning Filter Cutoff Frequency	1.50 Hz
2.2.1.16.5	[3.3.9]	Tmin Oscillation Period Lower Time Limit	1.00 sec
2.2.1.16.6	[3.3.9]	Tmax Oscillation Period Upper Time Limit	3.50 sec
2.2.1.16.7	[3.3.9]	LPRMmin Minimum LRPMS/Cell Required for Cell Operability	2
2.2.1.16.8	[3.3.9]	S1 Peak Threshold Setpoint/ABA & GRBA	1.20
2.2.1.16.9	[3.3.9]	S2 Valley Threshold Setpoint/ABA & GRBA	0.85
2.2.1.16.10	[3.3.9]	Smax Amplitude Trip Setpoint/ABA	1.50
2.2.1.16.11	[3.3.9]	DR3 Growth Rate Factor Setpoint/GRBA	1.60
2.2.2 Isolation Actuation Instrumentation			
2.2.2.1 Primary Containment Isolation			
2.2.2.1.1	3.3.6.1	Reactor Vessel Water Level Low, Level 3	≥ 13.0 inches ^(a)
2.2.2.1.2	3.3.6.1	Reactor Vessel Water Level Low Low, Level 2	≥ -38.0 inches ^(a)
2.2.2.1.3	3.3.6.1	Reactor Vessel Water Level Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.2.1.4	3.3.6.1	Drywell Pressure - High	≤ 1.72 psig
2.2.2.1.5	3.3.6.1	SGTS Exhaust Radiation - High	≤ 23.0 mR/hr
2.2.2.1.6	[3.3.6]	Main Steam Line Radiation – High High	≤ 15 x full power background without hydrogen injection

(continued)

^(a) See Figure 2.2-1.

TABLE 2.2-1 (Page 3 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.2.2	Secondary Containment Isolation		
2.2.2.2.1	3.3.6.2	Reactor Vessel Water Level - Low Low, Level 2	≥ -38.0 inches ^(a)
2.2.2.2.2	3.3.6.2	Drywell Pressure - High	≤ 1.72 psig
2.2.2.2.3	3.3.6.2	Refuel Floor High Exhaust Duct Radiation - High	≤ 18 mR/hr
2.2.2.2.4	3.3.6.2	Railroad Access Shaft Exhaust Duct Radiation - High	≤ 5 mR/hr
2.2.2.2.5	3.3.6.2	Refuel Floor Wall Exhaust Duct Radiation - High	≤ 21 mR/hr
2.2.2.3	Main Steam Line Isolation		
2.2.2.3.1	3.3.6.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.2.3.2	3.3.6.1	Main Steam Line Pressure - Low	≥ 861 psig
2.2.2.3.3	3.3.6.1	Main Steam Line Flow - High	≤ 173 psid
2.2.2.3.4	3.3.6.1	Condenser Vacuum - Low	≥ 9.0 inches Hg vacuum
2.2.2.3.5	3.3.6.1	Reactor Building Main Steam Line Tunnel Temperature - High	$\leq 177^{\circ}\text{F}$
2.2.2.3.6		This Section Not Used	
2.2.2.3.7		This section is not used.	
2.2.2.3.8	[3.3.6]	Turbine Building Main Steam Tunnel Temperature - High	$\leq 197^{\circ}\text{F}$
2.2.2.4	Reactor Water Cleanup System Isolation		
2.2.2.4.1	3.3.6.1	Reactor Vessel Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.2.4.2	3.3.6.1	RWCU Δ Flow - High	≤ 59 gpm
2.2.2.4.3	3.3.6.1	RWCU Flow - High	≤ 462 gpm
2.2.2.4.4	3.3.6.1	RWCU Penetration Area Temperature - High	$\leq 131^{\circ}\text{F}$
2.2.2.4.5		This section is not used.	
2.2.2.4.6	3.3.6.1	RWCU Pump Area Temperature - High	$\leq 147^{\circ}\text{F}$
2.2.2.4.7		This section is not used.	
2.2.2.4.8	3.3.6.1	RWCU Heat Exchanger Area Temperature - High	$\leq 147^{\circ}\text{F}$
2.2.2.4.9		This section is not used.	

(continued)

^(a) See Figure 2.2-1.

TABLE 2.2-1 (Page 4 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.2.5	Reactor Core Isolation Cooling System Isolation		
2.2.2.5.1	3.3.6.1	RCIC Steam Line Δ Pressure - High	≤ 138 inches H ₂ O
2.2.2.5.2	3.3.6.1	RCIC Steam Supply Line Pressure - Low	≥ 60 psig
2.2.2.5.3	3.3.6.1	RCIC Turbine Exhaust Diaphragm Pressure - High	≤ 10.0 psig
2.2.2.5.4	3.3.6.1	RCIC Equipment Room Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.5.5	3.3.6.1	RCIC Pipe Routing Area Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.5.6	3.3.6.1	RCIC Emergency Area Cooler Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.5.7	3.3.6.1	Drywell Pressure - High	≤ 1.72 psig
2.2.2.5.8		This section is not used.	
2.2.2.5.9		This section is not used.	
2.2.2.6	High Pressure Coolant Injection System Isolation		
2.2.2.6.1	3.3.6.1	HPCI Steam Line Δ Pressure - High	≤ 370 inches H ₂ O
2.2.2.6.2	3.3.6.1	HPCI Steam Supply Line Pressure - Low	≥ 104 psig
2.2.2.6.3	3.3.6.1	HPCI Turbine Exhaust Diaphragm Pressure - High	≤ 10 psig
2.2.2.6.4	3.3.6.1	HPCI Equipment Room Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.6.5	3.3.6.1	HPCI Emergency Area Cooler Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.6.6	3.3.6.1	HPCI Pipe Routing Area Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.6.7	3.3.6.1	Drywell Pressure - High	≤ 1.72 psig
2.2.2.6.8		This section is not used.	
2.2.2.6.9		This section is not used.	
2.2.2.7	Shutdown Cooling/System Isolation		
2.2.2.7.1	3.3.6.1	Reactor Vessel Water Level - Low, Level 3	≥ 13.0 inches ^(a)
2.2.2.7.2	3.3.6.1	Reactor Vessel Steam Dome Pressure - High	≤ 98 psig
2.2.2.7.3	[3.3.6]	RHR Flow - High	$\leq 25,000$ gpm
2.2.3	ECCS Actuation		
2.2.3.1	Core Spray System		
2.2.3.1.1	3.3.5.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.3.1.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.1.3	3.3.5.1	Reactor Vessel Steam Dome Pressure - Low injection permissive	$\geq 413, \leq 427$ psig

(continued)

^(a) See Figure 2.2-1.

TABLE 2.2-1 (Page 5 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.3.2	LPCI Mode of RHR System		
2.2.3.2.1	3.3.5.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.3.2.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.2.3	3.3.5.1	Reactor Vessel Steam Dome Pressure - Low, injection permissive	$\geq 413, \leq 427$ psig
2.2.3.2.4	3.3.5.1	Reactor Vessel Steam Dome Pressure - Low, Recirculation Discharge Valve permissive	≥ 236 psig, decreasing
2.2.3.3	HPCI System		
2.2.3.3.1	3.3.5.1	Reactor Vessel Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.3.3.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.3.3	3.3.5.1	Condensate Storage Tank Level - Low	≥ 40.5 inches above tank bottom
2.2.3.3.4	3.3.5.1	Reactor Vessel Water Level - High, Level 8	≤ 54 inches
2.2.3.4	Automatic Depressurization System (ADS)		
2.2.3.4.1	3.3.5.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches
2.2.3.4.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.4.3	3.3.5.1	ADS Timer	≤ 102 seconds
2.2.3.4.4	3.3.5.1	Core Spray Pump Discharge Pressure - High	$\geq 135, \leq 155$ psig
2.2.3.4.5	3.3.5.1	Low Pressure Coolant Injection Pump Discharge Pressure - High	$\geq 121, \leq 129$ psig
2.2.3.4.6	3.3.5.1	Reactor Vessel Water Level - Low, Level 3 Confirmatory	≥ 13 inches
2.2.3.4.7	3.3.5.1	ADS Drywell Pressure Bypass Timer	≤ 420 seconds
2.2.3.5	Loss of Power - ECCS Actuation		
2.2.3.5.1	4.16kv ESS Bus Undervoltage (Loss of Voltage < 20%)		
2.2.3.5.1.1	3.3.8.1	Bus Undervoltage	$\geq 823.2, \leq 856.8$ Volts
2.2.3.5.1.2	3.3.8.1	Time delay	$\geq 0.4, \leq 0.6$ seconds

(continued)

^(a) See Figure 2.2-1.

TABLE 2.2-1 (Page 6 of 8)
INSTRUMENTATION SETPOINTS

	SYSTEM/REFERENCE LCO [TRO]	TRIP FUNCTION	TRIP SETPOINT
2.2.3.5.2	4.16kV ESS Bus Undervoltage (Degraded Voltage < 65%)		
2.2.3.5.2.1	3.3.8.1	Bus Undervoltage	$\geq 2641.1, \leq 2748.9$ Volts
2.2.3.5.2.2	3.3.8.1	Time delay	$\geq 2.7, \leq 3.3$ seconds
2.2.3.5.3	4.16kV ESS Bus Undervoltage (Degraded Voltage, < 93%)		
2.2.3.5.3.1	3.3.8.1	Bus Undervoltage	$\geq 3829.3, \leq 3906.7$ Volts
2.2.3.5.3.2	3.3.8.1	Time Delay (Non-LOCA)	≥ 4 minute, 30 seconds
2.2.3.5.3.4	3.3.8.1	Time Delay (LOCA)	≤ 5 minute, 30 seconds $\geq 9, \leq 11$ seconds
2.2.3.5.4	480V ESS Bus 0B565 Undervoltage (Degraded Voltage, < 65%)		
2.2.3.5.4.1	[3.8.5]	480V Basis	$\geq 308.9, \leq 315.1$ Volts
2.2.3.5.4.2	[3.8.5]	Time Delay	$\geq 4.5, \leq 5.5$ seconds
2.2.3.5.5	480V ESS Bus 0B565 Undervoltage (Degraded Voltage, < 92%)		
2.2.3.5.5.1	[3.8.5]	480V Basis	$\geq 437.6, \leq 446.4$ Volts
2.2.3.5.5.2	[3.8.5]	Time Delay	$\geq 9, \leq 11$ seconds
2.2.4	ATWS Alternate Rod Injection and Recirculation Pump Trip		
2.2.4.1	3.3.4.2[3.1.1]	Reactor Vessel, Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.4.1	3.3.4.2[3.1.1]	Reactor Vessel Steam Dome Pressure - High	≤ 1135 psig
2.2.5	End of Cycle Recirculation Pump Trip		
2.2.5.1	3.3.4.1	Turbine Stop Valve-Closure	$\leq 5.5\%$ closed
2.2.5.2	3.3.4.1	Turbine Control Valve - Fast Closure	≥ 500 psig
2.2.6	Reactor Core Isolation Cooling System Actuation		
2.2.6.1	3.3.5.2	Reactor Vessel Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.6.2	3.3.5.2	Reactor Vessel Water Level - High, Level 8	≤ 54 inches ^(a)
2.2.6.3	3.3.5.2	Condensate Storage Tank Level - Low	≥ 36.0 inches above tank bottom

(continued)

^(a) See Figure 2.2-1.

TABLE 2.2-1 (Page 7 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.7	Control Rod Block		
2.2.7.1	Rod Block Monitor		
2.2.7.1.1	3.3.2	Low Power Range - Upscale	See COLR - TRO 3.2
	3.3.2	Intermediate Power Range - Upscale	See COLR - TRO 3.2
	3.3.2	High Power Range - Upscale	See COLR - TRO 3.2
2.2.7.1.2	3.3.2	Low Power Range Setpoint	See COLR - TRO 3.2
	3.3.2	Intermediate Power Range Setpoint	See COLR - TRO 3.2
	3.3.2	High Power Range Setpoint	See COLR - TRO 3.2
2.2.7.2	APRM		
2.2.7.2.1	[3.1.3]	Simulated Thermal Power-High - Two Loop Operation	0.55 W + 54.2%
2.2.7.2.2	[3.1.3]	Simulated Thermal Power-High - Single Loop Operation	0.55 (W - ΔW) + 54.2% ^(c)
2.2.7.2.3	[3.1.3]	Simulated Thermal Power-High Clamp	≤ 108% of RATED THERMAL POWER
2.2.7.2.4	[3.1.3]	Downscale	≥ 5% of RATED THERMAL POWER
2.2.7.2.5	[3.1.3]	Neutron Flux - High (Setdown)	≤ 12% of RATED THERMAL POWER
2.2.7.3	Source Range Monitors		
2.2.7.3.1	[3.1.3]	Upscale	≤ 2E5 cps
2.2.7.3.2	[3.1.3]	Downscale	≥ 3.0 cps ^(b)
2.2.7.4	Intermediate Range Monitors		
2.2.7.4.1	[3.1.3]	Upscale	≤ 108/125 divisions of full scale
2.2.7.4.2	[3.1.3]	Downscale	≥ 5/125 divisions of full scale
2.2.7.5	Scram Discharge Volume		
2.2.7.5.1	[3.1.3]	Water Level - High	≤ 35.9 gallons
2.2.7.6	Reactor Coolant System Recirculation Flow		
2.2.7.6.1	[3.1.3]	Upscale	114%

(continued)

^(b) With a signal-to-noise ratio ≥ 2, or within the limits of Figure 2.2-2.^(c) For single loop operation, the value of ΔW = 8.7.

TABLE 2.2-1 (Page 8 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.8	CREOASS		
2.2.8.1	3.3.7.1	Main Control Room Outside Air Intake Radiation Monitor	≤ 5 mR/hr
2.2.8.1.1	3.3.7.1	Reactor Vessel Water Level - Low Low, Level 2	≥ -38.0 inches ^(a)
2.2.8.1.2	3.3.7.1	Drywell Pressure - High	≤ 1.72 psig
2.2.8.1.3	3.3.7.1	Refuel Floor High Exhaust Duct Radiation - High	≤ 18 mR/hr
2.2.8.1.4	3.3.7.1	Railroad Access Shaft Exhaust Duct Radiation - High	≤ 5 mR/hr
2.2.8.1.5	3.3.7.1	Refuel Floor Wall Exhaust Duct Radiation - High	≤ 21 mR/hr
2.2.9	Feedwater/Main Turbine Trip System Actuation		
2.2.9.1	3.3.2.2	Reactor Vessel Level - High	≤ 54.0 inches ^(a)
2.2.10	MVP Isolation		
2.2.10.1	[3.3.11]	Main Steam Line Radiation - High High	≤ 15 x full power background without hydrogen injection

^(a) See Figure 2.2-1

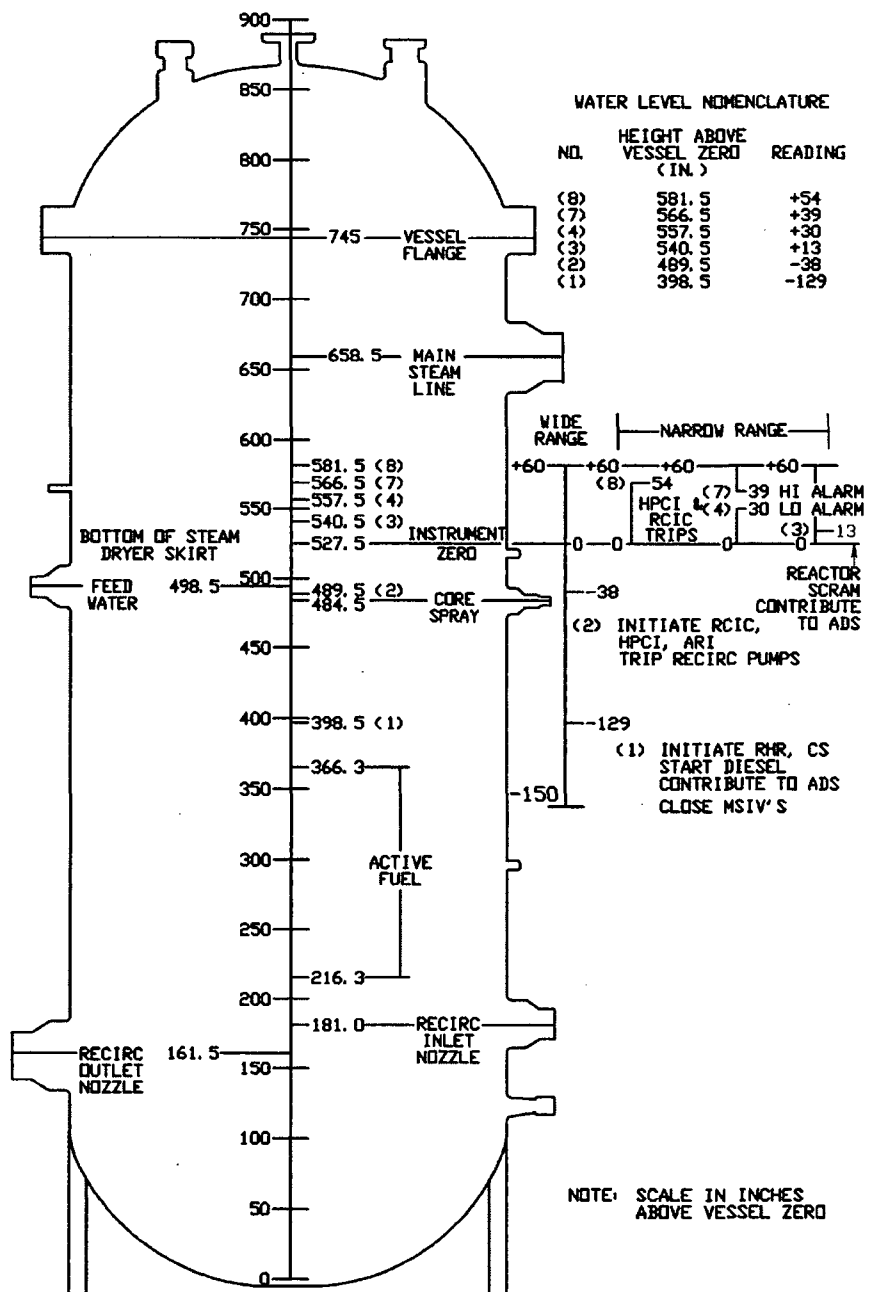


FIGURE 2.2-1
REACTOR VESSEL WATER LEVEL

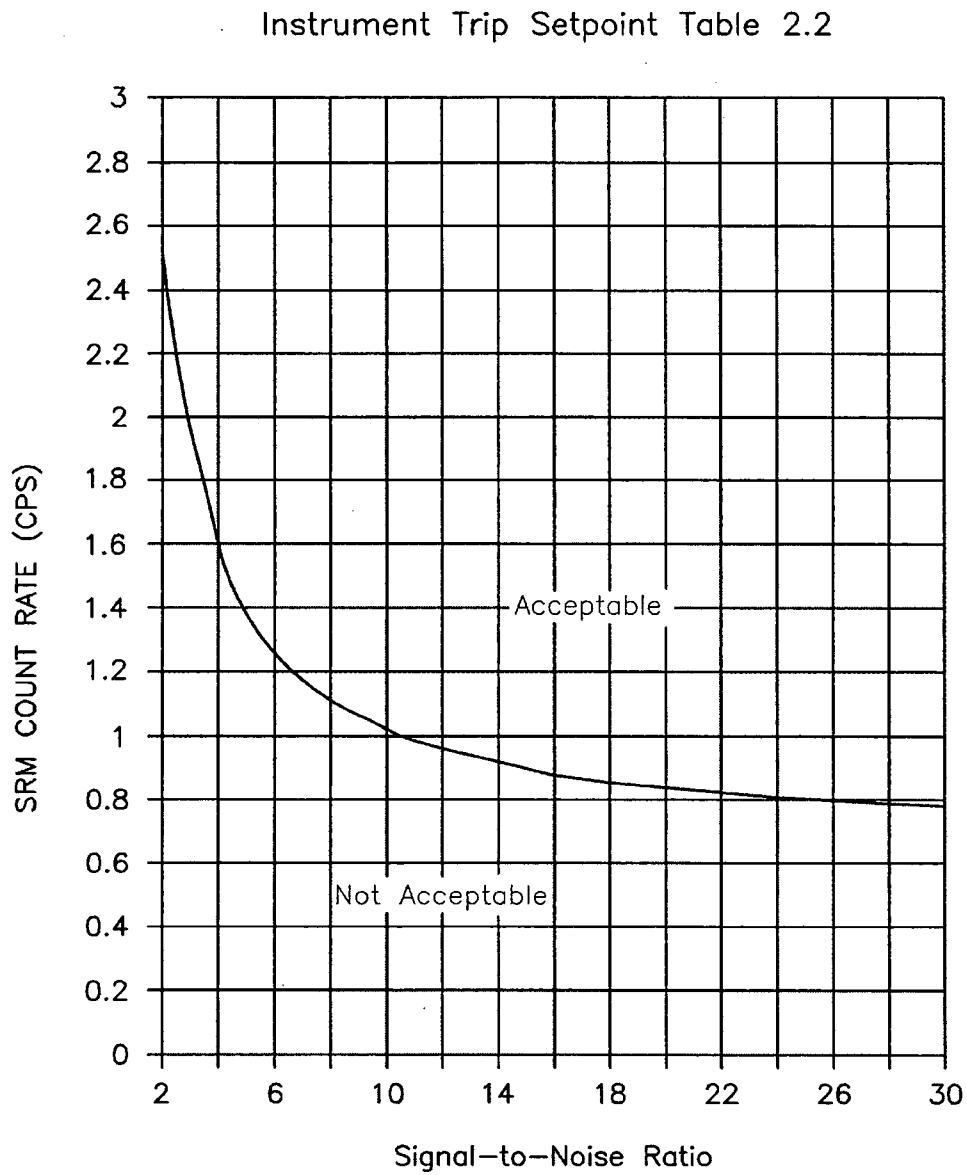


Figure 2.2-2
Minimum SRM Trip Setpoint Versus Signal-to-Noise Ratio

3.3 Instrumentation

3.3.6 TRM Isolation Actuation Instrumentation

TRO 3.3.6 The TRM containment isolation instrumentation for each Function in Table 3.3.6-1 shall be OPERABLE.

APPLICABILITY: As specified in Table 3.3.6-1

ACTIONS

NOTES

1. Penetration flow paths isolated to comply with Action C may be unisolated intermittently under administrative controls.
2. Separate Condition entry is allowed for each channel.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required channels inoperable	A.1 Place channel in trip.	12 hours for Function 2.a <u>AND</u> 24 hours for Functions other than Function 2.a
B. One or more Functions with isolation capability not maintained.	B.1 Restore isolation capability.	1 hour
C. Required Action and associated Completion Time of Condition A or B not met.	C.1 Initiate appropriate compensatory measures for the degraded condition.	24 hours

TECHNICAL REQUIREMENT SURVEILLANCE

-----NOTES-----

1. Refer to Table 3.3.6-1 to determine which TRSs apply for each TRM Isolation Actuation Instrumentation Function.
2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated function maintains isolation capability.

SURVEILLANCE		FREQUENCY
TRS 3.3.6.1	Perform CHANNEL CHECK	12 hours
TRS 3.3.6.2	Perform CHANNEL FUNCTIONAL TEST	92 days
TRS 3.3.6.3	Perform CHANNEL CALIBRATION	92 days
TRS 3.3.6.4	Perform CHANNEL CALIBRATION	24 months
TRS 3.3.6.5	Perform LOGIC SYSTEM FUNCTIONAL TEST	24 months
TRS 3.3.6.6	Perform RESPONSE TIME TEST	24 months on a staggered test basis

TABLE 3.3.6-1 (Page 1 of 2)
PRIMARY CONTAINMENT ISOLATION INSTRUMENTATION

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. Main Steam Line Isolation				
a. Turbine Building Main Steam Line Tunnel Temperature - High	1,2,3	2	TRS 3.3.6.2 TRS 3.3.6.3 TRS 3.3.6.5	$\leq 200^{\circ}\text{F}$
2. Primary Containment Isolation				
a. Main Steam Line Radiation - High High	1,2,3	2	TRS 3.3.6.1 TRS 3.3.6.2 TRS 3.3.6.4 TRS 3.3.6.5 TRS 3.3.6.6 ^(a)	$\leq 21 \times$ full power background without hydrogen injection
3. Shutdown Cooling System Isolation (b)				
a. RHR Flow - High	3,4,5	1	TRS 3.3.6.1 TRS 3.3.6.2 TRS 3.3.6.4 TRS 3.3.6.5	$\leq 26,000$ gpm

(a) Radiation detectors are exempt from response time testing.

(b) Not required when the penetration is isolated from the reactor vessel via manual isolation valve, blind flange, or deactivated auto isolation valve.

THIS PAGE INTENTIONALLY LEFT BLANK

B 3.3.6 TRM Isolation Actuation Instrumentation

BASES

TRO The TRM Actuation instrumentation automatically initiates closure of appropriate primary containment isolation valves (PCIVs). The function of the PCIVs, in combination with other accident mitigation systems, is to limit fission product release during and following postulated Design Basis Accidents (DBAs) (Reference 1). The TRM Isolation Actuation Instrument has been relocated from the Technical Specifications because the identified Function is not credited in the plant design basis to mitigate any plant event, but does provide a diverse means to initiate an Isolation Actuation.

The isolation instrumentation includes the sensors, relays, and instruments that are necessary to cause initiation of primary containment and Reactor Coolant Pressure Boundary (RCPB) isolation. When the setpoint is reached, the sensor actuates, which then outputs an isolation signal to the isolation logic. Monitoring a wide range of independent parameters provides functional diversity. The input parameters to the isolation logic are:

- (a) Main steam line radiation,
- (b) Turbine Building Main Steam Line Tunnel Temperature - High, and
- (c) RHR Flow - High.

The valves associated with these trip channels are identified in Table B 3.3.6-1. Each of these valves is also associated with other trip channels as identified in LCO Bases B 3.6.1.3.

The trips occur after a one second delay. See Tech Spec Basis B 3.3.6-1.

(continued)

B 3.3.6 TRM Isolation Actuation Instrumentation

BASES (continued)

ACTIONS The Actions are defined to ensure proper corrective measures are taken in response to the inoperable components. The ACTIONS are modified by two Notes. Note 1 allows penetration flow path(s) to be unisolated intermittently under administrative controls. These controls consist of stationing a dedicated operator at the controls of the valve, who is in continuous communication with the control room. In this way, the penetration can be rapidly isolated when a need for primary containment isolation is indicated. Note 2 is provided to modify the ACTIONS.

Condition C applies if the channel is not restored to OPERABLE status or placed in trip, or isolation capability is not restored, within the allowed Completion Time. If inoperable channels should not be placed in trip (e.g., might result in a undesirable transient) Action C may be intentionally entered as a result of not meeting Required Action A.1 in its required Completion Time. Required Action C.1 requires appropriate compensatory measures be in place within the following 24 hours. Examples of appropriate compensatory measures may consist of verifying that diverse isolation functions remain OPERABLE. Furthermore, isolating the penetration (e.g., as may be required by TS Actions for an inoperability affecting both the TRM Function and a required TS Function) also provides adequate compensatory actions since isolating the affected penetration flow path(s) accomplishes the safety function of the inoperable channels. If it is not desired to isolate the affected penetration flow path(s) (e.g., as in the case where isolating the penetration flow path(s) could result in a reactor scram or disabling RHR-SDC), alternate compensatory measures should be pursued. The 24 hour Completion Time is acceptable due to the fact that these Functions are not assumed in any accident or transient analysis in the FSAR.

TRS The TRSs are defined to be performed at the specified Frequency to ensure that the TRM Isolation Actuation Instrumentation Functions are maintained OPERABLE. TRM Isolation Actuation Instrumentation Surveillances are performed consistent with the Bases for LCO 3.3.6.1 "Isolation Activation Instrumentation."

(continued)

B 3.3.6 TRM Isolation Actuation Instrumentation

BASES (continued)

TRS 3.3.6.5

The LOGIC SYSTEM FUNCTIONAL TEST demonstrates the OPERABILITY of the required isolation logic for a specific channel. The system functional testing performed on PCIVs in LCO 3.6.1.3 overlaps this surveillance to provide complete testing of the assumed safety function. The 24 month Frequency is based on the need to perform portions of this surveillance under the conditions that apply during a plant outage and the potential for an unplanned transient if the surveillance were performed with the reactor at power. Operating experience has shown these components usually pass the surveillance when performed at the 24 month Frequency.

TRS 3.3.6.6

The response time testing of Function 2.a is per FSAR Table 7.3-29.

- REFERENCES
1. FSAR Section 7.3.1
 2. NRC Inspection and Enforcement Manual, Part 9900: Technical Guidance, Standard Technical Specification Section 1.0 Definitions, Issue dated 12/8/96.
-

Table B 3.3.6-1
Primary Containment Isolation Valves
 (Page 1 of 1)

Plant systems	Valve Number	Valve Description	Isolation Signal Function No. (Table 3.3.6-1)
Nuclear Boiler	HV-241F022A	MSIV	1.a
	HV-241F022B	MSIV	1.a
	HV-241F022C	MSIV	1.a
	HV-241F022D	MSIV	1.a
	HV-241F028A	MSIV	1.a
	HV-241F028B	MSIV	1.a
	HV-241F028C	MSIV	1.a
	HV-241F028D	MSIV	1.a
	HV-241F016	MSL Drain Isolation Valve	1.a
	HV-241F019	MSL Drain Isolation Valve	1.a
Reactor Recirculation	HV-243F019	Reactor Coolant Sample Valve	2.a
	HV-243F020	Reactor Coolant Sample Valve	2.a
RHR	HV-251F022	RHR - Reactor Vessel Head Spray Valve	3.a
	HV-251F023	RHR - Reactor Vessel Head Spray Valve	3.a
	HV-251F008	RHR – Shutdown Cooling Valve	3.a
	HV-251F009	RHR – Shutdown Cooling Valve	3.a