DOE/EIA-0348(2009)

Released: November 23, 2010 Revised: January 4, 2011

Electric Power Annual 2009

January 2011

U.S. Energy Information Administration

Assistant Administrator for Energy Statistics
Office of Electricity, Renewables, and Uranium Statistics
U.S. Department of Energy
Washington DC 20585

This report is only available on the Web at: http://www.eia.gov/cneaf/electricity/epa/epa sum.html

This report was prepared by the U.S. Energy Information Administration (EIA), the statistical and analytical agency within the U.S. Department of Energy. By law, EIA's data, analyses, and forecasts are independent of approval by any other officer or employee of the United States Government. The views in this report therefore should not be construed as representing those of the Department of Energy or other Federal agencies.

Contacts

Questions concerning the Electric Power Annual can be directed to the National Energy Information Center at 202-586-8800 or InfoCtr@eia.gov.

Year-in-Review

William Booth (202/586-5611) email: william.booth@eia.gov

Marie Rinkoski Spangler (202/586-2446) email: marie.rinkoski-spangler@eia.gov

Kevin G. Lillis (202/586-3704) email: <u>kevin.lillis@eia.gov</u>

Capacity

Vlad Dorjets (202/586-3141) email: <u>vlad.dorjets@eia.gov</u>

Patricia Hutchins (202/586-1029) email: patricia.hutchins@eia.gov

Generation

Channele Wirman (202/586-5356) email: channele.wirman@eia.gov

Chris Cassar (202/586-5448) email: christopher.cassar@eia.gov

Ron S. Hankey (202/586-2630) email: <u>ronald.hankey@eia.gov</u>

Demand, Capacity Resources, and Capacity Margins

Orhan M. Yildiz (202/586-5410) email: orhan.yildiz@eia.gov

Marie Rinkoski Spangler (202/586-2446) email: marie.rinkoski-spangler@eia.gov

Fuel

Channele Wirman (202/586-5356) email: channele.wirman@eia.gov

Rebecca Peterson (202/586-4509) email: rebecca.peterson@eia.gov

Chris Cassar (202/586-5448) email: christopher.cassar@eia.gov

Ron S. Hankey (202/586-2630) email: ronald.hankey@eia.gov

Emissions

Kevin G. Lillis (202/586-3704) email: kevin.lillis@eia.gov

Trade

Michelle Bowles (202/586-2430) email: michelle.bowles@eia.gov

Retail Customers, Sales, and Revenue

Stephen Scott (202/586-5140) email: stephen.scott@eia.gov

Karen McDaniel (202/586-4280) email: <u>karen.mcdaniel@eia.gov</u>

Revenue and Expense Statistics Stephen Scott (202/586-5140) email: stephen.scott@eia.gov

Karen McDaniel (202/586-4280) email: karen.mcdaniel@eia.gov

Kevin G. Lillis (202/586-3704) email: <u>kevin.lillis@eia.gov</u>

Demand-Side Management Stephen Scott (202/586-5140) email: stephen.scott@eia.gov

Karen McDaniel (202/586-4280) email: karen.mcdaniel@eia.gov

Quality

The U.S. Energy Information Administration is committed to quality products and service. To ensure that this report meets the highest standards for quality, please forward your comments or suggestions about this publication to Orhan M. Yildiz at 202/586-5410, or email: orhan.yildiz@eia.gov.

For general inquiries about energy data, please contact the National Energy Information Center at 202/586-8800. Internet users may contact the center at: infoctr@eia.gov.

Revision Notice

January 4, 2011 Revision:

A revision to the energy source codes for three generators in Montana (changed from geothermal to waste heat) has resulted in changes to the Electric Power Annual 2009.

Details of this revision can be found by using the highlighted link provided below.

http://www.eia.gov/cneaf/electricity/epa/epa noticerev.html

Please note that this link is also provided on the Electric Power Annual web page among publication related dates as:

Report Revised: January 4, 2011

Preface

The Electric Power Annual 2009 summarizes electric power industry statistics at the national The publication provides industry government policymakers, decision-makers. analysts, and the general public with historical data that may be used in understanding U.S. electricity markets. The Electric Power Annual is prepared by the Office of Electricity, Renewables, and Uranium Statistics; under the Assistant Administrator Energy Statistics; U.S. Energy Information Administration; U.S. Department of Energy.

Data in this report can be used in analytic studies for public policy and business decisions. The chapters present information and data in the following areas: electricity generation; electric generating capacity; demand, capacity resources, and capacity margins; fuel, consumption and receipts; emissions; electricity trade; retail electric customers, sales, revenue and average retail price; electric utility revenue and expense statistics; and demand-side management.

Monetary values in this publication are expressed in nominal terms.

Data published in the *Electric Power Annual* are compiled from four surveys completed annually or monthly by electric utilities and other electric power producers and submitted to the EIA and five surveys administered by other government organizations¹. The EIA forms are described in detail in the "Technical Notes."

¹The Department of Energy, Office of Electricity Delivery and Energy Reliability; the Federal Energy Regulatory Commission; the Department of Agriculture, Rural Utility Service; and the National Energy Board of Canada

Contents

	wer Industry 2009:	
Year in Re	view	1
Chapter 1.	Capacity	13
Chapter 2.	Generation and Useful Thermal Output	25
Chapter 3.	Fuel and Emissions.	30
Chapter 4.	Demand, Capacity Resources, and Capacity Margins	39
Chapter 5.	Characteristics of the Electric Power Industry	46
	Trade	
Chapter 7.	Retail Customers, Sales, and Revenue	54
Chapter 8.	Revenue and Expense Statistics	67
Chapter 9.	Demand-Side Management	71
Appendice		
A.	Technical Notes	77
Glossary		.100

Tables

		Pages
Table ES1.	Summary Statistics for the United States, 1998 through 2009	
Table ES2.	Supply and Disposition of Electricity, 1998 through 2009	12
Chapter 1.	Capacity	
Table 1.1.	Existing Net Summer Capacity by Energy Source and Producer Type, 1998 through 2009	14
Table 1.1.A.	Existing Net Summer Capacity of Other Renewables by Producer Type, 1998 through 2009	16
Table 1.2.	Existing Capacity by Energy Source, 2009	17
Table 1.3.	Existing Capacity by Producer Type, 2009	17
Table 1.4.	Planned Generating Capacity Additions from New Generators, by Energy Source, 2010-2014	18
Table 1.5.	Capacity Additions, Retirements and Changes by Energy Source, 2009	
Table 1.6.A.		
Table 1.6.B.	Capacity of Distributed Generators by Technology Type, 2004 through 2009	
Table 1.6.C.	Total Capacity of Dispersed and Distributed Generators by Technology Type, 2004 through 2009	
Table 1.7.	Fuel Switching Capacity of Operable Generators Reporting Natural Gas as the Primary Fuel, by Producer	Гуре,
T.1.1. 1.0	2009	
Table 1.8.	Fuel-Switching Capacity of Operable Generators: From Natural Gas to Petroleum Liquids by Type of Prin Mover, 2009	21
Table 1.9.	Fuel-Switching Capacity of Operable Generators: From Natural Gas to Petroleum Liquids by Type of Prin Mover, 2009	
Table 1.10.	Fuel-Switching Capacity of Operable Generators: From Natural Gas to Petroleum Liquids, by Year of Init	
	Commercial Operation, 2009	
Table 1.11.	Interconnection Cost and Capacity for New Generators, by Producer Type, 2008 and 2009	23
Table 1.12.	Interconnection Cost and Capacity for New Generators, by Grid Voltage Class, 2008 and 2009	24
Chapter 2.	Generation and Useful Thermal Output	25
Table 2.1.	Net Generation by Energy Source by Type of Producer, 1998 through 2009	26
Table 2.1.A.	Net Generation by Selected Renewables by Type of Producer, 1998 through 2009	28
Table 2.2.	Useful Thermal Output by Energy Source by Combined Heat and Power Producers, 1998 through 2009	29
Chapter 3.	Fuel and Emissions	
Table 3.1.	Consumption of Fossil Fuels for Electricity Generation by Type of Power Producer, 1998 through 2009	
Table 3.2.	Consumption of Fossil Fuels for Useful Thermal Output by Type of Combined Heat and Power Producers, through 2009	
Table 3.3.	Consumption of Fossil Fuels for Electricity Generation and for Useful Thermal Output, 1998 through 2009	
Table 3.4.	End-of-Year Stocks of Coal and Petroleum by Type of Producer, 1998 through 2009	
Table 3.5.	Receipts, Average Cost, and Quality of Fossil Fuels for the Electric Power Industry, 1998 through 2009	
Table 3.6.	Receipts and Quality of Coal Delivered for the Electric Power Industry, 1998 through 2009	
Table 3.7.	Average Quality of Fossil Fuel Receipts for the Electric Power Industry, 1998 through 2009	
Table 3.8.	Weighted Average Cost of Fossil Fuels for the Electric Power Industry, 1998 through 2009	
Table 3.9.	Emissions from Energy Consumption at Conventional Power Plants and Combined-Heat-and-Power Plants	
1 4010 3.7.	through 2009	
Table 3.10.	Number and Capacity of Existing Fossil-Fuel Steam-Electric Generators with Environmental Equipment, 1	
	through 2009	38
Table 3.11.	Average Costs of Existing Flue Gas Desulfurization Units, 1998 through 2009	38
Chanter 4.	Demand, Capacity Resources, and Capacity Margins	39
Table 4.1.	Noncoincident Peak Load, Actual and Projected by North American Electric Reliability Corporation Region	on,
	2005 through 2014	40
Table 4.2.	Net Internal Demand, Capacity Resources, and Capacity Margins by North American Electric Reliability	41
Table 4.3.	Corporation Region, Summer, 1998 through 2009	
1 4016 4.3.	Reliability Corporation Region, Summer, 2009 through 2014	
Table 4.4.	Net Internal Demand, Actual or Planned Capacity Resources, and Capacity Margins by North American E	
1 4010 7.7.	Reliability Corporation Region, Winter, 2009 through 2014	
	Tondont, Corporation region, white, 2007 allough 2017	
Chanter 5	Characteristics of the Electric Power Industry	46
Table 5.1.	Count of Electric Power Industry Power Plants, by Sector, by Predominant Energy Sources within Plant, 2	
14010 5.1.	through 2009	
Table 5.2.	Average Capacity Factors by Energy Source, 1998 through 2009	

Table 5.3.	Average Operating Heat Rate for Selected Energy Sources, 2001 through 2009	
Table 5.4.	Average Heat Rates by Prime Mover and Energy Source, 2009	
Table 5.5.	Planned Transmission Capacity Additions, by High-Voltage Size, 2010 through 2016	51
Chapter 6.	Trade	
Table 6.1.	Electric Power Industry - Electricity Purchases, 1998 through 2009	53
Table 6.2.	Electric Power Industry - Electricity Sales for Resale, 1998 through 2009	53
Table 6.3.	Electric Power Industry - U.S. Electricity Imports from and Electricity Exports to Canada and Mexico, 1998 through 2009	53
Chapter 7.	Retail Customers, Sales, and Revenue	54
Table 7.1.	Number of Ultimate Customers Served by Sector, by Provider, 1998 through 2009	
Table 7.2.	Retail Sales and Direct Use of Electricity to Ultimate Customers by Sector, by Provider, 1998 through 2009	
Table 7.3.	Revenue from Retail Sales of Electricity to Ultimate Customers by Sector, by Provider, 1998 through 2009	
Table 7.4.	Average Retail Price of Electricity to Ultimate Customers by End-Use Sector, 1998 through 2009	
Table 7.5.	Net Metering and Green Pricing Customers by End Use Sector, 2002 - 2009	
Chapter 8.	Revenue and Expense Statistics	67
Table 8.1.	Revenue and Expense Statistics for Major U.S. Investor-Owned Electric Utilities, 1998 through 2009	68
Table 8.2.	Average Power Plant Operating Expenses for Major U.S. Investor-Owned Electric Utilities, 1998 through 2009.	68
Table 8.3.	Revenue and Expense Statistics for Major U.S. Publicly Owned Electric Utilities (With Generation Facilities),	
	1998 through 2009	
Table 8.4.	Revenue and Expense Statistics for Major U.S. Publicly Owned Electric Utilities (Without Generation Facilities)	
	1998 through 2009	
Table 8.5.	Revenue and Expense Statistics for U.S. Federally Owned Electric Utilities, 1998 through 2009	
Table 8.6.	Revenue and Expense Statistics for U.S. Cooperative Borrower Owned Electric Utilities, 1998 through 2009	70
Chapter 9.	Demand-Side Management	71
Table 9.1.	Demand-Side Management Actual Peak Load Reductions by Program Category, 1998 through 2009	
Table 9.2.	Demand-Side Management Program Annual Effects by Program Category, 1998 through 2009	
Table 9.3.	Demand-Side Management Program Incremental Effects by Program Category, 1998 through 2009	72
Table 9.4.	Demand-Side Management Program Annual Effects by Sector, 1998 through 2009	73
Table 9.5.	Demand-Side Management Program Incremental Effects by Sector, 1998 through 2009	74
Table 9.6.	Demand-Side Management Program Energy Savings, 1998 through 2009	
Table 9.7.	Demand-Side Management Program Direct and Indirect Costs, 1998 through 2009	75
Appendices		
Table A1.	Sulfur Dioxide Uncontrolled Emission Factors.	
Table A2.	Nitrogen Oxides Uncontrolled Emission Factors	
Table A3.	Carbon Dioxide Uncontrolled Emission Factors	
Table A4.	Nitrogen Oxides Control Technology Emissions Reduction Factors	
Table A5.	Unit-of-Measure Equivalents	98

Illustrations

Figure ES 1.	U.S. Electric Power Industry Net Generation, 2009	2
Figure ES2.	U.S. Electric Power IndustrySummer Capacity, 2009.	4
Figure ES3.	Planned Summer Capacity Additions, 2010-2014.	5
Figure ES4.	Annual Change in Retail Sales to Bundled and Unbundled Customers, 2008 to 2009 (Percent Change)	6
Figure ES5.	Fossil Fuel Costs for Electricity Generation, 1998-2009	7
Figure 1.1.	U.S. Electric Industry Generating Capacity by State, 2009	15
Figure 2.1.	U.S. Electric Industry Net Generation by State, 2009	27
Figure 4.1	Historical North American Electric Reliability Council Regions for the Contiguous U.S., 2005	44
Figure 4.2	Consolidated North American Electric Reliability Corporation Regional Entities, 2009	45
Figure 7.1.	U.S. Electric Industry Total Ultimate Customers by State, 2009	56
Figure 7.2.	U.S. Electric Industry Total Retail Sales by State, 2009	58
Figure 7.3.	U.S. Electric Industry Total Revenues by State, 2009	60
Figure 7.4.	Average Retail Price of Electricity by State, 2009	62
Figure 7.5.	Average Residential Price of Electricity by State, 2009	63
Figure 7.6.	Average Commercial Price of Electricity by State, 2009	64
Figure 7.7.	Average Industrial Price of Electricity by State, 2009	65

Electric Power Industry 2009: Year in Review

Highlights

Generation. Electricity markets in 2009 were keenly affected by economic and environmental developments. Electricity generation was down 4.1 percent, reaching its lowest level since 2003; this was the largest decline in 6 decades and follows a 0.9-percent decline in 2008. The drop in power demand reflects a 2.6-percent decline in economic activity (GDP) during 2009.

Summer temperatures during 2009 were relatively mild, resulting in a 1.1 percent decline in residential electricity sales between 2008 and 2009.

A 9.1-percent decline in industrial demand for electricity, which fell to the lowest level since 1987, accounted for most of the decline in overall electricity consumption. The drop in industrial electricity demand reflected the 9.3-percent drop in industrial output, as measured by the Federal Reserve Bank's index of industrial production.³

Emissions. Environmental developments played an important role in electricity markets in 2009.

- The policy debate over greenhouse gas legislation continued throughout 2009. Electric power plant investment and operation decisions made during 2009 may have been affected by expectations that some form of future cap on carbon dioxide (CO₂) loomed on the horizon.
- CO₂, nitrogen oxides (NO_x,) and sulfur dioxide (SO₂) emissions posted the largest declines on record.⁴ Total CO₂ emissions were 8.6-percent lower in 2009. Emissions from coal-fired plants fell 11.0 percent, largely attributable to a 10.3-percent decline in coal consumption.

• NO_x and SO₂ emissions from electric power plants declined 28.1 and 23.8 percent, respectively (Table 3.9) in 2009. For coalfired generation, the declines in NO_x and SO₂ emissions were even greater, at 34.0 percent and 24.7 percent, respectively.

Fuel costs. The price of natural gas delivered to electric power plants fell in 2009 to roughly half the 2008 level. In 2009, annual average natural gas wellhead prices reached their lowest level in 7 years. Increased supply due to the availability of shale gas, coupled with mild winter temperatures and higher production, and storage levels, and significant expansions of pipelines capacity also worked to put downward pressure on natural gas prices.⁵

At the same time, the cost of coal rose 6.8 percent (Table 3.8), largely due to long-term contracts signed prior to the recent recession.^{6,7} Between 2000 and 2009, coal prices to electric power plants rose 84 percent.

Coal-to-gas switching. The increase in delivered coal prices and the decrease in delivered natural gas prices, combined with surplus capacity at highly-efficient gas-fired combined-cycle plants resulted in coal-to-gas fuel switching This occurred particularly in the Southeast (Alabama, Arkansas, Florida, Georgia, Mississippi, and South Carolina) and also Pennsylvania. Nationwide, coal-fired electric power generation declined 11.6 percent from 2008 to 2009, bringing coal's share of the electricity power output to 44.5 percent, the lowest level since 1978. Coal consumption at U.S. power plants paralleled the decline in generation, dropping 10.3 percent from 2008.

In sharp contrast, natural gas-fired generation increased 4.3 percent in 2009, despite the 4.1-percent decline in overall electric generation. The natural gas share of generation increased to 23.3 percent—the highest level since 1970. Electricity's share of the total U.S. natural gas consumption has also risen rapidly, growing from 17 percent in 1996 to over 30 percent in 2009.8

1

¹ The U.S. Energy Information Administration's historic electricity generation data goes back to 1949.

² U.S. Department of Commerce Bureau of Economic Analysis, News Release: *Gross Domestic Product: Second Quarter 2010 (Third Estimate)*, Table 1.

³ U.S. Federal Reserve Bank, <u>Industrial Production and Capacity Utilization</u>, (Table 11).

⁴The U.S. Energy Information Administration has been estimating CO₂, NO_X, and SO₂ emissions since 1989.

U.S. Energy Information Administration, <u>Natural Gas Year-in-Review</u>, 2009

⁶ U.S. Energy Information Administration, <u>U.S. Coal Supply and Demand: 2009</u> "Coal Prices", p. 12

⁷ The Southern Company (a large consumer of coal for electricity production), reported: "While coal prices reached unprecedented high levels in 2008, the recessionary economy pushed prices downward in 2009. However, the lower prices did not fully offset the higher priced coal already in inventory and under long-term contract." Southern Company 2009 10-K, p. II-16.

Wind development. Wind power has been the fastest-growing source of new electric power generation for several years. In 2009, generation from wind power increased 33.5 percent over 2008, bringing the share of total generation to 1.9 percent. This followed year-over-year generation gains of 60.7 percent in 2008, 29.6 percent in 2007, and 49.3 percent in 2006 (Table ES.1). Wind capacity in 2009 totaled 34,296 megawatts (MW), as compared to 24,651 MW in 2008.

In 2009 (and 2010), wind generators were eligible for Federal production and investment tax credits or a cash grant in lieu of those tax credits. Since passage of the 2005 Energy Policy Act (EPACT2005), interest-free financing via Clean Renewable Energy Bonds (CREBs) has been available to government entities investing in wind. Section 9006, under Title IX of the 2002 and 2008 Farm Bills, also contains grant and loan guarantee provisions for wind projects for farmers, ranchers, and other rural businesses.

Renewable generation is fostered by both Federal incentives and State renewable portfolio standards. As of October 2010, 29 States, the District of Columbia, and Puerto Rico have legislated renewable energy portfolio standards, and 7 more States have adopted renewable portfolio goals.¹⁰

Generation


Net generation of electric power fell 4.1 percent in 2009, to 3,950 million megawatthours (MWh) from 4,119 million MWh in 2008 (Figure ES1). This is the largest decline in electricity generation in at least 60 years. Electricity generation also declined 0.9 percent in 2008. The years 2008 and 2009 represent only the third and fourth instances that generation has dropped year over year since 1949 (the first two occurrences were during recessions in 1982 and 2001).

Additionally, this is the first time over the last 6 decades that generation has declined in two consecutive years.

Coal, natural gas, and nuclear generation accounted for 88.0 percent of total net generation in 2009, and between 85 and 90 percent during the period 1997 through 2009. However, the relative contribution of these energy sources has been shifting; natural gas generation has seen the fastest growth in recent years.

Figure ES 1. U.S. Electric Power Industry Net Generation, 2009

Total = 3,950 billion kWh



Electric Utility Plants = 60.1% Independent Power Producers and Combined Heat and Power Plants = 39.9%

Source: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report."

Coal. Coal-fired electric generation declined 11.6 percent between 2008 and 2009. With this decline, coal's share of electricity generation reached its lowest level since 1978: 44.5 percent of electricity generation in 2009, down from 48.2 percent in 2008.

Several factors have worked to erode the advantage that coal-fired generation has historically derived from its lower fuel costs. These factors include lower natural gas prices and higher coal prices; surplus capacity at efficient natural gas plants, and the cost of compliance with current environmental regulations.

Production at the Nation's coal mines in 2009 reflected the weakened state of coal demand for

⁸U.S. Energy Information Administration, Annual Energy Review, 2009, Table 6.5.

⁹ The grant program arose out of Section 1603 of the American Economic Recovery and Reinvestment Act of 2009 (ARRA) and was intended to allow investors who could not take advantage of tax credits to fund these projects with an equivalent government grants. This program expires December 31, 2010. See the Database of State Incentives for Renewables and Efficiency (DSIRE) at <a href="http://www.dsireusa.org/incentives/incentive.cfm?Incentive_Code=US53F&re=1&re=1

¹⁰ See the DSIRE database at http://www.dsireusa.org/.

electricity generation. Appalachian coal production fell 13.0 percent in 2009 from the previous year. Even Western (Powder River Basin) coal production, which has a significant price advantage, showed an 8.1-percent decline in 2009.

Natural gas-fired power generation increased by 4.3 percent in 2009, raising natural gas's share of the electricity market to 23.3 percent—its highest share since 1970. Natural gas's share of the electricity market has been greater than the nuclear share since 2006. New capacity, as well as the increased utilization of existing generators (see Table 5.2 on capacity factors), account for the increase in share.

Nuclear power generation accounted for 20.2 percent of the electricity generated in 2009, a 0.9-percent decrease from the prior year. The decline in nuclear generation in 2009 is the result of scheduled and unscheduled plant outages and derates.

Hydroelectric power generation fluctuates perennially with precipitation levels and snow accumulation. Overall, generation from conventional hydro plants (exclusive of pumped storage) increased 7.3 percent from 2008 to 2009 (Table ES.1). The western States were still suffering from a prolonged drought during 2009. The Bonneville Power Administration, which is the largest producer of hydroelectric power in the west, reported reduced runoff for the January through July 2009 period as compared to the same period in 2008. 12 In contrast, many eastern States experienced record rainfall: Alabama, Georgia, Kentucky, North Carolina, Tennessee all reported substantial gains in hydro generation in 2009. The Tennessee Valley Authority cited better water conditions, resulting in a 71-percent increase in hydropower during 2009.13

Renewables. Total non-hydro renewable generation increased 14.0 percent in 2009, following a 19.9-percent increase in 2008. The fastest-growing component was wind power (33.5-percent increase). Solar generation

increased 3.1 percent. Since 1998, generation from non-hydro renewables has increased 86.6 percent.

In 2009, renewable generation made up 10.6 percent of total generation. The largest three contributors were hydro (6.9 percent), wind (1.9 percent), followed by wood and wood-derived fuels (0.9 percent). Discounting the hydro portion, renewable generation made up 3.6 percent of total generation.

Petroleum's contribution to U.S. net electricity generation peaked in 1973 at 17 percent, but has fallen steadily since to almost insignificant levels. Petroleum's share of power output fell below one percent in 2009, reflecting a 15.8-percent decrease in petroleum-fired power generation between 2008 and 2009.

Nuclear and fossil capacity factors. The capacity factor is a measure of how consistently a generator is producing power: it represents the ratio of actual generation during a time period (typically a year) to the maximum possible generation assuming continuous full-load output. Baseload plants, which have high utilization rates due primarily to low variable operating costs, typically operate at capacity factors of 70 percent or higher. Intermediate plants, which have higher variable operating costs, typically vary their output during the day to meet changes in load. The most expensive peaking plants may operate rarely and only to meet the highest peaks, usually in the summer or winter.

Due to decreased demand for electricity, the average capacity factor for many fuels fell in 2009 (Table 5.2). Nuclear power plants (which in the United States are universally operated as baseload units because of their very low fuel costs) maintained a high capacity factor (90.3 in 2009). The capacity factor for coal plants, which make up the bulk of U.S. baseload capacity but can also operate in load-following mode, dropped sharply (8.4 percentage points) in 2009, from 72.2 percent to 63.8 percent.

The vast majority of natural gas capacity in the United States operates as load-following or peaking units. In 2009, coal-to-gas switching increased the usage of combined-cycle natural gas generators; the capacity factor for these units

 $^{^{11}}$ U.S. Energy Information Administration ., Annual Coal Report, 2008 and 2009, Table 6.

¹² Bonneville Power Administration, 2009 Annual Report, (10-K), p. 9. Melting snow creates much of BPA's runoff. Snowpack in the mountains accumulates from December to February (approximately), and significant runoff, and therefore peak hydro production, occurs March through July (approximately).

¹³ Tennessee Valley Authority, <u>2009 Annual Report (10-K)</u>, p.12.

¹⁴ Despite representing only three quarters of the capacity of natural gas plants, coal plants account for approximately twice the amount of electricity produced by natural gas plants (Table ES.1)

increased from 40.6 percent in 2008 to 42.5 percent in 2009.

Capacity

Total U.S. net summer generating capacity grew by 1.5 percent between 2008 and 2009 to 1,025 gigawatts (GW; Figure ES2). Both in absolute and percentage terms, wind generating capacity showed the strongest gains: the 9,645 MW of wind capacity additions were more than double that of natural gas, which had the second-largest increase in capacity at 3,812 MW. Coal, nuclear, and hydroelectric capacity experienced marginal gains.

During 2009, 382 new generators were connected to the grid, 51 fewer than in 2008 (Table 1.11). These new units added 23,144 MW of capacity, 50.1 percent of which were added by independent power producers (IPPs; 11,590 MW), with nearly all of the remainder added by electric utilities (10,939 MW).

Wind capacity additions accounted for 63.3 percent of all capacity gains in 2009, increasing the amount of installed wind capacity by 39.1 percent. With 34.3 GW of total capacity, wind now accounts for 3.3 percent of total U.S. capacity, up from less than 3 *tenths* of a percent 10 years earlier.


Four States accounted for 51 percent of total U.S. wind capacity: Texas (9.4 GW), ¹⁵ Iowa (3.4 GW), California (2.7 GW), and Washington (2.0 GW).

Natural gas capacity. In 2009, natural gas capacity increased by 1.0 percent, led by installations in California, Florida and Texas. About 72 percent of all natural gas plant capacity additions during 2009 were highly efficient combined-cycle units. In 2009, combined-cycle units accounted for 50 percent of total natural-gas-fired electricity capacity versus 2 percent of natural gas-fired capacity two decades ago.

Coal capacity. Coal-fired electric capacity increased by 0.3 percent between 2008 and 2009 to 314,294 MW. A total of 13 new coal-

fired generators came on line in 2009, notably the 682-MW Nebraska City 2 unit (Omaha Public Power District) and the 415-MW Springerville 4 unit (Salt River Project). Both East Kentucky Power Cooperative and Archer Daniels Midland installed generators capable of co-firing coal with biomass.

Figure ES2. U.S. Electric Power IndustrySummer Capacity, 2009



Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Coal retirements in 2009 totaled 529 MW. Further retirements are planned. For example, in December 2009, Progress Energy announced that it planned to retire 11 generators (1,500 MW) at four of its North Carolina coal plants that lacked desulfurization equipment, and replace the lost capacity with natural gas units. Progress Energy's remaining units are all equipped with scrubbers. 16

Solar capacity. Solar power is a rapidly growing source of new capacity, albeit from a relatively small base. Solar power producers added 83 MW of capacity in 2009, a 15.5-percent increase over 2008. California, with 450 MW of existing (utility-scale) solar capacity, accounted for 72.8 percent of total capacity, followed by Nevada, with 14.3 percent of capacity. Two large plants were brought on line in 2009: FPL's 25 MW DeSoto Solar Energy Plant in Florida, described as the largest photovoltaic solar

¹⁵ As of the end of 2009 Texas had 76 wind plants comprising 9.1 percent of overall Texas electricity capacity. In 2005, Texas adopted a RPS which required the state to have 5,880 MW of total renewable capacity in place by 2015, and 10,000 MW by 2025. Texas is very close to meeting the 2025 standard with its wind capacity

¹⁶ "Progress Energy Plans to Retire Remaining Unscrubbed Coal Plants in NC," December 1, 2009.

plant in the world (at the time),17 and NRG Energy's 21-MW facility in Blythe, California, which was constructed in just 3 months.

The 20 MW scale of recent solar power plant additions far exceeds the average size of the current fleet of solar units, but is in turn dwarfed by the scale of units in the planning stage. 18 For example, by 2013, BrightSource Energy is scheduled to bring on line all three units of its 390-MW Ivanpah concentrated thermal power plant in California.

Nuclear uprates. Since 1998, there have been 104 operable units in the United States.¹⁹ In 2009, nuclear capacity increased 249 MW, due to a combination of uprates (technical modifications of existing units) and other net capacity adjustments. Through such uprates to existing capacity, rather than new builds, 3.6 GW of nuclear capacity have been added to the system over the past decade (Table 1.1), representing over 3 percent of total U.S. nuclear capacity in 2009. This added capacity is the equivalent of building several new reactors.

Prospects for new nuclear reactors. Currently, there is one nuclear power unit under construction, TVA's 1,150 MW Watts Bar 2, which is scheduled to be in operation in 2012. Initial construction of Watts Bar 2, which began in 1973, was suspended in 1988 and resumed in 2007. TVA may also complete Unit 1 at its Bellefonte site, which would enter operation in the 2018-2019 time frame. TVA suspended construction of Bellefonte in 1988.


During 2009, one application was submitted to the Nuclear Regulatory Commission (NRC) for the construction of two nuclear units at FPL's existing Turkey Point facility. This compares to applications for 16 units during 2008 and 8 units in 2007. The NRC also granted an Early Site Permit to Southern Company's/Georgia Power's Vogtle nuclear power units 3 and 4 (August, 2009) and preliminary site preparation has begun.20

Planned Capacity

Capacity plans are constantly evolving as electric power producers navigate a dynamic, rapidly changing market. Each year, EIA asks electric power producers for a snapshot of their plans as of the end of the previous year. The information below, and in Table 1.4, represents capacity plans as of December 31, 2009, as reported to EIA during the spring of 2010. EIA also collects monthly data on the status of proposed generators.21

Capacity additions by fuel type. As of the end of 2009 electric power producers planned to add 72,157 MW of capacity between 2010 and 2014. Of this, 48.3 percent was planned to be fired by natural gas (34,828 MW) and 23.1 percent from coal (16,685 MW) (Figure ES3).

Figure ES3. Planned Summer Capacity Additions, 2010-2014



Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

For the period 2010-2014, planned wind additions totaled 11,560 MW, or 16.0 percent of total reported planned additions. Wind plants have a much shorter planning horizon and are built more quickly than fossil fuel-fired plants; only 6.2 percent of the reported new wind capacity additions were planned to occur after 2012.

¹⁷ FPL. <u>http://www.fpl.com/environment/solar/desoto.shtml</u>.

¹⁸ Todd Woody, "Solar Power Projects Face Potential Hurdles," *The* New York Times, October 28, 2010, http://www.nytimes.com/2010/10/29/business/energy-

environment/29solar.html? r=1&scp=1&sq=ivanpah&st=cse.

19 TVA's Brown Ferry 1 was offline for many years but was officially classified as "operable" because it retained a Nuclear Regulatory Commission operating license. The unit actually returned to service in 2007.

²⁰ Other investors include Oglethorpe Power (30 percent) and the Municipal Electric Authority of Georgia (22.7 percent).

World Nuclear News, "Georgia Power Accepts Vogtle Loan Guarantee," June 21, 2010.

21 U.S. Energy Information Administration, Electric Power Monthly,

Table ES3, New and Planned U.S. Electric Generating Units.

Solar additions were expected to add 4,087 MW of capacity by 2014. The planned completion of Watts Bar 2 in 2012 would add 1,122 MW of nuclear capacity. The construction of new coal plants has been discouraged by increasing costs for capital-intensive projects, concerns over possible future CO₂ and other environmental restrictions, and the prospect that natural gas prices will remain low over the long-term.


Electricity Sales and Prices

In 2009, retail sales of electricity fell to 3,597 billion kilowatthours, a 3.6-percent decline from the prior year and the lowest level of sales since 2004 (Table 7.2). Industrial demand experienced the greatest decline, falling 9.1 percent from 2008, to levels unseen since 1987. The residential and commercial sectors reported declines of 1.1 percent and 2.2 percent, respectively.

Retail sales to industrial customers. The Federal Reserve Bank's index of industrial production fell 9.2 percent in 2009, driven by 41 and 42 percent decreases in the automobile and iron and steel components, respectively.22 In the East North Central Census Division, which contains some of the Nation's industrialized States (Illinois, Indiana, Michigan, Ohio, and Wisconsin), overall electricity demand declined 6.9 percent (Figure ES4), led by a 12.3percent decline in industrial demand. The East South Central States (Alabama, Kentucky, Mississippi, and Tennessee) saw the next largest decline at 6.8 percent.

Weather and Retail Sales to Residential Customers. Year-over-year (i.e., short term) changes in residential electricity sales largely reflect changes in the weather. Summer temperatures during 2009 were relatively mild in the contiguous states.²³ This dampened air conditioning demand; for the June through August summer period, residential electricity sales declined 3.3 percent between 2008 and 2009.

Figure ES4. Annual Change in Retail
Sales to Bundled and
Unbundled Customers, 2008
to 2009 (Percent Change)



Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Prices. Overall retail electricity prices rose 0.9 percent between 2008 and 2009 (from 9.74 cents to 9.83 cents per kWh). The overall 25.8-percent decline in fossil fuel prices as delivered to electric plants had little immediate impact on electric power prices to the end user; the lag in changes between fuel prices and power prices can be a year or two, as changes in retail electricity rates are dependent on each State's utility regulatory review process.

Electric Trade

Wholesale Markets. Wholesale power purchases in 2009 totaled 5,029 million MWh.²⁴ This represents a decrease of 10.4 percent between 2008 and 2009, following an increase of 3.7 percent from 2007 to 2008 (Table 6.1) and a peak in 2002 at 8,755 million MWh. Electric utilities and energy-only providers (power marketers) each account for roughly half of wholesale purchases. The power marketers' share of the wholesale market dropped from 69.1 percent in 2002 to 51.0 percent in 2009, as a consequence of the financial failure of many marketers and contraction of trade following the collapse of Enron. Electric utilities' wholesale purchases have generally remained stable over the last decade, but in a shrinking market their market share has risen from 29.9 percent in 2002 to 47.0 percent in 2009.

²² IHS Global Insight, "U.S. Economic Outlook," April 2010, p. 92.

²³ National Oceanic & Atmospheric Administration, National Data Climate Center, State of the Climate National Overview Annual 2009

²⁴ A single "block" of electricity can be sold multiple times, with each purchase appearing in the data reported to EIA. Consequently, total wholesale purchases exceed total supply of electricity (3,950 million MWh in 2009).

Electricity sales for resale (wholesale power sales) fell similarly in 2009, down 10.8 percent from 2008 to 5,065 million MWh. Energy-only providers made up 44.2 percent of the market in 2009. Electric utilities comprised 29.5 percent of the market in 2009, IPPs 25.6 percent, and combined heat and power plants less than one percent.

International trade. The U.S. buys from and sells electricity to Canada and, to a much smaller degree, Mexico. Although the U.S. imported slightly less than 1 percent of its electricity consumption in 2009, Canadian exports account for roughly 8 percent of Canada's production of electricity (Table 6.3).25 Canada is the second largest exporter of electricity in the world, primarily generated by hydroelectric plants in Ouebec, Ontario, and British Columbia.26 Canadian and U.S. electricity markets are highly integrated with multiple transmission lines crossing the international border.


Electricity trade with Mexico is much smaller. Net purchases from Mexico in 2009 constituted 0.01 percent of total U.S. supply.

Fossil Fuels

Stocks at Electric Power Plants. End-of-year coal stocks rose 17.3 percent between 2008 and 2009 to reach their highest levels in at least 60 years. At 189 million tons, coal stocks have almost doubled since 2005 (Table 3.4), probably due to the sharp decline in coal-fired generation combined with limited flexibility in coal supply contracts to reduce deliveries. 27 In some cases, this involuntary inventory accumulation has prompted utilities to attempt to renegotiate their coal contracts or to petition their PUCs for ameliorative actions.28

Fossil Fuel Costs. The average delivered cost of fossil fuels to electric power plants fell 26.0 percent in 2009, from \$4.11 per MMBtu in 2008 to \$3.04 per MMBtu (Table 3.5). Most of this decline relates to natural gas prices; in 2009 natural gas prices fell to about half their 2008 levels (Figure ES5). Annual average costs of natural gas to the electric power industry peaked in 2008 at \$9.02 per million Btu-the highest nominal dollar level in at least two decades—before falling to \$4.74 per MMBtu in 2009. The average cost of coal actually rose between 2008 and 2009 from \$2.07 to \$2.21 per MMBtu, due to the prevalence of long-term contracts and the relatively small role of the coal spot market.

Figure ES5. Fossil Fuel Costs for **Electricity Generation**, 1998-2009



Source: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report."

Emissions

Decreases in all emissions. Estimated emissions of carbon dioxide (CO₂), sulfur dioxide (SO₂), and nitrogen oxide (NO_x) all declined in 2009 compared to 2008 (Table 3.9). This was due in part to reduced coal-fired generation. Coal produces far more emissions per kWh of electricity than other major fuels. SO₂ and NO_x emissions were further reduced by installations of new emission control devices.

SO₂ emissions fell 23.8 percent between 2008 and 2009, from 7,830 thousand metric tons to 5,970 thousand metric tons (Table 3.9). This is the largest year-over-year decline since 1989 (the

7

²⁵ U..S. Energy Information Administration, International Energy Statistics,

http://tonto.eia.doe.gov/cfapps/ipdbproject/IEDIndex3.cfm?tid=2&pid =2&aid=12. Note: The ratio of Canadian electricity exports to domestic generation is for the year 2008.

²⁶ North America Energy Working Group, Security and Prosperity Partnership, Energy Picture Experts Group, "North America-The Energy Picture II." January 2006.

27 In its 2009 annual report, the large coal-fired generation company,

AEP Corp, cited "an increase in coal inventory reflecting decreased

customer demand for electricity" AEP 2009 Annual Report, p. 20. ²⁸Duke Energy Carolinas, <u>Docket No. E-7</u>, Sub 909, and <u>Indiana Utility Regulatory Commission</u>, Cause No. 38707 FAC 83, Approved March 24 2010

http://www.in.gov/iurc/files/38707 83order 032410.pdf.

first year in EIA's data series). Nationwide, the count of generators with SO_2 control systems increased from 327 in 2008 to 384 in 2009 (Table 3-10), contributing to the reduction in SO_2 emissions.

Data for 2009 also show significant reductions in NO_x emissions, which dropped 28.1 percent from 2008, from 3,330 to 2,395 thousand metric tons—also the largest decline on record. Since 1998, sulfur dioxide and nitrogen oxide emissions have been reduced by 55.7 percent and 62.9 percent, respectively, largely due to the implementation of the Clean Air Act Amendments of 1990.

Estimated CO₂ emissions by U.S. electric generators and combined heat and power facilities fell by 8.6 percent from 2008 to 2009

(from 2,484 million metric tons to 2,270 million metric tons), largely due to decreased coal consumption. Emissions from coal-fired power plants typically account for four fifths of CO₂ emissions produced by the electric power sector.

The estimated CO₂, SO₂, and NO_x emissions are determined by the type and quantity of fossil fuels consumed by power plants. In the case of SO₂ and NO_x, boiler configurations and the presence of, or absence of, pollution abatement equipment play a major role. The methodology used to estimate emissions is described in the Technical Notes and Tables A1, A2, and A3.

	tiotics i	01 1110	CHITCE	Diate	39 1770	3 throu	ign zu	JJ				
Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Net Generation (thousand megawatthou	ırs)											
Coal ¹	, ,	1,985,801	2,016,456	1,990,511	2,012,873			1,933,130	1,903,956	1,966,265	1,881,087	1,873,516
Petroleum ²	38,938 920,797	46,243	65,739	64,166	122,225	121,145	119,406	94,567	124,880	111,221	118,061	128,800
Natural Gas ³ Other Gases ⁴	10,629	882,981 11,707	896,590 13,453	816,441 14,177	760,960 13,464	710,100 15,252	649,908 15,600	691,006 11,463	639,129 9,039	601,038 13,955	556,396 14,126	531,257 13,492
Nuclear		806,208	806,425	787,219	781,986	788,528	763,733	780,064	768,826	753,893	728,254	673,702
Hydroelectric Conventional ⁵		254,831	247,510	289,246	270,321	268,417	275,806	264,329	216,961	275,573	319,536	323,336
Other Renewables ⁶		126,101 ^R	105,238	96,525	87,329	83,067	79,487	79,109	70,769	80,906	79,423	77,088
Wind Solar Thermal and Photovoltaic		55,363 864	34,450 612	26,589 508	17,811 550	14,144 575	11,187 534	10,354 555	6,737 543	5,593 493	4,488 495	3,026 502
Wood and Wood Derived Fuels ⁷		37,300	39,014	38,762	38,856	38,117	37,529	38,665	35,200	37,595	37,041	36,338
Geothermal	15,009	14,840 ^R	14,637	14,568	14,692	14,811	14,424	14,491	13,741	14,093	14,827	14,774
Other Biomass ⁸	18,443	17,734	16,525	16,099	15,420	15,421	15,812	15,044	14,548	23,131	22,572	22,448
Pumped Storage ⁹ Other ¹⁰	-4,627 11,929	-6,288 11,804 ^R	-6,896	-6,558 12,074	-6,558	-8,488	-8,535	-8,743	-8,823	-5,539	-6,097	-4,467
All Energy Sources		4,119,388	12,231 4 156 745	12,974 4 064 702	12,821 4 055 423	14,232 3,970,555	14,045 3 883 185	13,527 3 858 452	11,906 3,736,644	4,794 3 802 105	4,024 3 694 810	3,571 3,620,295
Net Summer Generating Capacity (meg		4,117,500	4,150,745	1,001,702	4,000,420	3,770,333	3,003,103	3,030,432	3,730,044	3,002,103	3,074,010	3,020,273
Coal ¹	, ,	313,322	312,738	312,956	313,380	313,020	313,019	315,350	314,230	315,114	315,496	315,786
Petroleum ²	56,781	57,445	56,068	58,097	58,548	59,119	60,730	59,651	66,162	61,837	60,069	66,282
Natural Gas ³		397,460 ^R	392,876	388,294	383,061	371,011	355,442	312,512	252,832	219,590	195,119	180,288
Other Gases ⁴		1,995	2,313	2,256	2,063	2,296	1,994	2,008	1,670	2,342	1,909	1,520
Nuclear Hydroelectric Conventional ⁵	101,004 78,518	100,755 77,930	100,266 77,885	100,334 77,821	99,988 77,541	99,628 77,641	99,209 78,694	98,657 79,356	98,159 78,916	97,860 79,359	97,411 79,393	97,070 79,151
Other Renewables ⁶		38,466 ^R	30,069	24,113	21,205	18,717	18,153	16,710	16,101	15,572	15,942	15,444
Wind	34,296	24,651	16,515	11,329	8,706	6,456	5,995	4,417	3,864	2,377	2,252	1,720
Solar Thermal and Photovoltaic		536	502	411	411	398	397	397	392	386	389	335
Wood and Wood Derived Fuels ⁷		6,864	6,704	6,372	6,193	6,182	5,871	5,844	5,882	6,147	6,795	6,802
Geothermal Other Biomass ¹¹	2,382 4,317	2,229 ^R 4,186	2,214 4,134	2,274 3,727	2,285 3,609	2,152 3,529	2,133 3,758	2,252 3,800	2,216 3,748	2,793 3,869	2,846 3,660	2,893 3,694
Pumped Storage ⁹	22,160	21,858	21,886	21,461	21,347	20,764	20,522	20,371	19,664	19,522	19,565	19,518
Other ¹²	888	942	788	882	887	746	684	686	519	523	1,023	810
All Energy Sources	1,025,400		994,888	986,215	978,020	962,942	948,446	905,301	848,254	811,719	785,927	775,868
Demand, Capacity Resources, and Capa												
Net Internal Demand (megawatts)		744,151 ^R	766,786 ^R	776,479	746,470	692,908	696,752	696,376	674,833	680,941	653,857	638,086
Capacity Resources (megawatts)		909,504 ^R 18.2	914,397 ^R 16.1	891,226 12.9	882,125 15.4	875,870 20.9	856,131 18.6	833,380 16.4	788,990 14.5	808,054 15.7	765,744 14.6	744,670 14.3
Fuel	22.2	10.2	10.1	12.7	13.4	20.7	10.0	10.4	14.5	13.7	14.0	14.5
	4	49										
Consumption of Fossil Fuels for Elec		1,042,335	1.046.705	1 020 556	1 041 440	1 020 522	1 014 050	007 502	072 (01	004.022	040.903	046 205
Coal (thousand tons) ¹ Petroleum (thousand barrels) ²		80,932	1,046,795 112,615	1,030,556 110,634	206,785	1,020,523 203,494	1,014,058 206,653	987,583 168,597	972,691 216,672	994,933 195,228	949,802 207,871	946,295 222,640
Natural Gas (millions of cubic feet) ³		6,895,843			6,036,370			6,126,062		5,691,481	5,321,984	5,081,384
Other Gases (millions of Btu) ⁴		96,757	114,904	114,665	109,916	135,144	156,306	131,230	97,308	125,971	126,387	124,988
Consumption of Fossil Fuels for The		ut in Com	bined He	at and Po	wer Facil	ities						
Coal (thousand tons) ¹		22,168	22,810	23,227	23,833	24,275	17,720	17,561	18,944	20,466	20,373	20,320
Petroleum (thousand barrels) ²		12,016	19,775	20,371	24,408	25,870	17,939	14,811	18,268	22,266	26,822	28,845
Natural Gas (millions of cubic feet)3		793,537	872,579	942,817	984,340	1,052,100	721,267	860,019	898,286	985,263	982,958	949,106
Other Gases (millions of Btu) ⁴		203,236	214,321	226,464	238,396	218,295	137,837	146,882	166,161	230,082	223,713	208,828
Consumption of Fossil Fuels for Elec	•				-							
Coal (thousand tons) ¹		1,064,503		1,053,783	1,065,281		1,031,778	1,005,144		1,015,398	970,175	966,615
Petroleum (thousand barrels) ²		92,948	132,389	131,005	231,193	229,364	224,593	183,408	234,940	217,494	234,694	251,486
Natural Gas (millions of cubic feet) ³ Other Gases (millions of Btu) ⁴		7,689,380 299,993	7,961,922 329,225	7,404,432 341,129	7,020,709 348,312	6,726,679 353,438	6,337,402 294,143	6,986,081 278,111	6,730,591 263,469	6,676,744 356,053	350,100	6,030,490
Stocks at Electric Power Sector Facil			329,223	341,129	340,312	333,436	294,143	270,111	203,409	330,033	330,100	333,610
Coal (thousand tons) ¹³	incs (year											
	189 467		151 221	140 964	101 137	106 660	121 567	141 714	138 496	102 206	141 604	120 501
		161,589	151,221 47.203	140,964 51,583	101,137 50,062	106,669 51,434	121,567 53,170	141,714 52,490	138,496 57,031	102,296 40,932	141,604 54,109	
Petroleum (thousand barrels)14	46,181		151,221 47,203	140,964 51,583	101,137 50,062	106,669 51,434	121,567 53,170	141,714 52,490	138,496 57,031	102,296 40,932	141,604 54,109	
Petroleum (thousand barrels) ¹⁴ Receipts of Fuel at Electricity Genera	46,181 ators ¹⁵	161,589 44,498	47,203	51,583	50,062	51,434	53,170	52,490	57,031	40,932	54,109	56,591
Petroleum (thousand barrels)14	46,181 ators ¹⁵ 981,477	161,589										56,591 929,448
Petroleum (thousand barrels) ¹⁴ Receipts of Fuel at Electricity Genera Coal (thousand tons) ¹	46,181 ators ¹⁵ 981,477 88,951	161,589 44,498 1,069,709	47,203 1,054,664 88,347	51,583 1,079,943 100,965	50,062 1,021,437	51,434 1,002,032 186,655	53,170 986,026 185,567	52,490 884,287	57,031 762,815 124,618	40,932 790,274	54,109 908,232 145,939	56,591 929,448 181,276
Petroleum (thousand barrels) ¹⁴ Receipts of Fuel at Electricity Generation (thousand tons) ¹ Petroleum (thousand barrels) ²	46,181 ators ¹⁵ 981,477 88,951 8,118,550	161,589 44,498 1,069,709 96,341 7,879,046	47,203 1,054,664 88,347 7,200,316	51,583 1,079,943 100,965	50,062 1,021,437 194,733	51,434 1,002,032 186,655	53,170 986,026 185,567	52,490 884,287 120,851	57,031 762,815 124,618	40,932 790,274 108,272	54,109 908,232 145,939	56,591 929,448 181,276
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe	161,589 44,498 1,069,709 96,341 7,879,046	47,203 1,054,664 88,347 7,200,316	51,583 1,079,943 100,965	50,062 1,021,437 194,733	51,434 1,002,032 186,655	53,170 986,026 185,567	52,490 884,287 120,851	57,031 762,815 124,618	40,932 790,274 108,272	54,109 908,232 145,939	56,591 929,448 181,276 2,922,957
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 717	51,583 1,079,943 100,965 6,675,246 169 623	50,062 1,021,437 194,733 6,181,717 154 644	51,434 1,002,032 186,655 5,734,054 136 429	53,170 986,026 185,567 5,500,704 128 433	52,490 884,287 120,851 5,607,737 125 334	57,031 762,815 124,618 2,148,924 123 369	40,932 790,274 108,272 2,629,986 120 418	54,109 908,232 145,939 2,809,455 122 236	56,591 929,448 181,276 2,922,957
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe	161,589 44,498 1,069,709 96,341 7,879,046 r million l	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177	51,583 1,079,943 100,965 6,675,246	50,062 1,021,437 194,733 6,181,717	51,434 1,002,032 186,655 5,734,054	53,170 986,026 185,567 5,500,704	52,490 884,287 120,851 5,607,737	57,031 762,815 124,618 2,148,924	40,932 790,274 108,272 2,629,986	54,109 908,232 145,939 2,809,455	56,591 929,448 181,276 2,922,957
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe 221 702 474	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 717 711	51,583 1,079,943 100,965 6,675,246 169 623 694	50,062 1,021,437 194,733 6,181,717 154 644 821	51,434 1,002,032 186,655 5,734,054 136 429 596	53,170 986,026 185,567 5,500,704 128 433 539	52,490 884,287 120,851 5,607,737 125 334 356	57,031 762,815 124,618 2,148,924 123 369 449	40,932 790,274 108,272 2,629,986 120 418 430	54,109 908,232 145,939 2,809,455 122 236 257	56,591 929,448 181,276 2,922,957 125 202 238
Petroleum (thousand barrels) ¹⁴	46,181 ators¹5 981,477 88,951 8,118,550 s (cents pe 221 702 474 2,269,508	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902 2,484,012 ^E	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 711 3 2,547,032 ¹	51,583 1,079,943 100,965 6,675,246 169 623 694 3 2,488,918	50,062 1,021,437 194,733 6,181,717 154 644 821 3 2,543,838 [‡]	51,434 1,002,032 186,655 5,734,054 136 429 596 3 2,486,982 ^R	53,170 986,026 185,567 5,500,704 128 433 539	52,490 884,287 120,851 5,607,737 125 334 356 2,423,963 ¹	57,031 762,815 124,618 2,148,924 123 369 449	40,932 790,274 108,272 2,629,986 120 418 430	54,109 908,232 145,939 2,809,455 122 236 257 3 2,366,302 ⁸	56,591 929,448 181,276 2,922,957 125 202 238 2,351,600
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe 221 702 474 2,269,508 5,970	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902 2,484,012 ¹ 7,830	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 711 R 2,547,032 ¹ 9,042	51,583 1,079,943 100,965 6,675,246 169 623 694 2,488,918 ¹ 9,524	50,062 1,021,437 194,733 6,181,717 154 644 821	51,434 1,002,032 186,655 5,734,054 136 429 596	53,170 986,026 185,567 5,500,704 128 433 539 4 2,445,094 ^R 10,646	52,490 884,287 120,851 5,607,737 125 334 356	57,031 762,815 124,618 2,148,924 123 369 449 * 2,418,607* 11,174	40,932 790,274 108,272 2,629,986 120 418 430	54,109 908,232 145,939 2,809,455 122 236 257 3 2,366,302 ^E 12,843	56,591 929,448 181,276 2,922,957 125 202 238 2,351,600 13,46
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe 221 702 474 2,269,508 5,970	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902 2,484,012 ¹ 7,830	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 711 R 2,547,032 ¹ 9,042	51,583 1,079,943 100,965 6,675,246 169 623 694 2,488,918 ¹ 9,524	50,062 1,021,437 194,733 6,181,717 154 644 821 ⁸ 2,543,838 ⁸ 10,340	51,434 1,002,032 186,655 5,734,054 136 429 596 2,486,982 ^R 10,309	53,170 986,026 185,567 5,500,704 128 433 539	52,490 884,287 120,851 5,607,737 125 334 356 2,423,963 ¹ 10,881	57,031 762,815 124,618 2,148,924 123 369 449 * 2,418,607* 11,174	40,932 790,274 108,272 2,629,986 120 418 430 430 42,470,834 ^F 11,963	54,109 908,232 145,939 2,809,455 122 236 257 3 2,366,302 ⁸	56,591 929,448 181,276 2,922,957 125 202 238 2,351,600 13,46
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe 221 702 474 2,269,508 5,970 2,395	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902 2,484,012 ¹ 7,830	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 711 R 2,547,032 ¹ 9,042	51,583 1,079,943 100,965 6,675,246 169 623 694 2,488,918 ¹ 9,524	50,062 1,021,437 194,733 6,181,717 154 644 821 ⁸ 2,543,838 ⁸ 10,340	51,434 1,002,032 186,655 5,734,054 136 429 596 2,486,982 ^R 10,309	53,170 986,026 185,567 5,500,704 128 433 539 4 2,445,094 ^R 10,646	52,490 884,287 120,851 5,607,737 125 334 356 2,423,963 ¹ 10,881	57,031 762,815 124,618 2,148,924 123 369 449 * 2,418,607* 11,174	40,932 790,274 108,272 2,629,986 120 418 430 430 42,470,834 ^F 11,963	54,109 908,232 145,939 2,809,455 122 236 257 3 2,366,302 ^E 12,843	56,591 929,448 181,276 2,922,957 125 202 238 2,351,600 13,46 6,45
Petroleum (thousand barrels) ¹⁴	46,181 ators ¹⁵ 981,477 88,951 8,118,550 s (cents pe 221 702 474 2,269,508 5,970 2,395	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902 2,484,012 ¹ 7,830 3,330	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 717 711 R 2,547,032' 9,042 3,650	51,583 1,079,943 100,965 6,675,246 169 623 694 2,488,918 ¹ 9,524 3,799	50,062 1,021,437 194,733 6,181,717 154 644 821 3,2,543,838 ⁸ 10,340 3,961	51,434 1,002,032 186,655 5,734,054 136 429 596 2,486,982 ^R 10,309 4,143	53,170 986,026 185,567 5,500,704 128 433 539 2,445,094 ^R 10,646 4,532	52,490 884,287 120,851 5,607,737 125 334 356 2,423,963' 10,881 5,194	57,031 762,815 124,618 2,148,924 123 369 449 R 2,418,607 11,174 5,290	40,932 790,274 108,272 2,629,986 120 418 430 \$\frac{1}{2}\$,470,834\bigg\{\frac{1}{2}}\$,17963 5,638	54,109 908,232 145,939 2,809,455 122 236 257 2,366,302 ⁸ 12,843 5,955	56,591 929,448 181,276 2,922,957 125 202 238 2,351,600 13,46 6,45 2,021
Petroleum (thousand barrels) ¹⁴	46,181 ators¹5 981,477 88,951 8,118,550 s (cents pe 221 702 474 2,269,508 5,970 2,395 5,029 5,065 and megaw	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902 2,484,012 ^t 7,830 3,330 5,613 5,681	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 711 711 * 2,547,032' 9,042 3,650 5,411 5,479	51,583 1,079,943 100,965 6,675,246 169 623 694 8 2,488,918 ¹ 9,524 3,799 5,503	50,062 1,021,437 194,733 6,181,717 154 644 821 ⁸ 2,543,838 ¹ 10,340 3,961 6,092 6,072	51,434 1,002,032 186,655 5,734,054 136 429 596 2,486,982 ^R 10,309 4,143 6,999	53,170 986,026 185,567 5,500,704 128 433 539 4 2,445,094 ^R 10,646 4,532 6,980 6,921	52,490 884,287 120,851 5,607,737 125 334 356 2,423,963 10,881 5,194	57,031 762,815 124,618 2,148,924 123 369 449 3 2,418,607 ^R 11,174 5,290 7,555 7,345	40,932 790,274 108,272 2,629,986 120 418 430 11,963 5,638 2,346 2,355	54,109 908,232 145,939 2,809,455 122 236 257 2,366,302 ^t 12,843 5,955 2,040	56,591 929,448 181,2767 2,922,957 125 202 238 2,351,600 13,46 6,45 2,021 1,922
Petroleum (thousand barrels) ¹⁴	46,181 ators¹5 981,477 88,951 8,118,550 s (cents pe 221 702 474 2,269,508 5,970 2,395 5,029 5,065 and megaw 52,191	161,589 44,498 1,069,709 96,341 7,879,046 r million l 207 1,087 902 2,484,012 ^t 7,830 3,330 5,613 5,681	47,203 1,054,664 88,347 7,200,316 Btu) ¹⁵ 177 711 711 R 2,547,032' 9,042 3,650 5,411 5,479	51,583 1,079,943 100,965 6,675,246 169 623 694 8 2,488,918 ¹ 9,524 3,799 5,503	50,062 1,021,437 194,733 6,181,717 154 644 821 R 2,543,838 ¹ 10,340 3,961 6,092	51,434 1,002,032 186,655 5,734,054 136 429 596 2,486,982 ^R 10,309 4,143 6,999	53,170 986,026 185,567 5,500,704 128 433 539 4 2,445,094 ^R 10,646 4,532 6,980	52,490 884,287 120,851 5,607,737 125 334 356 2,423,963 10,881 5,194	57,031 762,815 124,618 2,148,924 123 369 449 R 2,418,607 11,174 5,290 7,555	40,932 790,274 108,272 2,629,986 120 418 430 2,470,834 ⁸ 11,963 5,638	54,109 908,232 145,939 2,809,455 122 236 257 2,366,302 ^t 12,843 5,955 2,040	120,501 56,591 929,448 181,276 2,922,957 125 202 238 2,351,600 13,46 6,45 2,021 1,922 39,513 13,656

See end of table for Notes and Sources.

Table ES1. Summary Statistics for the United States, 1998 through 2009

(Continued)

Description	2000	2000	2007	2004	2005	2004	2002	2002	2001	2000	1999	1998
Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Retail Sales and Revenue Data – Bundle	d and Un	bundled										
Number of Ultimate Customers (thousand	nds)											
Residential	125,177	124,937	123,950	122,471	120,761	118,764	117,280	116,622	114,890	111,718	110,383	109,048
Commercial	17,562	17,563	17,377	17,172	16,872	16,607	16,550	15,334	14,867	14,349	14,074	13,887
Industrial	758	775	794	760	734	748	713	602	571	527	553	540
Transportation	1	1	1	1	1	1	1	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	1,067	1,030	974	935	933
All Sectors	143,497	143,276	142,122	140,404	138,367	136,119	134,544	133,624	131,359	127,568	125,945	124,408
Sales to Ultimate Customers (thousand i	0											
Residential		1,379,981			1,359,227		1,275,824	1,265,180		1,192,446	, ,	
Commercial	917,442	1,335,981			1,275,079	1,230,425		1,104,497 990,238	1,083,069 996,609	1,055,232	1,001,996	979,401
Industrial Transportation	7,781	1,009,300 7,700	1,027,832 8,173	1,011,298 7,358	7,506	1,017,850 7,224	1,012,373 6,810	990,238 NA	996,609 NA	1,064,239 NA	1,058,217 NA	1,051,203 NA
Other	7,761 NA	7,700 NA	0,173 NA	7,556 NA	7,500 NA	7,224 NA	0,810 NA	105,552	113,174	109,496	106,952	103,518
All Sectors		3,732,962				3,547,479	3,493,734	3,465,466	3,394,458	3,421,414		3,264,231
Direct Use	126,938	132,197 ^R			150,016	168,470	168,295	166,184	162,649	170,943	171,629	160,866
Total Disposition		3,865,159 ^R									3,483,716	
Revenue From Ultimate Customers (mil			-,,	.,,.	- , ,	-,,-	.,,.	.,,	.,,	.,,	-,,-	., .,
Residential	157,008	155,433	148,295	140,582	128,393	115,577	111,249	106,834	103,158	98,209	93,483	93,360
Commercial	134,106	138,469	128,903	122,914	110,522	100,546	96,263	87,117	85,741	78,405	72,771	72,575
Industrial	61,459	68,920	65,712	62,308	58,445	53,477	51,741	48,336	50,293	49,369	46,846	47,050
Transportation	829	827	792	702	643	519	514	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	7,124	8,151	7,179	6,796	6,863
All Sectors	353,403	363,650	343,703	326,506	298,003	270,119	259,767	249,411	247,343	233,163	219,896	219,848
Average Retail Price (cents per kilowatt	hour)											
Residential	11.51	11.26	10.65	10.40	9.45	8.95	8.72	8.44	8.58	8.24	8.16	8.26
Commercial	10.26	10.36	9.65	9.46	8.67	8.17	8.03	7.89	7.92	7.43	7.26	7.41
Industrial	6.70	6.83	6.39	6.16	5.73	5.25	5.11	4.88	5.05	4.64	4.43	4.48
Transportation	10.65	10.74	9.70	9.54	8.57	7.18	7.54	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	6.75	7.20	6.56	6.35	6.63
All Sectors	9.83	9.74	9.13	8.90	8.14	7.61	7.44	7.20	7.29	6.81	6.64	6.74
Revenue and Expense Statistics (million	dollars)											
Major Investor Owned												
Utility Operating Revenues	276,124	298,962	270,964 ^R	275,501	265,652	238,759	230,151	219,609	267,276	233,915	213,090	214,849
Utility Operating Expenses	244,243	267,263	241,198 ^R		236,786	206,960	201,057	189,062	234,910	210,250	180,467	183,954
Net Utility Operating Income	31,881	31,699	29,766 ^R		28,866	31,799	29,094	30,548	32,366	23,665	32,623	30,896
Major Publicly Owned (with Generation		3)	,			,	,	,	,	,	,	, i
Operating Revenues	NA	NA	NA	NA	NA	NA	33,906	32,776	38,028	31,843	26,767	26,155
Operating Expenses	NA	NA	NA	NA	NA	NA	29,637	28,638	32,789	26,244	21,274	20,880
Net Electric Operating Income	NA	NA	NA	NA	NA	NA	4,268	4,138	5,238	5,598	5,493	5,275
Major Publicly Owned (without General							,	,	.,	.,	.,	.,
Operating Revenues	NA	NA	NA	NA	NA	NA	12,454	11,546	10,417	9,904	9,354	8,790
Operating Expenses	NA	NA	NA	NA	NA	NA	11,481	10,703	9,820	9,355	8,737	8,245
Net Electric Operating Income	NA	NA	NA	NA	NA	NA	974	843	597	549	617	545
Major Federally Owned												
Operating Revenues	NA	NA	NA	NA	NA	NA	11,798	11,470	12,458	10,685	10,186	9,780
Operating Expenses	NA	NA	NA	NA	NA	NA	8,763	8,665	10,013	8,139	7,775	7,099
Net Electric Operating Income	NA	NA	NA	NA	NA	NA	3,035	2,805	2,445	2,546	2,411	2,681
Major Cooperative Borrower Owned							-,	-,	-,	_,	-,	_,
Operating Revenues	42,189	42,087 ^R	38,208	36,723	34,088	30,650	29,228	27,458	26,458	25,629	23,824	23,988
Operating Expenses	38,337	38,511 ^R	34,843	33,550	31,209	27,828	26,361	24,561	23,763	22,982	21,283	21,223
Net Electric Operating Income	3,852	3,576 ^R	3,365	3,173	2,879	2,822	2,867	2,897	2,696	2,647	2,541	2,764
Demand-Side Management (DSM) Data		2,270	3,303	3,173	2,079	2,022	2,007	2,077	2,070	2,047	2,271	2,707
0 , ,												
Actual Peak Load Reductions (megawat	,	-										
Total Actual Peak Load Reduction	31,682	31,735 ^R	30,253	27,240	25,710	23,532	22,904	22,936	24,955	22,901	26,455	27,231
DSM Energy Savings (thousand megawa	atthours)											
Energy Efficiency	76,891	74,861 ^R	67,134	62,951	58,891	52,662	48,245	52,285	52,946	52,827	49,691	48,775
Load Management	1,015	1,813 ^R		865	1,006	2,047	2,020	1,790	990	875	872	392
DSM Cost (million dollars)												
Total Cost	3,594	3,175	R 2,523	2,051	1,921	1,557	1,297	1,626	1,630	1,565	1,424	1,421
	-,	5,175	-,0	-,	-,- = 1	-,/	-, /	-,0	-,	-,0	-,	, .=-

¹ Includes anthracite, bituminous, subbituminous and lignite coal. Waste and synthetic coal are included starting in 2002.

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology) and waste oil.

Includes a small number of generators for which waste heat is the primary energy source.

⁴ Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁵ Conventional hydroelectric power excluding pumped storage facilities.

⁶ Other renewables represents the summation of the sub-categories of Wind, Solar Thermal and Photovoltaic, Wood and Wood Derived Fuels, Geothermal, and Other Biomass

Wood/wood waste solids (including paper pellets, railroad ties, utility poles, wood chips, bark, and wood waste solids), wood waste liquids (red liquor, sludge wood, spent sulfite liquor,

and other wood-based liquids), and black liquor.

8 Biogenic municipal solid waste, landfill gas, sludge waste, agricultural byproducts, other biomass solids, other biomass liquids, and other biomass gases (including digester gases, methane, and other biomass gases).

⁹ Pumped storage is the capacity to generate electricity from water previously pumped to an elevated reservoir and then released through a conduit to turbine generators located at a lower level. The generation from a hydroelectric pumped storage facility is the net value of production minus the energy used for pumping...

Non biogenic municipal colid under between the production of production minus the energy used for pumping...

Non-biogenic municipal solid waste, batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

Municipal solid waste, landfill gas, sludge waste, agricultural byproducts, other biomass solids, other biomass liquids, and other biomass gases (including digester gases, methane, and other biomass gases).

NA = Not available.

R = Revised.

Note: 'See Glossary reference for definitions.' See Technical Notes Table A5 for conversion to different units of measure. Capacity by energy source is based on the capacity associated with the energy source reported as the most predominant (primary) one, where more than one energy source is associated with a generator. Dual-fired capacity returned to respective fuel categories for current and all historical years. New fuel switchable capacity tables have replaced dual-fired breakouts. Totals may not equal sum of components because of ind Sources: U.S. Energy Information Administration Form EIA-411, "Coordinated Bulk Power Supply Program Report," Form EIA-412, "Annual Electric Industry Financial Report" The Form EIA-412 was terminated in 2003; Form EIA-476, "Steam-Electric Plant Operation and Design Report" was suspended; Form EIA-860, "Annual Electric Generator Report;" Form EIA-861, "Annual Electric Power Industry Report," Form EIA-923, "Power Plant Operations Report" replaces several form(s) including: Form EIA-906, "Power Plant Report," Form EIA-920 "Combined Heat and Power Plant Report," Form EIA-423, "Monthly Cost and Quality of Fuels for Electric Plants Report; and FERC Form 423, "Monthly Report of Cost and Quality of Fuels for Electric Plants," and their predecessor forms. Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Utilities, Licensees and Others;" FERC Form 1-F, "Annual Report for Nonmajor Public Utilities and Licensees;" Rural Utilities Service (RUS) Form 7, "Operating Report;" RUS Form 12, "Operating Report;" Imports and Exports: DOE, Office of Electricity Delivery and Energy Reliability, Form OE-781R, "Annual Report of International Electric Export/Import Data," predecessor forms, and National Energy Board of Canada. For 2001 forward, data from the California Independent System Operator are used in combination with the Form OE-781R values to estimate electricity trade with Mexico.

¹² Batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

¹³ Anthracite, bituminous, subbituminous, lignite, and synthetic coal; excludes waste coal.

 ¹⁴ Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology). Data prior to 2004 includes small quantities of waste oil.
 ¹⁵ For 2002 through 2007, includes data from the Form EIA-423 for independent power producers, and commercial and industrial power-producing facilities. Beginning in 2008, data are

¹⁵ For 2002 through 2007, includes data from the Form EIA-423 for independent power producers, and commercial and industrial power-producing facilities. Beginning in 2008, data are collected on the Form EIA-923 for utilities, independent power producers, and commercial and industrial power-producing facilities. Receipts, cost, and quality data are collected from plants above a 50 MW threshold, and imputed for plants between 1 and 50 MW. Therefore, there may be a notable increase in fuel receipts beginning with 2008 data. Receipts of coal include imported coal.

¹⁶ Natural gas, including a small amount of supplemental gaseous fuels that cannot be identified separately.

¹⁷ Data presented are reflective of large utilities.

Table ES2. Supply and Disposition of Electricity, 1998 through 2009

(Million Megawatthours)

(~ /										
Category	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Supply												
Generation												
Electric Utilities	2,373	2,475	2,504	2,484	2,475	2,505	2,462	2,549	2,630	3,015	3,174	3,212
Independent Power Producers	1,278	1,332	1,324	1,259	1,247	1,119	1,063	955	781	458	201	91
Combined Heat and Power, Electric	159	167	177	165	180	184	196	194	170	165	155	154
Electric Power Sector Generation Subtotal	3,810	3,974	4,005	3,908	3,902	3,808	3,721	3,698	3,580	3,638	3,530	3,457
Combined Heat and Power, Commercial	8	8	8	8	8	8	7	7	7	8	9	9
Combined Heat and Power, Industrial	132	137	143	148	145	154	155	153	149	157	156	154
Industrial and Commercial Generation Subtotal	140	145	151	157	153	162	162	160	157	165	165	163
Total Net Generation	3,950	4,119	4,157	4,065	4,055	3,971	3,883	3,858	3,737	3,802	3,695	3,620
Total Imports	52	57	51	43	44 ^R	34	30	37	39	49	43	40
Total Supply	4,002	4,176	4,208	4,107	4,099 ^R	4,005	3,914	3,895	3,775	3,851	3,738	3,660
Disposition												
Retail Sales												
Full-Service Providers	3,289	3,434	3,468	3,438	3,413	3,318	3,285	3,324	3,297	3,310	3,236	3,240
Energy-Only Providers	296	286	283	219	237	222	189	141	98	112	76	24
Facility Direct Retail Sales	13	14	14	12	11	8	20	NA	NA	NA	NA	NA
Total Electric Industry Retail Sales	3,597	3,733	3,765	3,670	3,661	3,547	3,494	3,465	3,394	3,421	3,312	3,264
Direct Use	127	132 ^R	126 ^R	147	150	168	168	166	163	171	172	161
Total Exports	18	24	20	24	19 ^R	23	24	16	16	15	14	14
Losses and Unaccounted For	260	287 ^R	298 ^R	266	269	266	228	248	202	244	240	221
Total Disposition	4,002	4,176	4,208	4,107	4,099 ^R	4,005	3,914	3,895	3,775	3,851	3,738	3,660

NA = Not available.

Notes: • Facility Direct Retail Sales typically represent bilateral electric power sales between industrial and commercial generating facilities. • Direct Use represents commercial and industrial facility use of onsite net electricity generation; electricity sales or transfers to adjacent or co-located facilities; and barter transactions. Losses and Unaccounted For includes: (1) reporting by utilities and power marketers that represent losses incurred in transmission and distribution, as well as volumes unaccounted for in their own energy balance; and (2) discrepancies among the differing categories upon balancing the table. • Totals may not equal sum of components because of independent rounding.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report" and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report;" Form EIA-861, "Annual Electric Power Industry Report;" and predecessor forms. Imports and Exports: Mexico data - DOE, Fossil Fuels, Office of Fuels Programs, Form OE-781R, "Annual Report of International Electrical Export/Import Data:" Canada data - National Energy Board of Canada (metered energy firm and interruptible).

R = Revised.

Chapter 1. Capacity

Table 1.1. Existing Net Summer Capacity by Energy Source and Producer Type, 1998 through 2009 (Megawatts)

			Natural	Other		Hydroelectric	Other	Hydroelectric		
Period	Coal ¹	Petroleum ²	Gas ³	Gases ⁴	Nuclear	Conventional ⁵		Pumped Storage ⁷	Other ⁸	Total
Total (All Sectors)					ļ.					
1998	315,786	66,282	180,288	1,520	97,070	79,151	15,444	19,518	810	775,868
1999	315,496	60,069	195,119	1,909	97,411	79,393	15,942	19,565	1,023	785,927
2000	315,114	61,837	219,590	2,342	97,860	79,359	15,572	19,522	523	811,719
2001	314,230	66,162	252,832	1,670	98,159	78,916	16,101	19,664	519	848,254
2002	315,350 313,019	59,651 60,730	312,512 355,442	2,008 1,994	98,657 99,209	79,356 78,694	16,710 18,153	20,371 20,522	686 684	905,301 948,446
2004	313,019	59,119	371,011	2,296	99,209	78,694 77,641	18,717	20,764	746	962,942
2005	313,380	58,548	383,061	2,063	99,988	77,541	21,205	21,347	887	978,020
2006	312,956	58,097	388,294	2,256	100,334	77,821	24,113	21,461	882	986,215
2007	312,738	56,068	392,876	2,313	100,266	77,885	30,069	21,886	788	994,888
2008	313,322	57,445	397,460 ^R	1,995	100,755	77,930	38,466 ^R	21,858	942	1,010,171
2009	314,294	56,781	401,272	1,932	101,004	78,518	48,552	22,160	888	1,025,400
Electricity Genera										
1998	299,739	62,704	130,404	55	97,070	75,525	2,067	18,898	229	686,692
1999 2000	277,780 260,990	49,020 41,032	123,192 123,665	220 57	95,030 85,968	74,122 73,738	790 837	18,945 18,020	224 13	639,324 604,319
2001	244,451	38,456	112,841	57	63,060	72,968	979	17,097	13	549,920
2002	244,056	33,876	127,692	61	63,202	73,391	989	17,807		561,074
2003	236,473	32,570	125,612	61	60,964	72,827	925	17,803	13	547,249
2004	235,976	31,415	131,734	58	60,651	71,696	960	18,048	13	550,550
2005	229,705	30,867	147,752		56,564	71,568	1,545	18,195	39	556,235
2006	230,644	30,419	157,742	104	56,143	71,840	2,291	18,301	39	567,523
2007	231,289	29,115	162,756	104	54,211	72,186	2,806	18,693	39	571,200
2008	231,857	30,657	173,106		54,376	72,142	4,066	18,664	39	584,908
2009	234,397	30,174	180,571		54,355	72,690	5,614	18,930	39	596,769
Electricity Genera	6,132	1,463	17,051			2,454	6,955	620		34,675
1999	27,725	8,508	38,553		2,381	4,142	8,794	620		90,724
2000	44,164	18,771	60,327		11,892	4,509	8,994	1,502		150,159
2001	60,701	25,311	102,693		35,099	4,885	9,894	2,567	79	241,230
2002	61,770	23,664	140,404	9	35,455	4,911	10,390	2,564	80	279,246
2003	66,538	26,028	178,624	6	38,244	5,058	11,786	2,719	46	329,049
2004	67,242	25,918	190,855	8	38,978	5,274	12,070	2,717	46	343,106
2005	73,734	26,041	188,043	12	43,424	5,284	13,864	3,152	46	353,601
2006 2007	72,730 71,943	25,384 24,818	184,196 184,888	20 8	44,190 46,055	5,263 5,346	15,865 21,002	3,160 3,193	46 26	350,854 357,278
2008	71,864	24,823	179,169 ^R		46,379	5,433	28,139 ^R	3,193	46	359,044
2009	70,123	24,657	176,035	8	46,649	5,470	36,556	3,230	46	362,773
Combined Heat ar			170,000		10,015	2,170	30,550	3,230		302,773
1998	5,021	800	19,632				749			26,202
1999	5,230	1,097	19,390				741			26,459
2000	5,044	907	20,704	262			736			27,653
2001	4,628	972	21,226	287		1	498		28	27,639
2002	5,222	1,084	28,455	182		 1	555			35,499
2003	5,534 5,609	1,051 677	34,895 32,600	185 289		1	665 555			42,332 39,731
2005	5,560	530	31,740	289		1	614			38,735
2006	5,837	970	30,031	325		i	628			37,793
2007	5,885	907	29,468	339			656			37,254
2008	5,927	900	29,575	206			701			37,309
2009	5,940	897	28,875	206			740			36,658
Combined Heat ar										
1998	317	282	1,188			32	463			2,281
1999	317	381	1,106			32	465			2,302
2000	314 295	308 299	1,186 1,950			33 22	399 348			2,240 2,912
2001	295 292	301	1,950 1,216			22 22	348 357			2,912
2003	347	343	994			22	371			2,077
2004	368	321	1,069	5		22	404			2,188
2005	397	333	1,024	5		25	435			2,219
2006	428	341	1,040	5		25	433	==		2,272
2007	428	348	1,064	5		22	443		3	2,312
2008	428	352	1,059	5		22	444		3	2,312
2009	424	348	1,105	5		22	480		3	2,386
Combined Heat an			12.012	1 465		1 120	5 210		£01	26.010
1998 1999	4,577 4,443	1,034 1,062	12,012 12,877	1,465 1,689		1,139 1,097	5,210 5,151		581 799	26,019 27,119
2000	4,443	818	13,708	2,023		1,079	4,607		510	27,119
2001	4,156	1,124	14,123	1,327		1,041	4,382		399	26,553
2002	4,010	726	14,745	1,756		1,033	4,419		607	27,295
2003	4,127	738	15,316	1,742		786	4,406		625	27,740
2004	3,825	789	14,753	1,937		648	4,728		687	27,367
2005	3,984	777	14,501	1,757		662	4,747		802	27,230
2006	3,317	983	15,285	1,802		693	4,896		797	27,773
2007	3,194	880	14,699	1,858		331	5,163		720	26,844
	3,246	713	14,551	1,784		334	5,116		854	26,599
2008	3,412	704	14,686	1,714		337	5,162		800	26,815

 $^{^{\}rm 1}$ Anthracite, bituminous coal, subbituminous coal, lignite, and waste coal.

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

Includes a small number of generators for which waste heat is the primary energy source.

⁴ Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁵ Conventional hydroelectric power excluding pumped storage facilities.

⁶ Wood, black liquor, other wood waste, municipal solid waste, landfill gas, sludge waste, agriculture byproducts, other biomass, geothermal, solar thermal, photovoltaic energy, and wind.


⁷ Pumped storage capacity generates electricity from water pumped to an elevated reservoir and then released through a conduit to turbine generators located at a lower level.

⁸ Batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

⁹ Small number of electricity-only, non-Combined Heat and Power plants may be included.

Notes: • See Glossary reference for definitions. • Capacity by energy source is based on the capacity associated with the energy source reported as the most predominant (primary) one, where more than one energy source is associated with a generator. • Totals may not equal sum of components because of independent rounding.

U.S. Electric Industry Generating Capacity by State, 2009 Figure 1.1.

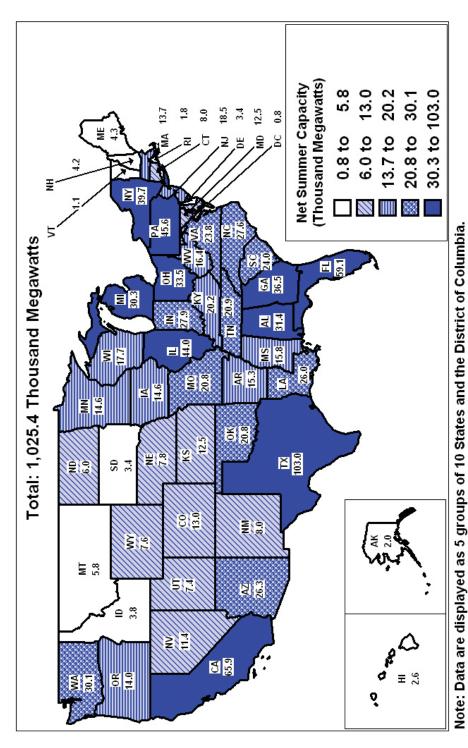

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Existing Net Summer Capacity of Other Renewables by Producer Type, 1998 through 2009 (Megawatts)

(icgawatts)					
Period	Wind	Solar Thermal and Photovoltaic	Wood and Wood- Derived Fuels ¹	Geothermal	Other Biomass ²	Total (Other Renewables)
Total (All Sectors)		•				
1998	1,720	335	6,802	2,893	3,694	15,444
1999	2,252	389	6,795	2,846	3,660	15,942
2000	2,377	386	6,147	2,793	3,869	15,572
2001	3,864	392	5,882	2,216	3,748	16,101
2002	4,417	397	5,844	2,252	3,800	16,710
2003	5,995	397	5,871	2,133	3,758	18,153
2004	6,456	398	6,182	2,152	3,529	18,717
2005	8,706	411	6,193	2,285	3,609	21,205
2006	11,329	411	6,372	2,274	3,727	24,113
2007	16,515	502	6,704	2,214	4,134	30,069
2008	24,651	536	6,864	2,229 ^R	4,186	38,466 ^R
2009	34,296	619	6,939	2,382	4,317	48,552
Electricity Generators, Elect	ric Utilities	5	268	1.550	226	2.067
1998 1999	29	5	240	1,550 273	236 243	2,067 790
2000	54	5	259	273	247	837
2001	60	4	309	273	335	979
2002	111	9	248	271	350	989
2003	140	ģ	268	162	346	925
2004	326	10	313	152	160	960
2005	765	11	391	242	136	1,545
2006	1,441	11	428	240	172	2,291
2007	1,928	12	418	158	290	2,806
2008	3,190	14	427	159	276	4,066
2009	4,655	42	431	159	327	5,614
Electricity Generators, Indep	pendent Power Producers					
1998	1,711	330	1,170	1,344	2,400	6,955
1999	2,222	385	1,244	2,573	2,370	8,794
2000	2,323	382	1,227	2,520	2,543	8,994
2001	3,804	388	1,178	1,945	2,580	9,894
2002	4,305	388	1,162	1,981	2,553	10,390
2003	5,855	388	1,121	1,972	2,450	11,786
2004	6,130	388 400	1,138	2,000	2,414	12,070
2005	7,941 9,888	400	1,033 1,037	2,044 2,034	2,447 2,505	13,864
2006	14,587	489	1,066	2,056	2,803	15,865 21,002
2008	21,461	521	1,196		2,891	
				2,070 ^R		28,139 ^R
Combined Heat and Power,	29,640	575	1,220	2,223	2,898	36,556
1998	Electric rower		356		393	749
1999			354		387	741
2000			242		494	736
2001			144		354	498
2002			144		411	555
2003			204		461	665
2004			179		375	555
2005			218		395	614
2006			212		416	628
2007			210		446	656
2008			223		478	701
2009			237		503	740
Combined Heat and Power,	Commercial ³					
1998			7		456	463
1999			7		459	465
2000			7		392	399
2001			6		342	348
2002			6 7		351	357
2003			/		364	371
2004			7		397 428	404 435
2005			7		428 426	433
2007		 	8		435	443
2008		*	8		436	444
2009	1	Ns.	8		471	480
Combined Heat and Power,						
1998			5,001		209	5,210
1999			4,950		201	5,151
2000			4,413		194	4,607
2001			4,245		138	4,382
2002			4,285		134	4,419
2003			4,271		136	4,406
2004			4,545	==	183	4,728
2005			4,545	==	202	4,747
2006			4,688		208	4,896
2007		1	5,002		160	5,163
2008		1	5,010		105	5,116
2009		1	5,043		118	5,162
1 Was d/was d waste solids	(in also dim a maman mallata	mailmond tion satility malon	rroad ahina hank and rroad	Avvocate colida) vuond vuont	a liamida (mad liamam a	

¹ Wood/wood waste solids (including paper pellets, railroad ties, utility poles, wood chips, bark, and wood waste solids), wood waste liquids (red liquor, sludge wood, spent sulfite liquor, and other wood-based liquids), and black liquor.

Municipal solid waste, landfill gas, sludge waste, agricultural byproducts, other biomass sliquids, and other biomass gases (including digester gases, methane, and

Notes: • See Glossary reference for definitions. • Totals may not equal sum of components because of independent rounding. • Capacity by energy source is based on the capacity associated with the energy source reported as the most predominant (primary) one, where more than one energy source is associated with a generator.

other biomass gases).

³ Small number of electricity-only, non-Combined Heat and Power plants may be included.

^{* =} Value is less than half of the smallest unit of measure.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 1.2. Existing Capacity by Energy Source, 2009 (Megawatts)

Energy Source	Number of Generators	Generator Nameplate Capacity	Net Summer Capacity	Net Winter Capacity
Coal ¹	1,436	338,723	314,294	316,363
Petroleum ²	3,757	63,254	56,781	60,878
Natural Gas ³	5,470	459,803	401,272	432,309
Other Gases ⁴	98	2,218	1,932	1,899
Nuclear	104	106,618	101,004	102,489
Hydroelectric Conventional ⁵	4,005	77,910	78,518	78,127
Wind	620	34,683	34,296	34,350
Solar Thermal and Photovoltaic	110	640	619	537
Wood and Wood Derived Fuels6	353	7,829	6,939	6,992
Geothermal	222	3,421	2,382	2,561
Other Biomass ⁷	1,502	5,007	4,317	4,382
Pumped Storage	151	20,538	22,160	22,063
Other ⁸	48	1,042	888	900
Total	17,876	1,121,686	1,025,400	1,063,848

¹ Anthracite, bituminous coal, subbituminous coal, lignite, and waste coal.

Table 1.3. Existing Capacity by Producer Type, 2009 (Megawatts)

Producer Type	Number of Generators	Generator Nameplate Capacity	Net Summer Capacity	Net Winter Capacity
Electric Power Sector Electric Utilities	9,428 5,531 14,959	646,984 399,030 1,046,014	596,769 362,773 959,542	615,483 377,974 993,457
Combined Heat and Power Sector				
Electric Power ¹	645	42,235	36,658	39,623
Commercial ²	649	2,676	2,386	2,478
Industrial ²	1,623	30,761	26,815	28,290
Total	2,917	75,672	65,858	70,391
Total All Sectors	17,876	1,121,686	1,025,400	1,063,848

¹ Includes only independent power producers' combined heat and power facilities.

Notes: • See Glossary reference for definitions. • Totals may not equal sum of components because of independent rounding. • In some reporting of capacity data, such as for wind, solar and wave energy sites, the capacity for multiple generators is reported in a single generator record and is presented as a single generator in the count of number of generators.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

Includes a small number of generators for which waste heat is the primary energy source.

⁴ Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁵ The net summer capacity and/or the net winter capacity may exceed nameplate capacity due to upgrades to and overload capability of hydroelectric generators.

⁶ Wood/wood waste solids (including paper pellets, railroad ties, utility poles, wood chips, bark, and wood waste solids), wood waste liquids (red liquor, sludge wood, spent sulfite liquor, and other wood-based liquids), and black liquor.

⁷ Municipal solid waste, landfill gas, sludge waste, agricultural byproducts, other biomass solids, other biomass liquids, and other biomass gases (including digester gases, methane, and other biomass gases).

⁸ Batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

Notes: • Capacity by energy source is based on the capacity associated with the energy source reported as the most predominant (primary) one, where more than one energy source is associated with a generator. • Totals may not equal sum of components because of independent rounding. • In some reporting of capacity data, such as for wind, solar and wave energy sites, the capacity for multiple generators is reported in a single generator record and is presented as a single generator in the count of number of generators.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

² Small number of electricity-only, non-Combined Heat and Power plants may be included.

Table 1.4. Planned Generating Capacity Additions from New Generators, by Energy Source, 2010-2014

(Count, Megawatts)

Energy Source	Number of Generators	Generator Nameplate	Capacity	Net Summer Capacity	Net Winter Capacity
<u> </u>	•		2010	, ,	
U.S. Total		25,520		23,523	24,407
Coal ¹		8,102		7,414	7,479
Petroleum ²		1,245		1,110	1,174
Natural Gas		9,488		8,361	9,107
Other Gases ³ Nuclear		117		117	117
Hydroelectric Conventional ⁴		21		21	21
Wind		5,780		5,775	5,776
Solar Thermal and Photovoltaic		510		507	507
Wood and Wood Derived Fuels ⁵		80		67	67
Geothermal		39		21	25
Other Biomass ⁶	. 85	138		129	133
Pumped Storage					
Other ⁷					
U.S. Total	. 238	19,362	2011	18.057	10.512
Coal ¹		19,362 2,534		2,397	18,512 2,397
Petroleum ²		2,334		2,397	209
Natural Gas		11,510		10,391	10,844
Other Gases ³	1	11,510		3	3
Nuclear		<u></u>			
Hydroelectric Conventional ⁴		8		8	8
Wind		3,949		3,931	3,931
Solar Thermal and Photovoltaic	. 66	950		942	943
Wood and Wood Derived Fuels ⁵		167		152	150
Geothermal				Ξ	
Other Biomass ⁶		27		27	27
Pumped Storage					
Other ⁷			2012		
U.S. Total	. 117	19,814	2012	18,521	19,171
Coal ¹		6,169		5,643	5,736
Petroleum ²		52		42	50
Natural Gas	. 56	9,713		9,171	9,668
Other Gases ³	. 2	41		41	41
Nuclear	. 1	1,270		1,122	1,164
Hydroelectric Conventional ⁴		125		116	116
Wind		1,138		1,138	1,138
Solar Thermal and Photovoltaic		857 258		851 224	851 236
Wood and Wood Derived Fuels ⁵ Geothermal		236		224	230
Other Biomass ⁶	. 8	192		173	173
Pumped Storage					
Other ⁷					
			2013		
U.S. Total		8,118		7,127	7,694
Coal ¹		290		290	290
Petroleum ²		 5 417		4 (40	 5 22 4
Natural Gas Other Gases ³	. 29	5,417		4,649	5,224
Nuclear	·			 	
Hydroelectric Conventional ⁴		270		270	270
Wind		415		415	415
Solar Thermal and Photovoltaic		1,123		982	972
Wood and Wood Derived Fuels ⁵	. 3	202		181	181
Geothermal	. 5	185		160	162
Other Biomass ⁶		217		181	181
Pumped Storage					
Other'			2014		
II S. Total	. 34	5,582	2014	4,929	5,137
U.S. Total		1.020		4,929 941	948
Petroleum ²		1,020		, TI	
Natural Gas		2,501		2,256	2,454
Other Gases ³		840		593	596
Nuclear					
Hydroelectric Conventional ⁴	. 3	34		34	34
Wind		300		300	300
Solar Thermal and Photovoltaic		888		805	805
Wood and Wood Derived Fuels'					
Geothermal					
Other Biomass ^o					
Pumped Storage					
Other'					

¹ Anthracite, bituminous coal, subbituminous coal, lignite, and waste coal.

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁴ Conventional hydroelectric power excluding pumped storage facilities; includes ocean power technology (wave energy).

⁵ Wood/wood waste solids (including paper pellets, railroad ties, utility poles, wood chips, bark, and wood waste solids), wood waste liquids (red liquor, sludge wood, spent sulfite liquor, and other wood-based liquids), and black liquor.

⁶ Municipal solid waste, landfill gas, sludge waste, agricultural byproducts, other biomass solids, other biomass liquids, and other biomass gases (including digester gases, methane, and other biomass gases).

⁷ Batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

Notes: • Projected data are updated annually, so revision superscript is not used. • Capacity by energy source is based on the capacity associated with the energy source reported as the most predominant (primary) one, where more than one energy source is associated with a generator. These data reflect plans as of December 31, 2009. • Totals may not equal sum of components because of independent rounding. • In some reporting of capacity data, such as for wind, solar and wave energy sites, the capacity for multiple generators is reported in a single generator record and is presented as a single generator in the count of number of generators.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 1.5. Capacity Additions, Retirements and Changes by Energy Source, 2009 (Count, Megawatts)

		Generato	r Additions		(Generator R	etirement	ts	Update	es and Revis	sions ¹
Energy Source	Number of Gene- rators	Generator Nameplate Capacity	Net Summer Capacity	Net Winter Capacity	Number of Gene- rators	Generator Nameplate Capacity	Net Summer Capacity	Net Winter Capacity	Generator Nameplate Capacity	Net Summer Capacity	Net Winter Capacity
Coal ²	13	2,021	1,793	1,793	12	537	529	528	-61	-291	-363
Petroleum ³	25	93	48	83	41	623	540	567	128	-172	-175
Natural Gas ⁴	76	10,760	9,403	10,170	79	5,940	5,634	5,657	335	43	67
Other Gases ⁵					3	51	46	46	7	-17	-13
Nuclear Hydroelectric									471	249	-5
Conventional	8	26	26	26	5	14	3	4	166	565	410
Wind Solar Thermal and	120	9,581	9,410	9,443	1	2	2	2	125	236	210
Photovoltaic Wood and Wood	20	88	82	80					13	1	1
Derived Fuels6	3	99	89	89	4	22	21	21	22	7	20
Geothermal	13	199	164	193	14	21	9	14		-2	-2
Other Biomass ⁷	104	278	264	261	13	39	32	32	-86	-102	-110
Pumped Storage									184	303	295
Other ⁸									1	-54	-68
Total	382	23,144	21,279	22,138	172	7,249	6,815	6,870	1,305	765	267

Generator re-ratings, re-powering, and revisions/corrections to previously reported data.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

² Anthracite, bituminous coal, subbituminous coal, lignite, and waste coal.

³ Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

⁴ Includes a small number of generators for which waste heat is the primary energy source.

⁵ Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁶ Wood/wood waste solids (including paper pellets, railroad ties, utility poles, wood chips, bark, and wood waste solids), wood waste liquids (red liquor, sludge wood, spent sulfite liquor, and other wood-based liquids), and black liquor.

⁷ Municipal solid waste, landfill gas, sludge waste, agricultural byproducts, other biomass solids, other biomass liquids, and other biomass gases (including digester gases, methane, and other biomass gases).

⁸ Batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

Notes: Capacity by energy source is based on the capacity associated with the energy source reported as the most predominant (primary) one, where more than one energy source is associated with a generator. Totals may not equal sum of components because of independent rounding. In some reporting of capacity data, such as for wind, solar and wave energy sites, the capacity for multiple generators is reported in a single generator record and is presented as a single generator in the count of number of generators.

Table 1.6.A. Capacity of Dispersed Generators by Technology Type, 2004 through 2009 (Count, Megawatts)

Period	Internal	Combustion	Steam Turbine	Hydroelectric	Wind and Other	Tota	1
	Combustion (MW)	Turbine (MW)	(MW)	(MW)	(MW)	Number of Generators	(MW)
2004	3,366	210	552	26	2	11,123	4,156
2005	4,290	335	126	2	13	11,373	4,766
2006	6,524	346	157	3	8	9,536	7,037
2007	7,866	268	102	31	30	11,057	8,297
2008	9,335	86	248	34	70	12,262	9,773
2009	9,751	329	204	81	108	13,928	10,475

Note: Dispersed generators are commercial and industrial generators which are not connected to the grid. They may be installed at or near a customer's site, or at other locations. They may be owned by either the customers of the distribution utility or by the utility. Other includes generators for which technology is not specified.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 1.6.B. Capacity of Distributed Generators by Technology Type, 2004 through 2009 (Count, Megawatts)

Period	Internal	Combustion	Steam Turbine	Hydroelectric	Wind and Other	Tota	l
	Combustion (MW)	Turbine (MW)	(MW)	(MW)	(MW)	Number of Generators	(MW)
2004	2,168	1,028	1,085	1,004	138	5,863	5,423
20051	4,025	1,917	1,830	999	995	17,371	9,766
2006	3,646	1,298	2,582	806	1,081	5,044	9,411
2007	4,624	1,990	3,596	1,051	1,441	7,103	12,702
2008	5,112	1,949	3,060	1,154	1,588	9,591	12,863
2009	4,339	4,147	4,621	1,166	1,729	13,006	16,002

¹ Distributed generator data in 2005 include a significant number of generators reported by one respondent, which may be for residential applications.

Note: Distributed generators are commercial and industrial generators which are connected to the grid. They may be installed at or near a customer's site, or at other locations. They may be owned by either the customers of the distribution utility or by the utility. Other includes generators for which technology is not specified.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 1.6.C. Total Capacity of Dispersed and Distributed Generators by Technology Type, 2004 through 2009

(Count, Megawatts)

Period	Internal	Combustion	Steam Turbine	Hydroelectric	Wind and Other	Tota	1
	Combustion (MW)	Turbine (MW)	(MW)	(MW)	(MW)	Number of Generators	(MW)
2004	5,534	1,238	1,637	1,030	140	16,986	9,579
20051	8,315	2,252	1,956	1,001	1,008	28,744	14,532
2006	10,169	1,644	2,739	809	1,088	14,580	16,448
2007	12,490	2,258	3,698	1,082	1,471	18,160	20,999
2008	14,447	2,035	3,308	1,188	1,658	21,853	22,636
2009	14,090	4,476	4,825	1,248	1,838	26,934	26,477

¹ Distributed generator data in 2005 include a significant number of generators reported by one respondent, which may be for residential applications.

Note: Dispersed and distributed generators are commercial and industrial generators. Dispersed generators are not connected to the grid. Distributed generators are connected to the grid. Both types of generators may be installed at or near a customer's site, or at other locations, and both types of generators may be owned by either the customers of the distribution utility or by the utility. Other includes generators for which technology is not specified.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Fuel Switching Capacity of Operable Generators Reporting Natural Gas as the Primary **Table 1.7.** Fuel, by Producer Type, 2009

(Megawatts, Percent)

	Total Net Summer	Fuel-Switchable Part of Total						
Producer Type	Capacity of All Generators Reporting Natural Gas as the Primary Fuel	Net Summer Capacity of Natural Gas-Fired Generators Reporting the Ability to Switch to Petroleum Liquids ¹	Fuel Switchable Capacity as Percent of Total	Maximum Achievable Net Summer Capacity Using Petroleum Liquids	Fuel Switchable Net Summer Capacity Reported to Have No Factors that Limit the Ability to Switch to Petroleum Liquids			
Electric Utility	180,571	76,700	42.5	75,023	26,360			
Independent Power Producers	176,035	40,395	22.9	39,545	11,176			
Combined Heat and Power, Electric Power ²	28,875	5,961	20.6	5,759	572			
Electric Power Sector Subtotal	385,481	123,056	31.9	120,327	38,108			
Combined Heat and Power, Commercial ³	1,105	532	48.2	526	139			
Combined Heat and Power, Industrial ³	14,686	1,263	8.6	1,207	270			
All Sectors	401,272	124,851	31.1	122,060	38,517			

¹ Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, and waste oil.

Table 1.8. Fuel-Switching Capacity of Operable Generators: From Natural Gas to Petroleum Liquids by Type of Prime Mover, 2009

(Megawatts, Percent)

	Tadal Nad Camanan	Fuel-Switchable Part of Total					
Producer Type	Total Net Summer Capacity of All Generators Reporting Petroleum as the Primary Fuel ¹	Net Summer Capacity of Petroleum-Fired Generators Reporting the Ability to Switch to Natural Gas	Fuel Switchable Capacity as Percent of Total	Maximum Achievable Net Summer Capacity Using Natural Gas			
Electric Utility	30,174	11,117	36.8	10,654			
Independent Power Producers	24,657	12,115	49.1	10,270			
Combined Heat and Power Electric Power ²	897	445	49.6	195			
Electric Power Sector Subtotal	55,728	23,677	42.5	21,119			
Combined Heat and Power Commercial ³	348	19	5.6	19			
Combined Heat and Power Industrial ³	704	59	8.3	39			
All Sectors	56,781	23,755	41.8	21,177			

¹ Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, and waste oil.

² Electric Utility CHP plants are included in Electric Utilities.

³ Small number of electricity-only, non-Combined Heat and Power plants may be included. Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

² Electric Utility CHP plants are included in Electric Utilities.

³ Small number of electricity-only, non-Combined Heat and Power plants may be included.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 1.9. Fuel-Switching Capacity of Operable Generators: From Natural Gas to Petroleum Liquids by Type of Prime Mover, 2009

(Count, Megawatts)

Prime Mover Type	Number of Generators	Net Summer Capacity	Fuel Switchable Net Summer Capacity Reported to Have No Factors that Limit the Ability to Switch to Petroleum Liquids ¹	
Steam Generator	205	28,193	16,642	
Combined Cycle	396	41,055	6,820	
Internal Combustion	332	922	349	
Gas Turbine	933	54,680	14,707	
All Fuel Switchable Prime Movers	1,866	124,851	38,517	

¹ Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, and waste oil. Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 1.10. Fuel-Switching Capacity of Operable Generators: From Natural Gas to Petroleum Liquids, by Year of Initial Commercial Operation, 2009

(Count, Megawatts)

Year of Initial Commercial Operation	Number of Generators	Net Summer Capacity	Fuel Switchable Net Summer Capacity Reported to Have No Factors that Limit the Ability to Switch to Petroleum Liquids ¹	
pre-1970	377	15,505	9,610	
1970-1974	391	17,976	9,668	
1975-1979	105	9,889	5,574	
1980-1984	47	943	213	
1985-1989	111	3,317	493	
1990-1994	215	12,987	2,259	
1995-1999	134	10,023	2,288	
2000-2004	381	39,773	6,345	
2005-2009	105	14,439	2,067	
Total	1,866	124,851	38,517	

¹ Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, and waste oil. Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 1.11. Interconnection Cost and Capacity for New Generators, by Producer Type, 2008 and 2009

Sector	Units¹	Nameplate Capacity (megawatts) ¹	Cost (thousand dollars) ¹
2008			
Total	433 ^R	19,062 ^R	523,846
Electric Utilities ²	123 ^R	8,831 ^R	185,955
Independent Power Producers ³	293 ^R	10,212 ^R	337,145
Commercial ⁴	16 ^R	16 ^R	745
Industrial ⁴	1	3	1
2009			
Total	382	23,144	819,680
Electric Utilities ²	106	10,939	237,751
Independent Power Producers ³	244	11,590	561,057
Commercial ⁴	20	58	10,587
Industrial ⁴	12	557	10,285

¹ Cost is the total cost incurred for the direct, physical interconnection of generators that started commercial operation in the respective years. These generator-specific costs may include costs for transmission or distribution lines, transformers, protective devices, substations, switching stations and other equipment necessary for interconnection. Units and Nameplate Capacity represent the number of units and associated capacity for which interconnection costs were incurred and reported.

² Electric utility CHP plants are included in Electric Generators, Electric Utilities.

Notes: • See Glossary reference for definitions. • Totals may not equal sum of components because of independent rounding. • In some reporting of capacity data, such as for wind, solar and wave energy sites, the capacity for multiple generators is reported in a single generator record and is presented as a single generator in the count of number of generators. Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

³ Includes only independent power producers' combined heat and power facilities.

⁴ Small number of electricity-only, non-Combined Heat and Power plants may be included. R = Revised.

Table 1.12. Interconnection Cost and Capacity for New Generators, by Grid Voltage Class, 2008 and 2009

Voltage Class	Units ¹	Nameplate Capacity (megawatts) ¹	Cost (thousand dollars) ¹
2008			
Total	433 ^R	19,062 ^R	523,846
Distribution (< 35 kV)	153 ^R	540 ^R	25,198
SubTransmission (35 kV - 138 kV)	185 ^R	$7,090^{R}$	181,061
Transmission (> 138 kV)	95 ^R	11,432 ^R	317,587
2009			
Total	382	23,144	819,680
Distribution (< 35 kV)	147	464	36,927
SubTransmission (35 kV - 138 kV)	131	6,423	315,874
Transmission (> 138 kV)	104	16,257	466,879

¹ Cost is the total cost incurred for the direct, physical interconnection of generators that started commercial operation in the respective years. These generator-specific costs may include costs for transmission or distribution lines, transformers, protective devices, substations, switching stations and other equipment necessary for interconnection. Units and Nameplate Capacity represent the number of units and associated capacity for which interconnection costs were incurred and reported.

R = Revised.

Notes: • See Glossary reference for definitions. • Totals may not equal sum of components because of independent rounding. • In some reporting of capacity data, such as for wind, solar and wave energy sites, the capacity for multiple generators is reported in a single generator record and is presented as a single generator in the count of number of generators.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Chapter 2. Generation and Useful Thermal Output

Net Generation by Energy Source by Type of Producer, 1998 through 2009 (Thousand Megawatthours)

Period	Coal ¹	Petroleum ²	Natural Gas	Other Gases ³	Nuclear	Hydroelectric Conventional ⁴	Other Renewables ⁵	Hydroelectric Pumped Storage ⁶	Other ⁷	Total
Total (All Sectors)										
1998	1,873,516	128,800	531,257	13,492	673,702	323,336	77,088	-4,467	3,571	3,620,295
1999	1,881,087 1,966,265	118,061	556,396	14,126	728,254	319,536	79,423 80,906	-6,097	4,024 4,794	3,694,810
2000	1,900,205	111,221 124,880	601,038 639,129	13,955 9,039	753,893 768,826	275,573 216,961	70,769	-5,539 -8,823	11,906	3,802,105 3,736,644
2002	1,933,130	94,567	691,006	11,463	780,064	264,329	79,109	-8,743	13,527	3,858,452
2003	1,973,737	119,406	649,908	15,600	763,733	275,806	79,487	-8,535	14,045	3,883,185
2004	1,978,301	121,145	710,100	15,252	788,528	268,417	83,067	-8,488	14,232	3,970,555
2005	2,012,873	122,225	760,960	13,464	781,986	270,321	87,329	-6,558	12,821	4,055,423
2006	1,990,511	64,166	816,441 896,590	14,177 13,453	787,219	289,246	96,525	-6,558 -6,896	12,974 12,231	4,064,702
2007	2,016,456 1,985,801	65,739 46,243	882,981	11,707	806,425 806,208	247,510 254,831	105,238 126,101 ^R	-6,288	12,231 11,804 ^R	4,156,745 4,119,388
2009	1,755,904	38,938	920,797	10,629	798,855	273,445	143,824	-4,627	11,929	3,949,694
Electricity Genera			,		,					
1998	1,807,480	110,158	309,222		673,702	308,844	7,206	-4,441		3,212,171
1999	1,767,679	86,929	296,381		725,036	299,914	3,716	-5,982		3,173,674
2000	1,696,619	72,180	290,715		705,433	253,155	2,241	-4,960 7,704	49.6	3,015,383
2001	1,560,146 1,514,670	78,908 59,125	264,434 229,639	206	534,207 507,380	197,804 242,302	1,666 3,089	-7,704 -7,434	486 480	2,629,946 2,549,457
2003	1,500,281	69,930	186,967	243	458,829	249,622	3,421	-7,532	519	2,462,281
2004	1,513,641	73,694	199,662	374	475,682	245,546	3,692	-7,526	467	2,505,231
2005	1,484,855	69,722	238,204	10	436,296	245,553	4,945	-5,383	643	2,474,846
2006	1,471,421	40,903	282,088	30	425,341	261,864	6,588	-5,281	700	2,483,656
2007	1,490,985	40,719	313,785	141	427,555	226,734	8,953	-5,328	586	2,504,131
2008	1,466,395 1,322,092	28,124 25,217	320,190 349,166	46 96	424,256 417,275	229,645 247,198	11,308	-5,143 -3,369	545 483	2,475,367
Electricity Genera				90	417,273	247,198	14,617	-5,309	403	2,372,776
1998	15,539	5,503	26,657	55		9,023	34,703	-26		91,455
1999	64,387	17,906	60,264	36	3,218	14,749	40,460	-115		200,905
2000	213,956	25,795	108,712	181	48,460	18,183	42,831	-579		457,540
2001	291,678	34,257	162,540	10	234,619	15,945	37,200	-1,119	5,460	780,592
2002	366,535	24,150	227,155	29	272,684	18,189	40,729	-1,309	7,168	955,331
2003	415,498 407,418	38,571 35,665	234,240 291,527	13 7	304,904 312,846	21,890 19,518	42,058 45,743	-1,003 -962	7,035 7,108	1,063,205 1,118,870
2005	470,658	41,485	314,970	3	345,690	21,477	48,294	-1,174	5,569	1,246,971
2006	462,302	14,340	335,898	3	361,877	24,383	55,890	-1,277	5,646	1,259,062
2007	470,978	16,189	372,523	3	378,869	19,103	62,301	-1,569	5,458	1,323,856
2008	465,558	11,145	363,138	1	381,952	23,444	82,358 ^R	-1,145	5,616 ^R	1,332,068
2009	389,783	6,689	373,448	1	381,579	24,304	97,928	-1,259	5,341	1,277,815
Combined Heat at	nd Power, Elec 27,174	6,550	113,413	2,260			4,234		159	153,790
1999	26,551	6,704	116,351	1,571			4,088		139	155,404
2000	32,536	7,217	118,551	1,847			4,330		125	164,606
2001	31,003	5,984	127,966	576			3,393		595	169,515
2002	29,408	6,458	150,889	1,734			3,737		1,444	193,670
2003	36,935	5,195	146,097	2,392			4,002		1,053	195,674
2004	36,128 36,541	5,320 5,275	135,983 130,655	3,187 3,765		10	2,893 3,415		747 716	184,259 180,375
2006	36,014	4,465	116,430	4,220		8	3,456		766	165,359
2007	36,428	4,398	128,444	3,898		6	3,450		733	177,356
2008	36,884	3,612	119,043	3,153		6	3,417		798	166,915
2009	29,248	3,910	118,286	2,958		4	3,932		808	159,146
Combined Heat ar		ımercial ⁹	4.970	7		120	2.272			9.740
1998	985 995	383 434	4,879 4,607	7 *		120 115	2,373 2,412		*	8,748 8,563
2000	1,097	432	4,262	*		100	2,412		*	7,903
2001	995	438	4,434	*		66	1,025		457	7,416
2002	992	431	4,310	*		13	1,065		603	7,415
2003	1,206	423	3,899			72	1,302		594	7,496
2004	1,340	499	3,969			105	1,575		781	8,270
2005	1,353	375	4,249	*		86	1,673		756 759	8,492
2006	1,310 1,371	235 189	4,355 4,257			93 77	1,619 1,614		758 764	8,371 8,273
2008	1,261	142	4,188			60	1,555		720	7,926
2009	1,096	163	4,225			71	1,769		842	8,165
Combined Heat ar										
1998	22,337	6,206	77,085	11,170		5,349	28,572		3,412	154,132
1999	21,474 22,056	6,088 5,597	78,793 78,798	12,519 11,927		4,758	28,747 29,491		3,885	156,264 156,673
2000	22,036	5,293	78,798 79,755	8,454		4,135 3,145	27,485		4,669 4,908	149,175
2002	21,525	4,403	79,013	9,493		3,825	30,489	 	3,832	152,580
2003	19,817	5,285	78,705	12,953		4,222	28,704		4,843	154,530
2004	19,773	5,967	78,959	11,684		3,248	29,164		5,129	153,925
2005	19,466	5,368	72,882	9,687		3,195	29,003		5,137	144,739
2006	19,464	4,223	77,669	9,923		2,899	28,972		5,103	148,254
2007	16,694	4,243	77,580	9,411		1,590	28,919		4,690	143,128
2008	15,703	3,219	76,421	8,507		1,676	27,462		4,125	137,113
	13,686	2,960	75,672	7,574		1,868	25,578		4,455	131,793

¹ Anthracite, bituminous coal, subbituminous coal, lignite, waste coal, and synthetic coal.

Note: Totals may not equal sum of components because of independent rounding

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report," Form EIA-860, "Annual Electric Generator Report."

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

3 Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

4 Conventional hydroelectric power excluding pumped storage facilities.

5 Conventional hydroelectric power excluding pumped storage facilities.

Other renewables represents the summation of the sub-categories of Wind, Solar Thermal and Photovoltaic, Wood and Wood Derived Fuels, Geothermal, and Other Biomass.


The quantity of output from a hydroelectric pumped storage facility represents production minus energy used for pumping.

Non-biogenic municipal solid waste, batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

⁸ Electric utility CHP plants are included in Electricity Generators, Electric Utilities.

⁹ Small number of electricity-only, non-Combined Heat and Power plants may be included. * = Value is less than half of the smallest unit of measure.

Figure 2.1. U.S. Electric Industry Net Generation by State, 2009

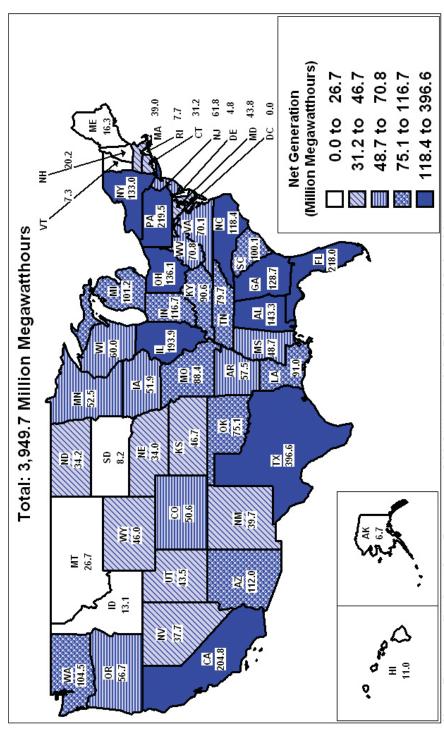

Note: Data are displayed as 5 groups of 10 States and the District of Columbia.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report" .

Table 2.1.A. Net Generation by Selected Renewables by Type of Producer, 1998 through 2009 (Thousand Megawatthours)

Period	Wind	Solar Thermal and Photovoltaic	Wood and Wood- Derived Fuels ¹	Geothermal	Other Biomass ²	Total (Other Renewables)
Total (All Sectors)						
1998	3,026	502	36,338	14,774	22,448	77,088
1999	4,488	495	37,041	14,827	22,572	79,423
2000	5,593	493	37,595	14,093	23,131	80,906
2001	6,737	543	35,200	13,741	14,548	70,769
2002	10,354	555	38,665	14,491	15,044	79,109
2003	11,187	534	37,529	14,424	15,812	79,487
2004	14,144	575	38,117	14,811	15,421	83,067
2005	17,811	550	38,856	14,692	15,420	87,329
2006	26,589	508	38,762	14,568	16,099	96,525
2007	34,450	612	39,014	14,637	16,525	105,238
2008	55,363	864	37,300	14,840 ^R	17,734	126,101 ^R
2009 Electricity Concrete vs. Float	73,886	891	35,596	15,009	18,443	143,824
Electricity Generators, Elect	ric Utilities 3	3	719	5,176	1,305	7,206
1999	23	3	684	1,698	1,307	3,716
2000	29	3	700	151	1,358	2,241
2001	135	3	560	152	815	1,666
2002	213	3	709	1,402	761	3,089
2003	354	2	882	1,249	934	3,421
2004	405	6	1,209	1,248	824	3,692
2005	1,046	16	1,829	1,126	929	4,945
2006	2,351	15	1,937	1,162	1,123	6,588
2007	4,361	11	2,226	1,139	1,217	8,953
2008	6,899	17	1,888	1,197	1,307	11,308
2009	10,348	28	1,748	1,182	1,312	14,617
Electricity Generators, Indep		500	5.025	0.500	15 (50	24.702
1998	3,023	500	5,925	9,598	15,658	34,703
1999	4,465 5,565	492 491	6,569 6,601	13,129 13,942	15,805 16,234	40,460 42,831
2000	6,602	539	6,011	13,588	10,460	37,200
2002	10,141	552	6,556	13,089	10,391	40,729
2003	10,834	532	6,520	13,175	10,998	42,058
2004	13,739	569	6,940	13,563	10,932	45,743
2005	16,764	535	6,668	13,566	10,761	48,294
2006	24,238	493	6,374	13,406	11,379	55,890
2007	30,089	601	6,451	13,498	11,662	62,301
2008	48,464	847	6,746	13,643 ^R	12,659	82,358 ^R
2009	63,538	863	6,733	13,826	12,968	97,928
Combined Heat and Power, l	Electric Power ³					
1998			1,964		2,270	4,234
1999			1,707		2,381	4,088
2000			1,615		2,715	4,330
2001			1,723		1,669	3,393
2002			1,744		1,993	3,737
2003			2,126	==	1,876	4,002
2004			1,588		1,306	2,893
2005			2,073		1,341	3,415
2006 2007	==		2,030 2,034		1,426 1,416	3,456 3,450
2008			2,004		1,413	3,417
2009			2,258		1,674	3,932
Combined Heat and Power,	Commercial ⁴		,		, , ,	
1998			38		2,335	2,373
1999			20		2,393	2,412
2000		==	27		1,985	2,012
2001			18		1,007	1,025
2002			13		1,053	1,065
2003			13		1,289	1,302
2004			13		1,562	1,575
2005			16		1,657	1,673
2006			21		1,599	1,619
2007		*	15 21		1,599	1,614 1,555
2009	*	*	21 20		1,534 1,748	1,555 1,769
Combined Heat and Power, I	Industrial ⁴		20		1,7 10	1,705
1998			27,693		880	28,572
1999			28,060		686	28,747
2000			28,652		839	29,491
2001			26,888		596	27,485
2002			29,643		846	30,489
2003			27,988		715	28,704
2004			28,367		797	29,164
2005			28,271		733	29,003
2006			28,400		572	28,972
2007			28,287		631	28,919
2008			26,641 24,838		821 740	27,462
2009						25,578

Wood/wood waste solids (including paper pellets, railroad ties, utility poles, wood chips, bark, and wood waste solids), wood waste liquids (red liquor, sludge wood, spent sulfite liquor, and other wood-based liquids), and black liquor.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report;" Form EIA-860, "Annual Electric Generator Report."

and other wood-based liquids), and black liquor.

² Biogenic municipal solid waste, landfill gas, sludge waste, agricultural byproducts, other biomass solids, other biomass liquids, and other biomass gases (including digester gases, methane, and other biomass gases).

methane, and other biomass gases).

³ Electric utility CHP plants are included in Electricity Generators, Electric Utilities.

⁴ Small number of electricity-only, non-Combined Heat and Power plants may be included.

^{* =} Value is less than half of the smallest unit of measure.

R = Revised.

Note: Totals may not equal sum of components because of independent rounding

Useful Thermal Output by Energy Source by Combined Heat and Power Producers, 1998 **Table 2.2.** through 2009

(Billion Btus)

Period	Coal ¹	Petroleum ²	Natural Gas	Other Gases ³	Other Renewables ⁴	Other ⁵	Total
Total Combined Heat and	Power					<u> </u>	
1998	381,546	135,519	781,637	167,064	757,131	46,437	2,269,334
1999	385,926	125,486	810,918	178,971	744,470	47,871	2,293,642
2000	383,687	108,045	812,036	184,062	763,674	50,459	2,301,963
2001	354,204	90,308	740,979	132,937	584,560	55,162	1,958,151
2002	336,848	72,826	708,738	117,513	571,507	48,264	1,855,697
2003	333,361	85,263	610,122	110,263	632,368	54,960	1,826,335
2004	351,871	97,484	654,242	126,157	667,341	45,456	1,942,550
2005	341,806	92,383	624,008	138,469	664,691	41,400	1,902,757
2006	332,548	78,232	603,288	126,049	689,549	49,308	1,878,973
2007	326,803	76,255	554,394	116,313	651,230	46,822	1,771,816
2008	315,244	47,817	509,330	110,680	610,131	23,729	1,616,931
2009	281,557	52,910	513,002	99,556	593,670	33,287	1,573,983
Combined Heat and Power		,,	,	,	,		-,-,-,-
1998	43,256	6,261	141,834	5,064	25,969	68	222,452
1999	52,061	6,718	145,525	3,548	30,172	28	238,052
2000	53,329	6,610	157,886	5,312	25,661	39	248,837
2001	51,515	6,087	164,206	4,681	12,676	3,343	242,508
2002	40.020	3,869	214,137	5,961	12,550	4,732	281,269
2003	38,249	7,379	200,077	9,282	19,786	3,296	278,068
2004	39,014	8.217	239,416	18,200	17,347	3,822	326,017
2005	39,652	7,809	239,324	36,694	18,240	3,884	345,605
2006	38,133	7,065	207,095	22,567	17,284	4,435	296.579
2007	38,260	7,156	212,705	20,473	19,166	4,459	302,219
2008	37,220	6,832	204,167	22,109	17,052	4,854	292,234
2009	38,015	6,786	190,875	19,830	17,625	5,055	278,187
Combined Heat and Power		0,780	190,673	19,630	17,023	3,033	270,107
1998	20,185	4,853	38,510	34	18,426		82,008
1999	20,479	3,298	36,857		17,145		77,779
2000	21,001	3,827	39,293		17,613		81,734
2001	18,495	4.118	34,923		8,253	5,770	71,560
2002	18,477	2,743	36,265		6,901	4,801	69,188
2003	22,780	2,716	16,955		8,297	6,142	56,889
2004	22,450	4,283	21,851		8,936	6,350	63,871
2005	22,430	3,684	20,227		8,647	5,921	61.081
	22,186	2,264	19,370	0	.,	. ,	59,422
2006				U	9,359	6,242	
2007	22,595	1,861	20,040		6,651	3,983	55,131
2008	22,991 20,057	1,999 1,250	20,183		8,863 8,450	6,054 5,761	60,091 61,420
Combined Heat and Power	.,	1,230	25,902		8,430	5,/61	61,420
1998	318,105	124,405	601,293	161,966	712,736	46,369	1,964,874
1999	313,386	115,470	628,536	175,423	697,153	47,843	1,977,811
2000	309.357	97.608	614.857	178,750	720,400	50,420	1.971.392
2001	284,194	80,103	541,850	128,256	563,631	46,049	1,644,083
2002	278,351	66,214	458,336	111,552	552,056	38,731	1,505,240
2003	272,332	75,168	393,090	100,981	604,285	45,522	1,491,378
2004	290.407	75,168 84.984	393,090	100,981	641.058	45,522 35.284	1,491,378
	,	. ,	,	,	. ,	, .	,,
2005	279,552	80,889	364,457	101,775	637,803	31,594	1,496,071
2006	272,229	68,903	376,822	103,481	662,906	38,630	1,522,971
2007	265,948	67,238	321,648	95,840	625,413	38,380	1,414,466
2008	255,032	38,986	284,980	88,571	584,216	12,821	1,264,606
2009	223,485	44,874	296,225	79,726	567,595	22,471	1,234,376

¹ Anthracite, bituminous coal, subbituminous coal, lignite, waste coal, and synthetic coal.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report;" Form EIA-860, "Annual Electric Generator Report.

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology) and waste oil.

Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

Other renewables represents the summation of the sub-categories of Wind, Solar Thermal and Photovoltaic, Wood and Wood Derived Fuels, Geothermal, and Other Biomass.

⁵ Non-biogenic municipal solid waste, batteries, chemicals, hydrogen, pitch, purchased steam, sulfur, tire-derived fuels and miscellaneous technologies.

Notes: • The methodology to allocate fuel use by combined heat and power plants to electric power generation and useful thermal output was modified beginning in 2007, and retroactively applied to data from 2004 to 2006. For more information, please see the Technical Notes in the Appendices. • Totals may not equal sum of components because of independent rounding.

Chapter 3. Fuel and Emissions

Table 3.1. Consumption of Fossil Fuels for Electricity Generation by Type of Power Producer, 1998 through 2009

	Coal	Petroleum	Natural Gas	Other Gases
Type of Power Producer and Period	(Thousand Tons) ¹	(Thousand Barrels) ²	(Thousand Mcf)	(Billion Btu) ³
otal (All Sectors)	(Thousand Tons)	(Industria Barrets)	(Thousand 1/141)	(Billion Bita)
998	946,295	222,640	5,081,384	124,988
999	949,802	207,871	5,321,984	126,387
00	994,933	195,228	5,691,481	125,971
01	972,691	216,672	5,832,305	97,308
002	987,583	168,597 206,653	6,126,062	131,230 156,306
03	1,014,058	· · · · · · · · · · · · · · · · · · ·	5,616,135	
04 05	1.020.523 1,041,448	203.494 206,785	5.674.580 6,036,370	135.144 109,916
006	1,030,556	110,634	6,461,615	114,665
007	1,046,795	112,615	7,089,342	114,904
08	1,042,335	80,932	6,895,843	96,757
09	934,683	67,666	7,120,585	83,593
ectricity Generators, Electric Utilities				
98	910,867	187,461	3,258,054	
99	894,120	151,868	3,113,419	
000	859,335	125,788	3,043,094	
01	806,269	133,456	2,686,287	5 100
002	767,803	99,219	2,259,684	5,182
03	757,384	118,087	1,763,764	6,078
004	772,224 761,349	124,541 118,874	1,809,443	5,163 91
105 106	753,390	71,624	2,134,859 2,478,396	358
007	764,765	70,950	2,736,418	1,523
08	760,326	50,475	2,730,134	1,818
009	695,615	45,651	2,911,279	2,209
ectricity Generators, Independent Power Producers				
998	9,486	9,676	285,878	1,345
999	30,572	30,037	615,756	696
000	107,745	45,011	1,049,636	1,951
001	139,799	60,489	1,477,643	92
002	192,274	44,993	1,998,782	354
003	226,154	68,817	2,016,550	171
004	222.550	63.060	2.332.092	86
005	254,291 251,370	72,953	2,457,412	43 49
006 007	251,379 258,075	26,873 29,868	2,612,653 2,875,183	62
008	257,480	21,284	2,790,358	19
009	217,951	12,547	2,838,826	16
ombined Heat and Power, Electric Power ⁴	217,531	12,517	2,030,020	10
998	13,773	12,310	871,881	21,406
999	13,197	12,440	914,600	13,627
000	15,634	13,147	921,341	16,871
001	15,455	11,175	978,563	9,352
002	15,174	11,942	1,149,812	19,958
003	19,498	8,431	1,128,935	23,317
004	17,685	8,209	933,804	21,899
005	17,927	7,933	892,509	24,289
006	18,033	6,738	800,173	27,173
007	18,506 19,085	6,498	890,012 821,839	25,428 21,513
	16,126	5,389 5,953	821,839 816,402	19,098
ombined Heat and Power, Commercial ⁵	10,120	3,933	810,402	19,090
998	440	802	40,693	54
999	481	931	39,045	*
000	514	823	37,029	*
001	532	1,023	36,248	*
002	477	834	32,545	*
003	582	894	38,480	
004	377	766	32.839	
005	377	585	33,785	
006	347	333	34,623	
007	361	258	34,087	
08 09	369 317	166 190	33,403 34,279	
ombined Heat and Power, Industrial ⁵	31/	190	34,419	-
198	11,728	12,392	624,878	102,183
999	11,432	12,595	639,165	112,064
000	11,706	10,459	640,381	107,149
001	10,636	10,530	653,565	87,864
002	11,855	11,608	685,239	105,737
003	10,440	10,424	668,407	126,739
004	7,687	6,919	566,401	107,995
005	7,504	6,440	517,805	85,492
006	7,408	5,066	535,770	87,084
007	5,089	5,041	553,643	87,892
	5.075	3,617	520,109	73,407
008 009	5,075 4,674	3,326	519,799	62,269

¹ Includes anthracite, bituminous, subbituminous and lignite coal. Waste and synthetic coal were included starting in 2002.

Notes: • See Glossary reference for definitions • A new method of allocating fuel consumption between electric power generation and useful thermal output (UTO) was implemented with publication of the preliminary 2008 data, and retroactively applied to 2004-2007 data. The new methodology evenly distributes a combined heat and power (CHP) plant's losses between the two output products (electric power and UTO). In the historical data, UTO was consistently assumed to be 80 percent efficient and all other losses at the plant were allocated to electric power. This change results in the fuel for electric power to be lower while the fuel for UTO is higher than the prior set of data as both are given the same efficiency. This results in the appearance of an increase in efficiency of production of electric power after 2003.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report," Form EIA-860, "Annual Electric Generator Report."

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁴ Electric utility CHP plants are included in Electricity Generators, Electric Utilities.

⁵ Small number of electricity-only, non-Combined Heat and Power plants may be included.

^{* =} Value is less than half of the smallest unit of measure.

Table 3.2. Consumption of Fossil Fuels for Useful Thermal Output by Type of Combined Heat and Power Producers, 1998 through 2009

T-m of Domes Dec 1 137	Coal	Petroleum	Natural Gas	Other Gases
Type of Power Producer and Year	(Thousand Tons)1	(Thousand Barrels)2	(Thousand Mcf)	(Billion Btu) ³
Total Combined Heat and Power	,			,
1998	20,320	28,845	949,106	208.828
1999	20,373	26,822	982,958	223,713
2000	20,466	22,266	985,263	230,082
2001	18,944	18,268	898,286	166,161
2002	17,561	14,811	860,019	146,882
2003	17,720	17,939	721,267	137,837
2004	24,275	25,870	1,052,100	218,295
2005	23,833	24,408	984,340	238,396
2006	23,227	20,371	942.817	226,464
2007	22,810	19,775	872,579	214,321
2008	22,168	12,016	793,537	203,236
2009	20,507	13,164	816,787	175,671
Electric Power ⁴	20,307	13,104	610,767	173,071
1998	2,493	1,322	172,471	6,329
1999	3,033	1,423	175,757	4,435
2000	3,107	1,412	192,253	6,641
2001	2,910	1,171	199,808	5,849
2002	2,255	841	263,619	7,448
2003	2,080	1,596	225,967	11,601
2004	3,809	2,688	388,424	31,132
2005	3,918	2,424	384,365	59,569
2006	3,834	2,129	330,878	36,963
2007	3,795	2,129	339,796	34,384
2008	3,793	1,907	326,048	34,384 37,899
2009	3,935	1,930	325,542	33,812
Commercial	3,933	1,930	303,342	33,812
1998	1,002	1,006	46,527	41
1999	1,002	682	44,991	41
2000	1.034	792	47.844	
2001	916	809	42,407	
2002	929	416	41,430	
	1.234	555	19.973	
2003	, -		- ,	
2004	1,540	1,243	39,233	
2005	1,544	1,045	34,172	
2006	1,539	601	33,112	1
2007	1,566	494	35,987	
2008	1,652	504	32,813	
2009	1,481	331	41,275	
[ndustrial	16.924	26.510	720 100	202.459
1998	16,824	26,518	730,108	202,458
1999	16,330	24,718	762,210	219,278
2000	16,325	20,062	745,165	223,441
2001	15,119	16,287	656,071	160,312
2002	14,377	13,555	554,970	139,434
2003	14,406	15,788	475,327	126,236
2004	18,926	21,939	624,443	187,162
2005	18,371	20,940	565,803	178,827
2006	17,854	17,640	578,828	189,501
2007	17,449	17,166	496,796	179,937
2008	16,827	9,605	434,676	165,337
2009	15,091	10,902	469,970	141,859

¹ Includes anthracite, bituminous, subbituminous and lignite coal. Waste and synthetic coal were included starting in 2002.

Notes: • Totals may not equal sum of components because of independent rounding. • A new method of allocating fuel consumption between electric power generation and useful thermal output (UTO) was implemented with publication of the preliminary 2008 data, and retroactively applied to 2004-2007 data. The new methodology evenly distributes a combined heat and power (CHP) plant's losses between the two output products (electric power and UTO). In the historical data, UTO was consistently assumed to be 80 percent efficient and all other losses at the plant were allocated to electric power. This change results in the fuel for electric power to be lower while the fuel for UTO is higher than the prior set of data as both are given the same efficiency. This results in the appearance of an increase in efficiency of production of electric power after 2003.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report;" Form EIA-860, "Annual Electric Generator Report."

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

petroleum, see Technical Notes for conversion methodology), and waste oil.

Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁴ Electric utility CHP plants are included in Table 4.1 with Electric Generators, Electric Utilities.

Consumption of Fossil Fuels for Electricity Generation and for Useful Thermal Output, **Table 3.3.** 1998 through 2009

Period	Coal	Petroleum	Natural Gas	Other Gases
	(Thousand Tons)1	(Thousand Barrels) ²	(Thousand Mcf)	(Billion Btu) ³
otal (All Sectors)	066.615	251.406	6.020.400	222.016
998	966,615 970,175	251,486	6,030,490	333,816
999 000	970,175	234,694	6,304,942	350,100
	1,015,398	217,494	6,676,744	356,053
001	991,635	234,940	6,730,591	263,469
002	1,005,144	183,408	6,986,081	278,111
003	1,031,778	224,593	6,337,402	294,143
004	1,044,798	229,364	6,726,679	353,438
005	1,065,281	231,193	7,020,709	348,312
006	1,053,783	131,005	7,404,432	341,129
007	1,069,606	132,389	7,961,922	329,225
008	1,064,503	92,948	7,689,380	299,993
009	955,190	80,830	7,937,372	259,264
ectricity Generators, Electric Utilities	010.005	107.461	2.250.054	
998	910,867	187,461	3,258,054	
999	894,120	151,868	3,113,419	
000	859,335	125,788	3,043,094	
001	806,269	133,456	2,686,287	5.102
002	767,803	99,219	2,259,684	5,182
003	757,384	118,087	1,763,764	6,078
004	772,224	124,541	1,809,443	5,163
005	761,349	118,874	2,134,859	91
006	753,390	71,624	2,478,396	358
007	764,765	70,950	2,736,418	1,523
008	760,326	50,475	2,730,134	1,818
009	695,615	45,651	2,911,279	2,209
ectricity Generators, Independent Power Producers	9,486	9,676	785 070	1,345
	9,486 30,572	9,676 30,037	285,878 615,756	1,345 696
999				1,951
000	107,745	45,011	1,049,636	1,931
001	139,799	60,489	1,477,643 1,998,782	
002	192,274	44,993	, ,	354
003	226,154	68,817	2,016,550	171
004	222,550	63,060	2,332,092	86
005	254,291	72,953	2,457,412	43
006	251,379	26,873	2,612,653	49
007	258,075	29,868	2,875,183	62
008	257,480	21,284	2,790,358	19
0094	217,951	12,547	2,838,826	16
ombined Heat and Power, Electric Power	16,266	12 (22	1,044,352	27.725
998 999	16,230	13,632 13,864	1,090,356	27,735 18,062
			1,113,595	
000	18,741	14,559		23,512
001	18,365	12,346	1,178,371	15,201
002	17,430	12,783	1,413,431	27,406
003	21,578	10,028	1,354,901	34,918
004	21,494	10,897	1,322,228	53,031
005	21,845	10,357	1,276,874	83,858
006	21,867	8,867	1,131,051	64,136
007	22,301	8,613	1,229,808	59,812
008	22,774	7,296	1,147,887	59,412
0095	20,061	7,883	1,121,944	52,911
ombined Heat and Power, Commercial ⁵	1 442	1 007	07.220	0.5
998	1,443	1,807	87,220	95
999	1,490	1,613	84,037	*
000	1,547	1,615	84,874	*
001	1,448	1,832	78,655	*
002	1,405	1,250	73,975	*
003	1,816	1,449	58,453	
004	1,917	2,009	72,072	
005	1,922	1,630	67,957	
006	1,886	935	67,735	1
007	1,927	752	70,074	
008	2,021	671	66,216	
009	1,798	521	75,555	
ombined Heat and Power, Industrial ⁵				
998	28,553	38,910	1,354,986	304,641
999	27,763	37,312	1,401,374	331,342
000	28,031	30,520	1,385,546	330,590
001	25,755	26,817	1,309,636	248,176
002	26,232	25,163	1,240,209	245,171
	24,846	26,212	1,143,734	252,975
003	26,613	28,857	1,190,844	295,158
				264,319
004		27.380	1,083.607	204.319
004	25,875	27,380 22,706	1,083,607 1,114,597	
003 004 005 006 007	25,875 25,262	22,706	1,114,597	276,585
004	25,875			

¹ Includes anthracite, bituminous, subbituminous and lignite coal. Waste and synthetic coal were included starting in 2002.

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

Blast furnace gas, propane gas, and other manufactured and waste gases derived from fossil fuels.

⁴ Electric utility CHP plants are included in Electricity Generators, Electric Utilities.

⁵ Small number of electricity-only, non-Combined Heat and Power plants may be included.

^{* =} Value is less than half of the smallest unit of measure.

Note: Totals may not equal sum of components because of independent rounding

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report;" Form EIA-860, "Annual Electric Generator Report.

Table 3.4. End-of-Year Stocks of Coal and Petroleum by Type of Producer, 1998 through 2009

	Electric P	ower Sector	Electric U	J tilities	Independent Power Producers		
Period	Coal (Thousand Tons) ¹	Petroleum (Thousand Barrels) ²	Coal (Thousand Tons) ¹	Petroleum (Thousand Barrels) ²	Coal (Thousand Tons)	Petroleum (Thousand Barrels)	
998	120,501	56,591	120,501	56,591	NA	NA	
999	141,604	54,109	129,041	46,169	12,563	7,940	
2000	102,296	40,932	90,115	30,502	12,180	10,430	
2001	138,496	57,031	117,147	37,308	21,349	19,723	
.002	141,714	52,490	116,952	31,243	24,761	21,247	
003	121,567	53,170	97,831	29,953	23,736	23,218	
.004	106,669	51.434	84.917	32,281	21.751	19,153	
005	101.137	50,062	77.457	31.400	23.680	18,661	
.006	140,964	51,583	110,277	32,082	30,688	19,502	
007	151,221	47,203	120,504	29,297	30,717	17,906	
008	161,589	44,498	127,463	28,450	34,126	16,048	
2009	189,467	46,181	154,815	31,778	34,652	14,402	

¹ Anthracite, bituminous, subbituminous, lignite, and synthetic coal, excludes waste coal.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report;" Form EIA-860, "Annual Electric Generator Report."

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology). Data prior to 2005 includes small quantities of waste oil.

NA = Not available

Note: Totals may not equal sum of components because of independent rounding.

Receipts, Average Cost, and Quality of Fossil Fuels for the Electric Power Industry, 1998 **Table 3.5.** through 2009

	tiii ougii z	Coal	l ¹			Petrol	eum²		Natura	ıl Gas³	All Fossil Fuels
Period	Receipts	Averag	ge Cost	Avg. Sulfur	Receipts	Averag	ge Cost	Avg. Sulfur	Receipts	Average Cost	Average Cost
	(thousand tons)	(cents per MMBtu)	(dollars/ ton)	Percent by Weight	(thousand barrels)	(cents per MMBtu)	(dollars/ barrel)	Percent by Weight ⁴	(thousand Mcf)	(cents per MMBtu)	(cents per MMBtu)
1998	929,448	125	25.64	1.06	181,276	202	12.71	1.48	2,922,957	238	144
1999	908,232	122	24.72	1.01	145,939	236	14.81	1.51	2,809,455	257	144
2000	790,274	120	24.28	.93	108,272	418	26.30	1.33	2,629,986	430	174
2001	762,815	123	24.68	.89	124,618	369	23.20	1.42	2,148,924	449	173
2002	884,287	125	25.52	.94	120,851	334	20.77	1.64	5,607,737	356	186
20035	986,026	128	26.00	.97	185,567	433	26.78	1.53	5,500,704	539	228
2004	1,002,032	136	27.42	.97	186,655	429	26.56	1.66	5,734,054	596	248
2005	1,021,437	154	31.20	.98	194,733	644	39.65	1.61	6,181,717	821	325
2006	1,079,943	169	34.09	.97	100,965	623	37.66	2.31	6,675,246	694	302
2007	1,054,664	177	35.48	.96	88,347	717	43.50	2.10	7,200,316	711	323
2008	1,069,709	207	41.14	.97	96,341	1,087	64.89	2.21	7,879,046	902	411
2009	981,477	221	43.74	1.01	88,951	702	41.64	2.14	8,118,550	474	304

Anthracite, bituminous, subbituminous, lignite, waste coal, and synthetic coal.

Notes: • Mcf equals 1,000 cubic feet. Totals may not equal sum of components because of independent rounding. • Beginning in 2008 with the Form EIA-923, receipts, cost, and quality data are imputed for plants between 1 and 50 MW, in addition to the data collected from plants above the 50 MW threshold. Therefore, there may be a notable increase in fuel receipts beginning with 2008 data.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report" and predecessor form(s) including U.S. Energy Information Administration, Form EIA-423, "Monthly Cost and Quality of Fuels for Electric Plants Report;" Federal Energy Regulatory Commission, FERC Form 423, "Monthly Report of Cost and Quality of Fuels for Electric Plants."

Receipts and Quality of Coal Delivered for the Electric Power Industry, 1998 through **Table 3.6.**

	F	Anthracite ¹			Bituminous ¹			Subbituminous			Lignite		
Period	Receipts (thousand tons)	Avg. Sulfur Percent by Weight	Avg. Ash Percent by Weight	Receipts (thousand tons)	Avg. Sulfur Percent by Weight	Avg. Ash Percent by Weight	Receipts (thousand tons)	Avg. Sulfur Percent by Weight	Avg. Ash Percent by Weight	Receipts (thousand tons)	Avg. Sulfur Percent by Weight	Avg. Ash Percent by Weight	
1998	511	.55	37.6	478,252	1.61	10.5	373,496	.38	6.6	77,189	.95	13.8	
1999	137	.64	37.8	444,399	1.57	10.2	386,271	.38	6.6	77,425	.90	14.2	
2000	11	.64	37.2	375,673	1.45	10.1	341,242	.35	6.3	73,349	.91	14.2	
2001				348,703	1.42	10.4	349,340	.35	6.1	64,772	.98	13.9	
2002				412,589	1.47	10.1	391,785	.36	6.2	65,555	.93	13.3	
2003 ²				436,809	1.49	9.9	432,513	.38	6.4	79,869	1.03	14.4	
2004				441,186	1.50	10.3	445,603	.36	6.0	78,268	1.05	14.2	
2005				451,680	1.55	10.5	456,856	.36	6.2	77,677	1.02	14.0	
2006				462,992	1.57	10.5	504,947	.35	6.1	75,742	.95	14.4	
2007				439,154	1.61	10.3	505,155	.34	6.0	71,930	.90	14.0	
2008				463,943	1.68	10.6	522,228	.34	5.8	68,945	.86	13.8	
2009				418,688	1.77	10.5	484,007	.34	5.8	64,966	.95	14.0	

Beginning in 2001, anthracite coal receipts were no longer reported separately. From 2001 forward, all anthracite coal receipts have been combined with bituminous coal receipts.

Notes: • Totals may not equal sum of components because of independent rounding. • Beginning in 2008 with the Form EIA-923, receipts, cost, and quality data are imputed for plants between 1 and 50 MW, in addition to the data collected from plants above the 50 MW threshold. Therefore, there may be a notable increase in fuel receipts beginning with 2008 data. Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report" and predecessor form(s) including U.S. Energy Information Administration, Form EIA-423, "Monthly Cost and Quality of Fuels for Electric Plants Report;" Federal Energy Regulatory Commission, FERC Form 423, "Monthly Report of Cost and Quality of Fuels for Electric Plants.'

² Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

Natural gas, including a small amount of supplemental gaseous fuels that cannot be identified separately. Natural gas values for 2001 forward do not include blast furnace gas or other

gas.

4 Beginning in 2006, receipts of petroleum liquids went down substantially, while the receipts of petroleum coke remained the nearly the same. The Average Sulfur Percent by Weight is higher beginning in 2006 as a result the greater influence by petroleum coke receipts, which has higher sulfur content, than the petroleum liquid receipts.

⁵ Beginning in 2002, data from the historical Form EIA-423 for independent power producers and combined heat and power producers are included in this table. Prior to 2002, these data were not collected; the data for 2001 and previous years include only data collected from electric utilities via the historical FERC Form 423.

² Beginning in 2002, data from the historical Form EIA-423 for independent power producers and combined heat and power producers are included in this table. Prior to 2002, these data were not collected; the data for 2001 and previous years include only data collected from electric utilities via the historical FERC Form 423.

Table 3.7. Average Quality of Fossil Fuel Receipts for the Electric Power Industry, 1998 through

	107					
		Coal ¹		Petrol	Natural Gas ³	
Year	Average Btu per Pound	Average Sulfur Percent by Weight	Average Ash Percent by Weight	Average Btu per Gallon	Average Sulfur Percent by Weight	Average Btu per Cubic Foot
1998	10,241	1.06	9.18	149,736	1.48	1,022
1999	10,163	1.01	9.01	149,407	1.51	1,019
2000	10,115	.93	8.84	149,857	1.33	1,020
2001	10,200	.89	8.80	147,857	1.42	1,020
2002	10,168	.94	8.74	147,902	1.64	1,025
2003 ⁴	10,137	.97	8.98	147,086	1.53	1,030
2004	10,074	.97	8.97	147,286	1.66	1,027
2005	10,107	.98	9.02	146,481	1.61	1,028
2006	10,063	.97	9.03	143,883	2.31	1,027
2007	10,028	.96	8.84	144,545	2.10	1,027
2008	9,947	.97	8.95	142,205	2.21	1,027
2009	9,902	1.01	8.94	141,321	2.14	1,025

¹ Anthracite, bituminous, subbituminous, lignite, waste coal, and synthetic coal.

Distillate fuel oil (all diesel and No. 1, No. 2, and No. 4 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil), jet fuel, kerosene, petroleum coke (converted to liquid petroleum, see Technical Notes for conversion methodology), and waste oil.

Natural gas, including a small amount of supplemental gaseous fuels that cannot be identified separately. Natural gas values for 2001 forward do not include blast furnace gas or other

gas.

4 Beginning in 2002, data from the historical Form EIA-423 for independent power producers and combined heat and power producers are included in this table. Prior to 2002, these data were not collected; the data for 2001 and previous years include only data collected from electric utilities via the historical FERC Form 423.

Note: Totals may not equal sum of components because of independent rounding.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report" and predecessor form(s) including U.S. Energy Information Administration, Form EIA-423, "Monthly Cost and Quality of Fuels for Electric Plants Report;" Federal Energy Regulatory Commission, FERC Form 423, "Monthly Report of Cost and Quality of Fuels for Electric Plants."

Table 3.8. Weighted Average Cost of Fossil Fuels for the Electric Power Industry, 1998 through 2009

				Co	oal						• • • • • • • • • • • • • • • • • • • •				
	Bitun	ninous	Subbiti	uminous	Lig	nite	All Coa	l Ranks	Petro	leum	Natur	al Gas	Total Fo	Total Fossil Fuels	
Period	Receipts (trillion Btu)	Average Cost (cents per MMBtu)	Receipts (trillion Btu)	Average Cost (cents per MMBtu)	Receipts (trillion Btu)	Average Cost (cents per MMBtu)									
1998	11,510	135	6,520	113	999	94	19,036	125	1,140	202	2,986	238	23,162	144	
1999	10,722	131	6,740	110	996	93	18,461	122	916	236	2,862	257	22,238	144	
2000	9,050	130	5,991	108	947	94	15,988	120	681	418	2,682	430	19,351	174	
2001	8,312	139	6,134	104	839	109	15,286	123	783	369	2,209	449	18,278	173	
2002	9,932	142	6,878	105	851	104	17,982	125	751	334	5,750	356	24,483	186	
2003	10,543	144	7,598	110	1,026	103	19,990	128	1,146	433	5,663	539	26,799	228	
2004	10,538	156	7,817	112	1,012	106	20,189	136	1,155	429	5,891	596	27,234	248	
2005	10,833	184	8,004	119	1,008	107	20,647	154	1,198	644	6,357	821	28,202	325	
2006	11,129	204	8,842	131	982	115	21,735	169	610	623	6,856	694	29,201	302	
2007	10,580	208	8,826	145	925	128	21,152	177	536	717	7,396	711	29,085	323	
2008	11,110	250	9,087	162	896	141	21,280	207	575	1,087	8,089	902	29,945	411	
2009	10,010	275	8,421	164	835	158	19,438	221	528	702	8,319	474	28,285	304	

Notes: • Totals may not equal sum of components because of independent rounding. • Beginning in 2008 with the Form EIA-923, receipts, cost, and quality data are imputed for plants between 1 and 50 MW, in addition to the data collected from plants above the 50 MW threshold. Therefore, there may be a notable increase in fuel receipts beginning with 2008 data. Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report" and predecessor form(s) including U.S. Energy Information Administration, Form EIA-423, "Monthly Cost and Quality of Fuels for Electric Plants Report;" Federal Energy Regulatory Commission, FERC Form 423, "Monthly Report of Cost and Quality of Fuels for Electric Plants."

Table 3.9. Emissions from Energy Consumption at Conventional Power Plants and Combined-Heatand-Power Plants, 1998 through 2009

(Thousand Metric Tons)

Emission	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Carbon Dioxide (CO ₂)	2,269,508	2,484,012 ^R	2,547,032 ^R	2,488,918 ^R	2,543,838 ^R	2,486,982 ^R	2,445,094 ^R	2,423,963 ^R	2,418,607 ^R	2,470,834 ^R	2,366,302 ^R	2,351,600 ^R
Sulfur Dioxide (SO ₂)	5,970	7,830	9,042	9,524	10,340	10,309	10,646	10,881	11,174	11,963	12,843	13,464
Nitrogen Oxides (NO _x)	2,395	3,330	3,650	3,799	3,961	4,143	4,532	5,194	5,290	5,638	5,955	6,459

R = Revised

Table 3.10. Number and Capacity of Existing Fossil-Fuel Steam-Electric Generators with Environmental Equipment, 1998 through 2009

Year		sulfurization bbers)	Particulate	e Collectors	Cooling	Towers	Total ¹		
rear	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity ² (megawatts)	Number of Generators	Capacity (megawatts)	
1998	186	87,783	1,130	351,790	474	166,896	1,294	377,117	
1999	192	89,666	1,148	353,480	505	175,520	1,343	387,192	
2000	192	89,675	1,141	352,727	505	175,520	1,336	386,438	
2001	236	97,988	1,273	360,762	616	189,396	1,485	390,821	
2002	243	98,673	1,256	359,338	670	200,670	1,522	401,341	
2003	246	99,567	1,244	358,009	695	210,928	1,546	409,954	
2004	248	101,492	1,217	355,782	732	214,989	1,536	409,769	
2005	248	101,648	1,216	355,599	730	217,646	1,535	411,840	
2006	NA	NA	NA	NA	NA	NA	NA	NA	
2007 ^R	278	119,024	1,188	354,407	771	228,704	1,547	421,120	
2008 ^R	327	140,223	1,187	355,517	789	234,254	1,556	426,073	
2009	384	167,517	1,188	358,342	818	241,347	1,573	430,956	

¹ Components are not additive since some generators are included in more than one category.

Notes: • Data for 2007 through 2009 reflect a minor revision to the aggregation methodology as compared to previous years. The new methodology takes generator status into account where previously the data only reflected boiler and flue gas desulfurization unit statuses. • Data for Independent Power Producer and Combined Heat and Power plants are included beginning with 2001 data. • Totals may not equal sum of components because of independent rounding.

Table 3.11. Average Costs of Existing Flue Gas Desulfurization Units, 1998 through 2009

Year	Average Operation & Maintenance Costs (mills per kilowatthour) ¹	Average Installed Capital Costs (dollars per kilowatt)
1998	1.12	126.00
1999	1.13	125.00
2000	.96	124.00
2001	1.27	130.80
2002	1.11	124.18
2003	1.23	123.75
2004	1.38	144.64
2005	1.23	141.34
2006	NA	NA
2007	1.51 ^R	135.29 ^R
2008	1.55	150.74 ^R
2009	1.61	186.73

¹ A mill is one tenth of one cent.

Notes: • The emissions data presented include total emissions from both electricity generation and the production of useful thermal output. • See Appendix A, Technical Notes, for a description of the sources and methodology used to develop the emissions estimates. • CO2 emissions for the historical years 1998-2008 have been revised due to changes in emission factors.

Source: Calculations made by the Office of Electricity, Renewables, and Uranium Statistics, U.S. Energy Information Administration.

² Nameplate capacity.

NA = Not available. Form EIA-767 data collection was suspended in the data year 2006.

R = Revised

Sources: Through 2005, U.S. Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report;" and from 2007 forward, U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

NA = Not available. Form EIA-767 data collection was suspended in the data year 2006.

R = Revised.

Notes: • Data for 2007 through 2009 reflect a minor revision to the aggregation methodology as compared to previous years. The new methodology takes generator status into account where previously the data only reflected boiler and flue gas desulfurization unit statuses. • Data for Independent Power Producer and Combined Heat and Power plants are included beginning with 2001 data. • Totals may not equal sum of components because of independent rounding.

Sources: Through 2005, U.S. Energy Information Administration, Form EIA-767, "Steam-Electric Plant Operation and Design Report;" and from 2007 forward, U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report" for Average Installed Capital Costs, and Form EIA-923, "Power Plant Operations Report" for Average Operation & Maintenance Costs.

Chapter 4. Demand	Capacity	Resources, and	d Capacity	Margins
-------------------	----------	----------------	------------	---------

Table 4.1. Noncoincident Peak Load, Actual and Projected by North American Electric Reliability Corporation Region, 2005 through 2014

(Megawatts)

North American Electric			Actual		
Reliability Corporation Regional Entity	2005	2006	2007	2008	2009
		Sumr	ner		
ECAR ¹	NA	NA	NA	NA	NA
ERCOT	60,210	62,339	62,188	62,174	63,518
FRCC	46,396	45,751	46,676	44,836	46,550
MAAC ¹	NA	NA	NA	NA	NA
MAIN ¹	NA	NA	NA	NA	NA
MRO (U.S.) ²	39,918	42,194	41.684	39.677	37,963
NPCC (U.S.)	58,960	63,241	58,314	58,543	55,944
ReliabilityFirst ³	190,200	191,920	181,700	169,155	161,241
SERC	190,705	199,052	209,109	199,779	191.032
SPP	41,727	42,882	43,167	43,476	41,465
	130.760	142.096	139.389	134.829	
WECC (U.S.)		,	,	. ,	128,245
Contiguous U.S.	758,876	789,475 Wir	782,227	752,470	725,958
ECAR ¹	NA	NA NA	NA	NA	NA
ERCOT	48,141	50,402	50,408	47,806	56,191
FRCC	42,657	42,526	41,701	45,275	53,022
MAAC ¹	NA	NA	NA	NA	NA
MAIN ¹	NA	NA	NA	NA	NA
MRO (U.S.) ²	33,748	34,677	33,191	36,029	35,351
NPCC (U.S.)	46,828	46,697	46,795	46,043	44,864
ReliabilityFirst ³	151,600	149,631	141,900	142,395	143,827
SERC	164,638	175,163	179,888	179,596	193,135
SPP	31,260	30,792	31,322	32,809	32,863
WECC (U.S.)	107,493	111,093	112,700	113,605	109,565
Contiguous U.S.	626,365	640,981	637,905	643,557	668,818
North American Electric			Projected		
Reliability Corporation Regional			•		
Entity	2010	2011	2012	2013	2014
		Sumr	nor	<u> </u>	
ΓRE (formerly ERCOT)	63,810	64,964	66,416	68,023	69,209
FRCC	46,006	46,124	46,825	47,469	48,059
MRO (U.S.) ²	42,240	· ·	43,549	44,164	44,627
		42,733	· ·	*	62,922
NPCC (U.S.)	60,215	60,820	61,532	62,307	
ReliabilityFirst ³	177,688	181,867	186,900	189,900	192,000
SERC	201,350	205,351	210,521	214,295	218,126
SPP	43,395	44,005	45,289	46,012	46,579
WECC (U.S.)	137,385	139,205	132,868	133,216	136,402
Contiguous U.S.	772,089	785,069	793,900	805,386	817,924
		Wir		45,819	16.579
TPE (formark, EPCOT)	42 022			41819	46,578
	43,823	43,823	44,804		
FRCC	46,235	43,823 46,821	47,558	48,219	48,992
FRCCMRO (U.S.) ²	46,235 35,722	43,823 46,821 36,816	47,558 37,359	48,219 37,876	38,324
FRCCMRO (U.S.) ²	46,235 35,722 46,374	43,823 46,821 36,816 46,529	47,558 37,359 46,753	48,219 37,876 47,154	38,324 47,401
FRCC	46,235 35,722 46,374 143,040	43,823 46,821 36,816 46,529 146,591	47,558 37,359 46,753 149,000	48,219 37,876 47,154 150,300	38,324 47,401 151,400
FRCC	46,235 35,722 46,374 143,040 183,614	43,823 46,821 36,816 46,529 146,591 186,364	47,558 37,359 46,753 149,000 190,065	48,219 37,876 47,154 150,300 193,158	38,324 47,401 151,400 195,703
TRE (formerly ERCOT) FRCC MRO (U.S.) 2 NPCC (U.S.) ReliabilityFirst3 SERC SPP	46,235 35,722 46,374 143,040 183,614 31,415	43,823 46,821 36,816 46,529 146,591 186,364 33,047	47,558 37,359 46,753 149,000 190,065 33,884	48,219 37,876 47,154 150,300 193,158 34,423	38,324 47,401 151,400 195,703 34,951
FRCC	46,235 35,722 46,374 143,040 183,614	43,823 46,821 36,816 46,529 146,591 186,364	47,558 37,359 46,753 149,000 190,065	48,219 37,876 47,154 150,300 193,158	38,324 47,401 151,400 195,703

¹ ECAR, MAAC, and MAIN dissolved at the end of 2005. Utility membership joined other reliability regional councils. Also, see Footnote 3.

Notes: • Projected data are updated annually, so revision superscript is not used. • NERC Regions are provided in Appendix A., Technical Notes. • Represents an hour of a day during the associated peak period. • The summer peak period begins on June 1 and extends through September 30. • The winter peak period begins on December 1 and extends through the end of February of the following year • The MRO, SERC, and SPP regional boundaries were altered as a variety of utilities changed reliability organizations. The historical data series have not been adjusted. • Totals may not equal sum of components because of independent rounding.

² Regional name has changed from Mid-Continent Area Power Pool to Midwest Reliability Organization.

³ ReliabilityFirst Corporation (RFC) came into existence on January 1, 2006, and submitted a consolidated filing covering the historical NERC regions of ECAR, MAAC, and MAIN. Many of the former utility members joined RFC.

NA = Not available.

Table 4.2. Net Internal Demand, Capacity Resources, and Capacity Margins by North American Electric Reliability Corporation Region, Summer, 1998 through 2009

(Megawatts)

Regional Entity and Item	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
					ECAR ¹							
Net Internal Demand ²	NA	NA	NA	NA	NA	95,300	98,487	101,251	100,235	98,651	94,072	92,359
Capacity Resources ³	NA	NA	NA	NA	NA	127,919	123,755	119,736	113,136	115,379	107,451	105,545
Capacity Margin (percent) ⁴	NA	NA	NA	NA	NA	25.5	20.4	15.4	11.4	14.5	12.5	12.5
					ormerly E							
Net Internal Demand ²	63,518	61,049	61,063	61,214	59,060	58,531	59,282	55,833	55,106	53,649	51,697	50,254
Capacity Resources ³ Capacity Margin (percent) ⁴	76,280 16.7	74,274 17.8	75,912 19.6	70,664 13.4	66,724 11.5	73,850 20.7	74,764 20.7	76,849 27.3	70,797 22.2	69,622 22.9	65,423 21.0	59,788 15.9
Capacity Margin (percent)	10./	17.0	19.0	13.4	FRCC	20.7	20.7	21.3		22.9	21.0	13.9
Net Internal Demand ²	46,263	44,660	46,434	45,345	45,950	42,243	40,387	37,951	38,932	35,666	34,832	34,562
Capacity Resources ³	49,239	51,541	53,027	50,909	50,200	48,579	46,806	43,342	42,290	43,083	40,645	39,708
Capacity Margin (percent)	6.0	13.4	12.4	10.9	8.5	13.0	13.7	12.4	7.9	17.2	14.3	13.0
enpress growing and growing an					MAAC ¹					-,,-		
Net Internal Demand ²	NA	NA	NA	NA	NA	52,049	53,566	54,296	54,015	51,358	49,325	47,626
Capacity Resources ³	NA	NA	NA	NA	NA	66,167	65,897	63,619	59,533	60,679	57,831	55,511
Capacity Margin (percent) ⁴	NA	NA	NA	NA	NA	21.3	18.7	14.7	9.3	15.4	14.7	14.2
					MAIN ¹							
Net Internal Demand ²	NA	NA	NA	NA	NA	50,499	53,617	53,267	53,032	51,845	47,165	45,570
Capacity Resources ³	NA	NA	NA	NA	NA	65,677	67,410	67,025	65,950	64,170	55,984	52,722
Capacity Margin (percent) ⁴	NA	NA	NA	NA	NA	23.1	20.5	20.5	19.6	19.2	15.8	13.6
				MF	RO (U.S.)	5						
Net Internal Demand ²	35,849	38,857	40,249	40,661	38,266	29,094	28,775	28,825	27,125	28,006	30,606	29,766
Capacity Resources ³	47,529	48,180	47,259	50,116	46,792	35,830	33,287	34,259	32,271	34,236	35,373	34,773
Capacity Margin (percent) ⁴	24.6	19.3	14.8	18.9	18.2	18.8	13.6	15.9	15.9	18.2	13.5	14.4
27.7					CC (U.S.)		** ** *		****			-1 -10
Net Internal Demand ²	55,730	59,896	58,221	60,879	57,402	51,580	53,936	55,164 66,208	55,888	54,270	53,450	51,760
Capacity Resources ³ Capacity Margin (percent) ⁴	78,639 29.1	75,894 21.1	73,771 21.1	73,095 16.7	72,258 20.6	71,532 27.9	70,902 23.9	16.7	63,760 12.3	63,376 14.4	63,077 15.3	60,439 14.4
Capacity Margin (percent)	27.1	21.1	21.1		ability <i>Fi</i>		23.7	10.7	12.3	17.7	13.3	17.7
Net Internal Demand ²	161,241	169,155	177,200	190,800	190,200	NA NA	NA	NA	NA	NA	NA	NA
Capacity Resources ³	215,700	215,477	213,544	214,693	220,000	NA	NA	NA NA	NA NA	NA	NA	NA
Capacity Margin (percent) ⁴	25.2	21.5	17.0	11.1	13.5	NA						
					SERC							
Net Internal Demand ²	186,507	196,711	205,321	196,196	186,049	153,024	148,380	154,459	144,399	151,527	142,726	138,146
Capacity Resources3	247,400	228,169	234,232	223,630	219,749	182,861	177,231	172,485	171,530	169,760	160,575	158,360
Capacity Margin (percent) ⁴	24.6	13.8	12.3	12.3	15.3	16.3	16.3	10.5	15.8	10.7	11.1	12.8
					SPP							
Net Internal Demand ²	41,117	42,906	42,459	41,982	41,079	39,383	39,428	38,298	38,807	39,056	37,807	36,402
Capacity Resources ³	49,194	48,110	48,573	45,831	46,376	48,000	45,802	47,233	45,530	46,109	43,111	42,554
Capacity Margin (percent) ⁴	16.4	10.8	12.6	8.4	11.4	18.0	13.9	18.9	14.8	15.3	12.3	14.5
2					CC (U.S.)							
Net Internal Demand ²	122,881	130,916	135,839	139,402	128,464	121,205	120,894	117,032	107,294	116,913	112,177	111,641
Capacity Margin (narrount) ⁴	152,467	167,860	168,080	162,288	160,026	155,455	150,277	142,624	124,193	141,640	136,274	135,270
Capacity Margin (percent) ⁴	19.4	22.0	19.2	14.1	19.7	22.0	19.6	17.9	13.6	17.5	17.7	17.5
Not Internal Day 12	712 107	744 151	7((70(guous U.S		(0) 773	(0(25)	(74.022	(00.041	(52.055	(20.007
Net Internal Demand ² Capacity Resources ³	713,106 916,449	744,151 909,504	766,786 914,397	776,479 891,226	746,470 882,125	692,908 875,870	696,752 856,131	696,376 833,380	674,833 788,990	680,941 808,054	653,857 765,744	638,086 744,670
Capacity Margin (percent) ⁴	22.2	18.2	16.1	12.9	15.4	20.9	18.6	16.4	14.5	15.7	14.6	14.3

¹ ECAR, MAAC, and MAIN dissolved at the end of 2005. Utility membership joined other reliability regional councils. Also, see Footnote 6.

NA = Not available.

Notes: • NERC Regions are provided in Appendix A., Technical Notes. • Represents an hour of a day during the associated peak period. • The summer peak period begins on June 1 and extends through September 30. • The MRO, SERC, and SPP regional boundaries were altered as a variety of utilities changed reliability organizations. The historical data series have not been adjusted. • Totals may not equal sum of components because of independent rounding.

² Net Internal Demand represent the system demand that is planned for by the electric power industry's reliability authority and is equal to Internal Demand less Direct Control Load Management and Interruptible Demand.

³ Capacity Resources: Utility- and IPP-owned generating capacity that is existing or in various stages of planning or construction, less inoperable capacity, plus planned capacity purchases from other resources, less planned capacity sales.

⁴ Capacity Margin is the amount of unused available capability of an electric power system at peak load as a percentage of capacity resources.

⁵ Regional name has changed from Mid-Continent Area Power Pool to Midwest Reliability Organization.

⁶ ReliabilityFirst Corporation (RFC) came into existence on January 1, 2006, and submitted a consolidated filing covering the historical NERC regions of ECAR, MAAC, and MAIN. Many of the former utility members joined RFC.

Table 4.3. Net Internal Demand, Actual or Planned Capacity Resources, and Capacity Margins by North American Electric Reliability Corporation Region, Summer, 2009 through 2014

(Megawatts)

North American Electric Reliability Corporation Regional Entity	Net Internal Demand ¹	Capacity Resources ²	Capacity Margin (percent) ³	Net Internal Demand ¹	Capacity Resources ²	Capacity Margin (percent) ³
		2009			2010	
TRE (formerly ERCOT)	63,518	76,280	16.7	62,412	75,181	17.0
FRCC	46,263	49,239	6.0	42,820	53,826	20.4
MRO (U.S.) ⁴	35,849	47,529	24.6	39,343	50,633	22.3
NPCC (U.S.)	55,730	78,639	29.1	60,001	73,341	18.2
ReliabilityFirst ⁵	161,241	215,700	25.2	171,488	219,583	21.9
SERC	186,507	247,400	24.6	195,833	247,674	20.9
SPP	41,117	49,194	16.4	42,976	53,298	19.4
WECC (U.S.)	122,881	152,467	19.4	124,924	161,358	22.6
Contiguous U.S	713,106	916,449	22.2	739,798	934,894	20.9
		2011			2012	
TRE (formerly ERCOT)	63,532	73,075	13.1	64,947	74,733	13.1
FRCC	42,831	54,441	21.3	43,409	55,117	21.2
MRO (U.S.) ⁴	39,823	51,748	23.0	40,618	51,645	21.4
NPCC (U.S.)	60,606	74,602	18.8	61,318	79,319	22.7
ReliabilityFirst ⁵	175,367	226,033	22.4	177,600	230,107	22.8
SERC	199,297	252,732	21.1	204,045	256,713	20.5
SPP	43,567	55,576	21.6	44,834	56,477	20.6
WECC (U.S.)	126,318	170,649	26.0	127,495	176,431	27.7
Contiguous U.S	751,342	958,855	21.6	764,267	980,542	22.1
		2013			2014	
TRE (formerly ERCOT)	66,514	75,435	11.8	67,655	76,191	11.2
FRCC	43,899	56,923	22.9	44,451	57,097	22.1
MRO (U.S.) ⁴	41,224	51,967	20.7	41,675	51,986	19.8
NPCC (U.S.)	62,093	78,424	20.8	62,708	78,374	20.0
ReliabilityFirst ⁵	180,600	232,543	22.3	182,700	232,924	21.6
SERC	207,756	260,524	20.3	211,512	262,024	19.3
SPP	45,544	57,154	20.3	46,102	58,368	21.0
WECC (U.S.)	127,459	179,803	29.1	130,302	181,327	28.1
Contiguous U.S	775,088	992,773	21.9	787,105	998,292	21.2

¹ Net Internal Demand represent the system demand that is planned for by the electric power industry's reliability authority and is equal to Internal Demand less Direct Control Load Management and Interruptible Demand.

² Capacity Resources: Utility- and IPP-owned generating capacity that is existing or in various stages of planning or construction, less inoperable capacity, plus planned capacity purchases from other resources, less planned capacity sales.

³ Capacity Margin is the amount of unused available capability of an electric power system at peak load as a percentage of capacity resources.

⁴ Regional name has changed from Mid-Continent Area Power Pool to Midwest Reliability Organization.

⁵ ReliabilityFirst Corporation (RFC) came into existence on January 1, 2006, and submitted a consolidated filing covering the historical NERC regions of ECAR, MAAC, and MAIN. Many of the former utility members joined RFC.

Notes: • 2009 data are final. • Projected data are updated annually, so revision superscript is not used. • Represents an hour of a day during the associated peak period. • The summer peak period begins on June 1 and extends through September 30. • The MRO, SERC, and SPP regional boundaries were altered as utilities changed reliability organizations. The historical data series have not been adjusted. • Totals may not equal sum of components because of independent rounding.

Table 4.4. Net Internal Demand, Actual or Planned Capacity Resources, and Capacity Margins by North American Electric Reliability Corporation Region, Winter, 2009 through 2014 (Megawatts)

North American Electric Reliability Corporation Regional Entity	Net Internal Demand ¹	Capacity Resources ²	Capacity Margin (percent) ³	Net Internal Demand ¹	Capacity Resources ²	Capacity Margin (percent) ²
		2009/ 2010			2010/ 2011	
TRE (formerly ERCOT)	56,191	69,490	19.1	43,487	76,385	43.1
FRCC	51,703	52,751	2.0	42,716	57,952	26.3
MRO (U.S.) ⁴	33,983	46,422	26.8	34,091	52,585	35.2
NPCC (U.S.)	44,864	78,992	43.2	46,374	73,083	36.5
ReliabilityFirst ⁵	143,827	215,700	33.3	143,040	218,752	34.6
SERC	188,653	255,527	26.2	178,614	253,918	29.7
SPP	32,741	50,097	34.6	31,197	56,009	44.3
WECC (U.S.)	106,256	151,022	29.6	100,580	159,643	37.0
Contiguous U.S.	658,219	920,002	28.5	620,100	948,326	34.6
	·	2011/2012			2012/ 2013	
TRE (formerly ERCOT)	43,453	77,343	43.8	44,397	78,381	43.4
FRCC	43,197	58,972	26.8	43,801	59,696	26.6
MRO (U.S.) ⁴	35,178	53,567	34.3	35,687	53,567	33.4
NPCC (U.Ś.)	46,529	75,244	38.2	46,753	79,602	41.3
ReliabilityFirst ⁵	146,591	225,259	34.9	149,000	229,644	35.1
SERC	181,129	260,021	30.3	184,379	262,157	29.7
SPP	32,819	56,435	41.8	33,645	57,674	41.7
WECC (U.S.)	103,663	168,753	38.6	105,211	174,613	39.7
Contiguous U.S.	632,559	975,595	35.2	642,873	995,334	35.4
	,	2013/ 2014			2014/ 2015	
TRE (formerly ERCOT)	45,372	79,199	42.7	46,086	79,976	42.4
FRCC	44,457	61,113	27.3	45,174	61,628	26.7
MRO (U.S.) ⁴	36,187	53,592	32.5	36,614	53,475	31.5
NPCC (U.S.)	47,154	78,942	40.3	47,401	78,943	40.0
ReliabilityFirst ⁵	150,300	231,415	35.1	151,400	231,795	34.7
SERC	187,415	267,999	30.1	189,890	269,724	29.6
SPP	34,177	58,004	41.1	34,703	59,245	41.4
WECC (U.S.)	107,438	178,495	39.8	109,208	179,961	39.3
Contiguous U.S.	652,500	1,008,759	35.3	660,476	1,014,748	34.9

¹ Net Internal Demand represent the system demand that is planned for by the electric power industry's reliability authority and is equal to Internal Demand less Direct Control Load Management and Interruptible Demand.

² Capacity Resources: Utility- and IPP-owned generating capacity that is existing or in various stages of planning or construction, less inoperable capacity, plus planned capacity purchases from other resources, less planned capacity sales.


³ Capacity Margin is the amount of unused available capability of an electric power system at peak load as a percentage of capacity resources.

⁴ Regional name has changed from Mid-Continent Area Power Pool to Midwest Reliability Organization.

⁵ ReliabilityFirst Corporation (RFC) came into existence on January 1, 2006, and submitted a consolidated filing covering the historical NERC regions of ECAR, MAAC, and MAIN. Many of the former utility members joined RFC.


Notes: • 2009/2010 data are final. • Projected data are updated annually, so revision superscript is not used. • Represents an hour of a day during the associated peak period. • The winter peak period begins on December 1 and extends through the end of February of the following year. For example, winter 2004/2005 begins December 1, 2004, and extends to February 28, 2005 • The MRO, SERC, and SPP regional boundaries were altered as a variety of utilities changed reliability organizations. The historical data series have not been adjusted. • Totals may not equal sum of components because of independent rounding.

Historical North American Electric Reliability Council Regions for Figure 4.1 the Contiguous U.S., 2005

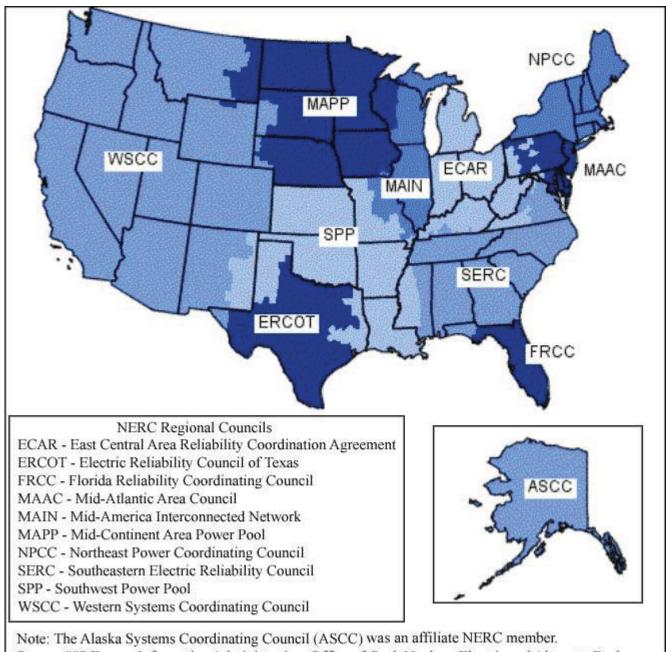

Source: U.S. Energy Information Administration, Office of Coal, Nuclear, Electric and Alternate Fuels.

Figure 4.2 Consolidated North American Electric Reliability Corporation Regional Entities, 2009

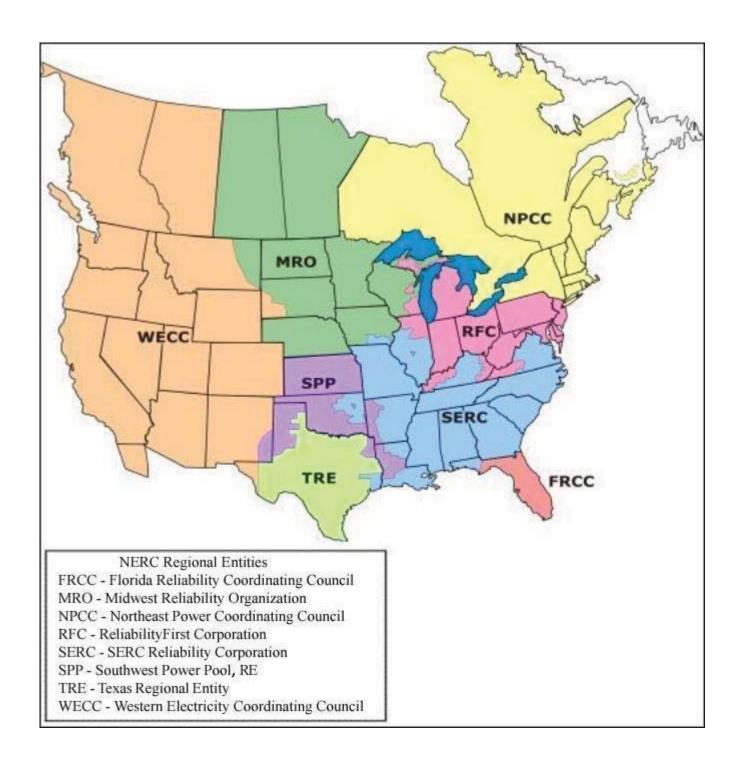

Chapter 5. Characteristics of the Electric Power Industry

Table 5.1. Count of Electric Power Industry Power Plants, by Sector, by Predominant Energy Sources within Plant, 2001 through 2009 (Count)

Period	Coal	Petroleum	Natural Gas	Other Gases	Nuclear	Hydroelectric Conventional	Other Renewables	Hydroelectric Pumped Storage	Other
Total (All Sectors)									
2001	645 633	1,160 1,186	1,576 1,649	35 40	66 66	1,421 1,426	672 684	37 38	14 26
2003	629	1,206	1,696	40	66	1,425	745	38	25
2004	626	1,201	1,677	46	66	1,425	752	39	26
2005	620	1,210	1,671	44	66	1,422	783	39	27
2006	617	1,215	1,663	46	66	1,421	845	39	27
2007	607 599	1,198	1,659	46 43	66	1,424	931	39 39	24 29
2008	599 594	1,205 1,203	1,653 1,651	43	66 66	1,423 1,427	1,080 1,224	39	28
	tors, Electric Utili		1,051		00	1,427	1,224	3,	20
2001	373	827	646	1	43	905	48	33	1
2002	365	839	670	1	43	907	49	34	
2003	356	856	672	1	42	900	58	34	1
2004 2005	354 347	853 851	680 719	1	41 37	895 896	61 66	35 34	1 1
2006	345	858	741	1	36	894	83	34	1
2007	341	854	746	1	34	890	91	34	1
2008	338	872	765		34	886	106	34	1
2009	341	868	768		34	887	130	34	1
	itors, Independent		205		22	447	420	4	
2001	100 102	177 189	295 351	2	23 23	447 451	429 438	4	2
2003	100	191	391	1	24	463	475	4	
2004	103	186	400	i	25	467	483	4	
2005	108	196	383	2	29	464	506	5	
2006	109	188	373	2	30	465	554	5	
2007	109	189	381	1	32	477	628	5	
2008	106 100	187 189	372 376	 1	32 32	481 485	755 870	5 5	2 2
	nd Power, Electric		370	1	32	403	870		
2001	46	14	154	3		1	30		1
2002	47	16	170	2			31		
2003	49	18	192	3 4		1	37		
2004 2005	48 47	17 15	186 184	4 4		1	33 36		
2006	50	19	177	4		1	35		
2007	50	15	175	4			34		
2008	50	14	170	3			38		
2009	51	12	166	3			41		
	nd Power, Comme								
2001	20 20	63 63	127 123			9 10	39 37		
2002	20 22	65	123			10	41		
2004	21	68	121	1		10	42		
2005	20	71	113	1		9	45		
2006	22	71	109	1		9	45		
2007	20	68	106	1		9	45	==	1
2008	20 18	66 70	106 107	1		9	48 49		1
2009	nd Power, Industri		107	1		9	49		1
2001	106	79	354	31		59	126		12
2002	99	79	335	35		58	129		24
2003	102	76	320	35		51	134		24
2004	100	77	290	39		52	133		25
2005	98	77	272	37		52	130		26
2006 2007	91 87	79 72	263 251	38 39		52 48	128 133		26 22
2008	85	66	240	39		47	133	 	25
2009	84	64	234	38		46	134		24

¹ Small number of electricity-only, non-Combined Heat and Power plants may be included.

Note: The number of power plants for each energy source is the number of sites for which the respective energy source was reported as the most predominant energy source for at least one of its generators. If all generators for a site have the same energy source reported as the most predominant, that site will be counted once under that energy source. However, if the most predominant energy source is not the same for all generators within a site, the site is counted more than once, based on the number of most predominant energy sources for generators at a site. In general, this table translates the number of generators by energy source (Table 1.2) into the number of sites represented by the generators for an energy source. Therefore, the count for Total (All Sectors) is the sum of the counts for each sector by energy source and does not necessarily represent unique sites

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 5.2. Average Capacity Factors by Energy Source, 1998 through 2009 (Percent)

	(1 0100110)							
Year	Coal	Petroleum	Natural Gas CC ¹	Natural Gas Other	Nuclear	Hydroelectric Conventional	Other Renewables	All Energy Sources
1998	67.7	22.2		34.2	79.2	46.6	57.0	54.6
1999	68.1	22.4		33.2	85.3	45.9	56.9	54.9
2000	71.0	20.5		37.1	87.7	39.5	59.1	54.6
2001	69.2	21.5		35.7	89.4	31.4	50.2	51.4
2002	70.0	18.1		38.2	90.3	38.0	54.0	49.7
2003	72.0	22.4	33.5	12.1	87.9	40.0	50.0	47.7
2004	71.9	23.3	35.5	10.7	90.1	39.4	50.5	47.9
2005	73.3	23.8	36.8	10.6	89.3	39.8	47.0	48.3
2006	72.6	12.6	38.8	10.7	89.6	42.4	45.7	48.0
2007	73.6	13.4	42.0	11.4	91.8	36.3	40.0	48.7
2008	72.2	9.2	40.6	10.6	91.1	37.2	37.3	47.4
2009	63.8	7.8	42.5	9.8	90.3	39.8	33.8	44.9

¹ Prior to 2003, the generation collected on Form EIA-906 did not have a distinction for combined cycle (CC) prime movers. All natural gas-fired plants of all types are included in "Natural Gas Other" for 1998 to 2002.

Note: Technical Note: Average Capacity Factor is the ratio of actual generation to maximum potential output, expressed as a percent.

Average Capacity Factor = [(Net Generation)/(Net Summer Capacity* Number of Hours in the Year)] * 100

for the respective energy source and year

Sources: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report;" Form EIA-923, Power Plant Operations Report," and predecessor forms.

Table 5.3. Average Operating Heat Rate for Selected Energy Sources, 2001 through 2009 (Btu per Kilowatthour)

Year	Coal ¹	Petroleum²	Natural Gas	Nuclear
2001	10,378	10,742	10,051	10,443
2002	10,314	10,641	9,533	10,442
2003	10,297	10,610	9,207	10,421
2004	10,331	10,571	8,647	10,427
2005	10,373	10,631	8,551	10,436
2006	10,351	10,809	8,471	10,436
2007	10,375	10,794	8,403	10,485
2008	10,378	11,015	8,305	10,453
2009	10,414	11,002	8,157	10,460

¹ Includes anthracite, bituminous, subbituminous and lignite coal. Waste coal and synthetic coal are included starting in 2002.

² Includes distillate fuel oil (all diesel and No. 1 and No. 2 fuel oils), residual fuel oil (No. 5 and No. 6 fuel oils and bunker C fuel oil, jet fuel, kerosene, petroleum coke, and waste oil. Notes: • Included in the calculation for coal, petroleum, and natural gas average operating heat rate are electric power plants in the utility and independent power producer sectors. • Combined heat and power plants, and all plants in the commercial and industrial sectors are excluded from the calculations. • The nuclear average heat rate is the weighted average tested heat rate for nuclear units as reported on the Form EIA-860.

Technical Note: The average operating heat rate for coal, petroleum and natural gas displayed in Table 5.3 is calculated by dividing the energy consumed (in BTUs) to generate electricity by the kilowatthours of power generated as reported on the Form EIA-923 and its predecessor forms. Included in the calculation for coal, petroleum and natural gas are utility and independent power producer plants. The calculation excludes combined heat and power plants, industrial plants, and commercial sector plants. The nuclear heat rate is a weighted average (by capacity) of the tested heat rate as reported on the Form EIA-860.

Sources: U.S. Energy Information Administration, Form EIA-923, "Power Plant Operations Report," and predecessor form(s) including U.S. Energy Information Administration, Form EIA-906, "Power Plant Report;" and Form EIA-920, "Combined Heat and Power Plant Report," Form EIA-860, "Annual Electric Generator Report."

Table 5.4. Average Heat Rates by Prime Mover and Energy Source, 2009 (Btu per Kilowatthour)

Prime Mover	Coal	Petroleum	Natural Gas	Nuclear
Steam Turbine	10,148	10,351	10,399	10,460
Gas Turbine		13,343	11,497	
Internal Combustion		10,262	9,973	
Combined Cycle	W	10,709	7,543	

W = Withheld to avoid disclosure of individual company data.

Notes: • See Glossary reference for definitions. • Totals may not equal sum of components because of independent rounding. • Heat rate is reported at full load conditions for electric utilities and independent power producers.

Technical Note: The heat rates reported on Form EIA-860 are weighted by Net Summer Capacity.

Average Heat Rate = Sum of [Reported Heat Rate * (NSC/Total Capacity)] where

NSC = Net Summer Capacity, and

Total Capacity = Sum of [NSC] of units for the respective prime mover and energy source categories.

Source: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report."

Table 5.5. Planned Transmission Capacity Additions, by High-Voltage Size, 2010 through 2016 (Circuit Miles of Transmission)

Voltage			Circuit Miles							
Туре	Operating (kV)	2010	2011	2012	2013	2014	2015	2016		
AC	230	725	1,126	855	711	529	671	118		
AC	345	804	767	1,576	3,478	1,300	589	345		
AC	500	421	336	1,400	1,314	1,512	2,090	1,688		
AC	765					275				
AC Total		1,950	2,230	3,831	5,503	3,616	3,350	2,151		
DC	100-299									
DC	300-399									
DC	400-599						620	1,300		
DC Total							620	1,300		
Grand Total		1,950	2,230	3,831	5,503	3,616	3,970	3,451		
Lines taken out of service		318	112	30	132	51		116		

Notes: • Circuit miles do not equal physical miles on the ground; the reference terminology for that concept is structural mile. • More than one circuit can be present on a structure. • Some structures were designed and then built to carry future transmission circuits in order to handle expected growth in new capability requirements. • Lines are taken out of service for a variety of reasons including intentional changes to the right-of-way to better use available land for different levels of voltage and types of poles and towers.

Chapter 6. Trade

 Table 6.1.
 Electric Power Industry - Electricity Purchases, 1998 through 2009

(Thousand Megawatthours)

	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
U.S. Total Electric Utilities Energy-Only	5,028,647 2,364,648	5,612,781 2,483,927	5,411,422 2,504,002	5,502,584 2,605,315	6,092,285 2,760,043	6,998,549 2,725,694	6,979,669 2,610,525	8,754,807 2,620,712	7,555,276 3,045,854	2,345,540 2,250,382	2,039,969 1,949,574	2,020,622 1,927,198
ProvidersIPP	2,564,407 27,922 71,669	3,024,730 25,431 78,693	2,805,833 24,942 76,646	2,793,288 26,628 77,353	3,250,298 12,201 69,744	4,170,331 24,258 78,267	4,264,102 37,921 67,122	6,050,159 15,801 68,135	4,412,064 97,357 ¹ NA	NA 10,622 84,536	NA 4,358 86,037	NA 4,089 89,334

¹ For 2001, CHP purchases are combined with IPP data above.

Notes: • Energy-only providers are wholesale and retail power marketers. • IPP are independent power producers and CHP are combined heat and power producers. • Totals may not equal sum of components because of independent rounding. • The data collection instrument was changed in 2001 to collect data at the corporate level, rather than the plant level. As a result, comparisons with data prior to 2001 and after 2001 should be done with caution.

Sources: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report." For unregulated entities prior to 2001. Form EIA-860B, "Annual Electric Generator Report - Nonutility," and predecessor forms; and Form EIA-923, "Power Plant Operations Report" for 2007 and predecessor form(s) for earlier years.

Table 6.2. Electric Power Industry - Electricity Sales for Resale, 1998 through 2009

(Thousand Megawatthours)

	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
U.S. Total Electric Utilities		5,680,733 1,576,976	5,479,394 1,603,179	5,493,473 1,698,389	6,071,659 1,925,710	6,758,975 1,923,440	6,920,954 1,824,030	8,568,678 1,838,901	7,345,319 2,146,689	2,355,154 1,715,582	1,998,090 1,635,614	1,921,858 1,664,081
Energy-Only Providers IPP CHP	1,295,857	2,718,661 1,355,017 30,079	2,476,740 1,368,310 31,165	2,446,104 1,321,342 27,638	2,867,048 1,252,796 26,105	3,756,175 1,053,364 25,996	3,906,220 1,156,796 33,909	5,757,283 943,531 28,963	4,386,632 811,998 ¹ NA	NA 611,150 28,421	NA 335,122 27,354	NA 228,617 29,160

¹ For 2001, CHP sales are combined with IPP data above.

Notes: • Energy-only providers are wholesale and retail power marketers. • IPP are independent power producers and CHP are combined heat and power producers. • The data collection instrument was changed in 2001 to collect data at the corporate level, rather than the plant level. As a result, comparisons with data prior to 2001, and after 2001 should be done with caution. • Totals may not equal sum of components because of independent rounding.

Sources: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report." For unregulated entities prior to 2001. Form EIA-860B, "Annual Electric Generator Report - Nonutility," and predecessor forms; and Form EIA-923, "Power Plant Operations Report" for 2007 and predecessor form(s) for earlier years.

Table 6.3. Electric Power Industry - U.S. Electricity Imports from and Electricity Exports to Canada and Mexico, 1998 through 2009

(Megawatthours)

Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Electricity Impor	Electricity Imports and Exports											
Canada												
Imports	51,108,502	55,732,400 ^R	50,118,056	41,544,052	42,332,039 ^R	33,007,487	29,324,625	36,536,479	38,401,598	48,515,476	42,911,308	39,502,108
Exports	17,490,264	23,499,445 ^R	19,559,417	23,405,387	18,680,237 ^R	22,482,109	23,584,513	15,231,079	16,105,612	12,684,706	12,953,488	11,683,276
Mexico												
Imports ¹	1,082,093	1,286,981 ^R	1,277,644	1,147,258	1,597,275	1,202,576	1,069,926	242,596	98,649	76,800	303,439	11,249
Exports	647,720	698,714 ^R	584,176	865,948	470,731	415,754	390,190	564,603	367,680	2,144,676	1,268,284	1,973,203
Total Imports Total Exports	52,190,595 18,137,984	57,019,381 ^R 24,198,159 ^R	51,395,702 20,143,592	42,691,310 24,271,335	43,929,314 ^R 19,150,968 ^R	34,210,063 22,897,863	30,394,551 23,974,703	36,779,077 15,795,681	38,500,247 16,473,292	48,592,276 14,829,382	43,214,747 14,221,772	39,513,357 13,656,479

¹ Includes contract terminations in 2000.

Sources: DOE, Office of Electricity Delivery and Energy Reliability, Form OE-781R, "Annual Report of International Electric Export/Import Data," predecessor forms, and National Energy Board of Canada. • For 2001 forward, data from the California Independent System Operator are used in combination with the Form OE-781R values to estimate electricity trade with Mexico.

NA = Not available.

R = Revised.

NA = Not available.

R = Revised.

R = Revised.

Note: Totals may not equal sum of components because of independent rounding.

Chapter 7. Retail Customers, Sales, and Revenue

Table 7.1. Number of Ultimate Customers Served by Sector, by Provider, 1998 through 2009 (Number)


Period	Residential	Commercial	Industrial	Transportation	Other	All Sectors
			Total Electric Industry	V		
1998	109,048,343	13,887,066	539,903	NA	932,838	124,408,150
1999	110,383,238	14,073,764	552,690	NA	935,311	125,945,003
2000	111,717,711	14,349,067	526,554	NA	974,185	127,567,517
2001	114,890,240	14,867,490	571,463	NA	1,030,046	131,359,239
2002	116,622,037	15,333,700	601,744	NA	1,066,554	133,624,035
2003	117,280,481	16,549,519	713,221	1,127	NA	134,544,348
2004	118,763,768	16,606,783	747,600	1,025	NA	136,119,176
2005	120,760,839	16,871,940	733,862	518	NA	138,367,159
2006	122,471,071	17,172,499	759,604	791	NA	140,403,965
2007	123,949,916	17,377,219	793,767	750	NA	142,121,652
2008	124,937,469	17,562,726	774,713	727	NA	143,275,635
2009	125,177,175	17,561,661	757,519	705	NA	143,497,060
			Full-Service Providers	1		
1998	108,736,845	13,832,662	538,167	NA	932,838	124,040,512
1999	109,817,057	13,963,937	527,329	NA	934,260	125,242,583
2000	110,505,820	14,058,271	512,551	NA	953,756	126,030,398
2001	112,472,629	14,364,578	553,280	NA	1,004,027	128,394,514
2002	113,790,812	14,899,747	586,217	NA	1,035,604	130,312,380
2003	115,029,545	16,136,616	695,616	1,042	NA	131,862,819
2004	116,325,747	16,161,269	733,809	941	NA	133,221,766
2005	118,469,928	16,389,549	719,219	496	NA	135,579,192
2006	120,677,627	16,673,766	745,645	764	NA	138,097,802
2007	121,782,003	16,767,635	771,637	710	NA	139,321,985
2008	122,595,644	16,952,660	756,294	664	NA	140,305,262
2009	122,533,414	16,866,476	737,059	659	NA	140,137,608
			Energy-Only Provider	S		
1998	311,498	54,404	1,736	NA	0	367,638
1999	566,181	109,827	25,361	NA	1,051	702,420
2000	1,211,891	290,796	14,003	NA	20,429	1,537,119
2001	2,417,611	502,912	18,183	NA	26,019	2,964,725
2002	2,831,225	433,953	15,527	NA	30,950	3,311,655
2003	2,250,936	412,903	17,605	85	NA	2,681,529
2004	2,438,021	445,514	13,791	84	NA	2,897,410
2005	2,290,911	482,391	14,643	22	NA	2,787,967
2006	1,793,444	498,733	13,959	27	NA	2,306,163
2007	2,167,913	609,584	22,130	40	NA	2,799,667
2008	2,341,825	610,066	18,419	63	NA	2,970,373
2009	2,643,761	695,185	20,460	46	NA	3,359,452

¹ Pursuant to applicable Texas statutes establishing competitive electricity markets within the Electric Reliability Council of Texas, all customers served by Retail Energy Providers must be provided bundled energy and delivery services, so they are included under "Full-Service Providers."

Notes: • See Technical Notes reference for definitions. • Full-Service Providers sell bundled electricity services (e.g., both energy and delivery) to end users. Full-Service Providers may purchase electricity from others (such as Independent Power Producers or other Full-Service Providers) prior to delivery. Direct sales from independent facility generators to end use consumers are reported under Full-Service Providers. Energy-Only Providers sell energy to end use customers; incumbent utility distribution firms provide Delivery-Only Services for these customers.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

NA = Not available.

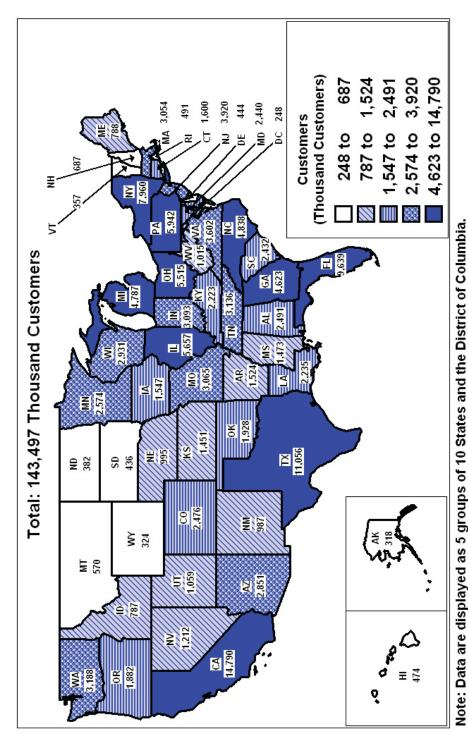

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

U.S. Energy Information Administration/Electric Power Annual 2009

Table 7.2. Retail Sales and Direct Use of Electricity to Ultimate Customers by Sector, by Provider, 1998 through 2009

(Megawatthours)

				Total				
Period	Residential	Commercial	Industrial	Trans- portation	Other	Total	Direct Use ¹	End Use
				Total Electric	Industry			
1998	1,130,109,120	979,400,928	1,051,203,115	NA	103,517,589	3,264,230,752	160,865,884	3,425,096,636
1999	1,144,923,069	1,001,995,720	1,058,216,608	NA	106,951,684	3,312,087,081	171,629,285	3,483,716,366
2000	1,192,446,491	1,055,232,090	1,064,239,393	NA	109,496,292	3,421,414,266	170,942,509	3,592,356,775
2001	1,201,606,593	1,083,068,516	996,609,310	NA	113,173,685	3,394,458,104	162,648,615	3,557,106,719
2002	1,265,179,869	1,104,496,607	990,237,631	NA	105,551,904	3,465,466,011	166,184,296	3,631,650,307
2003	1,275,823,910	1,198,727,601	1,012,373,247	6,809,728	NA	3,493,734,486	168,294,526	3,662,029,012
2004	1,291,981,578	1,230,424,731	1,017,849,532	7,223,642	NA	3,547,479,483	168,470,002	3,715,949,485
2005	1,359,227,107	1,275,079,020	1,019,156,065	7,506,321	NA	3,660,968,513	150,015,531	3,810,984,044
2006	1,351,520,036	1,299,743,695	1,011,297,566	7,357,543	NA	3,669,918,840	146,926,612	3,816,845,452
2007	1,392,240,996	1,336,315,196	1,027,831,925	8,172,595	NA	3,764,560,712	125,670,185 ^R	3,890,230,897 ^R
2008	1,379,981,104	1,335,981,135	1,009,300,309	7,699,632	NA	3,732,962,180	132,196,685 ^R	3,865,158,865 ^R
2009	1,364,474,417	1,307,167,813	917,442,063	7,780,573	NA	3,596,864,866	126,937,958	3,723,802,824
				Full-Service Pr	oviders ^{2,3}			
1998	1,127,734,988	968,528,009	1,040,037,873	NA	103,517,589	3,239,818,459	NA	3,239,818,459
1999	1,140,761,016	970,600,943	1,017,783,037	NA	106,754,043	3,235,899,039	NA	3,235,899,039
2000	1,183,137,429	1,000,865,367	1,017,722,945	NA	107,824,323	3,309,550,064	NA	3,309,550,064
2001	1,188,219,590	1,037,998,484	961,812,417	NA	108,632,086	3,296,662,577	NA	3,296,662,577
2002	1,248,349,458	1,036,366,268	937,138,192	NA	102,238,786	3,324,092,704	NA	3,324,092,704
2003	1,257,766,998	1,112,206,121	931,661,404	3,315,043	NA	3,304,949,566	NA	3,304,949,566
2004	1,272,237,425	1,116,497,417	933,529,502	3,188,466	NA	3,325,452,810	NA	3,325,452,810
2005	1,339,568,275	1,151,327,861	929,675,932	3,341,814	NA	3,423,913,882	NA	3,423,913,882
2006	1,337,837,993	1,170,661,399	939,194,648	3,040,062	NA	3,450,734,102	NA	3,450,734,102
2007	1,375,450,126	1,180,789,042	923,148,031	2,635,498	NA	3,482,022,697	NA	3,482,022,697
2008	1,362,811,730	1,152,674,093	929,246,647	2,515,304	NA	3,447,247,774	NA	3,447,247,774
2009	1,345,127,459	1,122,993,934	830,670,472	2,447,384	NA	3,301,239,249	NA	3,301,239,249
2009	1,0 10,127,107	1,122,>>0,>0	050,070,172	Energy-Only I		5,501,257,217	1111	3,301,233,213
1998	2,374,132	10,872,919	11,165,242	NA	0	24,412,293	NA	24,412,293
1999	4,162,053	31,394,777	40,433,571	NA	197,641	76,188,042	NA	76,188,042
2000	9,309,062	54,366,723	46,516,448	NA	1,671,969	111,864,202	NA	111,864,202
2001	13,387,003	45,070,032	34,796,893	NA	4,541,599	97,795,527	NA	97,795,527
2002	16,830,411	68,130,339	53,099,439	NA	3,313,118	141,373,307	NA	141,373,307
2003	18,056,912	86,521,480	80,711,843	3,494,685	NA	188,784,920	NA	188,784,920
2004	19,744,153	113,927,314	84,320,030	4,035,176	NA	222,026,673	NA	222,026,673
2005	19,658,832	123,751,159	89,480,133	4,164,507	NA	237,054,631	NA	237,054,631
2006	13,682,043	129,082,296	72,102,918	4,317,481	NA	219,184,738	NA	219,184,738
2007	16,790,870	155,526,154	104,683,894	5,537,097	NA	282,538,015	NA	282,538,015
2008	17,169,374	183,307,042	80,053,662	5,184,328	NA	285,714,406	NA	285,714,406
2009	19.346.958	184,173,879	86,771,591	5,333,189	NA	295,625,617	NA	295,625,617
2007	17,510,750	101,175,077	00,771,371	5,555,167	11/1	273,023,017	1171	273,023,017

Direct Use represents commercial and industrial facility use of onsite net electricity generation; and electricity sales or transfers to adjacent or co-located facilities for which revenue


Sources: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report;" Form EIA-923, "Power Plant Operations Report" and predecessor form(s) including Form EIA-906, "Power Plant Report;" Form EIA-920, "Combined Heat and Power Plant Report."

² Pursuant to applicable Texas statutes establishing competitive electricity markets within the Electric Reliability Council of Texas, all customers served by Retail Energy Providers must be provided bundled energy and delivery services, so are included under "Full-Service Providers." ³ These data include Facility Direct Retail Sales.

NA = Not available.

R = Revised.

Notes: • See Technical Notes reference for definitions. • Full-Service Providers sell bundled electricity services (e.g., both energy and delivery) to end users. Full-Service Providers may purchase electricity from others (such as Independent Power Producers or other Full-Service Providers) prior to delivery. Direct sales from independent facility generators to end use consumers are reported under Full-Service Providers. Energy-Only Providers sell energy to end use customers; incumbent utility distribution firms provide Delivery-Only Services for

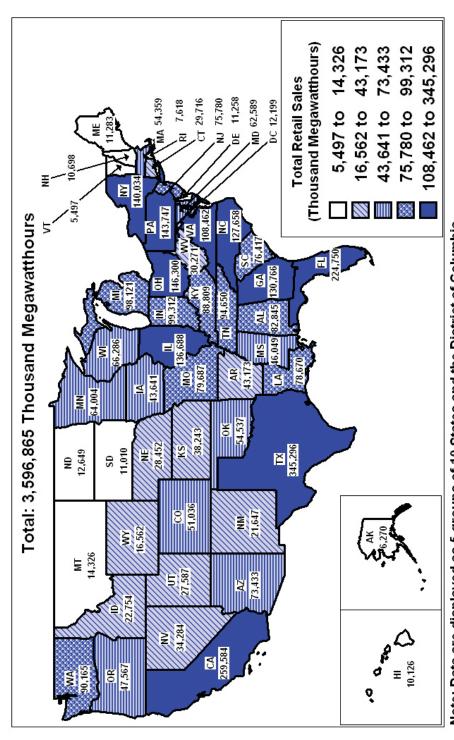

Note: Data are displayed as 5 groups of 10 States and the District of Columbia.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 7.3. Revenue from Retail Sales of Electricity to Ultimate Customers by Sector, by Provider, 1998 through 2009

(Million Dollars)

Period	Residential	Commercial	Industrial	Transportation	Other	All Sectors
			Total Electric Industry			
1998	93,360	72,575	47,050	NA	6,863	219,848
1999	93,483	72,771	46,846	NA	6,796	219,896
2000	98,209	78,405	49,369	NA	7,179	233,163
2001	103,158	85,741	50,293	NA	8,151	247,343
2002	106,834	87,117	48,336	NA	7,124	249,411
2003	111.249	96,263	51.741	514	NA	259.767
2004	115,577	100,546	53,477	519	NA	270.119
2005				643		
2005	128,393	110,522	58,445		NA	298,003
2006	140,582	122,914	62,308	702	NA	326,506
2007	148,295	128,903	65,712	792	NA	343,703
2008	155,433	138,469	68,920	827	NA	363,650
2009	157,008	134,106	61,459	829	NA	353,403
			Full-Service Providers	2		
1998	93,164	71,769	46,550	NA	6,863	218,346
1999	93.142	70,492	45,056	NA	6,783	215,473
2000	97,086	73,704	46,465	NA	6,988	224,243
2001	101,541	81,385	48,182	NA	7,766	238,874
2002	104,814	80,573	44,826	NA 226	6,803	237,014
2003	109,165	87,764	46,686	226	NA	243,841
2004	113,306	89,597	47,993	238	NA	251,134
2005	125,983	97,405	52,113	249	NA	275,749
2006	138,608	107,432	56,385	257	NA	302,683
2007	145,642	109,703	56.950	232	NA	312.527
2008	152,429	115,062	61,286	250	NA	329,027
2009	153,723	111,809	53,514	226	NA	319,271
2009	133,723		ructured Retail Service P		IVA.	319,2/1
1998	196	806	500	NA	NA	1,502
1999	340	2,279	1,791	NA	13	4,423
2000	1,123	4,702	2,904	NA	191	8,920
2001	1,617	4,356	2,111	NA	385	8,469
2002	2,020	6,545	3,510	NA	321	12,396
2003	2.084	8,499	5,055	288	NA	15,926
2004	2.272	10,949	5.484	281	NA	18.985
2005	2,410	13,117	6,333	394	NA	22,254
	1,974	15,482	5.922	445	NA	23.823
2006						
2007	2,653	19,200	8,762	560	NA	31,176
2008	3,004	23,407	7,635	577	NA	34,622
2009	3,286	22,297	7,946	603	NA	34,132
			Energy-Only Providers			
1998	196	806	500	NA	0	1,502
1999	340	2,279	1,791	NA	13	4,423
2000	530	3,175	2,374	NA	75	6.153
2001	714	2,806	1.632	NA	237	5,390
2002	914	3,989	2,408	NA NA	143	7,454
	980	5,210	3,605	215		10,011
2003					NA	
2004	1,086	6,859	3,881	201	NA	12,027
2005	1,285	8,844	4,749	308	NA	15,186
2006	1,127	10,792	4,510	356	NA	16,784
2007	1,646	13,553	7,197	458	NA	22,854
2008	1,873	17,126	6.212	455	NA	25,667
2009	1,877	15,438	6.161	460	NA	23,936
	-,-,-	,	Delivery-Only Service			
1998						
1999				 		
	502					2.767
2000	593	1,527	531	NA	116	2,767
2001	903	1,551	479	NA	147	3,080
2002	1,106	2,556	1,102	NA	178	4,942
2003	1,104	3,289	1,450	72	NA	5,915
2004	1,186	4,090	1,603	79	NA	6,958
2005	1,125	4,273	1,584	86	NA	7,068
2006	847	4,690	1,412	90	NA	7,040
2007	1,007	5,647	1,412	102	NA NA	8,322
	1,007	6,281	1,363	102	NA NA	8,322 8,956
2000					NA	
2008 2009	1,409	6,859	1,785	143	NA NA	10,196

¹ Sum of Full-Service Providers and Restructured Retail Service Providers.

Notes: • See Technical Notes reference for definitions. • Full-Service Providers sell bundled electricity services (e.g., both energy and delivery) to end users. Full-Service Providers may purchase electricity from others (such as Independent Power Producers or other Full-Service Providers) prior to delivery. Direct sales from independent facility generators to end use consumers are reported under Full-Service Providers. Energy-Only Providers sell energy to end use customers; incumbent utility distribution firms provide Delivery-Only Services for these customers. Data reported under Restructured Retail Service Providers represent the sum of Energy-Only and Delivery-Only Services. • For historical data, see the State of California discussion in Technical Notes. • Totals may not equal sum of components because of independent rounding.

² Pursuant to applicable Texas statutes establishing competitive electricity markets within the Electric Reliability Council of Texas, all customers served by Retail Energy Providers must be provided bundled energy and delivery services, so are included under "Full-Service Providers."


³ Sum of Energy-Only Providers and Delivery-Only Service.

⁴ From 1996 to 1999, revenue was estimated based on retail sales reported on the Form EIA-861.

NA = Not available.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Figure 7.3. U.S. Electric Industry Total Revenues by State, 2009

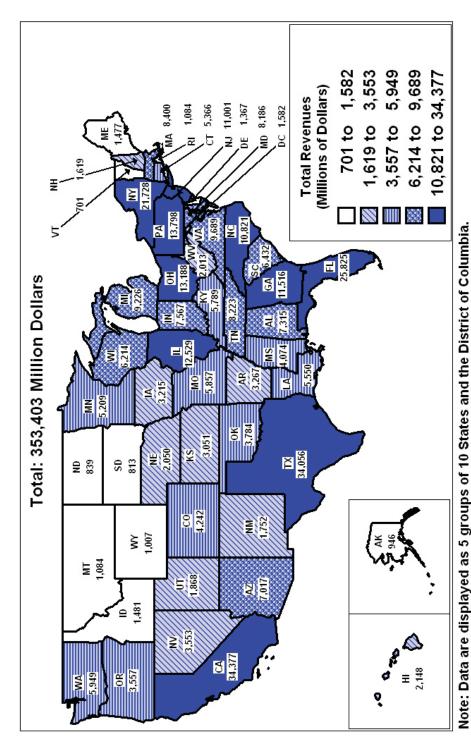

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 7.4. Average Retail Price of Electricity to Ultimate Customers by End-Use Sector, 1998 through 2009

(Cents per kilowatthour)

Period	Residential	Commercial	Industrial	Transportation	Other	All Sectors
			Total Electric Industr	y ¹		
1998	8.26	7.41	4.48	NA	6.63	6.74
1999	8.16	7.26	4.43	NA	6.35	6.64
2000	8.24	7.43	4.64	NA	6.56	6.81
2001	8.58	7.92	5.05	NA	7.20	7.29
2002	8.44	7.89	4.88	NA	6.75	7.20
	8.72	8.03	5.11	7.54	NA	7.44
2003						
2004	8.95	8.17	5.25	7.18	NA	7.61
2005	9.45	8.67	5.73	8.57	NA	8.14
2006	10.40	9.46	6.16	9.54	NA	8.90
2007	10.65	9.65	6.39	9.70	NA	9.13
2008	11.26	10.36	6.83	10.74	NA	9.74
2009	11.51	10.26	6.70	10.65	NA	9.83
			Full-Service Providers	s^2		
1998	8.26	7.41	4.48	NA	6.63	6.74
1999	8.16	7.26	4.43	NA	6.35	6.66
2000	8.21	7.36	4.57	NA	6.48	6.78
2001	8.55	7.84	5.01	NA	7.15	7.25
2002	8.40	7.77	4.78	NA	6.65	7.13
2003	8.68	7.89	5.01	6.82	NA	7.38
2004	8.91	8.02	5.14	7.47	NA NA	7.55 7.55
2005	9.40	8.46	5.61	7.45	NA	8.05
2006	10.36	9.18	6.00	8.44	NA	8.77
2007	10.59	9.29	6.17	8.82	NA	8.98
2008	11.18	9.98	6.60	9.96	NA	9.54
2009	11.43	9.96	6.44	9.22	NA	9.67
			tructured Retail Service P			
1998	8.26	7.41	4.48	NA	NA	6.15
1999	8.17	7.26	4.43	NA	6.45	5.81
2000	12.07	8.65	6.24	NA	11.42	7.97
2001	12.08	9.67	6.07	NA	8.47	8.66
2002	12.00	9.61	6.61	NA	9.69	8.77
2003	11.54	9.82	6.26	8.23	NA	8.44
2004	11.51	9.61	6.50	6.95	NA	8.55
	12.26	10.60	7.08	9.47	NA NA	9.39
2005						
2006	14.43	11.99	8.21	10.32	NA	10.87
2007	15.80	12.35	8.37	10.11	NA	11.03
2008	17.49	12.77	9.54	11.12	NA	12.12
2009	16.98	12.11	9.16	11.31	NA	11.55
1000			Energy-Only Provider			
1998	8.26	7.41	4.48	NA		6.15
1999	8.17	7.26	4.43	NA	6.45	5.81
2000	5.69	5.84	5.10	NA	4.47	5.50
2001	5.34	6.22	4.69	NA	5.23	5.51
2002	5.43	5.86	4.53	NA	4.30	5.27
2003	5.43	6.02	4.47	6.16	NA	5.30
2004	5.50	6.02	4.60	4.99	NA	5.42
2005	6.54	7.15	5.31	7.40	NA	6.41
2006	8.23	8.36	6.25	8.24	NA	7.66
2007	9.80	8.71	6.87	8.28	NA NA	8.09
	10.91	9.34	7.76	8.28 8.79		
2008					NA	8.98
2009	9.70	8.38	7.10	8.63	NA	8.10
1000			Delivery-Only Service	e		
1998						
1999						2.47
2000	6.37	2.81	1.14		6.95	2.47
2001	6.74	3.44	1.38		3.24	3.15
2002	6.57	3.75	2.08		5.39	3.50
2003	6.11	3.80	1.80	2.07		3.13
2004	6.00	3.59	1.90	1.96	NA	3.13
2005	5.72	3.45	1.77	2.07	NA	2.98
2006	6.19	3.63	1.96	2.08	NA	3.21
		3.63	1.50	1.84	NA	2.95
2007						
2007	6.00					
2008	6.00 6.59 7.28	3.43 3.72	1.78 2.06	2.34 2.68	NA NA	3.13 3.45

¹ Weighted average of Full-Service Providers and Restructured Retail Service Providers.

Notes: • See Glossary reference for definitions • Full-Service Providers sell bundled electricity services (e.g., both energy and delivery) to end users. Full-Service Providers may purchase electricity from others (such as Independent Power Producers or other Full-Service Providers) prior to delivery. Direct sales from independent facility generators to end use consumers are reported under Full-Service Providers. Energy-Only Providers sell energy to end use customers; incumbent utility distribution firms provide Delivery-Only Services for these customers. Data reported under Restructured Retail Service Providers represent the sum of Energy-Only and Delivery-Only Services.


Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

² Pursuant to applicable Texas statutes establishing competitive electricity markets within the Electric Reliability Council of Texas, all customers served by Retail Energy Providers must be provided bundled energy and delivery services, so are included under "Full-Service Providers."

³ Sum of Energy-Only Providers and Delivery-Only Service.

⁴ From 1996 to 1999, average revenue was estimated based on retail sales reported on the Form EIA-861.


NA = Not available.

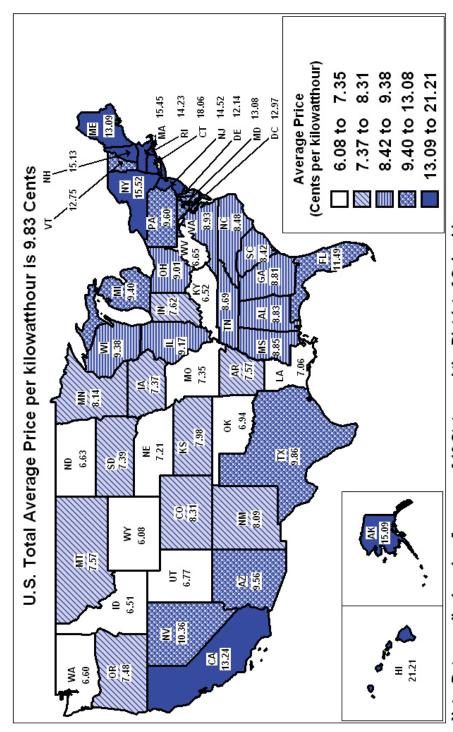

Note: Data are displayed as 5 groups of 10 States and the District of Columbia.


Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Figure 7.5. Average Residential Price of Electricity by State, 2009

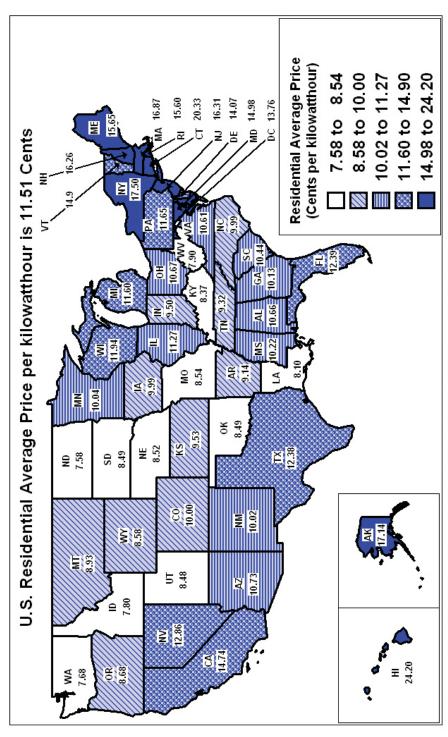


Note: Data are displayed as 5 groups of 10 States and the District of Columbia.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

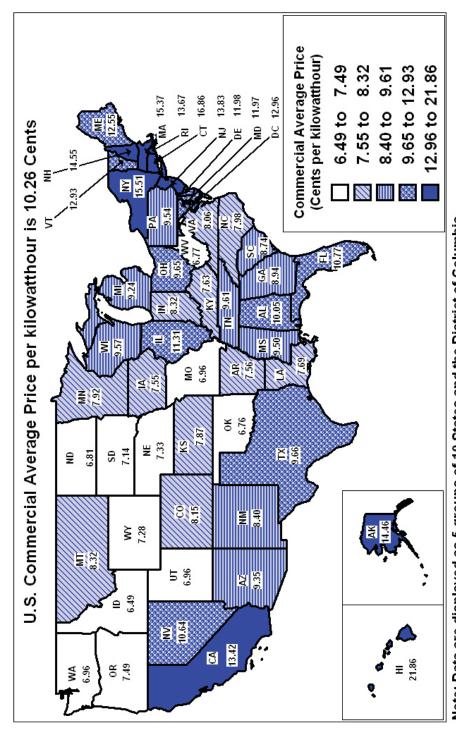

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report." Note: Data are displayed as 5 groups of 10 States and the District of Columbia.

Figure 7.7. Average Industrial Price of Electricity by State, 2009

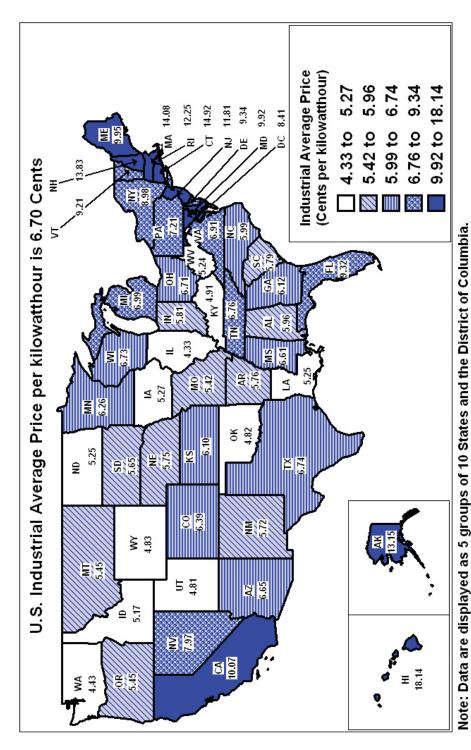

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 7.5. Net Metering and Green Pricing Customers by End Use Sector, 2002 - 2009

Year		Green Pricing			Net Metering	
i cai	Residential	Non Residential	Total	Residential	Non Residential	Total
2002	688,069	23,481	711,550	3,559	913	4,472
2003	819,579	57,547	877,126	5,870	943	6,813
2004	864,794	63,539	928,333	14,114	1,712	15,826
2005	871,774	70,998	942,772	19,244	1,902	21,146
2006 ¹	606,919	35,937	642,856	30,689	2,930	33,619
2007	773,391	62,260	835,651	44,886	3,943	48,829
2008	918,284	64,711	982,995	64,400	5,609	70,009
2009	1,058,185	65,593	1,123,778	88,222	8,284	96,506

¹ In 2006 the single largest provider of green pricing services in the country discontinued service in two States. More than 297,600 customers in green pricing programs reverted to standard service tariffs, predominantly in Ohio and Pennsylvania.

Notes: • Green Pricing programs allow electricity customers the opportunity to purchase electricity generated from renewable resources, thereby encouraging renewable energy development. Renewable resources include solar, wind, geothermal, hydroelectric power, and wood. • Net Metering arrangements permit facilities and residences (using a meter that reads inflows and outflows of electricity) to sell any excess power generated over its load requirement back to the distributor to offset consumption.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Chapter 8. Revenue and Expense Statistics

67

Table 8.1. Revenue and Expense Statistics for Major U.S. Investor-Owned Electric Utilities, 1998 through 2009

(Million Dollars)

Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Utility Operating Revenues	276,124	298,962	270,964 ^R	275,501	265,652	238,759	230,151	219,609	267,276	233,915	213,090	214,849
Electric Utility	249,303	266,124	240,864 ^R	246,736	234,909	213,012	206,268	200,360	243,982	213,634	197,010	199,643
Other Utility	26,822	32,838	$30,100^{R}$	28,765	30,743	25,747	23,883	19,250	23,294	20,281	16,081	15,206
Utility Operating Expenses	244,243	267,263	241,198 ^R	245,589	236,786	206,960	201,057	189,062	234,910	210,250	180,467	183,954
Electric Utility	219,544	236,572	213,076 ^R	218,445	207,830	183,121	179,044	171,604	213,458	191,564	165,942	170,162
Operation	154,925	175,887	153,885 ^R	158,893	150,645	131,560	125,436	116,660	161,233	132,607	107,686	109,317
Production	118,816	140,974	121,700 ^R	127,494	120,586	103,871	98,305	90,715	135,791	107,554	82,791	84,741
Cost of Fuel	40,242	47,337	39,548 ^R	37,945	36,106	28,544	26,871	24,149	29,434	32,407	29,605	30,945
Purchased Power	67,630	84,724	74,112 ^R	79,205	77,902	67,126	63,749	58,810	98,020	62,608	42,663	41,789
Other	10,970	8,937	8,058 ^R	10,371	6,599	8,226	7,709	7,776	8,359	12,561	10,551	12,036
Transmission	6,742	6,950	6,051 ^R	6,179	5,664	4,531	3,653	3,560	3,385	2,713	2,480	2,177
Distribution	3,947	3,997	$3,765^{R}$	3,640	3,502	3,287	3,214	3,117	3,208	3,092	2,959	2,759
Customer Accounts	5,203	5,286	$4,652^{R}$	4,409	4,229	4,077	4,262	4,168	4,432	4,239	4,190	3,964
Customer Service	3,857	3,567	$2,939^{R}$	2,536	2,291	2,013	1,902	1,820	1,855	1,826	1,854	1,937
Sales	178	225	239 ^R	240	219	237	238	264	282	405	474	510
Administrative and General	15,991	14,718	14,346 ^R	14,580	14,130	13,537	13,863	13,018	12,292	12,768	12,950	13,204
Maintenance	14,092	14,192	13,181 ^R	12,838	12,033	11,743	11,340	10,861	11,154	12,064	12,359	12,356
Depreciation	20,095	19,049	17,936 ^R	17,373	17,123	16,322	15,981	16,199	17,476	20,636	20,232	21,287
Taxes and Other	29,081	26,202	$27,000^{R}$	28,149	26,805	22,190	25,027	26,716	21,765	24,479	23,786	25,695
Other Utility	24,698	30,692	28,122 ^R	27,143	28,956	23,839	22,013	17,457	21,452	18,686	14,525	13,791
Net Utility Operating Income	31,881	31,699	29,766 ^R	29,912	28,866	31,799	29,094	30,548	32,366	23,665	32,623	30,896

R = Revised.

Notes: • Data for the year 2007 was updated reflecting revisions reported by Ventyx Global Energy Velocity Suite. • 2007 financial data does not include information on Entergy Gulf State Louisiana LLC and Entergy Texas Inc. as both were not reported on the FERC Form for that year. • Missing or erroneous respondent data may result in slight imbalances in some of the expense account subtotals. Totals may not equal sum of components because of independent rounding.

Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others, via Ventyx Global Energy Velocity Suite."

Table 8.2. Average Power Plant Operating Expenses for Major U.S. Investor-Owned Electric Utilities, 1998 through 2009

(Mills per Kilowatthour)

(ximo per rano montro or)													
Plant Type	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998	
				0	peration								
Nuclear	10.00 4.23 4.88 3.05	9.89 ^R 3.72 ^R 5.78 3.77 ^R	9.54 ^R 3.63 ^R 5.44 3.26 ^R	9.03 ^R 3.57 ^R 3.76 3.51 ^R	8.26 ^R 3.21 ^R 3.95 3.69 ^R	8.97 ^R 3.13 ^R 3.83 ^R 4.27 ^R	9.12 ^R 2.74 ^R 3.47 3.50 ^R	9.00 ^R 2.59 3.71 3.26 ^R	8.44 ^R 2.47 ^R 4.27 3.65 ^R	6.03 ^R 2.17 ^R 3.52 3.93 ^R	8.17 ^R 2.16 ^R 3.35 5.01 ^R	9.86 ^R 2.19 ^R 3.09 4.51 ^R	
				Ma	aintenance)							
Nuclear	6.34 3.96 3.50 2.58	6.20 3.59 3.89 2.72	5.79 3.37 3.87 2.42	5.69 3.19 2.70 2.16	5.27 2.98 2.73 1.89	5.38 ^R 2.96 ^R 2.76 ^R 2.14 ^R	5.23 2.72 2.32 2.26	5.04 2.67 2.62 2.38	5.02 2.61 2.89 3.33	4.96 2.42 2.22 3.26	5.01 2.46 2.03 4.78	5.77 2.41 1.58 3.42	
					Fuel								
Nuclear	5.35 32.30 51.93	5.29 28.43 64.23	4.99 23.88 58.75	4.85 23.09 53.89	4.63 21.69 55.52	4.58 ^R 18.21 ^R 45.18 ^R	4.60 17.29 43.89	4.60 16.09 31.84	4.67 18.15 43.55	4.90 17.73 41.76	5.16 15.50 27.95	5.39 15.86 22.85	
				Т	otal								
Nuclear	21.69 40.48 8.38 57.55	21.37 ^R 35.75 ^R 9.67 70.72 ^R	20.32 ^R 30.88 ^R 9.32 64.43 ^R	19.57 ^R 29.85 ^R 6.46 59.56 ^R	18.15 ^R 27.88 ^R 6.68 61.10 ^R	18.93 ^R 24.31 ^R 6.60 ^R 51.59 ^R	18.95 ^R 22.75 ^R 5.79 49.66 ^R	18.65 ^R 21.36 6.33 37.47 ^R	18.13 ^R 23.23 ^R 7.16 50.53 ^R	15.89 ^R 22.32 ^R 5.74 48.94 ^R	18.35 ^R 20.12 ^R 5.38 37.74 ^R	21.02 ^R 20.45 ^R 4.67 30.79 ^R	

¹ Conventional hydro and pumped storage.

Notes: • Data for the years 1998 - 2008 were updated reflecting revisions reported by Ventyx Global Energy Velocity Suite. • Expenses are average expenses weighted by net generation. • A mill is a monetary cost and billing unit equal to 1/1000 of the U.S. dollar (equivalent to 1/10 of one cent). • Totals may not equal sum of components because of independent rounding. Source: Federal Energy Regulatory Commission, FERC Form 1, "Annual Report of Major Electric Utilities, Licensees and Others via Ventyx Global Energy Velocity Suite."

² Gas turbine, internal combustion, photovoltaic, and wind plants.

R = Revised.

Table 8.3. Revenue and Expense Statistics for Major U.S. Publicly Owned Electric Utilities (With Generation Facilities), 1998 through 2009

(Million Dollars)

Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Operating Revenue - Electric	NA	NA	NA	NA	NA	NA	33,906	32,776	38,028	31,843	26,767	26,155
Operating Expenses - Electric	NA	NA	NA	NA	NA	NA	29,637	28,638	32,789	26,244	21,274	20,880
Operation Including Fuel	NA	NA	NA	NA	NA	NA	22,642	21,731	25,922	19,575	15,386	15,120
Production	NA	NA	NA	NA	NA	NA	17,948	17,176	21,764	15,742	11,923	11,608
Transmission	NA	NA	NA	NA	NA	NA	872	858	785	781	732	773
Distribution	NA	NA	NA	NA	NA	NA	696	680	605	574	516	603
Customer Accounts	NA	NA	NA	NA	NA	NA	582	537	600	507	415	390
Customer Service	NA	NA	NA	NA	NA	NA	280	315	263	211	160	127
Sales	NA	NA	NA	NA	NA	NA	84	74	73	66	49	51
Administrative and General	NA	NA	NA	NA	NA	NA	2,180	2,090	1,832	1,695	1,591	1,567
Maintenance	NA	NA	NA	NA	NA	NA	2,086	1,926	1,904	1,815	1,686	1,631
Depreciation and Amortization	NA	NA	NA	NA	NA	NA	3,844	3,907	4,009	3,919	3,505	3,459
Taxes and Tax Equivalents	NA	NA	NA	NA	NA	NA	1,066	1,074	954	936	697	670
Net Electric Operating Income	NA	NA	NA	NA	NA	NA	4,268	4,138	5,238	5,598	5,493	5,275

NA = Not available

Notes: • In 2004, Form EIA-412 was terminated. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, EIA Form-412, "Annual Electric Industry Financial Report," and predecessor forms.

Table 8.4. Revenue and Expense Statistics for Major U.S. Publicly Owned Electric Utilities (Without Generation Facilities), 1998 through 2009

(Million Dollars)

(1/11111011	Domai	9)										
Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Operating Revenue - Electric	NA	NA	NA	NA	NA	NA	12,454	11,546	10,417	9,904	9,354	8,790
Operating Expenses - Electric	NA	NA	NA	NA	NA	NA	11,481	10,703	9,820	9,355	8,737	8,245
Operation Including Fuel	NA	NA	NA	NA	NA	NA	10,095	9,439	8,864	8,424	7,874	7,437
Production	NA	NA	NA	NA	NA	NA	8,865	8,311	7,863	7,486	7,015	6,661
Transmission	NA	NA	NA	NA	NA	NA	105	93	61	64	48	44
Distribution	NA	NA	NA	NA	NA	NA	348	320	311	280	261	230
Customer Accounts	NA	NA	NA	NA	NA	NA	172	163	164	155	143	130
Customer Service	NA	NA	NA	NA	NA	NA	31	39	26	22	22	21
Sales	NA	NA	NA	NA	NA	NA	11	10	15	16	14	9
Administrative and General	NA	NA	NA	NA	NA	NA	562	504	423	402	371	342
Maintenance	NA	NA	NA	NA	NA	NA	418	389	304	286	272	263
Depreciation and Amortization	NA	NA	NA	NA	NA	NA	711	631	405	394	369	330
Taxes and Tax Equivalents	NA	NA	NA	NA	NA	NA	257	244	247	251	223	215
Net Electric Operating Income	NA	NA	NA	NA	NA	NA	974	843	597	549	617	545

NA = Not available

Notes: • In 2004, Form EIA-412 was terminated. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, EIA Form-412, "Annual Electric Industry Financial Report," and predecessor forms.

Table 8.5. Revenue and Expense Statistics for U.S. Federally Owned Electric Utilities, 1998 through 2009

(Million Dollars)

Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Operating Revenue - Electric	NA	NA	NA	NA	NA	NA	11,798	11,470	12,458	10,685	10,186	9,780
Operating Expenses - Electric	NA	NA	NA	NA	NA	NA	8,763	8,665	10,013	8,139	7,775	7,099
Operation Including Fuel	NA	NA	NA	NA	NA	NA	6,498	6,419	7,388	5,873	5,412	5,184
Production	NA	NA	NA	NA	NA	NA	5,175	5,236	6,247	5,497	4,890	4,735
Transmission	NA	NA	NA	NA	NA	NA	307	244	354	332	349	323
Distribution	NA	NA	NA	NA	NA	NA	1	1	1	2	2	2
Customer Accounts	NA	NA	NA	NA	NA	NA	4	10	16	6	1	1
Customer Service	NA	NA	NA	NA	NA	NA	63	60	60	48	50	51
Sales	NA	NA	NA	NA	NA	NA	20	6	6	10	28	14
Administrative and General	NA	NA	NA	NA	NA	NA	927	862	705	467	528	535
Maintenance	NA	NA	NA	NA	NA	NA	600	566	521	488	436	476
Depreciation and Amortization	NA	NA	NA	NA	NA	NA	1,335	1,351	1,790	1,471	1,623	1,175
Taxes and Tax Equivalents	NA	NA	NA	NA	NA	NA	329	328	315	308	304	264
Net Electric Operating Income	NA	NA	NA	NA	NA	NA	3,035	2,805	2,445	2,546	2,411	2,681

NA = Not available

Notes: • In 2004, Form EIA-412 was terminated. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, Form EIA-412, "Annual Electric Industry Financial Report," and predecessor forms.

Table 8.6. Revenue and Expense Statistics for U.S. Cooperative Borrower Owned Electric Utilities, 1998 through 2009

(Million Dollars)

Description	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Operating Revenue - Electric	42,189	42,087 ^R	38,208	36,723	34,088	30,650	29,228	27,458	26,458	25,629	23,824	23,988
Operation and Maintenance Expenses	38,337	38,511 ^R	34,843	33,550	31,209	27,828	26,361	24,561	23,763	22,982	21,283	21,223
Operation Including Fuel	35,412	35,782 ^R	32,229	30,920	28,723	25,420	24,076	22,383	21,703	20,942	19,336	19,280
Production		$30,107^{R}$	26,929	25,799	23,921	20,752	19,559	18,143	17,714	17,080	15,706	15,683
Transmission	862	799	754	748	679	665	637	579	524	525	466	452
Distribution	2,395	2,327 ^R	2,161	2,037	1,895	1,860	1,787	1,681	1,589	1,530	1,451	1,440
Customer Accounts		714 ^R	677	655	612	595	579	545	532	487	455	446
Customer Service	186	176	163	158	147	141	140	136	119	133	132	132
Sales		81	78	80	76	80	79	79	88	82	81	77
Administrative and General	1,686	1,577 ^R	1,468	1,444	1,393	1,327	1,295	1,219	1,137	1,104	1,045	1,050
Depreciation and Amortization	2,656	2,462 ^R	2,350	2,367	2,253	2,182	2,076	1,992	1,895	1,820	1,747	1,732
Taxes and Tax Equivalents	269	267 ^R	264	262	234	226	209	186	164	220	200	211
Net Electric Operating Income	3,852	3,576 ^R	3,365	3,173	2,879	2,822	2,867	2,897	2,696	2,647	2,541	2,764

R = Revised.

Note: Totals may not equal sum of components because of independent rounding.

Source: U.S. Department of Agriculture, Rural Utilities Service (prior Rural Electrification Administration), Statistical Report, Rural Electric Borrowers publications, as compiled from RUS Form 7 and RUS Form 12.

Chapter 9. Demand-Side Management

Table 9.1. Demand-Side Management Actual Peak Load Reductions by Program Category, 1998 through 2009

(Megawatts)

Item	2009	2008 ^R	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Total Actual Peak Load Reduction	31,682	31,735	30,253	27,240	25,710	23,532	22,904	22,936	24,955	22,901	26,455	27,231
Energy Efficiency	19,766	19,707	17,710	15,959	15,351	14,272	13,581	13,420	13,027	12,873	13,452	13,591
Load Management	11,916	12,028	12,543	11,281	10,359	9,260	9,323	9,516	11,928	10,027	13,003	13,640

R = Revised.

Notes: • Data presented are reflective of large utilities. • See Technical Notes for the Demand-Side Management definitions located within the Form EIA-861 section. • Totals may not equal sum of components because of independent rounding.

Table 9.2. Demand-Side Management Program Annual Effects by Program Category, 1998 through 2009

Item	2009	2008 ^R	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
					Annual I	Effects – Er	ergy Effici	ency				
Large Utilities												
Actual Peak Load Reduction (MW)	19,766	19,707	17,710	15,959	15,351	14,272	13,581	13,420	13,027	52,827	49,691	48,775
Energy Savings (Thousand MWh)	76,891	74,861	67,134	62,951	58,891	52,662	48,245	52,285	52,946	12,873	13,452	13,591
					Annual E	ffects - Lo	ad Manage	ment				
Large Utilities												
Actual Peak Load Reduction (MW)	11,916	12,028	12,543	11,281	10,359	9,260	9,323	9,516	11,928	10,027	13,003	13,640
Potential Peak Load Reductions (MW)	26,178	26,246	23,087	21,270	21,282	20,998	25,290	26,888	27,730	28,496	30,118	27,840
Energy Savings (Thousand MWh)	1,015	1,813	1,857	865	1,006	2,047	2,020	1,790	990	875	872	392

R = Revised.

Notes: • See Technical Notes for the Demand-Side Management definitions located within the Form EIA-861 section. • Totals may not equal sum of components because of independent rounding.

Table 9.3. Demand-Side Management Program Incremental Effects by Program Category, 1998 through 2009

Item	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
				Incr	emental	Effects -	- Energy	Efficien	cy			
Large Utilities												
Actual Peak Load Reduction (MW)	2,941	5,764 ^R	1,649	1,177	1,403	1,521	945	1,054	999	720	695	796
Energy Savings (Thousand MWh)	12,698	10,407 ^R	7,426	5,385	5,872	4,522	2,939	3,543	4,402	3,284	3,027	3,324
Small Utilities												
Actual Peak Load Reduction (MW)	777	567	349	91	302	204	90	49	20	25	22	12
Energy Savings (Thousand MWh)	209	21	254	9	7	10	8	192	8	8	8	37
				Incre	emental l	Effects –	Load M	anageme	ent			
Large Utilities												
Actual Peak Load Reduction (MW)	2,152	2,923 ^R	1,356	1,495	1,009	907	1,084	1,160	1,297	919	1,568	1,821
Potential Peak Load Reductions (MW)	5,811	6,636 ^R	3,342	2,544	2,005	2,622	1,981	2,655	2,448	2,439	6,457	2,832
Energy Savings (Thousand MWh)	65	167 ^R	132	95	133	2	29	65	79	63	67	37
Small Utilities												
Actual Peak Load Reduction (MW)	75	371	1,036	195	153	242	81	54	45	137	54	124
Potential Peak Load Reductions (MW)	232	620	1,423	273	218	422	131	76	177	190	84	160
Energy Savings (Thousand MWh)	1	1	5	4	5	4	4	2	4	9	2	7

R = Revised.

Notes: • See Technical Notes for the Demand-Side Management definitions located within the Form EIA-861 section. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 9.4. Demand-Side Management Program Annual Effects by Sector, 1998 through 2009

Item	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
					Actual Pe	ak Load R	eductions	(MW)				
Large Utilities												
Residential	12,605	$12,910^{R}$	13,192	10,730	9,432	8,870	9,431	9,137	9,619	9,446	9,976	9,327
Commercial	11,399	11,097 ^R	8,054	7,779	7,926	7,194	6,774	6,839	8,210	6,987	7,777	9,482
Industrial	7,666	$7,602^{R}$	8,990	8,692	8,343	7,454	6,594	6,500	6,553	6,141	6,360	7,927
Transportation	12	126	17	39	9	14	105	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	460	573	327	2,342	495
Total	31,682	$31,735^{R}$	30,253	27,240	25,710	23,532	22,904	22,936	24,955	22,901	26,455	27,231
				1	Potential P	eak Load l	Reductions	(MW)				
Large Utilities								,				
Residential	15,986	16,831 ^R	15,263	13,040	12,097	11,967	12,525	12,072	12,274	12,970	12,812	13,022
Commercial	14,366	$13,850^{R}$	10,201	10,006	10,214	9,624	8,943	9,298	10,469	9,114	8,868	12,210
Industrial	15,502	15,103 ^R	15,271	14,119	14,260	13,665	17,298	18,321	17,344	18,775	17,237	15,512
Transportation	90	169	62	64	62	14	105	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	617	670	510	4,653	686
Total	45,944	45,953 ^R	40,797	37,229	36,633	35,270	38,871	40,308	40,757	41,369	43,570	41,430
					Energy S	Savings (Tl	nousand M	(Wh)				
Large Utilities					O.	0 (
Residential	27,811	$26,534^{R}$	23,688	21,437	19,255	17,763	13,469	15,438	16,027	16,287	16,263	16,564
Commercial	35,019	$34,869^{R}$	30,725	28,982	28,416	24,624	25,089	24,391	24,217	25,660	23,375	25,125
Industrial	15,002	15,196 ^R	14,470	13,348	12,178	12,273	11,156	11,339	10,487	9,160	8,156	3,347
Transportation	76	76	109	50	48	51	551	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	2,907	3,206	2,593	2,770	831
Total	77,907	76,674 ^R	68,992	63,817	59,897	54,710	50,265	54,075	53,936	53,701	50,563	49,167

NA = Not available.

R = Revised.

Notes: • See Technical Notes for the Demand-Side Management definitions located within the Form EIA-861 section. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 9.5. Demand-Side Management Program Incremental Effects by Sector, 1998 through 2009

Item	2009	2008	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
			•		Actual Pea	ak Load R	eductions	(MW)		•	•	
Large Utilities												
Residential	2.055	5.507 ^R	1.344	1.012	966	1.361	640	895	790	572	605	599
Commercial	1,598	2,329 ^R	983	759	715	560	528	527	742	515	684	1,176
Industrial	1.436	849 ^R	677	901	731	507	849	680	640	502	929	799
Transportation	4	2	1	0	0	0	12	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	112	124	50	45	43
Total	5,093	8,687 ^R	3,005	2,672	2,412	2,428	2.029	2,214	2,296	1,640	2,263	2,617
Small Utilities				,	•		•	•		•		•
Residential	586	220	871	131	325	280	88	48	32	37	27	35
Commercial	226	287	342	63	71	126	58	41	15	37	22	34
Industrial	40	431	130	92	59	40	25	12	16	62	7	56
Transportation	0	0	42	0	0	0	0	NA	NA	NA	NÁ	NA
Other	NA	NA	NA	NA	NA	NA	NA	0	0	26	19	10
Total	852	938	1,385	286	455	446	171	101	63	162	76	136
U.S. Total	5,945	9,625 ^R	4,390	2,958	2,867	2,874	2.200	2,317	2,361	1,802	2,339	2,753
U.S. 10tal	3,743	9,023	4,370			eak Load I			2,301	1,002	4,337	2,733
Large Utilities				•	otential 1	un Boud I	.tcuuction.	(1,1,1,1)				
Residential	3,118	7,246 ^R	2.374	1,406	1.311	1.680	752	1.311	900	699	753	751
Commercial	2,762	3,025 ^R	1,574	1,114	1,098	894	602	751	1,115	565	718	1,863
Industrial	2,849	2,127 ^R	1,042	1,201	999	1.569	1.551	1.506	1,277	1.815	5,612	1,438
Transportation	23	2,127	1,0.2	0	0	0	21	NA	NA	NA	NA	NA
Other	NA	NĀ	NA	NA	NA	NA	NA	141	155	79	68	76
Total	8,752	12,400 ^R	4,991	3,721	3,408	4.143	2.926	3,709	3,447	3,159	7.151	3,628
Small Utilities	0,752	12,100	1,221	3,721	3,100	1,115	2,>20	3,707	3,117	3,137	7,131	3,020
Residential	653	315	962	164	367	395	116	64	158	55	41	49
Commercial	251	304	513	95	100	154	73	43	19	51	25	41
Industrial	105	568	243	105	53	77	32	15	18	64	9	70
Transportation	0	0	54	0	0	0	0	NA	NA	NA	NÁ	NA
Other	NA	NA	NA	NA	NA	NA	NA	3	2	44	31	12
Total	1,009	1,187	1,772	364	520	626	221	125	197	215	106	172
	9,761	13,587 ^R	6,763	4,085	3.928	4,769	3.147	3,834	3,644	3,374	7,257	3,800
U.S. Total	9,701	13,567	0,703	4,005		avings (Th	- /		3,044	3,3/4	1,231	3,800
Large Utilities					Energy	avings (11	iousanu w	1 ** 11)				
Residential	4.867	4.584 ^R	3,515	2.141	2.276	1.842	868	1.203	1.365	856	990	909
Commercial	4.975	4,440 ^R	2.831	2,339	2,638	1.815	1.356	1,583	1,867	1.780	1.502	1.703
Industrial	2.920	1.549 ^R	1.199	999	1.090	867	732	706	872	547	475	645
Transportation	2,920	1,549	1,199	0	1,090	0	12	NA	NA	NA	NA	NA
Other	NA	NA	NA	NA	NA	NA	NA	116	376	164	127	104
Total	12,763	10,574 ^R	7,558	5,479	6,004	4,524	2,968	3,608	4,481	3,347	3,094	3,361
	12,703	10,374	1,330	3,479	0,004	4,324	2,900	3,000	4,401	3,347	3,094	3,301
Small Utilities	197	16	157	9	6	6	7	45	5	9	4	8
Residential	197	4	98	3	5	6 7	5		3	4	3	
Commercial	8	•			5 *	,	3	148		•	-	6
Industrial	8	2	4	1		2	0	2	2	1	1	3
Transportation		•	0	0	0	0	0	NA *	NA	NA	NA	NA
Other	NA	NA	NA 250	NA	NA	NA	NA		3	3	1	1
Total	210	22 10.70 cR	259	13	12	14	13	194	13	17	9	18
U.S. Total	12,972	10,596 ^R	7,817	5,492	6,016	4,539	2,981	3,802	4,492	3,364	3,103	3,379

^{* =} Value is less than half of the smallest unit of measure.

NA = Not available.

R = Revised.

Notes: • See Technical Notes for the Demand-Side Management definitions located within the Form EIA-861 section. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 9.6. Demand-Side Management Program Energy Savings, 1998 through 2009

(Thousand Megawatthours)

Item	2009	2008 ^R	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Total Energy Savings	77,907	76,674	68,992	63,817	59,897	54,710	50,265	54,075	53,936	53,701	50,563	49,167
Energy Efficiency	76,891	74,861	67,134	62,951	58,891	52,662	48,245	52,285	52,946	52,827	49,691	48,775
Load Management	1,015	1,813	1,857	865	1,006	2,047	2,020	1,790	990	875	872	392

R = Revised.

Notes: • Data presented are reflective of large utilities. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

Table 9.7. Demand-Side Management Program Direct and Indirect Costs, 1998 through 2009 (Thousand Dollars)

Item	2009	2008 ^R	2007	2006	2005	2004	2003	2002	2001	2000	1999	1998
Direct Cost ¹ 3	3,199,568	2,994,280	2,364,739	1,923,891	1,794,809	1,425,172	1,159,540	1,420,937	1,455,602	1,384,232	1,250,689	1,233,018
Energy Efficiency	2,255,451	2,158,242	1,664,563	1,258,158	1,169,241	910,115	807,403	1,007,323	1,097,504	938,666	820,108	766,384
Load Management	944,117	836,038	700,176	665,733	625,568	515,057	352,137	413,614	358,098	445,566	430,581	466,634
Indirect Cost ²	394,182	181,131	158,378	127,499	126,543	132,294	137,670	204,600	174,684	180,669	172,955	187,902
Total DSM Cost ³ 3	3,593,750	3,175,410	2,523,117	2,051,394	1,921,352	1,557,466	1,297,210	1,625,537	1,630,286	1,564,901	1,423,644	1,420,920

¹ Reflects electric utility costs incurred during the year that are identified with one of the demand-side program categories.

Notes: • Data presented are reflective of large utilities. • Includes expenditures reported by large electric utilities, only. See the data files for Demand Side Management expenditures of small utilities. • Totals may not equal sum of components because of independent rounding.

Source: U.S. Energy Information Administration, Form EIA-861, "Annual Electric Power Industry Report."

² Reflects costs not directly attributable to specific programs.

³ Reflects the sum of the total incurred direct and indirect cost for the year.

R = Revised

Appendices

Appendix A.

Technical Notes

This appendix describes how the U.S. Energy Information Administration (EIA) collects, estimates, and reports electric power data in the *Electric Power Annual*. Following is a description of the ongoing data quality efforts and sources of data for the *Electric Power Annual*.

Data Quality

The *Electric Power Annual* (EPA) is prepared by the Office of Electricity, Renewables, and Uranium Statistics (ERUS), U.S. Energy Information Administration (EIA), U.S. Department of Energy (DOE). ERUS performs routine reviews of the data collected and the forms on which they are collected. Additionally, to assure that the data are collected from the complete set of respondents, ERUS routinely reviews the frames for each data collection.

Unified Data Submission Process

Data are entered directly by respondents into the ERUS e-filing system. A small number of hard copy forms are keyed by ERUS. All data are subject to review via edits built into the system, additional quality assurance reports, and review by subject matter experts. Questionable data values are verified through contacts with respondents. Also, survey non-respondents are identified and contacted.

Initial edit checks of the data are performed through the system by the respondent. Other program edits include both deterministic checks, in which records are checked for the presence of data in required fields, and statistical checks, in which the data are checked against a range of values based on historical data values and for logical or mathematical consistency with data elements reported in the survey. Discrepancies found in the data, as a result of these checks, are resolved either by the processing staff or by further information obtained from a telephone call to the respondent company.

Those respondents unable to use the electronic reporting method provide the data in hard copy, typically via fax and e-mail. These data are manually entered into the computerized database and are subjected to the same data edits as those that are electronically submitted. Resolution of questionable data is accomplished via telephone or e-mail contact with the respondents.

Reliability of Data

Annual survey data have nonsampling errors. Non-sampling errors can be attributed to many sources: (1) inability to obtain complete information about all cases (i.e., nonresponse); (2) response errors; (3) definitional difficulties; (4) differences in the interpretation of questions; (5) mistakes in recording or coding the data; and (6) other errors of collection, response, coverage, and estimation for missing data.

Although no direct measurement of the biases due to nonsampling errors can be obtained, precautionary steps were taken in all phases of the frame development and data collection, processing, and tabulation processes, in an effort to minimize their influence.

Imputation. If the reported values appeared to be in error and the data issue could not be resolved with the respondent, or if the facility was a nonrespondent, a regression methodology was used to impute for the facility. ^{1,2,3,4,5} The regression methodology relies on other data to make estimates for erroneous or missing responses.

The basic technique employed is described in the paper "Model-Based Sampling and Inference²," on the EIA website. Additional references can be found on the InterStat website. The basis for the current methodology involves a 'borrowing of strength' technique for small domains.^{1,6,7}

Data Revision Procedure

ERUS has adopted the following procedures with respect to the revision of data disseminated in energy data products:

 Annual survey data are disseminated either as preliminary or final when first appearing in a data product. Data initially released as preliminary will be so noted in the data

¹ Knaub, J.R., Jr. (1999a), "Using Prediction-Oriented Software for Survey Estimation," InterStat, August 1999, http://interstat.statjournals.net/

² Knaub, J.R. Jr. (1999b), "Model-Based Sampling, Inference and Imputation," EIA web site:

http://www.eia.gov/cneaf/electricity/forms/eiawebme.pdf

³ Knaub, J.R., Jr. (2005), "Classical Ratio Estimator," InterStat, October 2005, http://interstat.statjournals.net/.

⁴ Knaub, J.R., Jr. (2007a), "Cutoff Sampling and Inference," InterStat, April 2007, https://interstat.statjournals.net/.

Knaub, J.R., Jr. (2008), forthcoming. "Cutoff Sampling." Definition in Encyclopedia of Survey Research Methods, Editor: Paul J. Lavrakas, Sage, to appear.

⁶Knaub, J.R., Jr. (2000), "Using Prediction-Oriented Software for Survey Estimation - Part II: Ratios of Totals," InterStat, June 2000, http://interstat.statjournals.net/

⁷ Knaub, J.R., Jr. (2001), "Using Prediction-Oriented Software for Survey Estimation - Part III: Full-Scale Study of Variance and Bias,"

product. These data are typically released as final by the next dissemination of the same product; however, if final data are available at an earlier interval they may be released in another product.

- After data are disseminated as final, further revisions will be considered if they make a difference of 1 percent or greater at the national level. Revisions for differences that do not meet the 1 percent or greater threshold will be determined by the Office Director. In either case, the proposed revision will be subject to the EIA revision policy concerning how it affects other EIA products.
- The magnitudes of changes due to revisions experienced in the past will be included periodically in the data products, so that the reader can assess the accuracy of the data.

The *Electric Power Annual* presents the most current annual data available to the EIA. The statistics may differ from those published previously in EIA publications due to corrections, revisions, or other adjustments to the data subsequent to its original release.

Sensitive Data (Formerly Identified as Data Confidentiality). Most of the data collected on the electric power surveys are not considered business sensitive. However, the data that are classified as sensitive are handled by ERUS consistent with EIA's "Policy on the Disclosure of Individually Identifiable Energy Information in the Possession of the EIA" (45 Federal Register 59812 (1980)).

Rounding and Percent Change Calculations

Rounding Rules for Data. To round a number to n digits (decimal places), add one unit to the nth digit if the (n+1) digit is 5 or larger and keep the nth digit unchanged if the (n+1) digit is less than 5. The symbol for a number rounded to zero is (*).

Percent Change. The following formula is used to calculate percent differences.

Percent Change =
$$\left(\frac{x(t_2)-x(t_1)}{x(t_1)}\right)x 100$$
,

where x (t_1) and x (t_2) denote the quantity at year t_1 and subsequent year t_2 .

Data Sources for *Electric Power Annual*

Data published in the *Electric Power Annual* are compiled from forms filed annually or aggregated to an annual basis from monthly forms by electric utilities and electricity generators (see figure on EIA Electric Industry Data Collection at the end of Appendix A.) The EIA forms used are:

- Form EIA-411, "Coordinated Bulk Power Supply Program Report;"
- Form EIA-860, "Annual Electric Generator Report;" [Modified]
- Form EIA-861, "Annual Electric Power Industry Report;"
- Form EIA-923, "Power Plant Operations Report,"

These forms can be found on the EIA Internet website at: http://www.eia.gov/cneaf/electricity/page/forms.html.

The purpose of each form follows.

Survey data from other Federal sources are also utilized for this publication. They include:

- Department of Energy Form OE-781R, "Annual Report of International Electric Export/Import Data" (Office of Electricity Delivery and Energy Reliability);
- Federal Energy Regulatory Commission Form 1, "Annual Report of Major Electric Utilities, Licensees, and Others;"
- Rural Utility Service Form 7, "Financial and Statistical Report;" and
- Rural Utility Service Form 12, "Operating Report Financial."

In addition to the above-named forms, the historical data published in the EPA are compiled from the following sources:

- Form EIA-412, "Annual Electric Industry Financial Report,"
- Federal Energy Regulatory Commission Form 423, "Cost and Quality of Fuels for Electric Plants,"
- Form EIA-423, "Monthly Cost and Quality of Fuels for Electric Plants Report;" [Replaced]
- Form EIA-759, "Monthly Power Plant Report,"
- Form EIA-767, "Steam-Electric Plant Operation and Design Report;" [Replaced]

- Form EIA-860A, "Annual Electric Generator Report—Utility,"
- Form EIA-860B, "Annual Electric Generator Report–Nonutility,"
- Form EIA-867, "Annual Non-utility Power Producer Report,"
- Form EIA-900, "Monthly Nonutility Power Report,"
- Form EIA-906, "Power Plant Report;" [Replaced] and
- Form EIA-920, "Combined Heat and Power Plant Report." [Replaced]

Additionally, some data reported in this publication were acquired from the National Energy Board of Canada.

Meanings of Symbols Appearing in Tables

Some symbols appearing in the data tables have further standardized to describe all data collected by the Office of Electricity, Renewables, and Uranium Statistics of EIA. The meanings are indicated in footnotes on the applicable tables and include the following:

- * The value reported is less than half of the smallest unit of measure, but is greater than zero.
- P Usage of this symbol indicates a preliminary value. The P is defined in endnotes as "P=Preliminary data."
- NM Data value is not meaningful when compared to the same value for the previous month or the previous year. This symbol is also used to indicate a data value is not meaningful due to having a high Relative Standard Error (RSE).

Form EIA-411

The Form EIA-411 is filed as a mandatory report except for Schedule 7 (Transmission Outages) that is still voluntary reported. The information reported includes: (1) actual energy and peak demand for the preceding year and five additional years; (2) existing and future generating capacity; (3) scheduled capacity transfers; (4) projections of capacity, demand, purchases, sales, and scheduled maintenance; and (5) bulk power system maps. The report presents various North American Electric Reliability Corporation (NERC) regional council aggregate totals for their member electric utilities, with some nonmember information included. The eight NERC councils submit data for the Form EIA-411 to NERC. A joint

response, through the NERC Headquarters, is filed annually on July 15. The forms are compiled from data furnished by electricity generators and electric utilities (members, associates, and nonmembers) within the council areas.

Instrument and Design History. The Form EIA-411 program was initiated under the Federal Power Commission Docket R-362, Reliability and Adequacy of Electric Service, and Orders 383-2, 383-3, and 383-4. The Department of Energy, established in October 1977, assumed the responsibility for this activity. Until 2008, this form was considered voluntary under the authority of the Federal Power Act (Public Law 88-280), The Federal Energy Administration Act of 1974 (Public Law 93-275), and the Department of Energy Organization Act (Public Law 95-91). The responsibility for collecting these data had been delegated to the Office of Emergency Planning and Operations within the Department of Energy and was transferred to EIA for the reporting year 1996.

Issues within Historical Data Series

The Florida Reliability Coordinating Council (FRCC) separated itself from the Southeastern Electric Reliability Council (SERC) in the mid-1990s and all time series data have been adjusted. In 1998, several utilities realigned from Southwest Power Pool (SPP) to SERC. Adjustments were made to the information to account for the separation and to address the tracking of shared reserve capacity that was under long-term contracts with multiple members. Name changes altered both the Mid-Continent Area Power Pool (MAPP) to the Midwest Reliability Organization (MRO) and the Western Systems Coordinating Council (WSCC) to the Western Electricity Coordinating Council (WECC). The MRO membership boundaries have altered over time, but WECC membership boundaries have not. The utilities in the associated regional entity identified as the Alaska System Coordination Council (ASCC) dropped their formal participation in NERC. Both the States of Alaska and Hawaii are not contiguous with the other continental States and have no electrical interconnections. At the close of calendar year 2005, the following reliability regional councils were dissolved: East Central Area Reliability Coordination Agreement (ECAR), Mid-Atlantic Area Council (MAAC), and Mid-America Interconnected Network (MAIN).

On January 1, 2006, the Reliability First Corporation (RFC) came into existence as a new regional reliability council. Individual utility membership in the former ECAR, MAAC, and MAIN councils mostly shifted to RFC. However, adjustments in membership as utilities joined or left various reliability councils impacted MRO, SERC, and SPP. The Texas Regional Entity (TRE) was formed from a delegation of authority from NERC to handle the regional responsibilities of the Electric Reliability

Council of Texas (ERCOT). The revised delegation agreements covering all the regions were approved by the Federal Energy Regulatory Commission on March 21, 2008. Reliability Councils that are unchanged include: Florida Reliability Coordinating Council (FRCC), Northeast Power Coordinating Council (NPCC), and the Western Electricity Coordinating Council (WECC). The historical time series have not been adjusted to account for individual membership shifts.

The new NERC Regional Entity names are as follows:

- Florida Reliability Coordinating Council (FRCC),
- Midwest Reliability Organization (MRO),
- Northeast Power Coordinating Council (NPCC),
- Reliability First Corporation (RFC),
- Southeastern Electric Reliability Council (SERC),
- Southwest Power Pool (SPP),
- Texas Regional Entity (TRE), and
- Western Electricity Coordinating Council (WECC).

Concept of Demand within the EIA-411: Historically, the Form EIA-411 has used the electric power industry's methodology for examining aggregated supply and demand. To get to the megawatts of power that are determined to be available for planning purposes each year, different categories are subtracted from the theoretical true totals. The definitions for demand are as follows:

- Net Internal Demand: Internal Demand less Direct Control Load Management and Interruptible Demand.
- Internal Demand: To collect these data, NERC develops a Total Internal Demand that is the sum of the metered (net) outputs of all generators within the system and the metered line flows into the system, less the metered line flows out of the system. The demand of station service or auxiliary needs (such as fan motors, pump motors, and other equipment essential to the operation of the generating units) is not included nor are any requirement customer (utility) load or capacity found behind the line meters on the system.
- Direct Control Load Management:

 Demand-Side Management that is under the direct control of the system operator. DCLM may control the electric supply to individual appliances or equipment on customer premises; it does not included Interruptible Demand
- Interruptible Demand: The magnitude of customer demand that, in accordance with

contractual arrangements, can be interrupted at the time of the Regional Council's seasonal peak by direct control of the System Operator or by action of the customer at the direct request of the System Operator.

Sensitive Data (Formerly Identified as Data Confidentiality). Power flow cases and maps are considered business sensitive.

Form EIA-412 [Terminated]

The Form EIA-412 was used annually to collect accounting, financial, and operating data from major publicly owned electric utilities in the United States. Those publicly owned electric utilities engaged in the generation, transmission, or distribution of electricity which had 150,000 megawatthours of sales to ultimate consumers and/or 150,000 megawatthours of sales for resale for the two previous years, as reported on the Form EIA-861, "Annual Electric Utility Report," were required to submit the Form EIA-412. The Form EIA-412 was made available in January to collect data as of the end of the preceding calendar year. The completed surveys were due to EIA on or before April 30.

Instrument and Design History. The Federal Power Commission (FPC) created the FPC Form 1M in 1961 as a mandatory survey. It became the responsibility of the EIA in October 1977 when the FPC was merged with DOE. In 1979, the FPC Form 1M was superseded by the Economic Regulatory Administration (ERA) Form ERA-412, and in January 1980 by the Form EIA-412.

Beginning in 1996 data represent those electric a threshold utilities meeting of 120,000 megawatthours for ultimate consumers' sales and/or resales. The criteria used to select the respondents for this survey fit approximately 500 publicly owned electric utilities. Federal electric utilities are required to file the Form EIA-412. The financial data for the U.S. Army Corps of Engineers (except for Saint Mary's Falls at Sault Ste. Marie, Michigan); the U.S. Department of Interior, Bureau of Reclamation; and the U.S. International Boundary and Water Commission were collected on the Form EIA-412 from the Federal power marketing administrations. The form was terminated after the 2003 data year.

Issues within Historical Data Series

Beginning with the 2001 data collection, the plant statistics reported on Schedule 9 were also collected from unregulated entities that own plants with a nameplate capacity of 10 megawatts or greater. Also beginning with the 2003 collection, the transmission

data reported in Schedules 10 and 11 were collected from each generation and transmission cooperative owning transmission lines having a nominal voltage of 132 kilovolts or greater.

For 2001 - 2003, California Department of Water Resources - Electric Energy Fund data were included in the EIA-412 data tables. In response to the energy shortfall in California, in 2001 the California State legislature authorized the California Department of Water Resources, using its undamaged borrowing capability, to enter the wholesale markets on behalf of the California retail customers effective on January 17, 2001 and for the period ending December 31, 2002. Their 2001 revenue collected \$5,501,000,000 with purchased power costs of \$12,055,000,000. Their 2002 revenue collected was \$4,210,000,000 with purchased power costs of \$3,827,749,811. Their 2003 revenue collected was \$4,627,000,000 with purchased power costs of \$4,732,000,000. The California Public Utility Commission was required by statute to establish the procedures for retail revenue recovery mechanisms for their purchase power costs in the future.

Sensitive Data (Formerly Identified as Data Confidentiality). The nonutility data collected on Schedule 9 "Electric Generating Plant Statistics" for "Cost of Plant" and "Production Expenses," are considered business sensitive.

Form EIA-423 [Replaced in 2008 by the Form EIA-923]

The Form EIA-423, "Monthly Cost and Quality of Fuels for Electric Plants Report," collected information from selected electric generating plants in the United States. The data collected on this survey included the cost and quality of fossil fuels delivered to nonutility plants to produce electricity. These plants included independent power producers (including those facilities that formerly reported on the FERC Form 423) and commercial and industrial combined heat and power producers whose total fossil-fueled nameplate generating capacity is 50 or more megawatts.

Instrument and Design History. The Form EIA-423^s was originally implemented in January 2002 to collect monthly cost and quality data for fossil fuel receipts from owners or operators of nonutility electricity generating plants. It was terminated on January 1, 2008, and replaced by the Form EIA-923, "Power Plant Operations Report."

Issues within Historical Data Series

Natural gas values for 2001 forward do not include blast furnace gas or other gas.

Sensitive Data (Formerly Identified as Data Confidentiality). Plant fuel cost data collected on the survey are considered business sensitive. State and national level aggregations will be published in this report if sufficient data are available to avoid disclosure of individual company and plant level costs.

FERC Form 423 [Replaced in 2008 by Form EIA-923]

The Federal Energy Regulatory Commission (FERC) Form 423, "Monthly Report of Cost and Quality of Fuels for Electric Plants," was administered by FERC. The data were downloaded from the Commission's website into an EIA database. The Form was filed by approximately 600 regulated plants. To meet the old criteria for filing, a plant must have had a total steam turbine electric generating capacity and/or combinedcycle (gas turbine with associated steam turbine) generating capacity of 50 or more megawatts. Only fuel delivered for use in steam-turbine and combinedcycle units was reported. Fuel received for use in gasturbine or internal-combustion units that was not associated with a combined-cycle operation is not reported. The 2007 data collection represents the last year where the information came from the FERC Form 423.

Instrument and Design History. On July 7, 1972, the Federal Power Commission (FPC) issued Order Number 453 enacting the New Code Federal Regulations, Section 141.61, legally creating the FPC Form 423. Originally, the form was used to collect data only on fossil-steam plants, but was amended in 1974 to include data on internalcombustion and combustion-turbine units. The FERC Form 423 replaced the FPC Form 423 in January 1983. The FERC Form 423 eliminated peaking units, for which data were previously collected on the FPC Form 423. In addition, the generator nameplate capacity threshold was changed from 25 megawatts to 50 megawatts. This reduction in coverage eliminated approximately 50 utilities and 250 plants. All historical FPC Form 423 data in this publication were revised to reflect the new generator-nameplatecapacity threshold of 50 or more megawatts reported on the FERC Form 423. In January 1991, the collection of data on the FERC Form 423 was extended to include combined-cycle units. Historical data have not been revised to include these units. Starting with the January 1993 data, the FERC began to collect the data directly from the respondents. On January 1, 2008, EIA assumed responsibility for collection and the information is now under the Form EIA-923, "Power Plant Operations Report."

⁸ Due to the restructuring of the electric power industry, many plants which had historically submitted this information for utility plants on the FERC Form 423 (see subsequent section) were being transferred to the nonutility sector. As a result, a large percentage of fossil fuel receipts were no longer being reported. The Form EIA-423 was implemented to fill this void and to capture the data associated with existing nonregulated power producers. Its design closely follows that of the FERC Form 423.

Formulas and Methodologies. Data for the FERC Form 423 were collected at the plant level. These data were then used in the same formulas used by the Form EIA-423 to produce aggregates and averages for each fuel type at the State, Census division, and U.S. levels.

Issues within Historical Data Series. The FERC Form 423 data published by EIA have been reviewed for consistency between volumes and prices and for their consistency over time.

Receipts data for regulated utilities were compiled by EIA from data collected by the Federal Energy Regulatory Commission (FERC) on the FERC Form 423. These data were collected by FERC for regulatory rather than statistical and publication purposes. EIA did not attempt to resolve any late filing issues in the FERC Form 423 data. Due to the estimation procedure discussed previously, 2003 and later data cannot be directly compared to previous years' data.

Sensitive Data (Formerly Identified as Data Confidentiality). Data collected on FERC Form 423 are not considered to be business sensitive.

Form EIA-767 [Replaced by Forms EIA-860 and EIA-923]

The Form EIA-767 was used to collect data annually on plant operations and equipment design, including boiler, generator, cooling system, air pollution control equipment, and stack characteristics. Data were collected from a mandatory restricted-universe census of all electric power plants with a total existing or planned organic-fueled or combustible renewable steam-electric generator nameplate rating of 10 or more megawatts. The entire form was filed by approximately 800 power plants with a nameplate capacity of 100 or more megawatts. An additional 600 power plants with a nameplate capacity under 100 megawatts submitted information only on fuel consumption and quality, boiler and generator configuration, and nitrogen oxides, mercury, particulate matter, and sulfur dioxide controls.

Instrument and Design History. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data. The predecessor form, FPC-67, "Steam-Electric Plant Air and Water Quality Control Data," was used to collect data from 1969 to 1980, when the form number was changed to Form EIA-767. In 1982, the form was completely redesigned and retitled Form EIA-767, "Steam-Electric Plant Operation and Design Report." In 1986, the respondent universe of 700 was increased to 900 to include plants with nameplate capacity from 10 megawatts to 100 megawatts. In 2002, the respondent universe was increased by almost 1,370 plants with the addition of non-utility plants. Collection of data via the form was suspended for the 2006 data year. Starting for the collection of 2007 calendar year data, most of the Form EIA-767 information is now collected on either the revised Form EIA-860, "Annual Electric Generator Report" or the new Form EIA-923, "Power Plant Operations Report."

Estimation of EIA-767 Data. No estimation of Form EIA-767 data was performed, as 100 percent of the forms were collected.

Issues within Historical Data Series

None.

Sensitive Data (Formerly Identified as Data Confidentiality). Historical latitude and longitude data collected on the Form EIA-767 are considered business sensitive.

Form EIA-860

The Form EIA-860 is a mandatory census of all existing and planned electric generating facilities in the United States with a total generator nameplate capacity of 1 or more megawatts. The survey is used to collect data on existing power plants and 5-year plans for constructing new plants, generating unit additions, modifications, and retirements in existing plants. Data on the survey are collected at the individual generator level. Certain power plant environmental related data are now collected at the boiler level. These data include environmental equipment design parameters and boiler air emission standards and boiler emission controls. The Form EIA-860 is made available in January to collect data for the previous year and is due to EIA by February 15 of each year.

Instrument and Design History. The Form EIA-860 was originally implemented in January 1985 to collect plant data on electric utilities as of year-end 1984. In January 1999, the Form EIA-860 was renamed the Form EIA-860A and was implemented to collect data as of January 1, 1999.

In 1989, the Form EIA-867, "Annual Nonutility Power Producer Report," was initiated to collect plant data on unregulated entities with a total generator nameplate capacity of 5 or more megawatts. In 1992, the reporting threshold of the Form EIA-867 was lowered to include all facilities with a combined nameplate capacity of 1 or more megawatts. Previously, data were collected every 3 years from facilities with a nameplate capacity between 1 and 5 megawatts. In 1998, the Form EIA-867, was renamed Form EIA-860B, "Annual Electric Generator Report – Nonutility." The Form EIA-860B was a mandatory survey of all existing and planned nonutility electric generating facilities in the United States with a total generator nameplate capacity of 1 or more megawatts.

Beginning with data collected for the year 2001, the infrastructure data collected on the Form EIA-860A

and the Form EIA-860B were combined into the new Form EIA-860 and the monthly and annual versions of the Form EIA-906. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data.

Starting with the 2007 data,, design parameters data formerly collected on Form EIA-767 are collected on Form EIA-860. These include design parameters associated with certain steam-electric plants' boilers, cooling systems, flue gas particulate collectors, flue gas desulfurization units and stacks and flues.

Estimation of EIA-860 Data. Of the 17,879 existing generators in the 2009 For EIA-860 frame, imputation was performed on 5 generators. These 5 generators account for less than 0.0006% of the existing capacity. Imputation was performed at the generators levels using the respondents' 2008 data.

Issues within Historical Data Series

Categorization of Capacity by Business Sector: There are a small number of electric utility combined heat and power plants, as well as a small number of industrial and commercial generating facilities that are not combined heat and power. For the purposes of this report the data for these plants are included, respectively, in the following categories: "Electricity Generators, Electric Utilities," "Combined Heat and Power, Industrial," and "Combined Heat and Power, Commercial."

Some capacity in 2001 through 2004 is classified based on the operating company's classification as an electric utility or an independent power producer. Starting in the *Electric Power Annual 2006*, capacity by producer type was determined at the generating plant level for 2005 and 2006, based on whether the plant is an electric utility plant or an electric nonutility plant. Therefore, the revised capacity by producer type for 2005 is comparable to the capacity for 2006 and later years, by producer type. The previously published 2005 capacity by producer type was determined based on the operating company's classification of electric utility or electric nonutility.

<u>Planned Capacity</u>: Delays and cancellations may have occurred subsequent to respondent data reporting as of December 31 of the data year.

Capacity by Energy Source: Prior to the *Electric Power Annual* 2005, the capacity for generators for which natural gas or petroleum was the most predominant energy source was presented in the categories "petroleum only," "natural gas only" and "dual-fired." The "dual-fired" category, which was EIA's effort to infer which generators could fuel-switch between natural gas and fuel oil, included only the capacity of generators for which the most predominant energy source and second most

predominant energy source were reported as natural gas or petroleum. Beginning in 2005 capacity is assigned to energy source based solely on the most predominant (primary) energy source reported for a generator. The "dual-fired" category was eliminated. Separately, summaries of capacity associated with generators with fuel-switching capability are presented for 2005 and later years.. These summaries are based on data collected from new questions added to the Form EIA-860 survey that directly address the ability of generators to switch fuels and co-fire fuels.

In the *Electric Power Annual 2005*, certain petroleum-fired capacity was misclassified as natural gas-fired capacity for 1995 – 2003. This has been corrected in the *Electric Power Annual 2006*. Corrections were noted as revised data.

Sensitive Data (Formerly Identified as Data Confidentiality). The tested heat rate data collected on the Form EIA-860 are considered business sensitive.

Form EIA-861

The Form EIA-861 is a mandatory census of electric power industry participants in the United States. The survey is used to collect information on power production and sales data from approximately 3,300 respondents. About 3,200 are electric utilities, and the remainder is nontraditional entities such as energy service providers, or the unregulated subsidiaries of electric utilities and power marketers. The data collected are used to maintain and update the ERUS electric power industry participant frame database. The Form EIA-861 is made available in January of each year to collect data as of the end of the preceding calendar year and is due by April 30.

Transportation Sector. Prior to 2003, sales of electric power to the Transportation sector of the U. S. economy were included in the Other sector, along with sales to customers for public buildings, traffic signals, public street lighting, and sales to irrigation consumers. Beginning with the 2003 collection cycle, sales to the Transportation sector are collected separately. Sales to public-sector customers for public buildings, traffic signals and street lighting, previously reported in the Other sector, were reclassified as Commercial sector sales. Sales to irrigation customers, where separately identified, were reclassified to the Industrial sector.

On the Form EIA-861, the Transportation sector is defined as electrified rail, primarily urban transit, light rail, automated guideway, and other rail systems whose primary propulsive energy source is electricity. Electricity sales to transportation sector consumers whose primary propulsive energy source is not

electricity (i.e., gasoline, diesel fuel, etc.) are not included.

Benchmark statistics were reviewed from outside surveys, most notably the U.S. Department of Transportation, Federal Transit Administration's National Transportation Database, a source previously used by EIA to estimate electricity transportation consumption. The U.S. Department of Transportation (DOT) survey indicated the State and city locations of expected respondents. The EIA-861 survey methodology assumed that sales, revenue, and customer counts associated with these mass transit systems would be provided by the incumbent utilities in these areas, relying on information drawn routinely from rate schedules and classifications designed to serve the sector separately and distinctly. In 2007, 72 respondents reported transportation data in 28 States.

Imputation. The *Electric Power Annual* (EPA) reports total retail sales volumes (megawatthours) and customer counts in States with deregulated markets as the sum of bundled sales reported by full-service providers and delivery reported by transmission and distribution utilities. ERUS has concluded that the retail sales data reported by delivery utilities are more reliable than data reported by power marketers and Energy Service Providers (ESPs).

The reporting methodology change uses sales volumes and customer counts reported by distribution utilities, and add only an incremental revenue value. representing revenue associated with missing sales assumed to be attributable to the ESPs that were under-represented in the survey frame. In some cases, adjustments are also made to retail sales, revenue, and customer counts associated with underreporting of delivery volumes by one or more of the distribution utilities. In those cases, EIA assumes that total load served by those utilities is accurate, and that any underreporting of delivery volumes resulted from misclassifying actual delivery volumes as bundled Therefore, in those instances EIA adjusted upwards the delivery volumes, revenues, and customer counts and made a corresponding equivalent offset (reduction) to the bundled sales by State and end-use sector.

Data for 2009 reflect imputed retail sales data to account for non-respondents on Form EIA-861. The imputation methodology used is the same as that used in preparing the *Electric Power Monthly* (whose retail sales data are drawn from Form EIA-826). Form EIA-826 is a monthly stratified sample of approximately 475 investor-owned and public utilities, as well as a census of energy service providers and power marketers. If an EIA-861 respondent did not file an annual form for 2009, their data were assumed to be the amount imputed during the year using the EIA-826 sample form collection and imputation process.

Instrument and Design History. The Form EIA-861 was implemented in January 1985 for collection of data as of year-end 1984. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data.

Data Reconciliation. The EPA reports total retail sales volumes (megawatthours) and customer counts in States with deregulated markets as the sum of bundled sales reported by full-service providers and delivery reported by transmission and distribution utilities. ERUS has concluded that the retail sales data reported by delivery utilities are more reliable than data reported by power marketers and ESPs.

Average Retail Price of Electricity. This represents the cost per unit of electricity sold and is calculated by dividing retail electric revenue by the corresponding sales of electricity. The average retail price of electricity is calculated for all consumers and for each end-use sector. State-level weighted average prices per unit of sales are calculated as the ratio of revenue to sales.

The electric revenue used to calculate the average retail price of electricity is the operating revenue reported by the electric power industry participant. Operating revenue includes energy charges, demand charges, consumer service charges, environmental surcharges, fuel adjustments, and other miscellaneous charges. Electric power industry participant operating revenues also include ratepayer reimbursements for State and Federal income taxes and taxes other than income taxes paid by the utility.

The average retail price of electricity reported in this publication by sector represents a weighted average of consumer revenue and sales within sectors and across sectors for all consumers, and does not reflect the per kWh rate charged by the electric power industry participant to the individual consumers. Electric utilities typically employ a number of rate schedules within a single sector. These alternative rate schedules reflect the varying consumption levels and patterns of consumers and their associated impact on the costs to the electric power industry participant for providing electrical service.

Issues within Historical Data Series

Beginning in 2003 the Other sector has been eliminated. Data previously assigned to the Other sector have been reclassified as follows: lighting for public buildings, streets, and highways, interdepartmental sales, and other sales to public authorities are now included in the Commercial sector; agricultural and irrigation sales where separately identified are now included in the Industrial

sector; and a new sector, Transportation, includes electrified rail and various urban transit systems (such as automated guideway, trolley, and cable) where the principal propulsive energy source is electricity. Comparisons of data across years should include consideration of these reclassification changes.

Changes from year to year in consumer counts, sales and revenues, particularly involving the commercial and industrial consumer sectors, may result from respondent implementation of changes in the definitions of consumers, and reclassifications. Utilities and energy service providers may classify commercial and industrial customers based on either NAICS codes or demands or usage falling within specified limits by rate schedule. Also, the number of ultimate customers is an average of the number of customers at the close of each month.

<u>Demand-Side Management:</u> The following definitions are supplied to assist in interpreting Tables 9.1 through 9.5. Utility costs reflect the total cash expenditures for the year, in nominal dollars, that flow out to support demand-side management (DSM) programs.

- Actual Peak Load Reduction. The actual reduction in annual peak load achieved by all program participants during the reporting year, at the time of annual peak load, as opposed to the installed peak load reduction capability (Potential Peak Load Reduction). Actual peak load reduction is reported by large utilities only.
- Energy Savings. The change in aggregate electricity use (measured in megawatthours) for consumers that participate in a utility DSM program. These savings represent changes at the consumer's meter (i.e., exclude transmission and distribution effects) and reflect only activities that are undertaken specifically in response to utility-administered programs, including those activities implemented by third parties under contract to the utility.
- Large Utilities. Those electric utilities with annual sales to ultimate customers or sales for resale greater than or equal to 150 million kilowatthours in 1998-2009 and, for years prior, the threshold was set at 120 million kilowatthours.
- Potential Peak Load Reductions. The potential peak load reduction as a result of load management, and also the actual peak load reduction achieved by energy efficiency programs.

Wholesale Trade: Alaska and Hawaii are not included.

Sensitive Data (Formerly Identified as Data Confidentiality). Data collected on the Form EIA-861 are not considered to be business sensitive.

Form EIA-906 [Replaced in 2007 by Form EIA-923]

The Form EIA-906 was used to collect plant-level data on generation, fuel consumption, stocks, and fuel heat content, from electric utilities and nonutilities. Data were collected monthly from a model-based sample of approximately 1,700 utility and nonutility electric power plants. The form was also used to collect these statistics from another 2,667 plants (i.e., all other generators 1 MW or greater) on an annual basis. The 2007 data collection represents the last year where the information came from the Form EIA-906. Starting with the collection of 2008 calendar year data, the Form EIA-906 information is now collected on a replacement form (the Form EIA-923). The monthly data for Form EIA-906 is now being collected on the replacement form starting in January of 2008.

Instrument and Design History. The Bureau of Census and the U.S. Geological Survey collected, compiled, and published data on the electric power industry prior to 1936. After 1936, the Federal Power Commission (FPC) assumed all data collection and publication responsibilities for the electric power industry and implemented the Form FPC-4. The Federal Power Act, Section 311 and 312, and FPC Order 141 defined the legislative authority to collect power production data. The Form EIA-759 replaced the Form FPC-4 in January 1982. In 1996, the Form EIA-900 was initiated to collect sales for resale data from unregulated entities. In 1998, the form was modified to collect sales for resale, gross generation, and sales to end user data. In 1999, the form was modified to collect net generation, consumption, and ending stock data. In 2000, the form was modified to include useful thermal output data.

In January 2001, Form EIA-906 superseded Forms EIA-759 and EIA-900. In January 2004, Form EIA-920 superseded Form EIA-906 for those plants defined as combined heat and power plants; all other plants that generate electricity continue to report on Form EIA-906. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data. In January 2008, the Form EIA-923 superseded this form.

Issues within Historical Data Series

There were a small number of electric commercial and industrial- only plants that are included in the combined heat and power category. For the purposes of this report the data for these plants were included, respectively, in the following categories: "Electricity Generators, Electric Utilities," "Combined Heat and

Power, Industrial," and "Combined Heat and Power, Commercial." No information on the production of Useful Thermal Output (UTO) or fuel consumption for UTO was collected or estimated for the electric utility combined heat and power plants.

Sensitive Data (Formerly Identified as Data Confidentiality). The only business sensitive data element collected on the Form EIA-906 is fuel stocks at the end of the reporting period.

Form EIA-920 [Replaced in 2007 by Form EIA-923]

The Form EIA-920, "Combined Heat and Power Plant Report" was used to collect plant-level data on generation, fuel consumption, stocks, and fuel heat content of combined heat and power (CHP) plants. Data were collected monthly from a sample of plants. The form was also used to collect the statistics from combined heat and power plants on an annual basis.

Instrument and Design History. In January 2004, Form EIA-920 superseded Form EIA-906 for those plants defined as combined heat and power plants; all other plants that generate electricity continue to report on Form EIA-906. Starting with the collection of 2007 calendar year data, the Form EIA-920 information is now collected on a replacement form (the Form EIA-923). The monthly data for Form EIA-920 began collection on the replacement form in January of 2008. (For further information on predecessor forms, see the discussion of the EIA-906 survey, above.) The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data.

Issues within Historical Data Series

There are a small number of electric commercial and industrial only plants that are included in the combined heat and power category. For the purposes of this report the data for these plants are included, respectively, in the following categories: "Electricity Generators, Electric Utilities," "Combined Heat and Power, Industrial," and "Combined Heat and Power, Commercial." No information on the production of UTO or fuel consumption for UTO was collected or estimated for the electric utility combined heat and power plants.

Sensitive Data (Formerly Identified as Data Confidentiality). The only business sensitive data element collected on the Form EIA-920 were fuel stocks at the end of the reporting period.

Form EIA-923

Form EIA-923, "Power Plant Operations Report," is used to collect information on receipts and cost of fossil fuels, fuel stocks, generation, consumption of

fuel for generation, and environmental data (e.g., emission controls and cooling systems). Data are collected from a monthly sample of approximately 1,600 plants, which includes a census of nuclear and pumped storage hydroelectric plants. The plants in the monthly sample report their receipts, cost and stocks of fossil fuels, electric power generation, and the total consumption of fuels for both electric power generation and, if a combined heat and power plant, useful thermal output. At the end of the year, the monthly respondents report their annual source and disposition of electric power (nonutilities only), and if applicable, the environmental data on the Form EIA-923 Supplemental Form (Schedules 6, 7, and 8A to 8F). Approximately 3,300 plants, representing all generators not included in the monthly sample and with a nameplate capacity of 1 MW or more, report data on the entire form (Schedules 1 to 8F, as applicable) annually. In addition to electric power generating plants, respondents include fuel storage terminals without generating capacity that receives shipments of fossil fuels for eventual use in electric power generation. The monthly data are due by the last day of the month following the reporting period.

Receipts of fossil fuels, fuel cost and quality information, and fuel stocks at the end of the reporting period are all reported at the plant level. Fuel receipts and costs are collected from plants with a nameplate capacity of 50 MW or more and burn fossil fuels. Plants that burn organic fuels and have a steam turbine capacity of at least 10 megawatts report consumption at the boiler level and generation at the generator level for each month, regardless of whether the plant reports in the monthly sample or reports once a year (annually). For all other plants, consumption is reported at the prime-mover level. For these plants, generation is reported either at the prime-mover level or, for noncombustible sources (e.g., wind, nuclear), at the prime-move and energy source level (including generating unit for nuclear only). The source and disposition of electricity is reported annually for nonutilities at the plant level, as is revenue from sales for resale. Additional operational data, including environmental data, are collected annually from facilities that have a steam turbine capacity of at least 10 megawatts.

Instrument and Design History:

Receipts and Cost and Quality of Fossil Fuels

On July 7, 1972, the Federal Power Commission (FPC) issued Order Number 453 enacting the New Code of Federal Regulations, Section 141.61, legally creating the FPC Form 423. Originally, the form was used to collect data only on fossil-steam plants, but was amended in 1974 to include data on internal-combustion and combustion-turbine units. The FERC Form 423 replaced the FPC Form 423 in January 1983. The FERC Form 423 eliminated peaking units, for which data were previously collected on the FPC

Form 423. In addition, the generator nameplate capacity threshold was changed from 25 megawatts to 50 megawatts. This reduction in coverage eliminated approximately 50 utilities and 250 plants. All historical FPC Form 423 data in this publication were revised to reflect the new generator-nameplate-capacity threshold of 50 or more megawatts reported on the FERC Form 423. In January 1991, the collection of data on the FERC Form 423 was extended to include combined-cycle units. Historical data have not been revised to include these units. Starting with the January 1993 data, the FERC began to collect the data directly from the respondents.

The Form EIA-423 was originally implemented in January 2002 to collect monthly cost and quality data for fossil fuel receipts from owners or operators of nonutility electricity generating plants. Due to the restructuring of the electric power industry, many plants which had historically submitted this information for utility plants on the FERC Form 423 (see above) were being transferred to the nonutility sector. As a result, a large percentage of fossil fuel receipts were no longer being reported. The Form EIA-423 was implemented to fill this void and to capture the data associated with existing non-regulated power producers. Its design closely followed that of the FERC Form 423.

Both the Form EIA-423 and FERC-423 were superseded by Form EIA-923 (Schedule 2) in January of 2008. The EIA-923 maintains the same 50 megawatt threshold for these data. However, not all data are collected monthly on the new form. Beginning with 2008 data, a sample of the respondents will report monthly, with the remainder reporting annually (monthly values will be imputed via regression). For 2007, Schedule 2 annual data will not be collected or imputed. Most of the plants required to report on Schedule 2 already submitted their 2007 receipts data on a monthly basis.

Generation and Consumption

The Bureau of Census and the U.S. Geological Survey collected, compiled, and published data on the electric power industry prior to 1936. After 1936, the Federal Power Commission (FPC) assumed all data collection and publication responsibilities for the electric power industry and implemented the Form FPC-4. The Federal Power Act, Section 311 and 312, and FPC Order 141 defined the legislative authority to collect power production data. The Form EIA-759 replaced the Form FPC-4 in January 1982.

In 1996, the Form EIA-900 was initiated to collect sales for resale data from unregulated entities. In 1998, the form was modified to collect sales for resale, gross generation, and sales to end user data. In 1999, the form was modified to collect net generation,

consumption, and ending stock data. In 2000, the form was modified to include useful thermal output data.

In January 2001, Form EIA-906 superseded Forms EIA-759 and EIA-900. In January 2004, Form EIA-920 superseded Form EIA-906 for those plants defined as combined heat and power plants; all other plants that generate electricity continue to report on Form EIA-906. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data.

Forms EIA-906 and EIA-920 were superseded by survey form EIA-923 beginning in January 2008 with the collection of annual 2007 data and monthly 2008 data.

Steam Electric Plant Operational Data

The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data. The predecessor form, FPC-67, "Steam-Electric Plant Air and Water Quality Control Data," was used to collect data from 1969 to 1980, when the form number was changed to Form EIA-767. In 1982, the form was completely redesigned and retitled Form EIA-767, "Steam-Electric Plant Operation and Design Report." In 1986, the respondent universe of 700 was increased to 900 to include plants with nameplate capacity from 10 megawatts to 100 megawatts. In 2002, the respondent universe increased to above 1,370 plants plus the addition of non-utility plants. Collection of data via the Form EIA-767 was suspended for the 2006 data year, but was resumed on the Form EIA-923 for data year 2007. For respondents selected to be in the monthly sample for Form EIA-906 or EIA-920 in 2007, and were thus were not annual filers for Form EIA-923, this data was collected for 2007 via a one-time supplemental filing in 2008.

Data Processing and Data System Editing. Respondents are encouraged to enter data directly into a computerized database via the e-filing system. A variety of automated quality control mechanisms are run during this process, such as range checks and comparisons with historical data. These edit checks were performed as the data were provided, and many problems that are encountered are resolved during the reporting process. Those plants that are unable to use the electronic reporting medium provide the data in hard copy, typically via fax. These data were manually entered into the computerized database. The data were subjected to the same edits as those that were electronically submitted.

If the reported data appeared to be in error and the data issue could not be resolved by follow up contact with the respondent, or if a facility was a nonrespondent, a regression methodology was used to impute for the facility.

Imputation. For data collected monthly, regression prediction, or imputation, is done for all missing data including non-sampled units and any nonrespondents. For data collected annually, imputation is done for nonrespondents.

For gross generation and total fuel consumption, multiple regression is used for imputation. For gross generation, the regressors are prior year average generation for the same fuel, prior year average generation from other fuels, and nameplate capacity. Regressors for total fuel consumption are prior year average fuel consumption from the same fuel, prior year average consumption from other fuels, and nameplate capacity. For stocks, a linear combination of the prior month's ending stocks value and the current month's consumption and receipts values is used.

Only approximately 0.01% of the national total gross generation for 2009 reported here is imputed, although this will vary by State and energy source.

Net generation, where not reported, is estimated by using a fixed ratio to gross generation by prime-mover type.

Receipts of Fossil Fuels. Receipts data, including cost and quality of fuels, are collected at the plant level from selected electric generating plants and fossil-fuel storage terminals in the United States. These plants include independent power producers, electric utilities, and commercial and industrial combined heat and power producers whose total fossil-fueled nameplate capacity is 50 megawatts or more (excluding storage terminals, which do not produce electricity). The data on cost and quality of fuel shipments are then used in the following formulas to produce aggregates and averages for each fuel type at the State, Census division, and U.S. levels. For these formulas, receipts and average heat content are at the plant level. For each geographic region, the summation sign, \sum , represents the sum of all facilities in that geographic region.

For coal, units for receipts are in tons and units for average heat contents (A) are in million Btu per ton.

For petroleum, units for receipts are in barrels and units for average heat contents (A) are in million Btu per barrel.

For gas, units for receipts are in thousand cubic feet (Mcf) and units for average heat contents (A) are in million Btu per thousand cubic foot.

For each of the above fossil fuels:

Total Btu =
$$\sum_{i} (R_i \times A_i)$$
,

where *i* denotes a facility; R_i = receipts for facility *i*; A_i = average heat content for receipts at facility *i*;

Weighted Average Btu =
$$\frac{\sum_{i} (R_i \times A_i)}{\sum_{i} R_i},$$

where *i* denotes a facility; R_i = receipts for facility i; and, A_i = average heat content for receipts at facility i.

The weighted average cost in cents per million Btu is calculated using the following formula:

Weighted Average Cost =
$$\frac{\sum_{i} (R_i \times A_i \times C_i)}{\sum_{i} (R_i \times A_i)},$$

where i denotes a facility; R_i = receipts for facility i; A_i average heat content for receipts at facility i; and C_i = cost in cents per million Btu for facility i.

The weighted average cost in dollars per unit (i.e., tons, barrels, or Mcf) is calculated using the following formula:

Weighted Average Cost =
$$\frac{\sum_{i} (R_i \times A_i \times C_i)}{10^2 \sum_{i} R_i},$$

where *i* denotes a facility; R_i = receipts for facility *i*; A_i = average heat content for receipts at facility *i*; and, C_i = cost in cents per million Btu for facility *i*.

Power Production, Fuel Stocks, and Fuel Consumption Data. The Bureau of Census and the U.S. Geological Survey collected, compiled, and published data on the electric power industry prior to 1936. After 1936, the Federal Power Commission (FPC) assumed all data collection and publication responsibilities for the electric power industry and implemented the Form FPC-4. The Federal Power Act, Section 311 and 312, and FPC Order 141 defined the legislative authority to collect power production data. The Form EIA-759 replaced the Form FPC-4 in January 1982.

In 1996, the Form EIA-900 was initiated to collect sales for resale data from unregulated entities. In 1998, the form was modified to collect sales for resale, gross generation, and sales to end user data. In 1999, the form was modified to collect net generation, consumption, and ending stock data. In 2000, the form was modified to include useful thermal output data.

In January 2001, Form EIA-906 superseded Forms EIA-759 and EIA-900. In January 2004, Form EIA-920 superseded Form EIA-906 for those plants defined as combined heat and power plants; all other plants that generate electricity continue to report on Form EIA-906. The Federal Energy Administration Act of 1974 (Public Law 93-275) defines the legislative authority to collect these data.

In January 2004, Form EIA-920 superseded Form EIA-906 for those plants defined as combined heat and power plants; all other plants that generate electricity continue to report on Form EIA-906. In January 2008, Form EIA-923 superseded both the EIA-906 and EIA-920 forms for the collection of these data.

Methodology to Estimate Biogenic and Non-biogenic Municipal Solid Waste⁹. Municipal Solid Waste (MSW) consumption for generation of electric power is split into its biogenic and non-biogenic components beginning with 2001 data by the following methodology:

The reported tonnage of MSW is reported on the Form EIA-923. The composition of MSW and categorization of the components were obtained from the Environmental Protection Agency publication, *Municipal Solid Waste in the United States: 2005 Facts and Figures.* The Btu contents of the components of MSW were obtained from various sources.

The potential quantities of combustible MSW discards (which include all MSW material available for combustion with energy recovery, discards to landfill, and other disposal) were multiplied by their respective Btu contents. The EPA-based categories of MSW were then classified into renewable and non-renewable groupings. From this, EIA calculated how much of the energy potentially consumed from MSW was attributed to biogenic components and how much to non-biogenic components (see Table 1 and 2, below). 10

These values are used to allocate the net and gross generation published in the *Electric Power Monthly* and *Electric Power Annual* generation tables. The tons of biogenic and non-biogenic components were estimated with the assumption that glass and metals were removed prior to combustion. The average Btu/ton for the biogenic and non-biogenic components is estimated by dividing the total Btu consumption by the total tons. Published net generation attributed to biogenic MSW and non-biogenic MSW is classified under Other Renewables and Other, respectively.

Table 1. Btu Consumption for Biogenic and Nonbiogenic Municipal Solid Waste (percent)

	2001	2002	2003	2004	2005	2006
Biogenic	57	56	55	55	56	56
Non- biogenic	43	44	45	45	44	44

Table 2. Tonnage Consumption for Biogenic and Non-biogenic Municipal Solid Waste (percent)

	2001	2002	2003	2004	2005	2006
Biogenic	77	77	76	76	75	75
Non- biogenic	23	23	24	24	25	25

Useful Thermal Output. With the implementation of the Form EIA-923, "Power Plant Operations Report," in 2008, combined heat and power (CHP) plants are required to report total fuel consumed and electric power generation4. Beginning with preliminary January 2008 data, EIA estimated the allocation of the total fuel consumed at CHP plants between electric power generation and useful thermal output.

The estimated allocation methodology is summarized in the following paragraphs. The methodology was retroactively applied to 2004-2007 data. Prior to 2004, useful thermal output was collect on the Form EIA-906 and an estimated allocation of fuel for electricity was not necessary.

First, an efficiency factor is determined for each plant and prime mover type. Based on data for electric power generation and useful thermal output (UTO) collected in 2003 (on Form EIA-906, "Power Plant Report") efficiency was calculated for each prime mover type at a plant. The efficiency factor is the total output in Btu, including electric power and useful thermal output (UTO), divided by the total input in Btu. Electric power is converted to Btu at 3,412 Btu per kilowatthour.

Second, to calculate the amount of fuel for electric power, the gross generation in Btu is divided by the efficiency factor. The fuel for UTO is the difference between the total fuel reported and the fuel for electric power generation. UTO is calculated by multiplying the fuel for UTO by the efficiency factor.

⁹ See the following sources:

Bahillo, A. et al. Journal of Energy Resources Technology, "NOx and N2O Emissions During Fluidized Bed Combustion of Leather Wastes." Volume 128, Issue 2, June 2006. pp. 99-103.

U.S. Energy Information Administration. Renewable Energy Annual 2004. "Average Heat Content of Selected Biomass Fuels." Washington, DC, 2005

Penn State Agricultural College Agricultural and Biological Engineering and Council for Solid Waste Solutions. Garth, J. and Kowal, P. Resource Recovery, Turning Waste into Energy, University Park, PA, 1993

Utah State University Recycling Center Frequently Asked Questions. Published at http://www.usu.edu/recycle/faq.htm. Accessed December 2006

¹⁰ Biogenic components include newsprint, paper, containers and packaging, leather, textiles, yard trimmings, food wastes, and wood. Non-biogenic components include plastics, rubber and other miscellaneous non-biogenic waste.

In addition, if the total fuel reported is less than the estimated fuel for electric power generation, then the fuel for electric power generation is equal to the total fuel consumed, and the UTO will be zero.

Issues within Historical Data Series

Receipts and Cost and Quality of Fossil Fuels

Values for receipts of natural gas for 2001 forward do not include blast furnace gas or other gas.

Historical data collected on FERC Form 423 and published by EIA have been reviewed for consistency between volumes and prices and for their consistency over time. However, these data were collected by FERC for regulatory rather than statistical and publication purposes. EIA did not attempt to resolve any late filing issues in the FERC Form 423 data. In 2003, EIA introduced a procedure to estimate for late or non-responding entities who were required to report on the FERC Form 423. Due to the introduction of this procedure, 2003 and later data cannot be directly compared to previous years' data.

Prior to 2008, regulated plants reported receipts data on the FERC Form 423. These plants, along with unregulated plants, now report receipts data on Schedule 2 of Form EIA-923. Because FERC issued waivers to Form 423 filing requirements to some plants who met certain criteria, and because not all types of generators were required to report (only steam turbines and combined cycle units reported), a significant number of plants either did not submit fossil fuel receipts data or submitted only a portion of their fossil fuel receipts. Since Form EIA-923 does not have exemptions based on generator type, or reporting waivers, receipts data from 2008 and later cannot be directly compared to previous years' data for the regulated sector. Furthermore, there may be a notable increase in fuel receipts beginning with January 2008 data.

Also beginning with January 2008 data, tables for total receipts will include imputed quantities for plants with capacity one megawatt or more, to be consistent with other electric power data. Previous published receipts data were from plants over a 50 megawatt threshold, which was a legacy of their original collection as information for a regulatory agency, not as a survey to provide more meaningful estimates of totals for statistical purposes. Totals appeared to become smaller as more electric production came from unregulated plants, until the EIA-423 was created to help fill that gap. As a further improvement, estimation of all receipts for the universe normally depicted in the EPA (i.e., one megawatt and above), with associated relative standard errors, provides a more complete assessment of the market.

Generation and Consumption

Beginning in 2008, a new method of allocating fuel consumption between electric power generation and useful thermal output (UTO) was implemented (see above). This new methodology evenly distributes a combined heat and power (CHP) plant's losses between the two output products (electric power and UTO). In the historical data, UTO was consistently assumed to be 80 percent efficient and all other losses at the plant were allocated to electric power. This change causes the fuel for electric power to be lower while the fuel for UTO is higher as both are given the same efficiency. This results in the appearance of an increase in efficiency of production of electric power between periods.

Steam Electric Plant Operational Data

Due to suspension of Form EIA-767 in 2007, there is a one year break in this data series as data year 2006 could not be collected.

Sensitive Data (Formerly identified as Data Confidentiality). Most of the data collected on the Form EIA-923 are not considered business sensitive. However, the total delivered cost of fuel delivered to nonutilities, commodity cost of fossil fuels, and reported fuel stocks at the end of the reporting period are considered business sensitive. The release of these data must adhere to EIA's "Policy on the Disclosure of Individually Identifiable Energy Information in the Possession of the EIA" (45Federal Register 59812 (1980)).

Air Emissions

This section describes the methodology for calculating estimated emissions of carbon dioxide (CO₂) from electric generating plants for 1989 through 2009, as well as the estimated emissions of sulfur dioxide (SO₂) and nitrogen oxides (NO_x) from electric generating plants for 2001 through 2009. For a description of the methodology used for other years, see the technical notes to the *Electric Power Annual 2003*.

Methodology Overview

Initial estimates of uncontrolled SO_2 and NO_x emissions for all plants are made by applying an emissions factor to fuel consumption data collected by EIA on the Form EIA-923. An emission factor is the average quantity of a pollutant released from a power plant when a unit of fuel is burned, assuming no use of pollution control equipment. The basic relationship is:

Emissions = Quantity of Fuel Consumed x Emission Factor

Quantity is defined in physical units (e.g., tons of solid fuels, million cubic feet of gaseous fuels, and thousands of barrels of liquid fuels) for determining NO_x and SO_2 emissions. As discussed below, physical quantities are converted to millions of Btus for calculating CO_2 emissions.

For some fuels, the calculation of SO₂ emissions requires including in the formula the sulfur content of the fuel measured in percentage of weight. Examples include coal and fuel oil. In these cases the formula is:

Emissions = Quantity of Fuel Consumed x Emission Factor x Sulfur Content

The fuels that require the percent sulfur as part of the emissions calculation are indicated in Table A1, which lists the SO₂ emission factors used for this report.

In the case of SO_2 and NO_x emissions, the factor applied to a fuel can also vary with the combustion system: either a steam-producing boiler, a combustion turbine, or an internal combustion engine. In the case of boilers, NO_x emissions can also vary with the firing configuration of a boiler and whether or not the boiler is a wet-bottom or dry-bottom design. These distinctions are shown in Tables A1 and A2.

For SO₂ and NO_x, the initial estimate of uncontrolled emissions is reduced to account for the plant's operational pollution control equipment, when data on control equipment are available from the historical Form EIA-767 survey (i.e., data for the years 2005 and earlier) and the EIA-860 survey for the years 2007 and 2008. A special case for removal of SO₂ is the fluidized bed boiler, in which the sulfur removal process is integral with the operation of the boiler. The SO₂ emission factors shown in Table A1 for fluidized bed boilers already account for 90 percent removal of SO₂ since, in effect, the plant has no uncontrolled emissions of this pollutant.

Although SO_2 and NO_x emission estimates are made for all plants, in many cases the estimated emissions can be replaced with actual emissions data collected by the U.S. Environmental Protection Agency's Continuous Emissions Monitoring System (CEMS) program. (CEMS data for CO_2 are incomplete and are not used in this report.) The CEMS data account for the bulk of SO_2 and NO_x emissions from the electric power industry. For those plants for which CEMS data are available, the EIA estimates of SO_2 and NO_x

emissions are employed for the limited purpose of allocating emissions by fuel, since the CEMS data itself do not provide a detailed breakdown of plant emissions by fuel. For plants for which CEMS data are unavailable, the EIA-computed values are used as the final emissions estimates.

There are a number of reasons why the historical data are periodically revised. These include data revisions, revisions in emission and technology factors, and changes in methodology. For instance, the 2008 EPA report features a revision in historic CO2 values. This revision occurred due to a change in the accepted methodology regarding adjustments made for the percentage combustion of fuels.

The emissions estimation methodologies are described in more detail below.

CO₂ Emissions. CO₂ emissions are estimated using the information on fuel consumption in physical units and the heat content of fuel collected on the Forms EIA-923 (data for combined heat and power plants) and EIA-906 (all other power plants) for the years 1989 through 2006. In 2007, a new form was introduced, the Power Plant Operations Survey (Form EIA-923), which includes information on fuel consumption previously part of the Form EIA-906/EIA-920 Surveys. Fuel consumption data from the Form EIA-923 was used to estimate CO₂. The heat content information is used to convert physical units to millions of Btu (MMBtu) consumed. To estimate CO₂ emissions, the fuel-specific emission factor from Table A3 is multiplied by the fuel consumption in MMBtu.

The estimation procedure calculates uncontrolled CO_2 emissions. CO_2 control technologies are currently in the early stages of research and there are no operational systems installed. Therefore, no estimates of controlled CO_2 emissions are made.

SO₂ and NO_x Emissions. To comply with environmental regulations controlling SO₂ emissions, many coal-fired generating plants have installed flue gas desulfurization (FGD) units. Similarly, NO_x control regulations require many plants to install low-NO_x burners, selective catalytic reduction systems, or other technologies to reduce emissions. It is common for power plants to employ two or even three NO_x control technologies; accordingly, the NO_x emissions estimation approach accounts for the combined effect of the equipment (Table A4). However, control equipment information is available only for plants that reported on the Form EIA-923 and for historical data from the Form EIA-767. Both the EIA-923 and the historical EIA-767 surveys are limited to plants with boilers fired by combustible fuels12 with a minimum generating capacity of 10 megawatts (nameplate). Pollution control equipment data are unavailable from

¹¹ A boiler's firing configuration relates to the arrangement of the fuel burners in the boiler, and whether the boiler is of conventional or cyclone design. Wet and dry-bottom boilers use different methods to collect a portion of the ash that results from burning coal. For information on wet and dry bottom boilers, see the EIA Glossary at

http://www.eia.gov/glossary/index.html. Additional information on wet and dry-bottom-boilers and on other aspects of boiler design and operation, including the differences between conventional and cyclone designs, can be found in Babcock and Wilcox, Steam: Its Generation and Use, 41st Edition, 2005.

¹² Boilers that rely entirely on waste heat to create steam, including the heat recovery portion of most combined cycle plants, did not report on the historical Form EIA-767 or EIA-923.

EIA sources for plants that did not report on the historical EIA-767 survey, or the EIA-923.

The following method is used to estimate SO_2 and NO_x emissions:

- For steam electric plants, uncontrolled emissions are estimated using the emission factors shown in Tables A1 and A2 as well as reported data on fuel consumption, sulfur content, and boiler firing configuration. Controlled emissions are then determined when pollution control equipment is present. Although information on control equipment was unreported for the years 2006 and 2007, updates for new installations during this period were made based upon Environmental Protection Agency data. For 2008, this data was collected on the Form EIA-923. For SO₂, the reported efficiency of the plant's FGD units is used to convert uncontrolled to controlled emission estimates. For NO_x, the reduction percentages shown in Table A4 are applied to the uncontrolled estimates.
- For plants and prime movers not reported on the historical Form EIA-767 survey or EIA-923, uncontrolled emissions are estimated using the Table A1 and Table A2 emission factors and the following data and assumptions:
 - Fuel consumption is taken from the Form EIA-923 (for historical data, from the Form EIA-920 - for combined heat and power plants) or the Form EIA-906 - all other power plants).
 - The sulfur content of the fuel is estimated from fuel receipts for the plant reported the Form EIA-923 (for historical data, from either the Form EIA-423 or the FERC Form 423). When plant-specific sulfur content data are unavailable, the national average sulfur content for the fuel, computed from the Form EIA-923 (for historical data, from the Form EIA-423 and the FERC Form 423), is applied to the plant.
 - As noted earlier, the emission factor for plants with boilers depends in part on the type of combustion system, including whether a boiler is wet-bottom or dry-bottom, and the boiler firing configuration. However, this boiler information is unavailable for steam electric plants that did not report on the historical Form EIA-767 or EIA-860. For these cases, the plant is assumed to have a dry-bottom, non-cyclone boiler using a firing method that falls into the "All Other" category shown on Table A1.13

- For the plants that did not report on the historical Form EIA-767 or EIA-860, pollution control equipment data are unavailable and the uncontrolled estimates are not reduced.
- If actual emissions of SO₂ or NO_x are reported in EPA's CEMS data, the EIA estimates are replaced with the CEMS values, using the EIA estimates to allocate the CEMS plant-level data by fuel. If CEMS data are unavailable, the EIA estimates are used as the final values.

Conversion of Petroleum Coke to Liquid Petroleum

The quantity conversion is 5 barrels (of 42 U.S. gallons each) per short ton (2,000 pounds). Coke from petroleum has a heating value of 6.024 million Btu per barrel.

Relative Standard Error

The relative standard error (RSE) statistic, usually given as a percent, describes the magnitude of sampling error that might reasonably be incurred. The RSE is the square root of the estimated variance, divided by the variable of interest. The variable of interest may be the ratio of two variables, or a single variable.

The sampling error may be less than the nonsampling error. In fact, large RSE estimates found in preliminary work with these data have often indicated nonsampling errors, which were then identified and corrected. Nonsampling errors may be attributed to many sources, including the response errors, definitional difficulties, differences in the interpretation of questions, mistakes in recording or coding data obtained, and other errors of collection, response, or coverage. These nonsampling errors also occur in complete censuses. In a complete census, this problem may become unmanageable.

Using the Central Limit Theorem, which applies to sums and means such as are applicable here, there is approximately a 68-percent chance that the true total or mean is within one RSE of the estimated total. Note that reported RSEs are always estimates, themselves, and are usually, as here, reported as percents. As an example, suppose that a net generation from coal value is estimated to be 1,507 total million kilowatthours with an estimated RSE of 4.9 percent. This means that, ignoring any nonsampling error, there is approximately a 68-percent chance that the kilowatthour million value is approximately 4.9 percent of 1,507 kilowatthours (that is, between 1,433 and 1,581 million kilowatthours). Also under the Central Limit

¹³ The "All Other" firing configuration category includes, for example, arch firing and concentric firing. For a full list of firing method options for reporting on the historical Form EIA-767, see the form instructions, page xi, at http://www.eia.gov/cneaf/electricity/forms/eia767/eia767instr.pdf.

Theorem, there is approximately a 95-percent chance that the true mean or total is within 2 RSEs of the estimated mean or total.

Note that there are times when a model may not apply, such as in the case of a substantial reclassification of sales, when the relationship between the variable of interest and the regressor data does not hold. In such a case, the new information represents only itself, and such numbers are added to model results when estimating totals. Further, there are times when sample data may be known to be in error, or are not reported. Such cases are treated as if they were never part of the model-based sample, and values are imputed.

Business Classification

Nonutility power producers consist of entities that own or operate electric generating units but are not subject to direct economic regulation of rates, such as by state utility commissions. Nonutility power producers do not have a designated franchised service area. In addition to entities whose primary business is the production and sale of electric power, entities with other primary business classifications can and do sell electric power. These can consist of, for example, manufacturing facilities and paper mills.

The Energy Information Administration, in the *Electric Power Annual* and other data products, classifies nonutility power producers into the following categories:

- Independent Power Producers (IPPs) whose primary business is selling electricity in the public markets. (The combination of the utility and IPP businesses are referred to by EIA as the Electric Power Sector.)
- Power producers whose primary business falls under NAICS¹⁴ classifications Agriculture, Forestry, Fishing, Mining, Construction, or Manufacturing are classified as "industrial" producers.
- Power producers whose primary business falls under NAICS classifications Transportation and Public (non-electric) Utilities, Wholesale Trade, Retail Trade, Finance, Insurance, and Real Estate are classified as "commercial" producers.

Each of these non-utility sectors are further divided into facilities which do or do not operate as combined heat and power plants (CHP; often also referred to as co-generators). CHP plants produce heat, such as steam for use in a manufacturing process, along with electricity.

The following is a list of the main NAICS classifications and the category of primary business activity within each classification.

Agriculture, Forestry, and Fishing

- 111 Agriculture production-crops
- 112 Agriculture production, livestock and animal specialties
- 113 Forestry
- Fishing, hunting, and trapping
- 115 Agricultural services

Mining

- 211 Oil and gas extraction
- 2121 Coal mining
- 2122 Metal mining
- 2123 Mining and quarrying of nonmetallic minerals except fuels

Construction

23

Manufacturing

- Food and kindred products
- 3122 Tobacco products
- 314 Textile and mill products
- Apparel and other finished products made from fabrics and similar materials
- 316 Leather and leather products
- 321 Lumber and wood products, except furniture
- 322 Paper and allied products (other than 322122 or 32213)
- 322122 Paper mills, except building paper
- 32213 Paperboard mills
- 323 Printing and publishing
- 325 Chemicals and allied products (other than 325188, 325211, 32512, or 325311)
- 32512 Industrial organic chemicals
- 325188 Industrial Inorganic Chemicals
- 325211 Plastics materials and resins
- 325311 Nitrogenous fertilizers
- Petroleum refining and related industries (other than 32411)
- 32411 Petroleum refining
- Rubber and miscellaneous plastic products
- Stone, clay, glass, and concrete products (other than 32731)
- 32731 Cement, hydraulic
- Primary metal industries (other than 331111 or 331312)
- 331111 Blast furnaces and steel mills
- 331312 Primary aluminum
- Fabricated metal products, except machinery and transportation equipment
- Industrial and commercial equipment and components except computer equipment

¹⁴ Business classifications are based on the North American Industry Classification System (NAICS).

3345	<i>G</i> , <i>n n j G</i> , <i>n n j G</i>		Retail Trade
	instruments, photographic, medical, and optical goods, watches and clocks		441 to 454
335	Electronic and other electrical equipment and components except computer equipment		Finance, Insurance, and Real Estate
336	Transportation equipment	521 to 5	
337	Furniture and fixtures		Services
339	Miscellaneous manufacturing industries	512	Motion pictures
	T	514	Business services
	Transportation and Public Utilities	514199	Miscellaneous services
22	Electric, gas, and sanitary services	541	Legal services
2212	Natural gas transmission	561	Engineering, accounting, research,
2213	Water supply		management, and 611 Education services
22131	Irrigation systems	622	Health services
22132	Sewerage systems	624	Social services
481	Transportation by air	712	Museums, art galleries, and botanical and
482	Railroad transportation		zoological gardens
483	Water transportation	713	Amusement and recreation services
484	Motor freight transportation and warehousing	721	Hotels
485	Local and suburban transit and interurban	811	Miscellaneous repair services
	highway passenger transport	8111	Automotive repair, services, and parking
486	Pipelines, except natural gas	812	Personal services
487	Transportation services	813	Membership organizations related services
491	United States Postal Service	814	Private households
513	Communications		
562212	Refuse systems		Public Administration
	Wholesale Trade	92	

421 to 422

Table A1. Sulfur Dioxide Uncontrolled Emission Factors

(Units and Factors)

Fuel, Code, Source and Emission units				Combustion System Type/Firing Configuration								
1 40.,			, ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,									
Fuel And EIA Fuel Code	Source and Tables (As appropriate)	Emissions Units (Lbs = pounds, MMCF = million cubic feet, MG = thousand gallons)	Cyclone Boiler	Fluidized Bed Boiler	Opposed Firing Boiler	Spreader Stoker Boiler	Tangential Boiler	All Other Boiler Types	Combustion Turbine	Internal Combustion Engine		
Agricultural Byproducts (AB) Blast Furnace Gas (BFG)	Source: 1 Sources: 1 (including footnote 7 within source); 2, Table 1.4-2 (including footnote d within source)	Lbs per ton Lbs per MMCF	0.08 0.6	0.01 0.06	0.08 0.6	0.08 0.6	0.08 0.6	0.08 0.6	NA 0.6	NA 0.6		
Bituminous Coal (BIT)*	Source: 2, Table 1.1-3	Lbs per ton	38.00	3.8	38.00	38.00	38.00	38.00	NA	NA		
Black Liquor (BLQ)	Source: 1	Lbs per ton **	7.00	0.70	7.00	7.00	7.00	7.00	NA	NA		
Distillate Fuel Oil (DFO)*	Source: 2, Table 3.1-2a, 3.4-1 & 1.3-1	Lbs per MG	157.0	15.70	157.0	157.0	157.0	157.0	140.0	140.0		
Jet Fuel (JF)*	Assumed to have emissions similar to DFO.	Lbs per MG	157.0	15.70	157.0	157.0	157.0	157.0	140.0	140.0		
Kerosene (KER)*	Assumed to have emissions similar to DFO.	Lbs per MG	157.0	15.70	157.0	157.0	157.0	157.0	140.0	140.0		
Landfill Gas (LFG)	Sources: 1 (including footnote 7 within source); 2, Table 1.4-2 (including footnote d within source)	Lbs per MMCF	0.6	0.06	0.6	0.6	0.6	0.6	0.6	0.6		
Lignite Coal (LIG)*	Source: 2, Table 1.7-1	Lbs per ton	30.00	3.00	30.00	30.00	30.00	30.00	NA	NA		
Municipal Solid Waste (MSW)	Source: 1	Lbs per ton	1.70	0.17	1.70	1.70	1.70	1.70	NA	NA		
Natural Gas (NG)	Sources: 1 (including footnote 7 within source); 2, Table 1.4-2 (including footnote d within source)	Lbs per MMCF	0.60	0.06	0.60	0.60	0.60	0.60	0.60	0.60		
Other Biomass Gas (OBG)	Sources: 1 (including footnote 7 within source); 2, Table 1.4-2 (including footnote d within source)	Lbs per MMCF	0.60	0.06	0.60	0.60	0.60	0.60	0.60	0.60		
Other Biomass Liquids (OBL)*	Source: 1 (including footnotes 3 and 16 within source)	Lbs per MG	157.0	15.70	157.0	157.0	157.0	157.0	140.0	140.0		
Other Biomass Solids (OBS)	Source: 1 (including footnote 11 within source)	Lbs per ton	0.23	0.02	0.23	0.23	0.23	0.23	NA	NA		
Other Gases (OG)	Source: 1 (including footnote 7 within source)	Lbs per MMCF	0.60	0.06	0.60	0.60	0.60	0.60	0.60	0.60		
Other (OTH)	Assumed to have emissions similar to NG.	Lbs per MMCF	0.60	0.06	0.60	0.60	0.60	0.60	0.60	0.60		
Petroleum Coke (PC)* Propane Gas (PG)	Source: 1 Sources: 1 (including footnote 7 within source); 2, Table 1.4-2 (including	Lbs per ton Lbs per MMCF	39.00 0.60	3.90 0.06	39.00 0.60	39.00 0.60	39.00 0.60	39.00 0.60	NA 0.60	NA 0.60		
Residual Fuel Oil (RFO)* Synthetic Coal (SC)*	footnote d within source) Source: 2, Table 1.3-1 Assumed to have the emissions similar to	Lbs per MG Lbs per ton	157.00 38.00	15.70 3.8	157.00 38.00	157.00 38.00	157.00 38.00	157.00 38.00	NA NA	NA NA		
Sludge Waste (SLW)	Bituminous Coal. Source: 1 (including footnote 11 within source)	Lbs per ton **	2.80	0.28	2.80	2.80	2.80	2.80	NA	NA		
Subbituminous Coal (SUB)*	Source: 2, Table 1.1-3	Lbs per ton	35.00	3.5	35.00	38.00	35.00	35.00	NA	NA		
Tire-Derived Fuel (TDF)*	Source: 1 (including footnote 13 within source)	Lbs per ton	38.00	3.80	38.00	38.00	38.00	38.00	NA	NA		
Waste Coal (WC)*	Source: 1 (including footnote 20 within source)	Lbs per ton	30.00	3.00	30.00	30.00	30.00	30.00	NA	NA		
Wood Waste Liquids (WDL)*	Source: 1 (including footnotes 3 and 16 within source)	Lbs per MG	157.0	15.70	157.0	157.0	157.0	157.0	140.0	140.0		
Wood Waste Solids (WDS)	Source: 1	Lbs per ton	0.29	0.08	0.29	0.08	0.29	0.29	NA	NA		
Waste Oil (WO)*	Source: 2, Table 1.11-2	Lbs per MG	147.00	14.70	147.00	147.00	147.00	147.00	NA	NA		

Note: * For these fuels, emissions are estimated by multiplying the emissions factor by the physical volume of fuel and the sulfur percentage of the fuel (other fuels do not require the sulfur percentage in the calculation). Note that EIA data do not provide the sulfur content of TDF. The value used (1.56 percent) is from U.S. EPA, Control of Mercury Emissions from Coal-Fired Electric Utility Boilers, April 2002, EPA-600/R-01-109, Table A-11 (available at:http://www.epa.gov/appcdwww/aptb/EPA-600-R-01-109A.pdf).

**Although Sludge Waste and Black Liquor consist substantially of liquids, these fuels are measured and reported to EIA in tons.

Sources:

Eastern Research Group, Inc. and E.H. Pechan & Associates, Inc., Documentation for the 2002 Electric Generating Unit National Emissions Inventory, Table 6, September 2004. Prepared for the U.S. Environmental Protection Agency, Emission Factor and Inventory Group (D205-01), Emissions, Monitoring and Analysis Division, Research Triangle Park; and

U.S. Environmental Protection Agency, AP 42, Fifth Edition (Compilation of Air Pollutant Emission Factors, Volume 1: Stationary Point and Area Sources); available at: http://www.epa.gov/ttn/chief/ap42/

Table A2. Nitrogen Oxides Uncontrolled Emission Factors

(Units and Factors)

Fuel, Coo	Combustion System Type/Firing Configuration										
,	,		Factors for Wet-Bottom Boilers are in Brackets; All Other Boiler Factors are for Dry-Bottom								
Fuel And EIA Fuel Code	Source and Tables (As appropriate)	Emissions Units (Lbs = pounds, MMCF = million cubic feet, MG = thousand gallons)	Cyclone Boiler	Fluidized Bed Boiler	Opposed Firing Boiler	Spreader Stoker Boiler	Tangential Boiler	All Other Boiler Types	Combustion Turbine	Internal Combustion Engine	
Agricultural Byproducts (AB) Blast Furnace Gas (BFG)	Source: 1 Sources: 1 (including footnote 7 within source); EIA estimates	Lbs per ton Lbs per MMCF	1.20 15.40	1.20 15.40	1.20 15.40	1.20 15.40	1.20 15.40	1.20 15.40	NA 30.40	NA 256.55	
Bituminous Coal (BIT)		Lbs per ton	33.00	5.00	12 [31]	11.00	10.0 [14.0]	12.0 [31.0]	NA	NA	
Black Liquor (BLQ)	Source: 1	Lbs per ton **	1.50	1.50	1.50	1.50	1.50	1.50	NA	NA	
Distillate Fuel Oil (DFO)	Source: 2, Tables 3.4-1 & 1.3-1	Lbs per MG	24.00	24.00	24.00	24.00	24.00	24.00	122.0	443.8	
Jet Fuel (JF)		Lbs per MG	24.00	24.00	24.00	24.00	24.00	24.00	118.0	432.0	
Kerosene (KER)	Source: 2, Tables 3.1-2a, 3.4-1 & 1.3-1	Lbs per MG	24.00	24.00	24.00	24.00	24.00	24.00	118.0	432.0	
Landfill Gas (LFG)	Sources: 1 (including footnote 7 within source); EIA estimates	Lbs per MMCF	72.44	72.44	72.44	72.44	72.44	72.44	144.0	1215.22	
Lignite Coal (LIG)	Source: 2, Table 1.7-1	Lbs per ton	15.00	3.60	6.3	5.80	7.10	6.3	NA	NA	
Municipal Solid Waste (MSW)	Source: 1	Lbs per ton	5.0	5.0	5.0	5.0	5.0	5.0	NA	NA	
Natural Gas (NG)	Source: 2, Tables 1.4-1, 3.1-1, and 3.4-1	Lbs per MMCF	280.00	280.00	280.00	280.00	170.00	280.00	328.00	2768.00	
Other Biomass Gas (OBG)		Lbs per MMCF	112.83	112.83	112.83	112.83	112.83	112.83	313.60	2646.48	
Other Biomass Liquids (OBL)	Source: 1 (including footnote 3 within source)	Lbs per MG	19.0	19.0	19.0	19.0	19.0	19.0	NA	NA	
Other Biomass Solids (OBS)	Source: 1 (including footnote 11 within source)	Lbs per ton	2.0	2.0	2.0	2.0	2.0	2.0	NA	NA	
Other Gases (OG)	Sources: 1 (including footnote 7 within source); EIA estimates	Lbs per MMCF	152.82	152.82	152.82	152.82	152.82	152.82	263.82	2226.41	
Other (OTH)	Assumed to have emissions similar to natural gas.	Lbs per MMCF	280.00	280.00	280.00	280.00	170.00	280.00	328.00	2768.00	
Petroleum Coke (PC)	Source: 1 (including footnote 8 within source)	Lbs per ton	21.00	5.00	21.00	21.00	21.00	21.00	NA	NA	
Propane Gas (PG)	Sources: 3; EIA estimates	Lbs per MMCF	215.00	215.00	215.00	215.00	215.00	215.00	330.75	2791.22	
Residual Fuel Oil (RFO)	Source: 2, Table 1.3-1	Lbs per MG	47.00	47.00	47.00	47.00	32.00	47.00	NA	NA	
Synthetic Coal (SC)	Assumed to have emissions similar to Bituminous Coal.	Lbs per ton	33.00	5.00	12 [31]	11.00	10.0 [14.0]	12.0 [31.0]	NA	NA	
Sludge Waste (SLW)	Source: 1 (including footnote 11 within source)	Lbs per ton **	5.00	5.00	5.00	5.00	5.00	5.00	NA	NA	
Subbituminous Coal (SUB)	Source: 2, Table 1.1-3	Lbs per ton	17.00	5.00	7.4 [24]	8.80	7.2	7.4 [24.0]	NA	NA	
Tire-Derived Fuel (TDF)	Source: 1 (including footnote 13 within source)	Lbs per ton	33.00	5.00	12 [31]	11.00	10.0 [14.0]	12.0 [31.0]	NA	NA	
Waste Coal (WC)	Source: 1 (including footnote 20 within source)	Lbs per ton	15.00	3.60	6.30	5.80	7.10	6.30	NA	NA	
Wood Waste Liquids (WDL)	Source: 1 (including footnote 16 within source)	Lbs per MG	5.43	5.43	5.43	5.43	5.43	5.43	NA	NA	
Wood Waste Solids (WDS)	,	Lbs per ton	2.51	2.00	2.51	1.50	2.51	2.51	NA	NA	
Waste Oil (WO)	Source: 2, Table 1.11-2	Lbs per MG	19.00	19.00	19.00	19.00	19.00	19.00	NA	NA	

Note: ** Although Sludge Waste and Black Liquor consist substantially of liquids, these fuels are measured and reported to EIA in tons. Sources:

Eastern Research Group, Inc. and E.H. Pechan & Associates, Inc., *Documentation for the 2002 Electric Generating Unit National Emissions Inventory*, Table 6, September 2004. Prepared for the U.S. Environmental Protection Agency, Emission Factor and Inventory Group (D205-01); Emissions, Monitoring and Analysis Division, Research Triangle Park;

U.S. Environmental Protection Agency, AP 42, Fifth Edition (Compilation of Air Pollutant Emission Factors, Volume 1: Stationary Point and Area Sources); available at: http://www.epa.gov/ttp/chief/ap42/; and

^{3.} U.S. Environmental Protection Agency, Factor Information Retrieval (FIRE) Database, Version 6.25; available at: http://www.epa.gov/ttn/chief/software/fire/index.html

Table A3. Carbon Dioxide Uncontrolled Emission Factors (Pounds of CO₂ per Million Btu)

Fuel, Code, Source, and Emission Factor							
Fuel And EIA Fuel Code	Source and Tables (As appropriate)	Factor (Pounds of CO ₂ Per Million Btu)***					
Bituminous Coal (BIT)	Source: 3	205.573 ^Ř					
Distillate Fuel Oil (DFO)	Source: 1	161.386					
Geothermal (GEO)	Estimate from EIA, Office of Integrated Analysis and Forecasting	16.59983					
Jet Fuel (JF)	Source: 1	156.258					
Kerosene (KER)	Source: 1	159.535					
Lignite Coal (LIG)	Source: 3	215.070					
Municipal Solid Waste (MSW)	Source: 1 (including footnote 2 within source)	91.900					
Natural Gas (NG)	Source: 1	117.080					
Petroleum Coke (PC)	Source: 1	225.130					
Propane Gas (PG)	Source: 1	139.178					
Residual Fuel Oil (RFO)	Source: 1	173.906					
Synthetic Coal (SC)	Assumed to have emissions similar to Bituminous Coal.	205.573 ^R					
Subbituminous Coal (SUB)	Source: 3	214.212 ^R					
Tire-Derived Fuel (TDF)	Source: 1	189.538					
Waste Coal (WC)	Assumed to have emissions similar to Bituminous Coal.	205.573 ^R					
Waste Oil (WO)	Source: 2, Table 1.11-3 (assumes typical heat content of 4.4 MMBtus per barrel)	210.000					

Note: *** CO_2 factors do not vary by combustion system type or boiler firing configuration. R = Revised.

Sources: 1. U.S. Energy Information Administration, Office of Integrated Analysis and Forecasting, Voluntary Reporting of Greenhouse Gases Program, Table of Fuel and Energy Source: Codes and Emission Coefficients; 2. U.S. Environmental Protection Agency, AP 42, Fifth Edition (Compilation of Air Pollutant Emission Factors, Volume 1: Stationary Point and Area Sources); available at: http://www.epa.gov/ttn/chief/ap42/, and, 3. Environmental Protection Agency, Inventory of Greenhouse Gas Emissions and Sinks, 1990-2008, Annex 2, (April 2010, Washington, DC), Table A-36, and, Energy Information Administration, Form EIA-923, "Power Plant Operations Report." Emission factor data has been converted to pounds per million Btu. Emission factor data is also an average of annual emission factors for the years 1990-2008 appearing in the Inventory of Greenhouse gas Emissions and Sinks, 1990-2008 weighted by annual coal receipts at electric power plant data appearing in the EIA-923 data base over the same time period.

Table A4. Nitrogen Oxides Control Technology Emissions Reduction Factors

Nitrogen Oxides Control Technology	EIA-Code(s)	Reduction Factor (Percent)
Advanced Overfire Air	AA	301
Alternate Burners	BF	20
lue Gas Recirculation	FR	40
luidized Bed Combustor	CF	20
Tuel Reburning	FU	30
ow Excess Air	LA	20
ow NO _x Burners	LN	30^{1}
Other (or Unspecified)	OT	20
verfire Air	OV	20^1
elective Catalytic Reduction	SR	70
elective Catalytic Reduction		
With Low Nitrogen Oxide Burners	SR and LN	90
elective Noncatalytic Reduction	SN	30
elective Noncatalytic Reduction		
With Low NO _x Burners	SN and LN	50
lagging	SC	20


^{1.} Starting with 1995 data, reduction factors for advanced overfire air, low NO_x burners, and overfire air were reduced by 10 percent. Sources: U.S. Energy Information Administration, Form EIA-860, "Annual Electric Generator Report;" Babcock and Wilcox, Steam 41st Edition, 2005.

Table A5. Unit-of-Measure Equivalents

Table A5. Unit-of-Measure Equivalents		
Unit	Equivalent	Unit
Kilowatt (kW)	1,000 (One Thousand)	Watts
Kilowatt (kW)	1,000,000 (One Million)	Watts
Gigawatt (GW)	1,000,000,000 (One Billion)	Watts
Terawatt (TW)	1,000,000,000,000 (One Trillion)	Watts
Gigawatt	1,000,000 (One Million)	Kilowatts
Thousand Gigawatts	1,000,000,000 (One Billion)	Kilowatts
Kilowatthours (kWh)	1,000 (One Thousand)	Watthours
Megawatthours (MWh)		Watthours
Gigawatthours (GWh)	1,000,000,000 (One Billion)	Watthours
Terawatthours (TWh)	1,000,000,000,000 (One Trillion)	Watthours
Gigawatthours	1,000,000 (One Million)	Kilowatthours
Thousand Gigawatthours	1,000,000,000(One Billion)	Kilowatthours
U.S. Dollar	1,000 (One Thousand)	Mills
U.S. Cent	10 (Ten)	Mills

Source: U.S. Energy Information Administration, Office of Electricity, Renewables, and Uranium Statistics.

EIA Electric Industry Data Collection

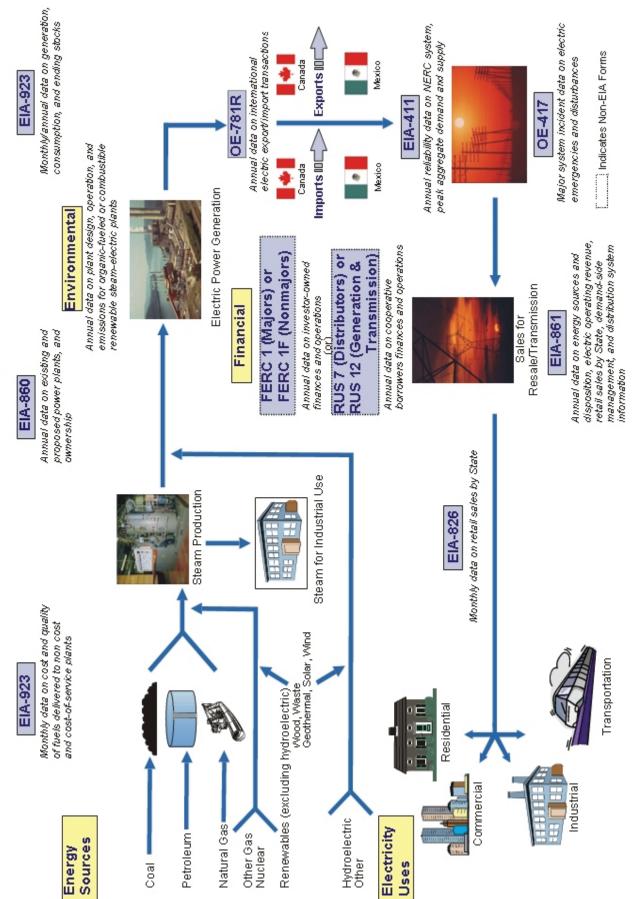

U.S. Energy Information Administration/Electric Power Annual 2009

Glossary

The Office of Electricity, Renewables, and Uranium Statistics' Master Glossary contains all references used in this publication. Please use this URL:

http://www.eia.gov/cneaf/electricity/page/glossary.html