

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8103310488 DOC. DATE: 81/03/25 NOTARIZED: NO DOCKET #
 FACIL: ~~50-438~~ Bellefonte Nuclear Plant, Unit 1, Tennessee Valley Au 05000438
 50-439 Bellefonte Nuclear Plant, Unit 2, Tennessee Valley Au 05000439
 AUTH. NAME AUTHOR AFFILIATION
 MILLS, L.M. Tennessee Valley Authority
 RECIPIENT NAME RECIPIENT AFFILIATION

SUBJECT: Fifth interim deficiency report re AUMA Actuators motor operated valve operators. Actuators returned to factory for repair. Auma has recommended actuators be reinstalled by factory trained svc employees. Next report by 810618.

DISTRIBUTION CODE: B019S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2
 TITLE: Construction Deficiency Report (10CFR50.55E)

NOTES:

	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES	
		LTTR	ENCL		LTTR	ENCL
ACTION:	A/D LICENSING 04	1	1	YOUNGBLOOD, B 05	1	1
	RUSHBROOK, M. 06	1	1	BOURNIA, T. 07	1	1
INTERNAL:	ASLBP/J. HARD	1	1	D/DIR HUM FAC15	1	1
	EDD & STAFF 19	1	1	EQUIP QUAL BR11	1	1
	HYD/GEO BR 22	1	1	I&E 09	1	1
	LIC QUAL BR 12	1	1	MPA 20	1	1
	NRC PDR 02	1	1	OELD 21	1	1
	PROC/TST REV 13	1	1	QA BR 14	1	1
	<u>REG FILE</u> 01	1	1	RUTHERFORD, W. IE	1	1
	STANEROS DEV 21	1	1			
EXTERNAL:	ACRS 16	16	16	LPDR 03	1	1
	NSIC 08	1	1			

APR 1 1981

TOTAL NUMBER OF COPIES REQUIRED: LTTR 37 ENCL 37

TENNESSEE VALLEY AUTHORITY

MEMPHIS, TENNESSEE 381

50-438
439

400 Chestnut Street Tower II

March 25, 1981

Mr. James P. O'Reilly, Director
Office of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
Region II - Suite 3100
101 Marietta Street
Atlanta, Georgia 30303

Dear Mr. O'Reilly:

BELLEFONTE NUCLEAR PLANT UNITS 1 AND 2 - AUMA ACTUATORS - MOV OPERATOR -
NCR'S 1200 AND 1256 - FIFTH INTERIM REPORT

The subject nonconformance was initially reported to NRC-OIE Inspector R. W. Wright on June 11, 1980, in accordance with 10 CFR 50.55(e). This was followed by our interim reports dated July 10 and August 20, 1980. After that time, related NCR 1256 was determined to be reportable in accordance with 10 CFR 50.55(e). This was followed by our interim reports dated October 16, 1980, and January 14, 1981. Enclosed is our fifth interim report. We expect to submit our next written report by June 18, 1981.

If you have any questions concerning this matter, please get in touch with D. L. Lambert at FTS 857-2581.


Very truly yours,

TENNESSEE VALLEY AUTHORITY

L. M. Mills, Manager
Nuclear Regulation and Safety

Enclosure

cc: Mr. Victor Stello, Jr., Director (Enclosure) ✓
Office of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
Washington, DC 20555

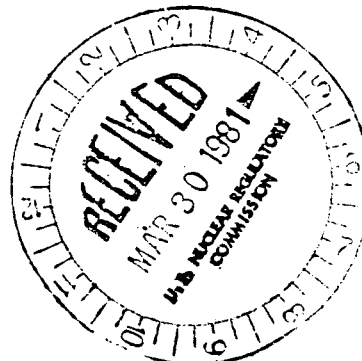

B019
S
111

8103310488

S

ENCLOSURE

BELLEFONTE NUCLEAR PLANT UNITS 1 AND 2
AUMA ACTUATORS, INCORPORATED - MOV OPERATOR
NCR'S 1200 AND 1256
FIFTH INTERIM REPORT

Description of Deficiency

Numerous problems with motor-operated valve operators supplied by Auma Actuators, Incorporated, for Jamesbury valves located in the Essential Raw Cooling Water System (ERCW) have resulted in the issuance of two significant NCR's as follows.

NCR 1200 - Valves failed to operate in either the electrical or mechanical mode

NCR 1256 - Gears for open limit switch operation were stripped causing open limit switch not to operate

Interim Progress

TVA informed Jamesbury of the problems and requested that the affected valves and operators be examined by a factory-trained service representative from Auma Actuators, Incorporated, to ascertain the problem. As a result of the inspection by Auma, the actuators were returned to the factory for repair. Auma has recommended the actuators be reinstalled by factory-trained service employees.

TVA is continuing to work with Auma on the corrective action.