




A
B
C
D
E
F
G

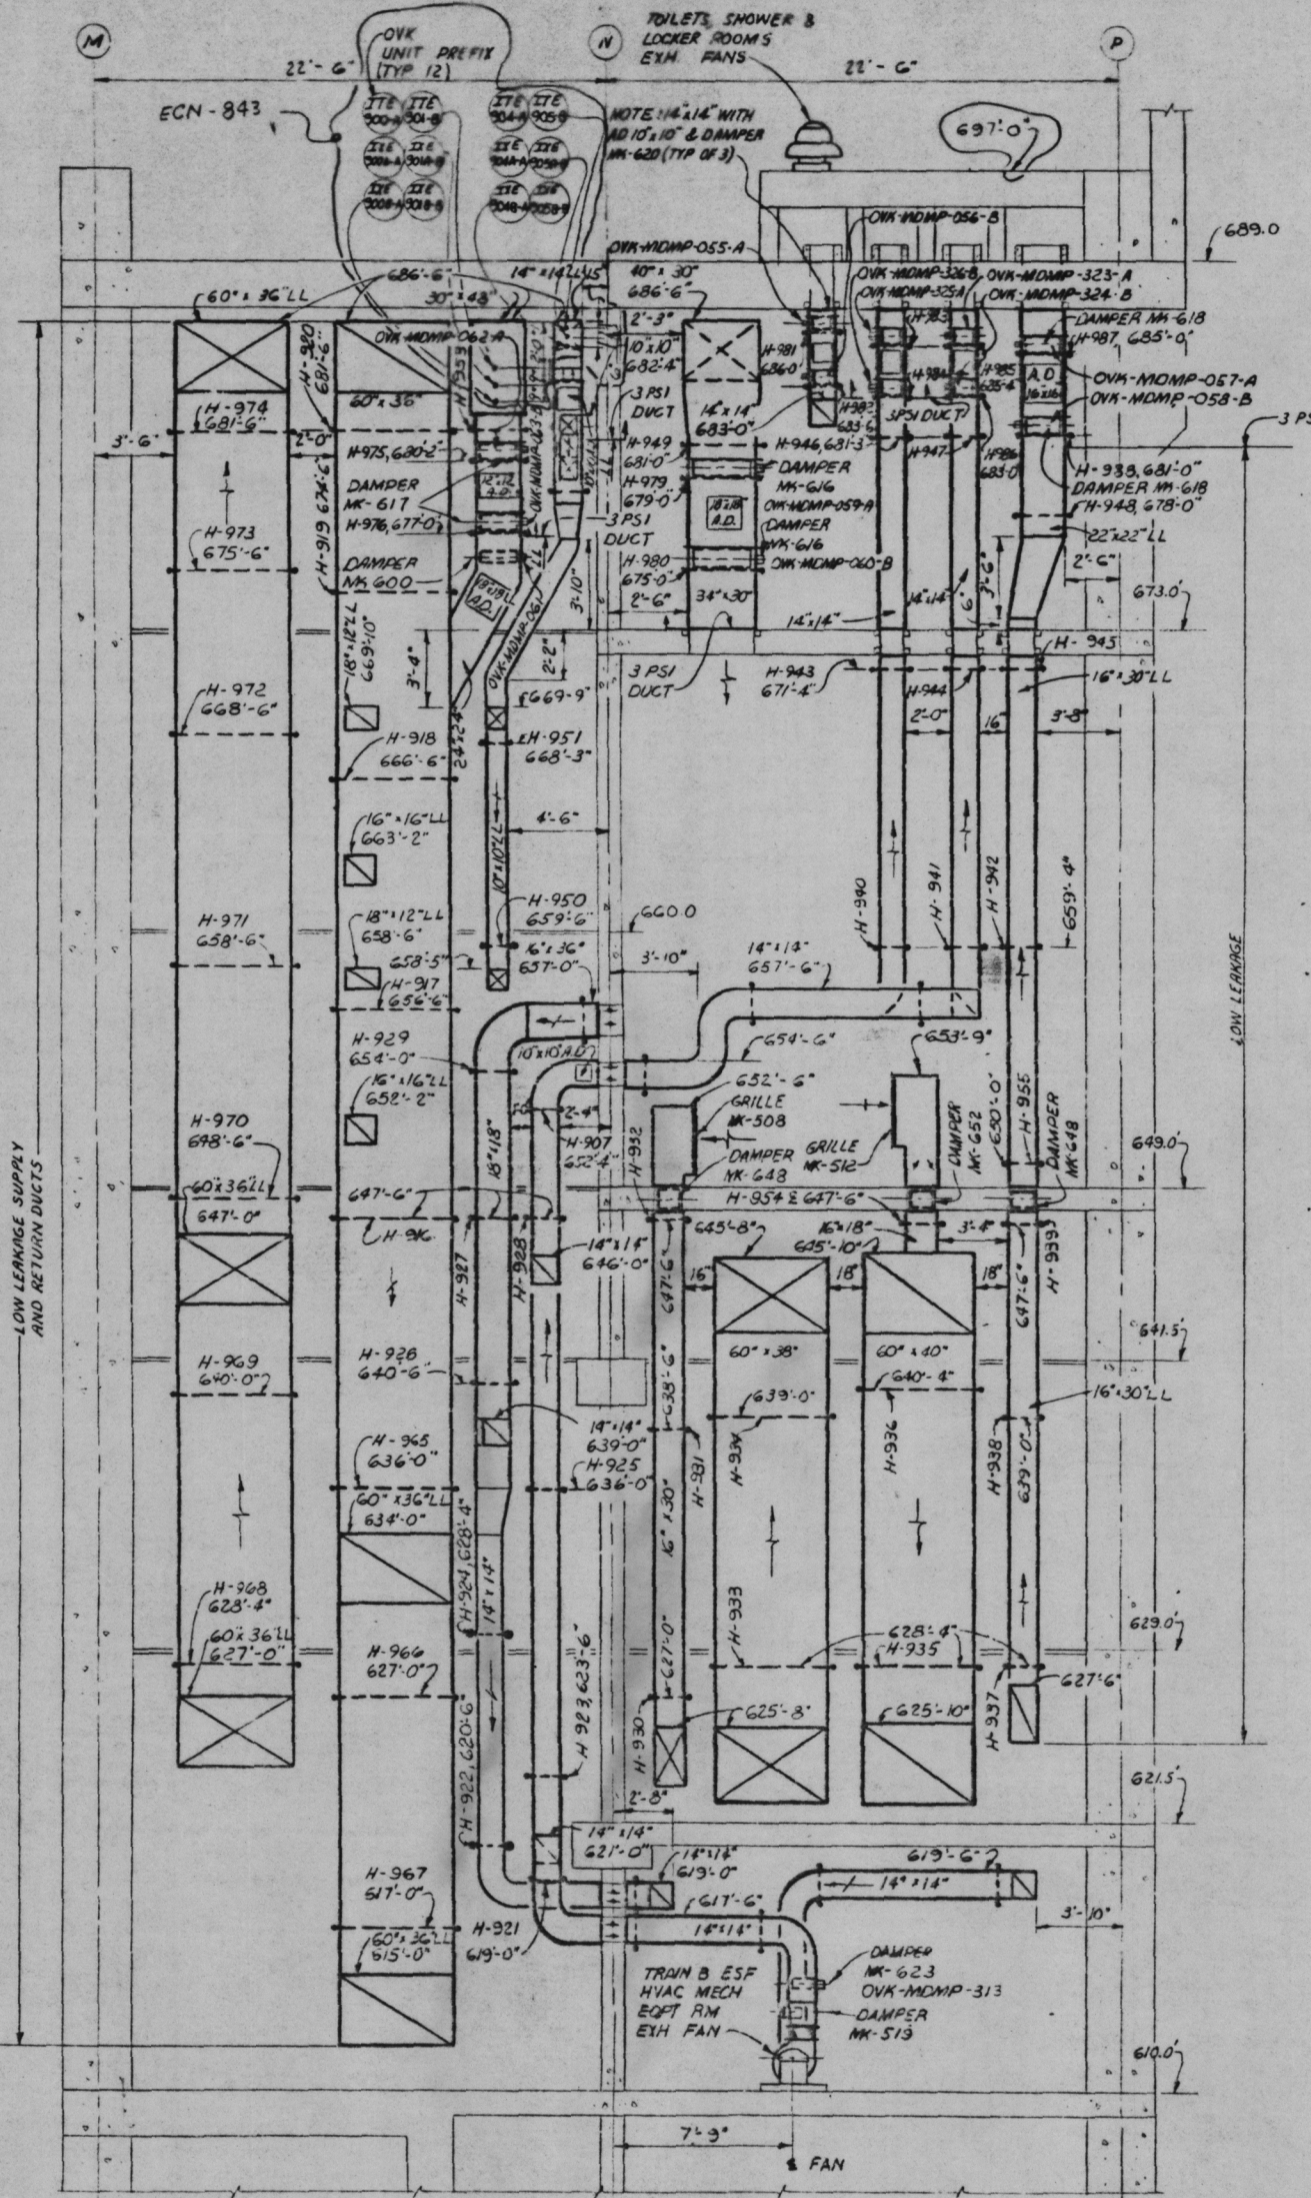


SECTION A9-A9
SHEETS 1, 3, 5, 6, 8

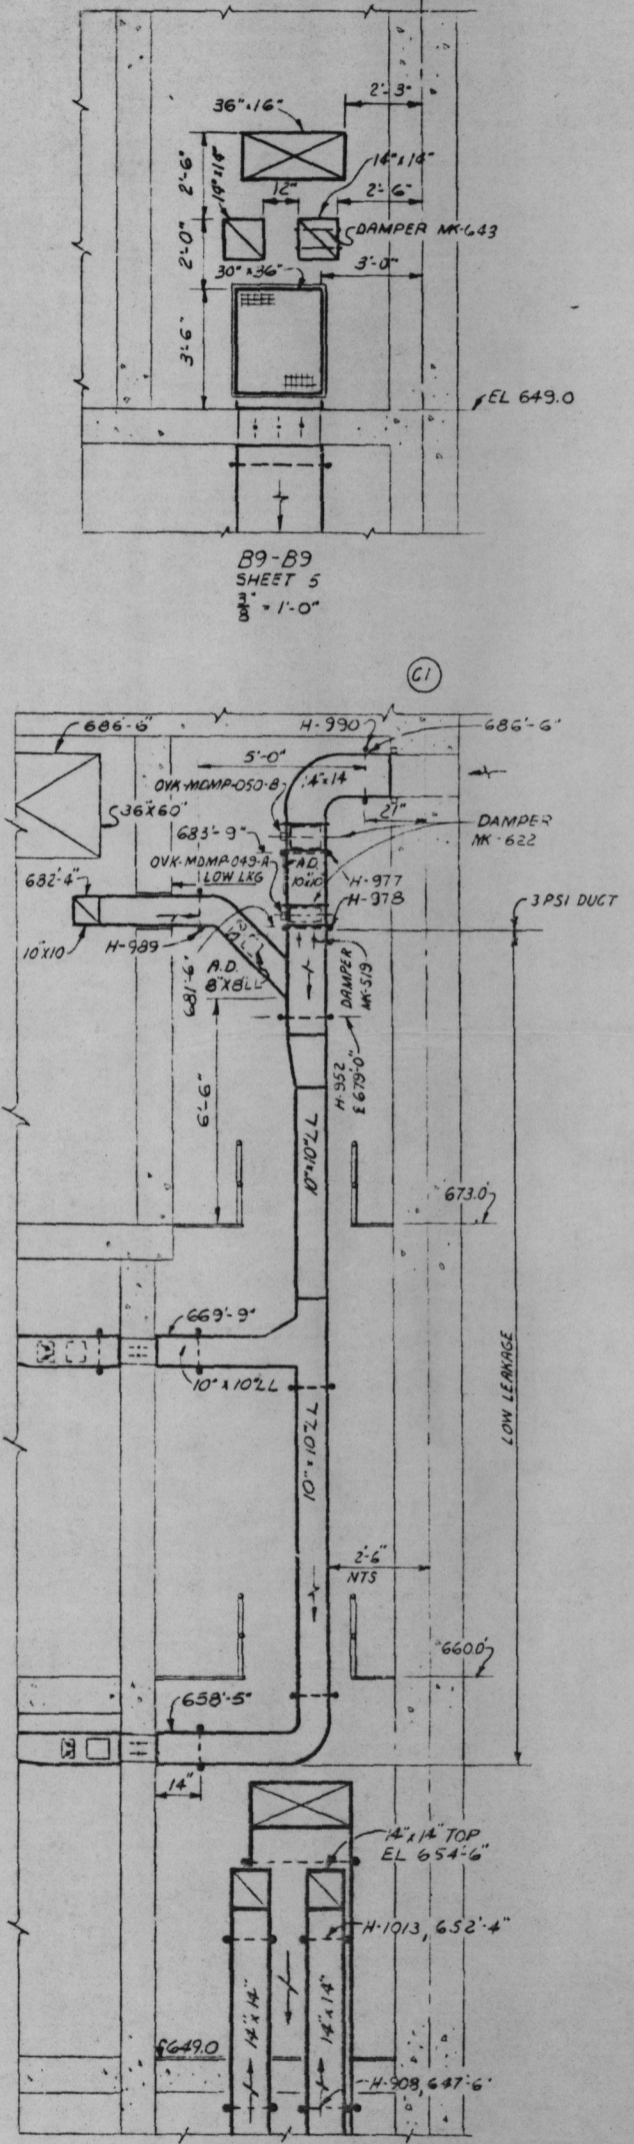

C9-C9
SHEETS 5 & 6
3/4\"/>

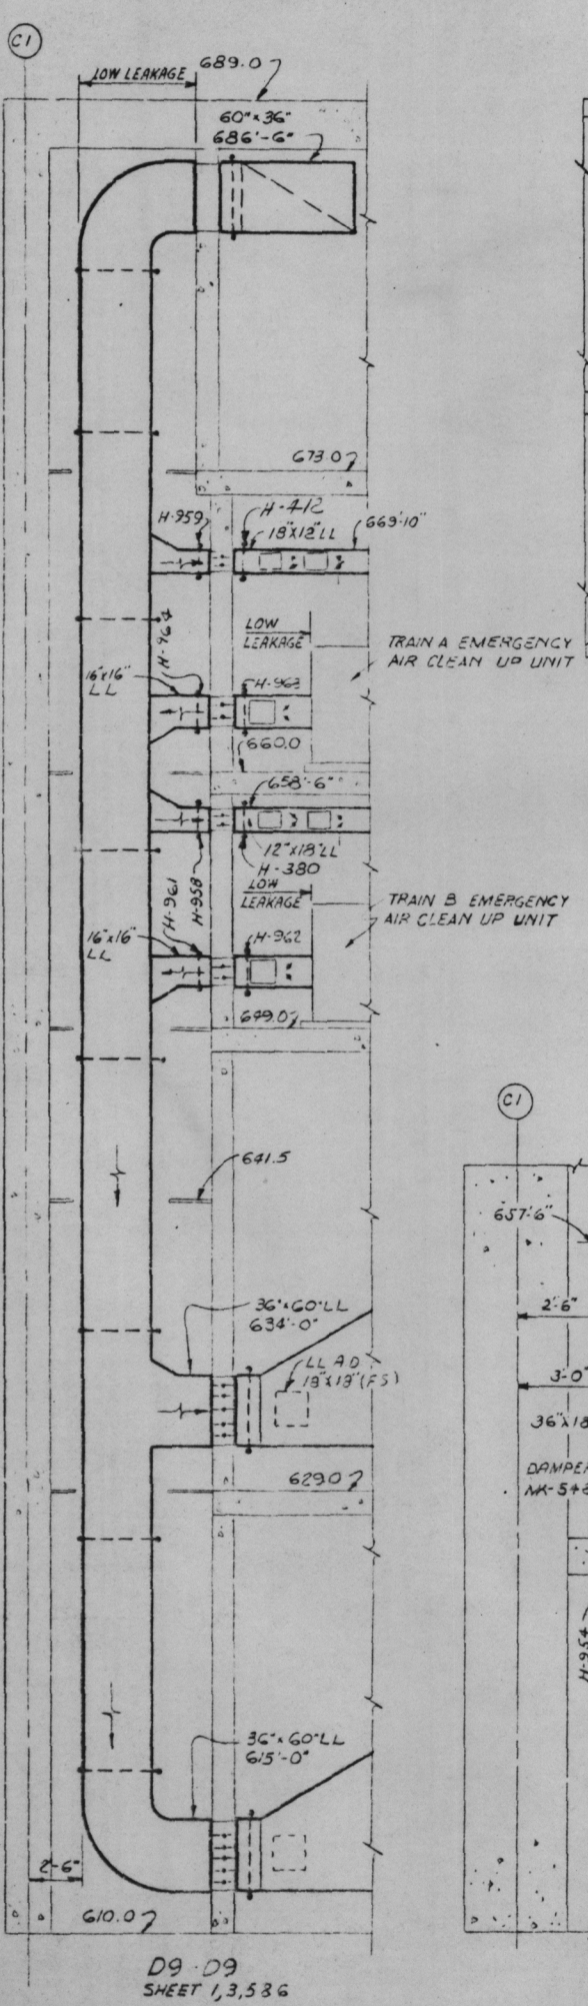

D9-D9
SHEET 1, 3, 5, 6

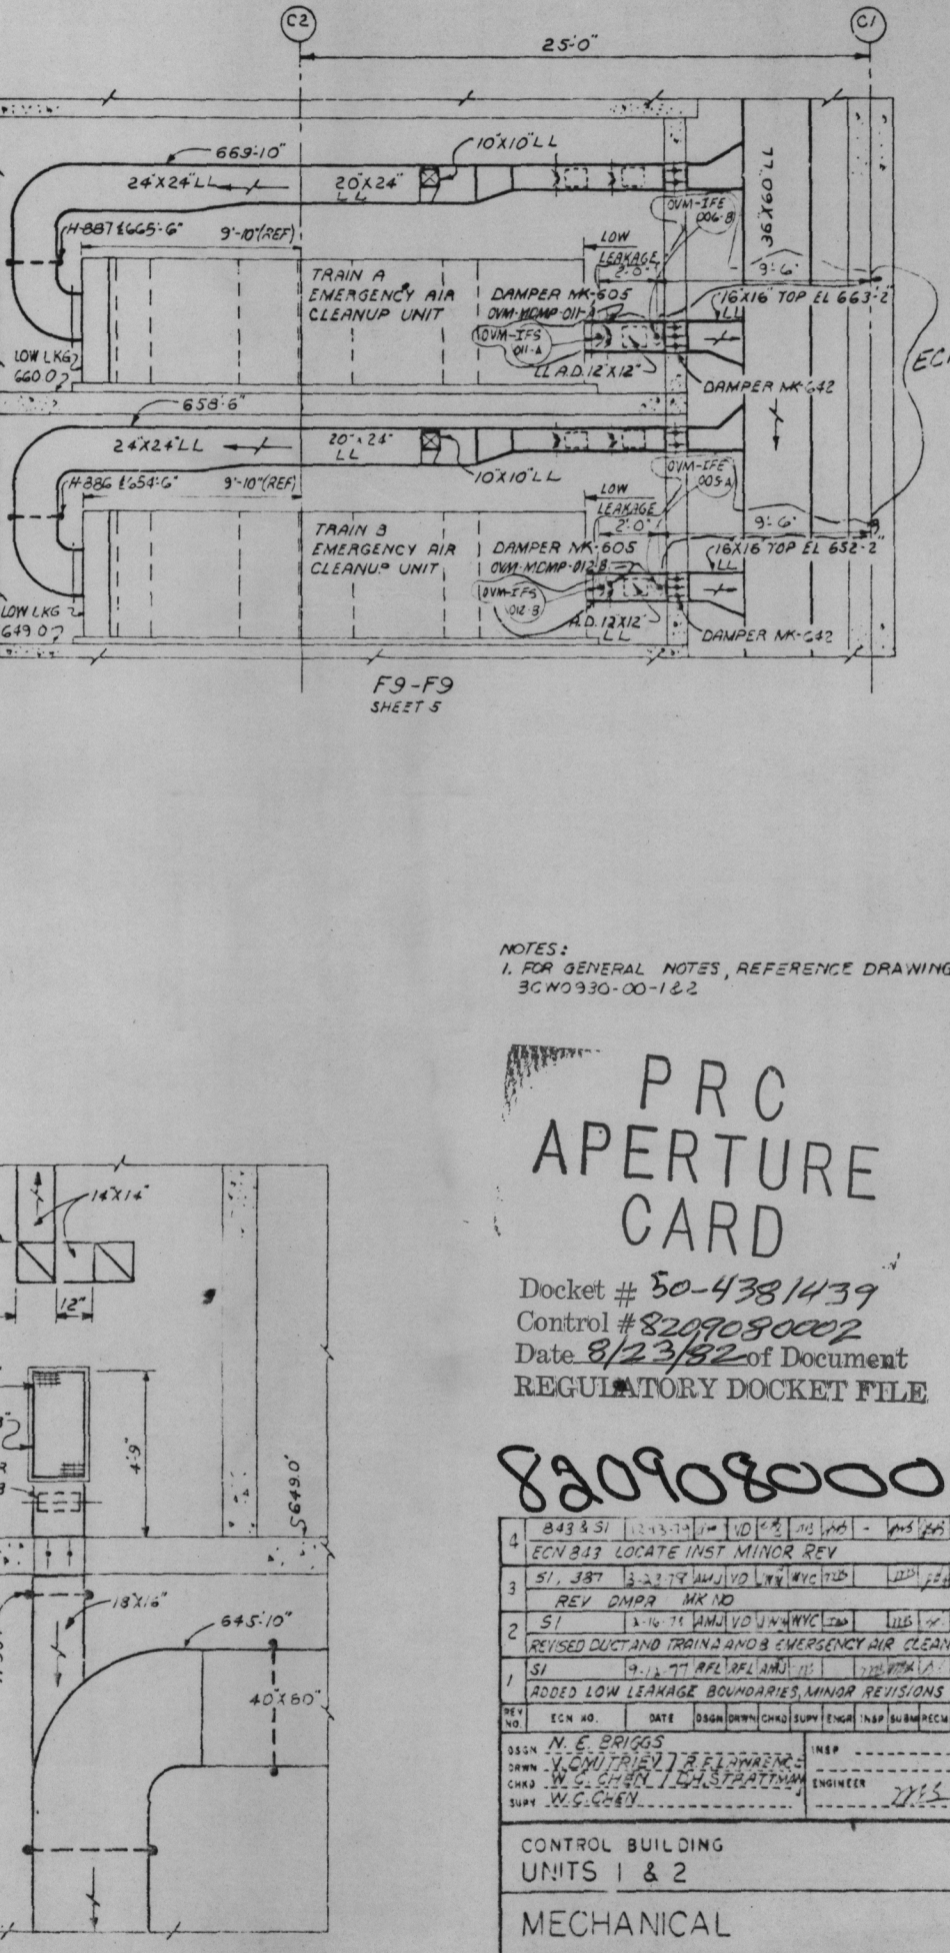

E9-E9
SHEET 3 & 5
3/4\"/>

NOTES:
1. FOR GENERAL NOTES, REFERENCE DRAWINGS SEE 3CW0930-00-122

PRC
APERTURE
CARD

Docket # 50-4381439
Control # 8209080004
Date 8/23/52 of Document
REGULATORY DOCKET FILE

8209080004

4	843 & 51	10/15/52	10/15/52	10/15/52	10/15/52
3	ECN 813	LOCATE INST. MINOR REV.			
2	51	JBT	12/29/50	12/29/50	12/29/50
1	51	REV DAMP MK 10			
		REVISED DUCT AND TRAINS AND B EMERGENCY AIR CLEANUP UNITS			
		ADDED LOW LEAKAGE BOUNDARIES, MINOR REVISIONS			
DESIGNER	N. E. BRIGGS	DATE	10/15/52	CHECKED	10/15/52
DRAWN	V. G. WATSON	DATE	10/15/52	CHECKED	10/15/52
CHECKED	M. S. GIBSON	DATE	10/15/52	CHECKED	10/15/52
SUPV	M. S. GIBSON	DATE	10/15/52	CHECKED	10/15/52

CONTROL BUILDING
UNITS 1 & 2
MECHANICAL
HEATING, VENTILATING, AND
AIR CONDITIONING

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

SUBMITTED	RECOMMENDED	APPROVED
KNOXVILLE	BB M	3CW0930-00-09

POOR ORIGINAL