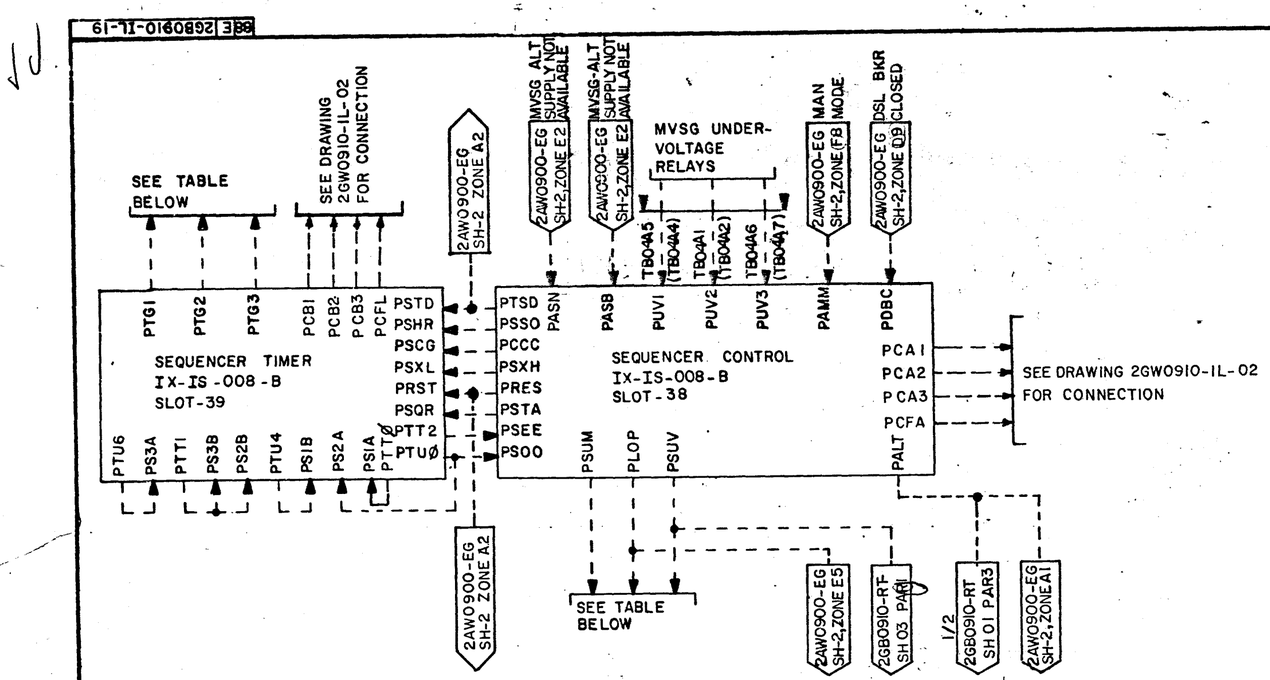

CONTROLLED DEVICE IN IX-IS-008-B	FUNCTION / SLOT						SSCS CID DRAWING NUMBER
	PLOP	PSUM	PSUV	PTG 1	PTG 2	PTG 3	
VE-MPMP-213-B	45	45	45			45	2GB0910-VE-10
VJ-MFAN-036-B	61	61	61	61			2GB0910-VJ-09
VITAL CONT PWR	58	58	58			58	2GB0910-IL-09
TIE CB & MCC SHEDS	11						2GB0910-IL-07
EG-AUX PWR DISTR SYS	21						2AW0900-EG-02

* UNIT 1 ONLY ** UNIT 2 ONLY

APERTURE CARD

3	SI	8-8-80 CORRECTED PLOT PARI WAS PAR1
2	SI	6-17-78 AWO SH-1 CORRECTED SLOT NO.
1	SI	2-27-78

POWERHOUSE
UNITS 1 & 2

SSCS CIRCUIT
INTERFACE DIAGRAM
LOAD SEQUENCER

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF CONSTRUCTION DESIGN

DESIGNED			
DRAWN			
TRACED			
REGISTERED			

KNOXVILLE 3-16-78 | 28E 2GB0910-IL-19 R3

INSPECTED AND APPROVED FOR ISSUE
KM Nelson

Docket # 50-438
Control # 8202080064
Date 820202 of Document
REGULATORY DOCKET FILE