



BACK PHL EP

1	2	3	4
5	6	7	8
9	10	11	12
13	14	15	16
17	18	19	20
21	22	23	24
25	26	27	28
29	30	31	32
33	34	35	36
37	38	39	40
41	42	43	44
45	46	47	48
49	50	51	52
53	54	55	56
57	58	59	60
61	62	63	64
65	66	67	68
69	70	71	72
73	74	75	76
77	78	79	80
81	82	83	84
85	86	87	88
89	90	91	92
93	94	95	96
97	98	99	100

REF. 58W0747-RP-1
TYP S001

TABLE I

480V MCC2E4-A
EMCC-64-A

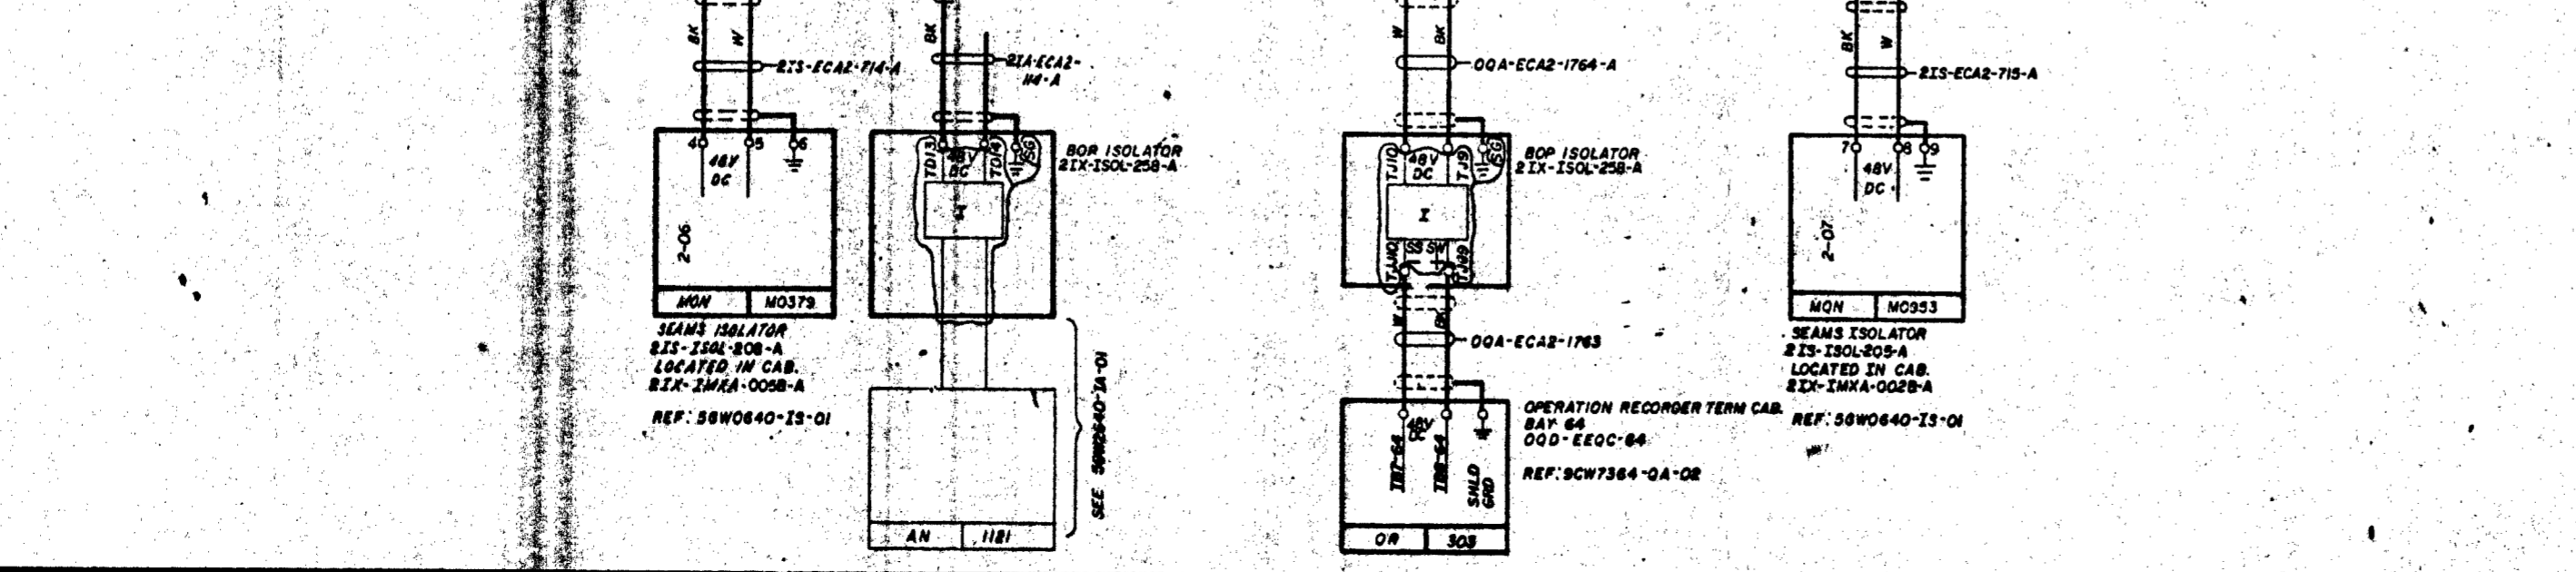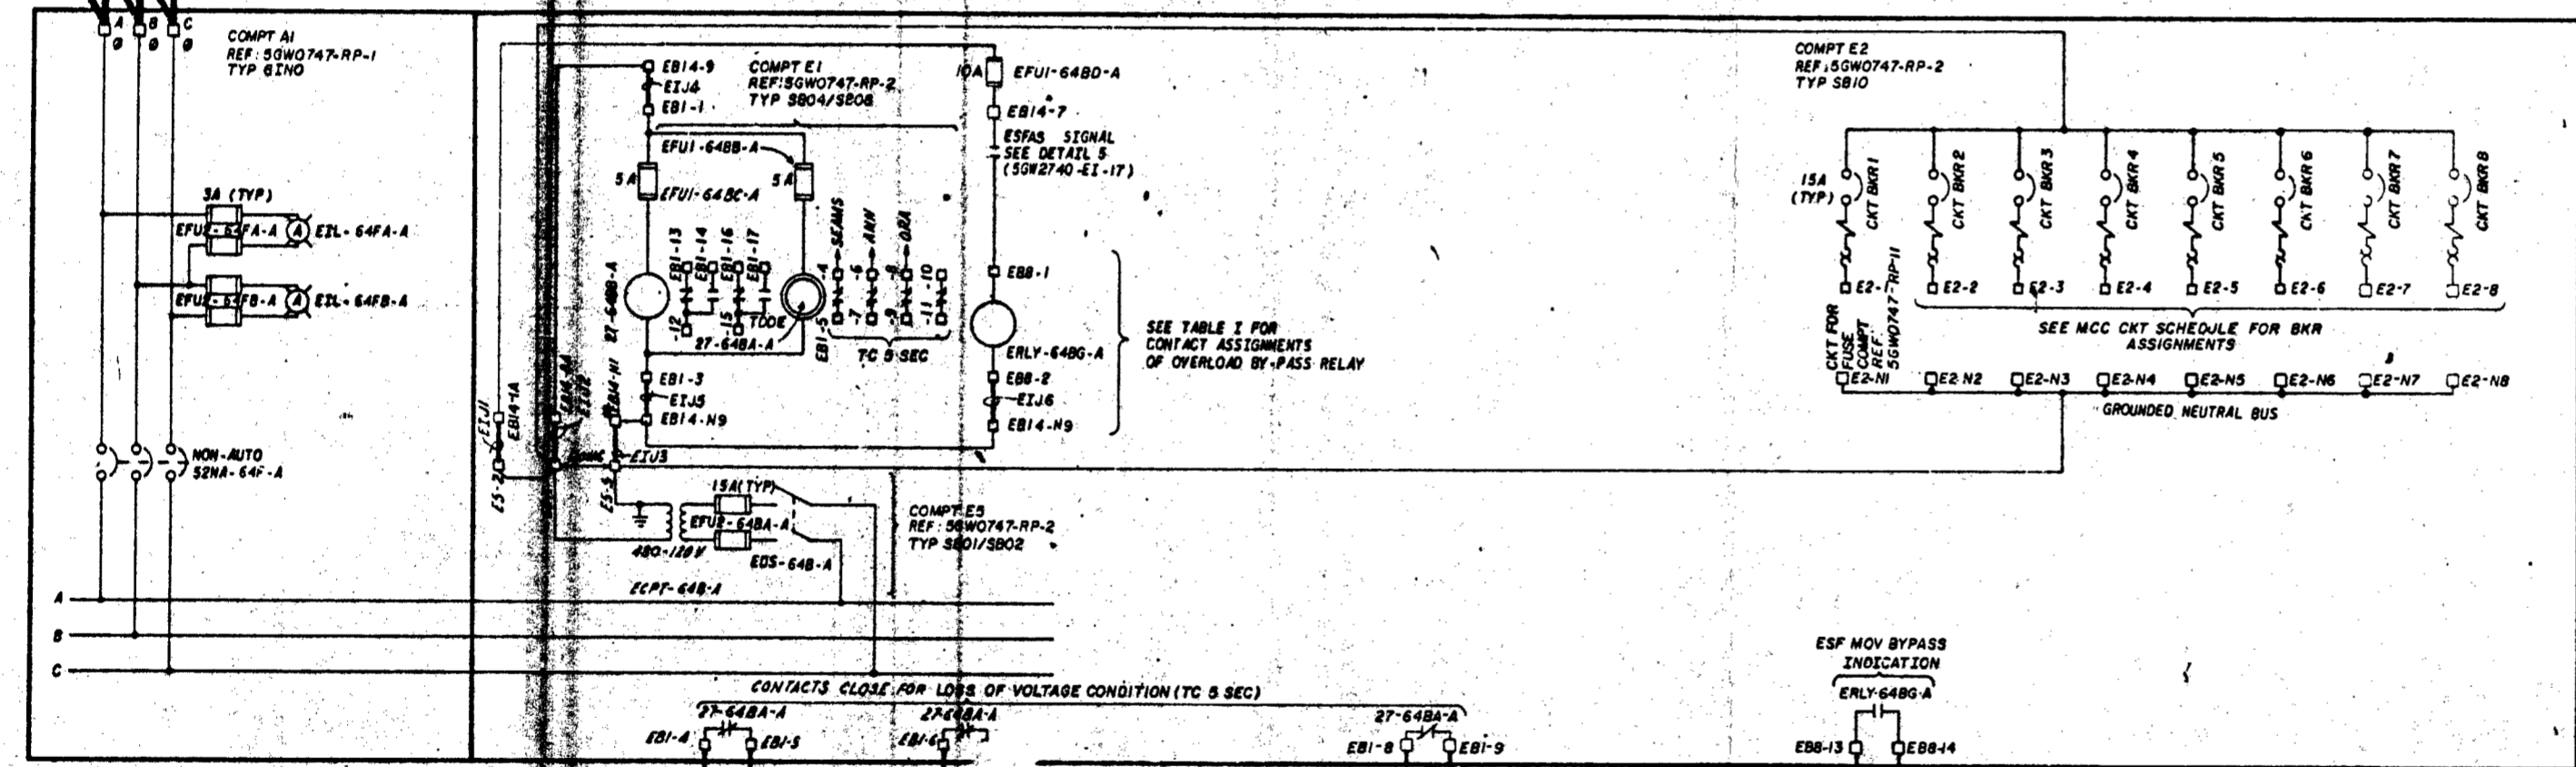

NOTES:
1. FOR GENERAL NOTES AND SYMBOLS SEE DWG 58W2740-E1-01.
2. TABLE I RESERVES RELAY CONTACTS FOR THE MOV
OVERLOAD BYPASS FUNCTION. SEE DRAWING
26W900-1L-01 FOR LIST OF MOV OVERLOADS BYPASSED.

PRC
APERTURE
CARD

Doc # 58-438
Control # 8304050576
Date 3-25-83 of Document
REGULATORY DCKET FILE

1	21	16-24-79	REGULATORY DCKET FILE	12/24
ADDED BOP ISOLATOR TERMINAL NUMBERS				
REV	REV NO.	DATE	BY	APP
001	1	12/24/79	WJZ	WJZ
SCALE: EXCEPT AS NOTED				
GENERAL UNIT 2				
SYSTEM SCHEMATIC 480V CLASS 1E AC AUX POWER DISTRIBUTION SYSTEM				
BELLEFONTE NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN				
SUBMITTED		RECOMMENDED		APPROVED
WJZ		WJZ		WJZ
INSPECTED AND APPROVED FOR ISSUE				
KNOXVILLE 12-24-79 58W2740-E1-13				