


REFERENCE DRAWINGS	
DRAWING NO	TITLE
2KW2718-EI-1	6900V SWGR 2E2-A, B SINGLE LINE
9KW2732-EI-2	480V MCC 2E3-A SINGLE LINE
9KW2733-EI-2	480V MCC 2E3-B SINGLE LINE

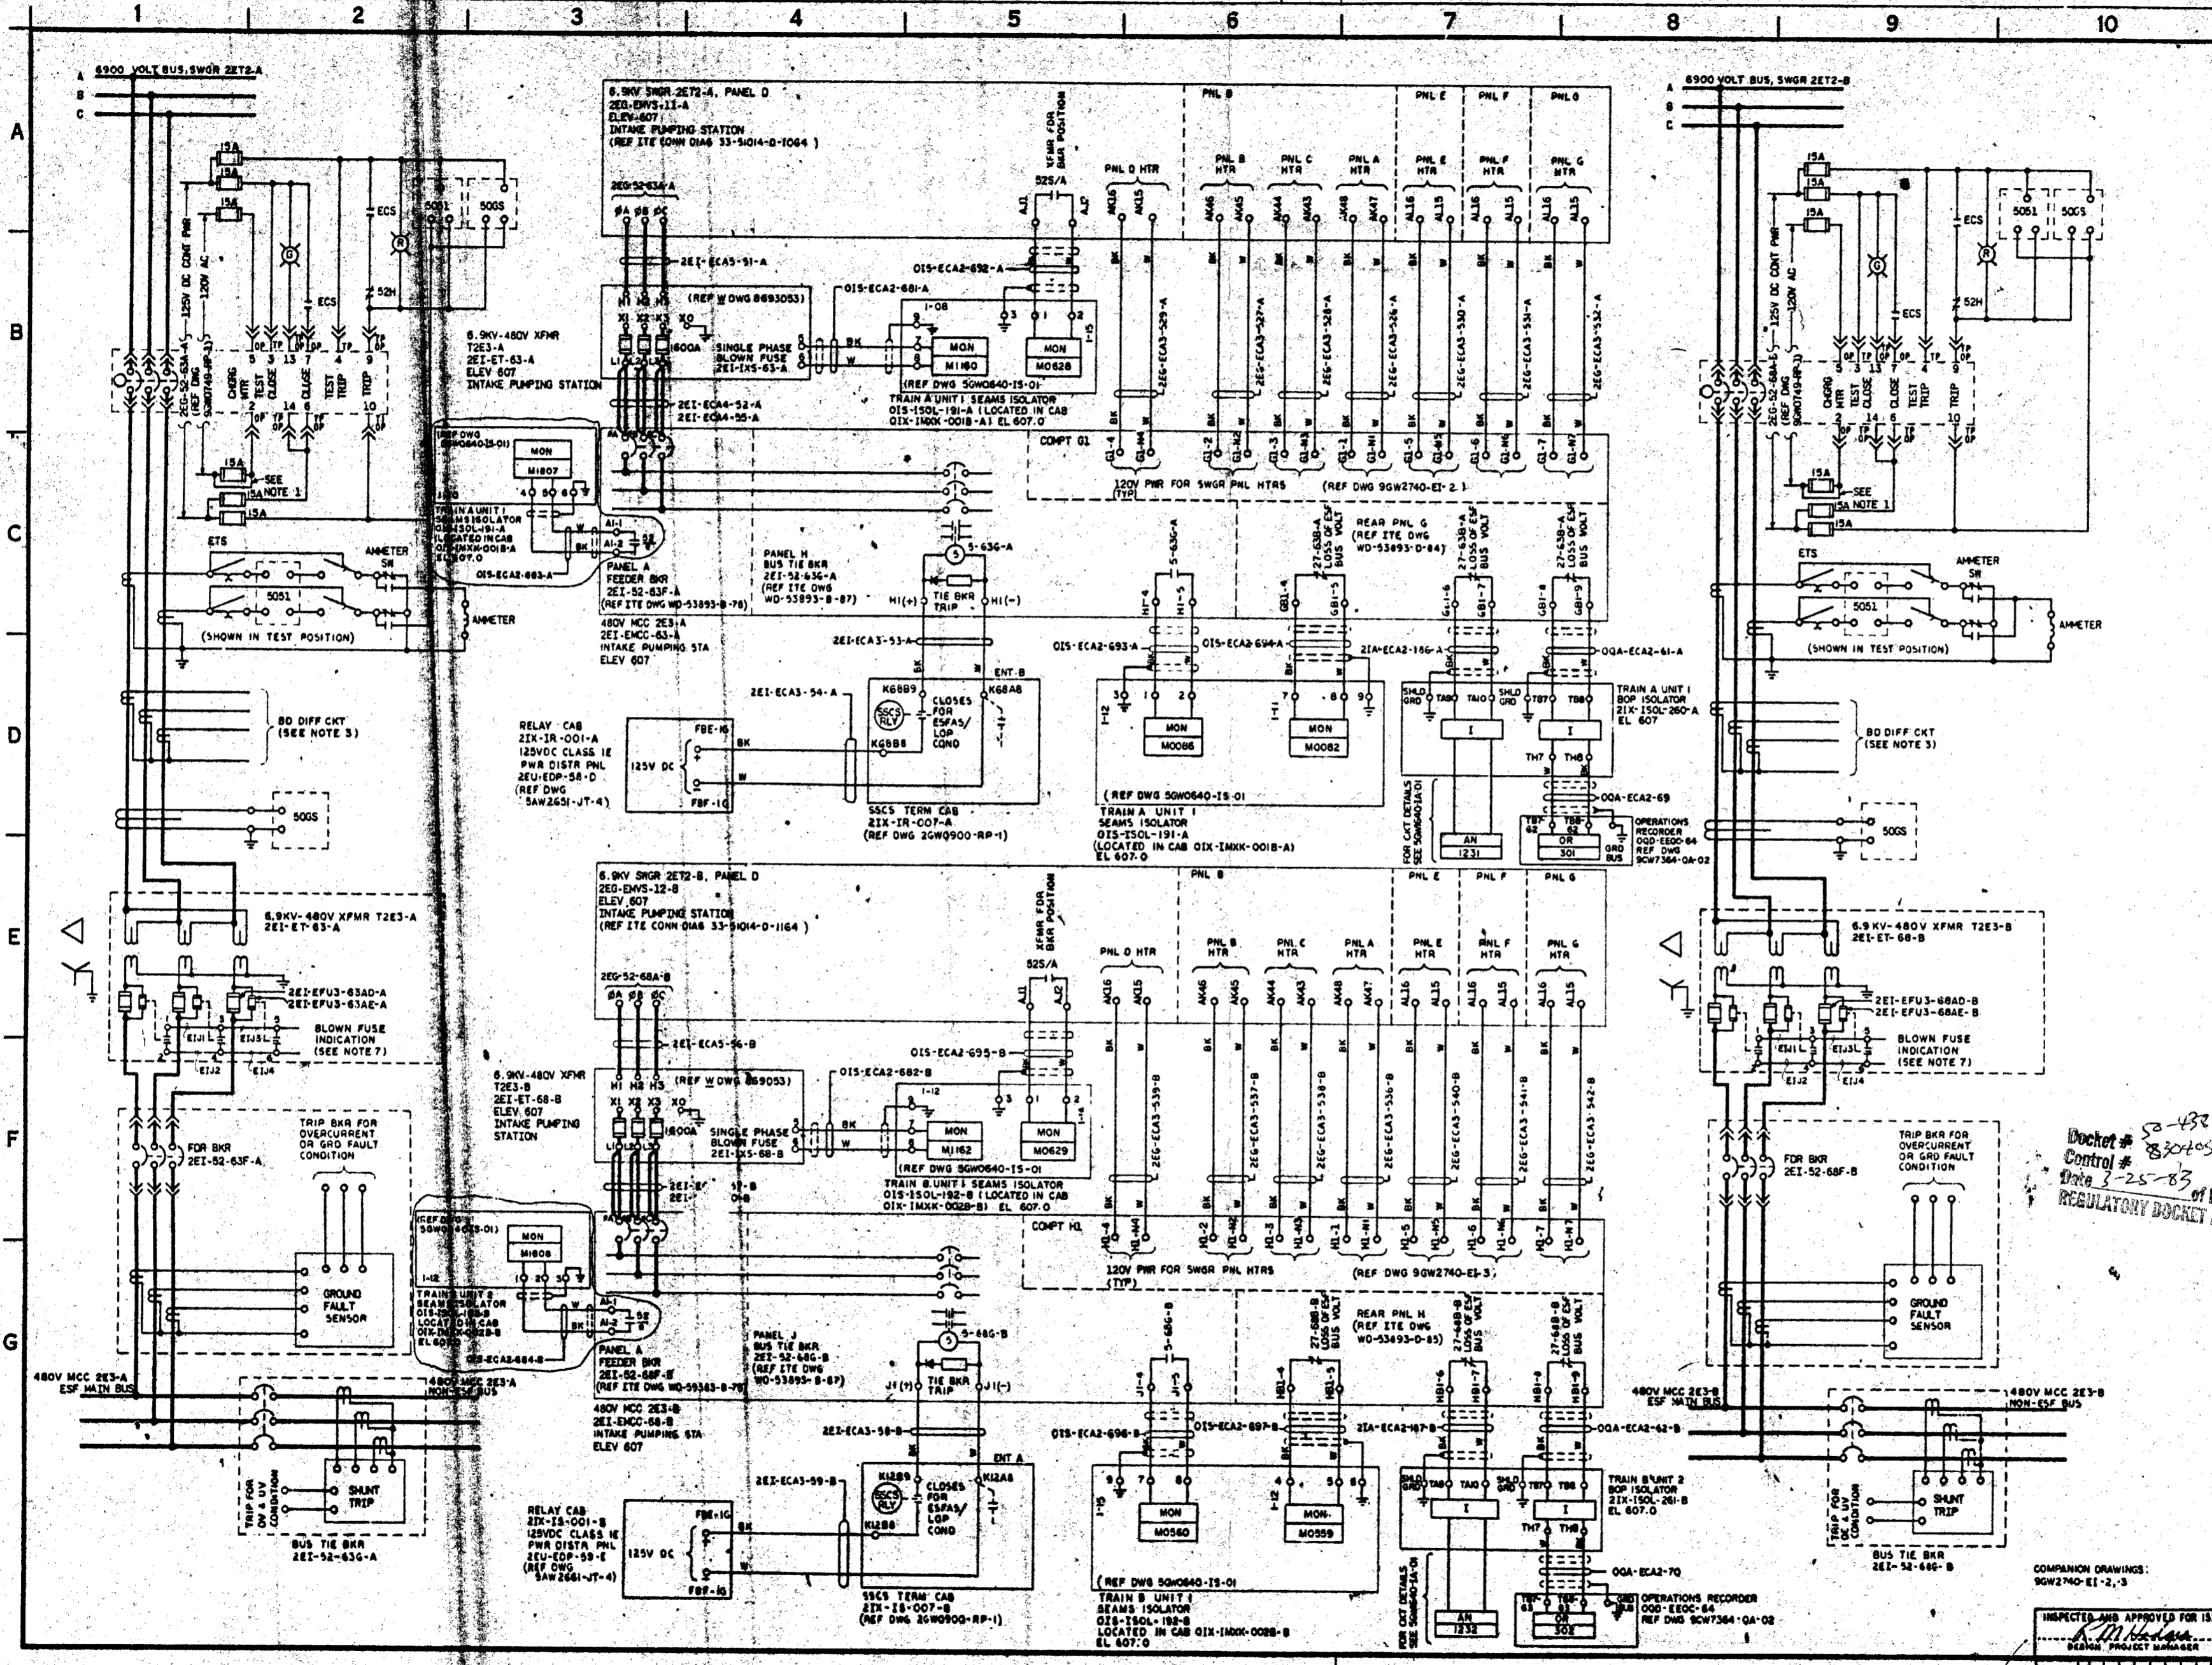

- NOTES:
1. TVA FIELD TO JUMPER FUSE.
 2. 6900V SWGR MFR, EFC IMPERIAL CORP CONTRACT NO 75R5-93583.
 3. FOR INTERNAL SCHEMATIC OF 6900V SWGR SEE TVA DWG 96W0749-AP-1.
 4. 6.9KV-480V XFMR MFR, WESTINGHOUSE ELECTRIC CORP CONTRACT NO 76K3-85526. FOR DETAILS SEE WESTINGHOUSE OUTLINE DWG 86-93093.
 5. 480V MCC MFR I-T-E IMPERIAL CORP, CONTRACT NO 76K3-86242.
 6. TERMINATION OF ALL MEDIUM VOLTAGE CABLES WILL BE IN ACCORDANCE WITH CONSTRUCTION SPEC NO G-38.
 7. 6900-480V XFMR SECONDARY BLOWN FUSE ALARM ALSO INDICATES POSSIBLE SINGLE PHASE CONDITION. FOR WIRING DETAILS SEE WESTINGHOUSE DWG 8730025.
 8. SYSTEM JUMPERS ARE SHOWN PREFIXED WITH THE SYSTEM DESIGNATION EI. COMPLETE JUMPER DESIGNATION WILL INCLUDE THE UNIT OF THE APPLICABLE ENCLOSURE, EXAMPLE: 2E1-ET-63-A-EI1.

- SYMBOLS:
- MON SAFETY-RELATED SEAMS MONITORING SYSTEM
 - XXXX POINT NUMBER
 - AN UNIT ANNUNCIATION SYSTEM
 - XXXX POINT NUMBER
 - OR MCR OPERATIONS RECORDER
 - XXXX POINT NUMBER
 - o DEVICE TERMINAL POINT
 - o INDICATING LIGHT, R-RED, G-GREEN

Docket # 58-432
Control # 802050536
Date 3-25-83
of Documents
REGULATORY DOCKET FILE

PRC
APERTURE
CARD

211369	7-1-75	58-432	802050536
ECH 1363-ADDED CONTACTOR FOR MAIN MCC FOR BKR POSITION INPUT TO SEAMS			
ECH 1363-ADDED TERM AND POINT ADDRESS AND MADE VARIOUS WHICH CHANGES			
NO	REV	DATE	BY
1	1		
DESIGN: S. R. ZACHARY			
DRAWN: [Signature]			
CHECKED: [Signature]			
APPROVED: [Signature]			
INTAKE PUMPING STATION UNIT 2			
SYSTEM SCHEMATIC			
480V CLASS IE AC AUX PWR DISTR SY			
BELLEFONTE NUCLEAR PLANT			
TENNESSEE VALLEY AUTHORITY			
DIVISION OF ENGINEERING DESIGN			
SUBMITTED: Robert J. Vanit		APPROVED: [Signature]	
KNOXVILLE 7-26-77		96M2748-EI-1 R2	

COMPANION DRAWINGS:
96W2740-EI-2, 3

INSPECTED AND APPROVED FOR ISSUE:
[Signature]
SEALS PROJECT MANAGER