

REFERENCE DRAWINGS	
DWG NO.	FILE
96M0740-ED-01.2	480V MCC SXCL SINGLE LINE

- NOTES:
- 480V MCC MFR I-Y-E IMPERIAL CORP. CONTRACT NO 76K5-86242
  - MOTOR CONTROL CENTER TERMINAL BLOCK DESIGNATIONS ARE SHOWN AS FOLLOWS:  
FOR COMPT TERMINAL BLOCKS (MOUNTED INSIDE COMPARTMENTS OF PNL D AND REAR OF COMPARTMENTS LOCATED IN ALL OTHER PANELS)  
E 4 - 8 TERMINAL NO  
COMPARTMENT PANEL  
FOR COMMON RELAY MOUNTING PANEL (REAR OF PANEL D ONLY)  
2 8 12 TERMINAL NO  
TERMINAL BLOCK NO  
BACK PANEL PANEL
  - SYSTEM JUMPERS TO BE FIELD WIRED ARE SHOWN PREFIXED WITH 'S' DESIGNATION AND INDICATED BY A HEAVY LINE. COMPLETE JUMPER DESIGNATION WILL INCLUDE THE UNIT OF THE APPLICABLE ENCLOSURE. EXAMPLE: OED-EMCC-79-EDJ1
  - SEE CABLE PROGRAM FOR COMPLETE CABLE INFORMATION.

- SYMBOLS:
- MCC COMPARTMENT TERMINATION
  - LOW-VOLTAGE SWGR COMPARTMENT TERMINATION
  - DEVICE TERMINATION

PRC APERTURE CARD

REV	ECN NO.	DATE	DESCRIPTION
1	1725	11-16-77	ISSUED FOR CONSTRUCTION
2	723	11-16-77	RELEASED HOLD
3	723	11-16-77	ADDED COOLING TOWERS SETTLING POND PUMP RCPT
4	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
5	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
6	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
7	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
8	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
9	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
10	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
11	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL
12	723	11-16-77	ADDED RADIATION MONITOR BLDG 480VAC POWER DISTR PNL

SCALE: EXERT AS NOTED

COW HYPOCHLORITE BLDG UNITS 1 & 2


SYSTEM SCHEMATIC  
480V NORMAL AC  
AUXILIARY POWER SYSTEM

BELLEFONTE NUCLEAR PLANT  
TENNESSEE VALLEY AUTHORITY  
DIVISION OF ENGINEERING SECTION

INSPECTED AND APPROVED FOR ISSUE

DATE: 11-16-77

BY: R.M. Holmes

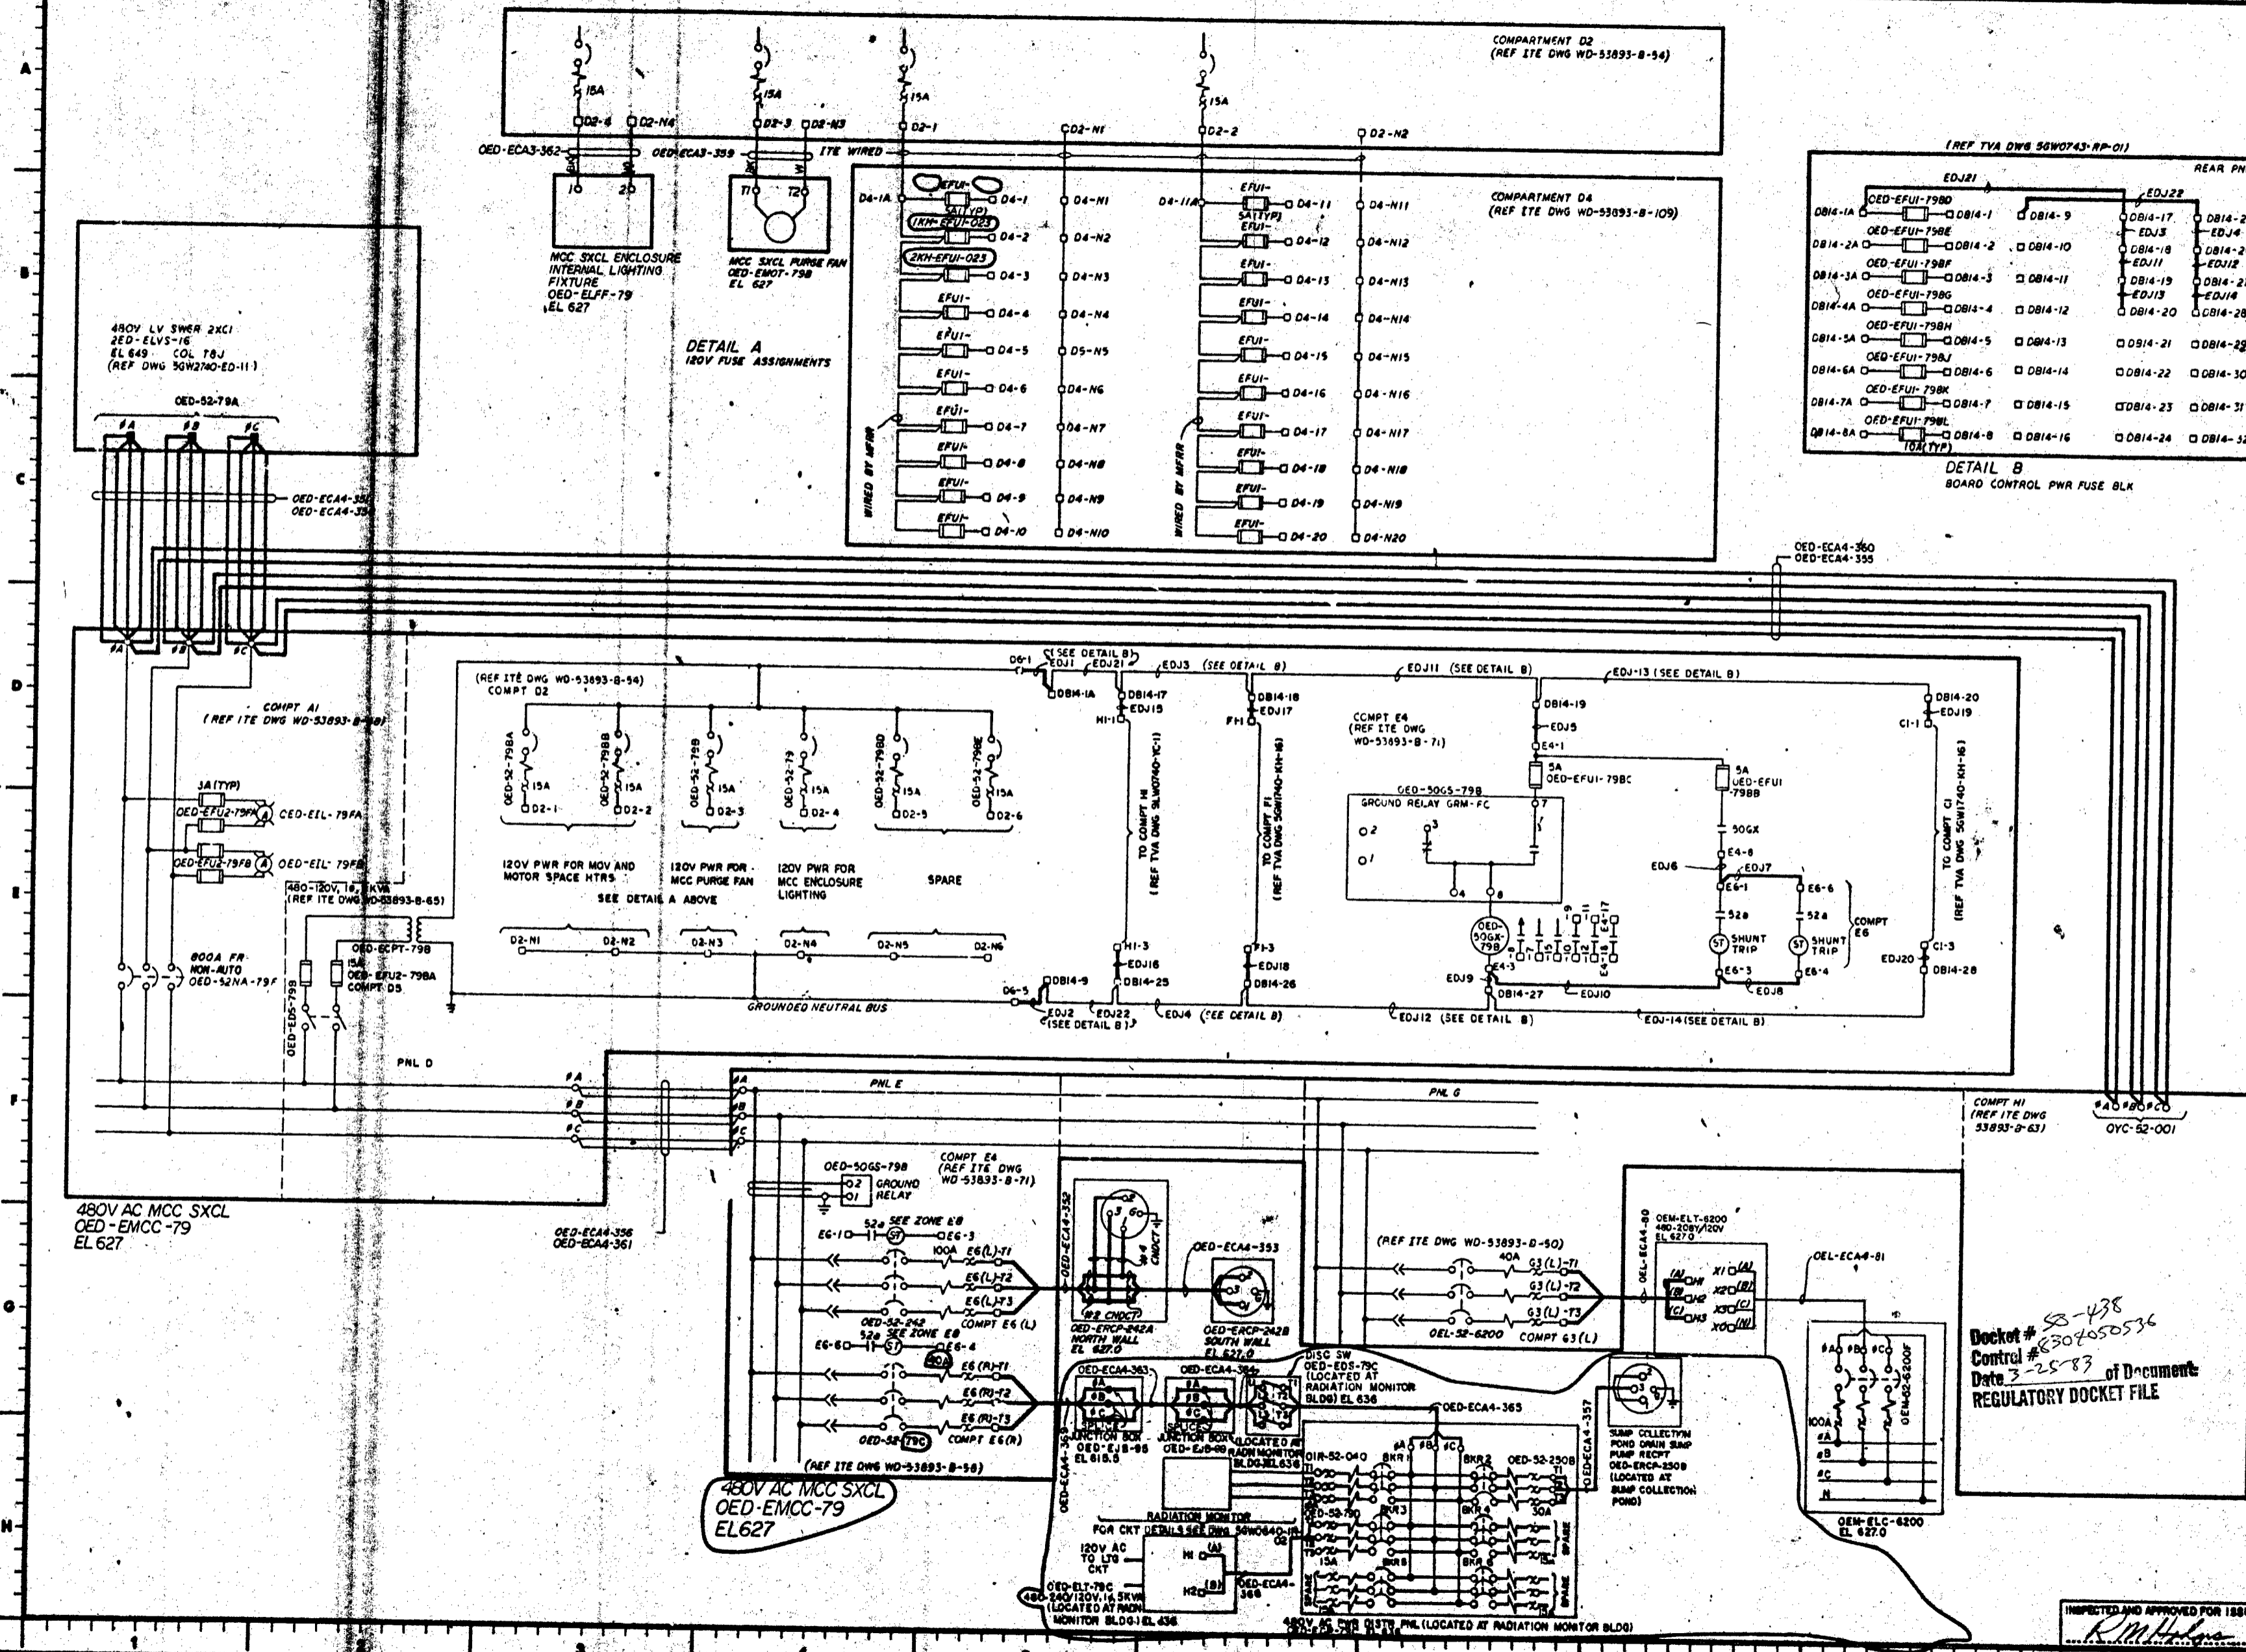

Docket # 58-438  
Control # 8304050536  
Date 3-25-83 of Document  
REGULATORY DOCKET FILE

INSPECTED AND APPROVED FOR ISSUE

DATE: 11-16-77

BY: R.M. Holmes