


NOTES:
1. FOR NOTES AND SYMBOLS SEE SHEET 01.

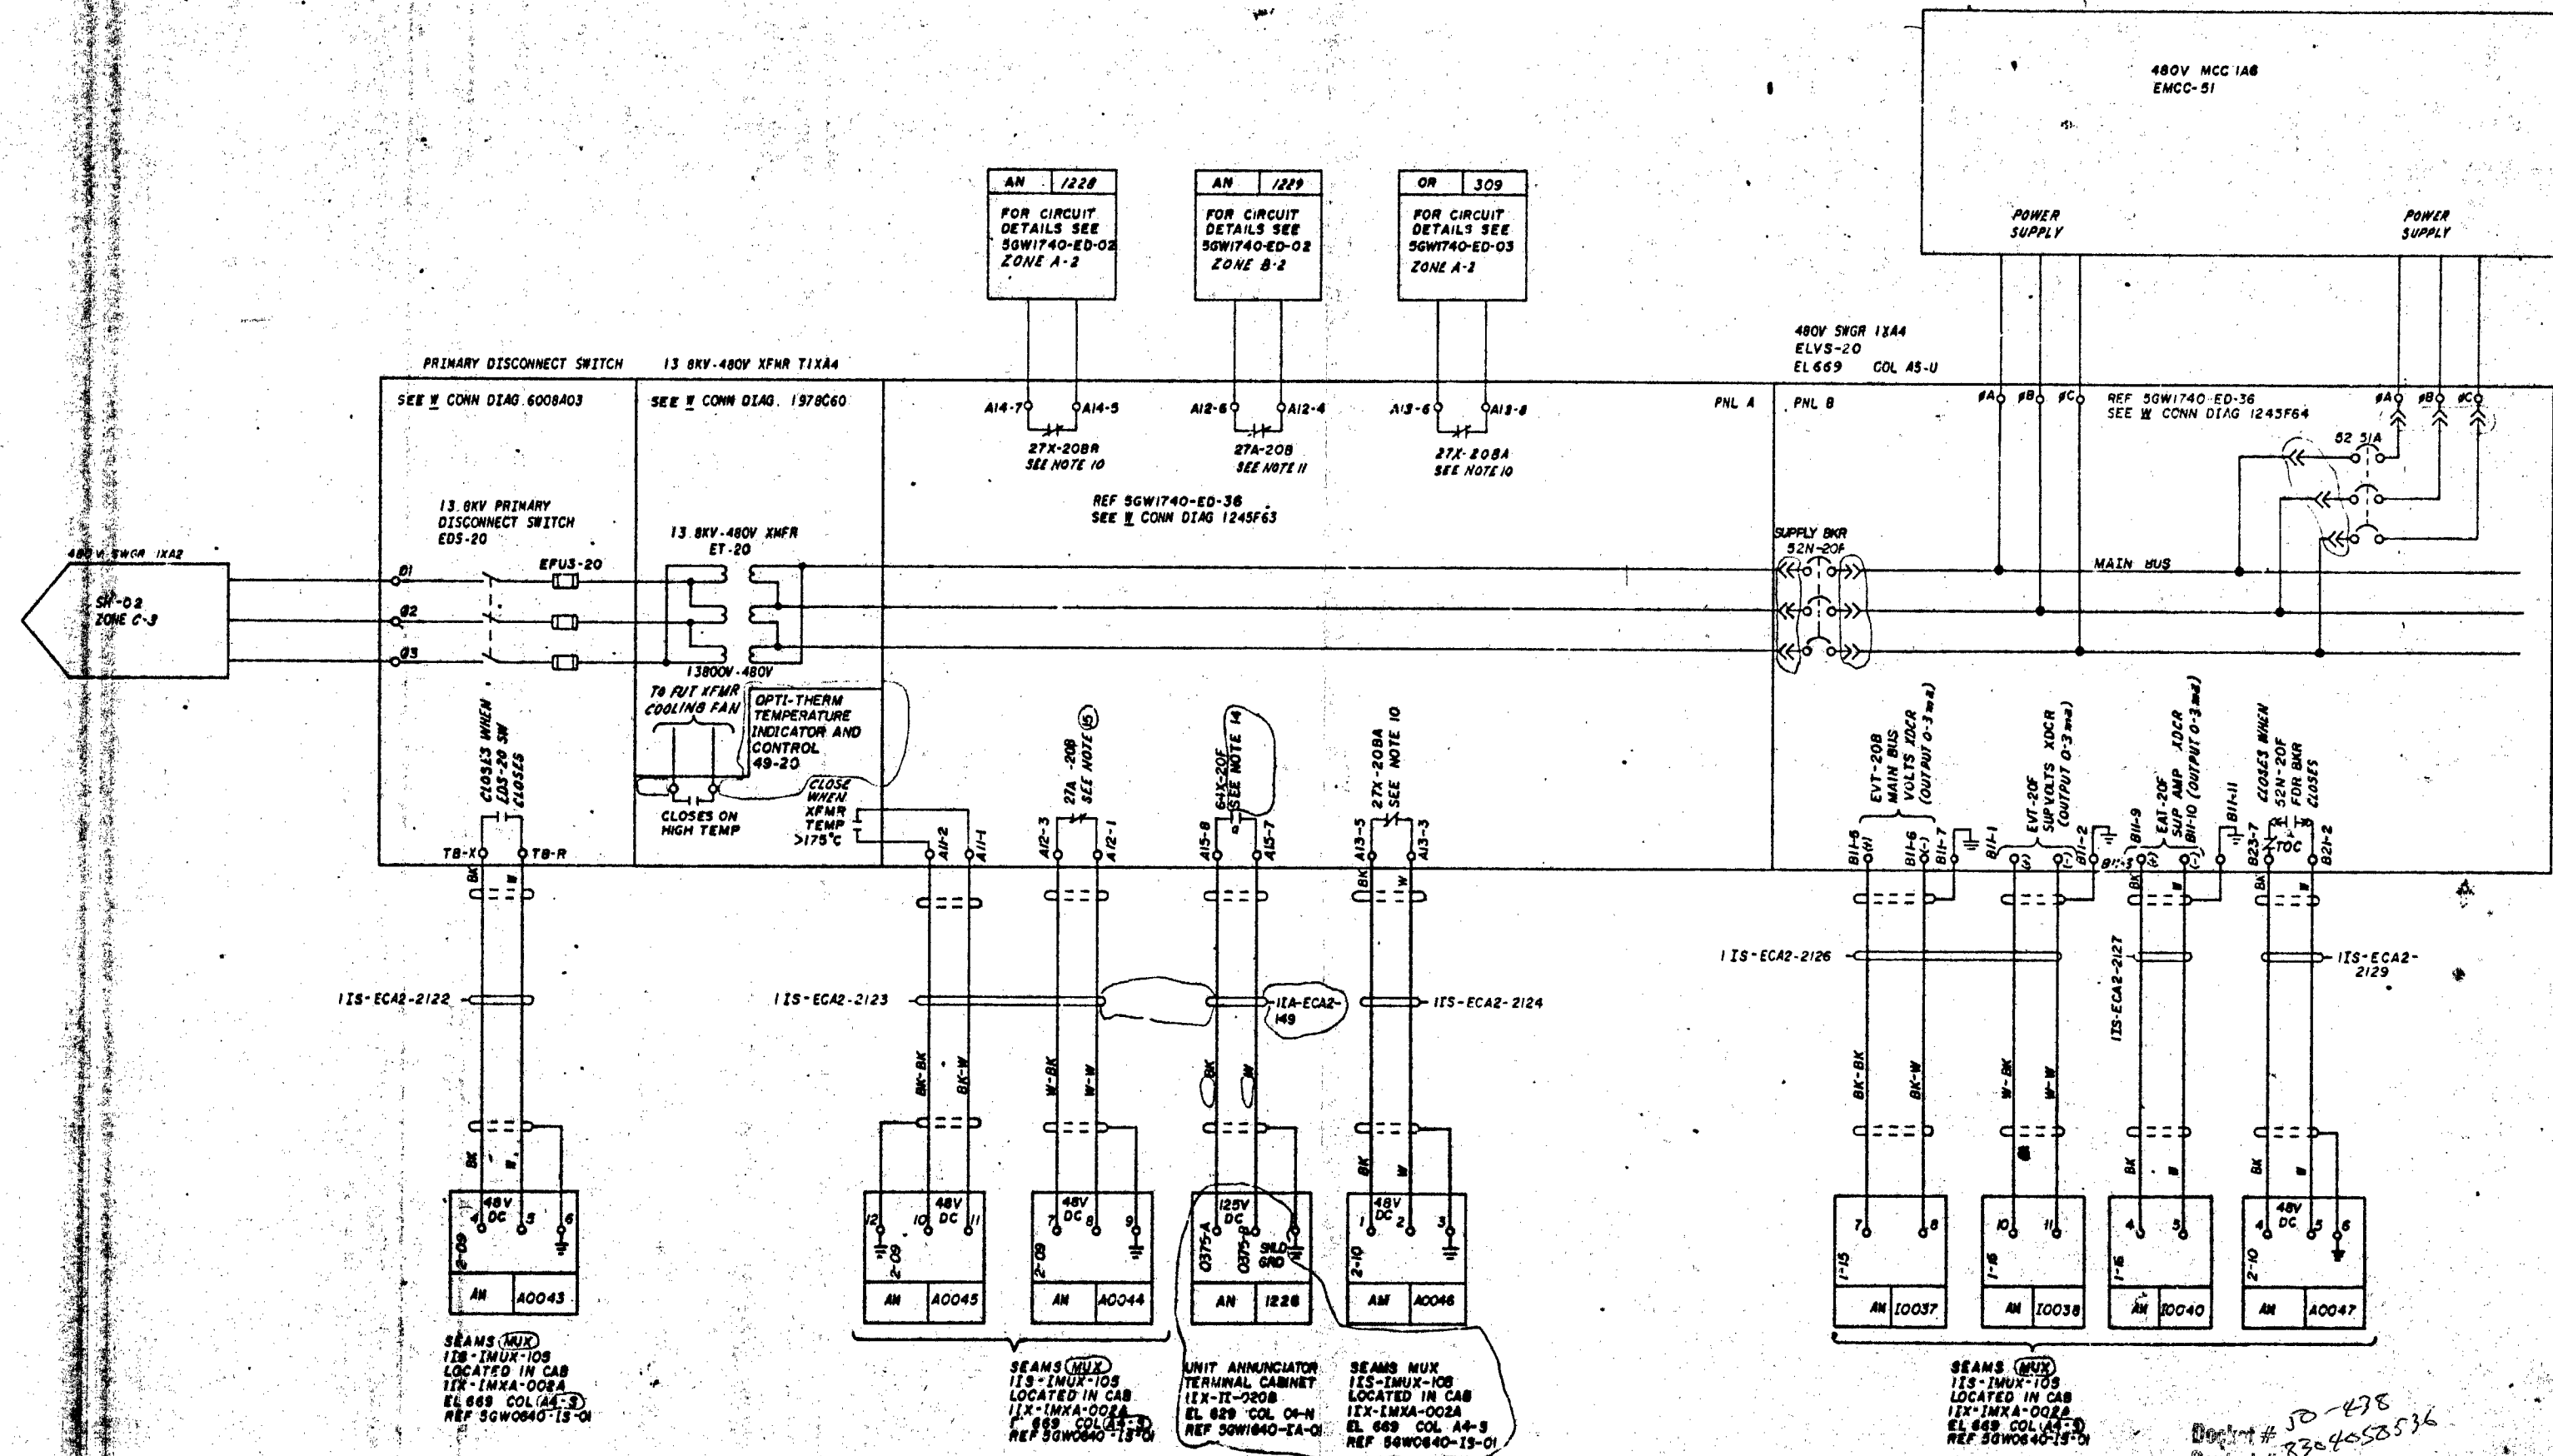

FOR CIRCUIT DETAILS SEE SGM1740-AC-14

PRC APERTURE CARD

SEAMS MUX 118-1MXX-108 LOCATED IN CAB 11X-1MXX-002A EL 669 COL 44-3 REF 50W040-13-01

SEAMS MUX 118-1MXX-108 LOCATED IN CAB 11X-1MXX-002A EL 669 COL 44-3 REF 50W040-13-01

UNIT ANNUNCIATOR TERMINAL CABINET 11X-II-208 EL 629 COL 04-N REF 50W1840-1A-01

SEAMS MUX 118-1MXX-108 LOCATED IN CAB 11X-1MXX-002A EL 669 COL 44-3 REF 50W040-13-01

SEAMS MUX 118-1MXX-108 LOCATED IN CAB 11X-1MXX-002A EL 669 COL 44-3 REF 50W040-13-01

Doc # 10-478
Control # 8304058536
Date 7-25-83
REGULATORY DOCUMENT FILE

PRESSURIZER HEATER SWGR 1XA4

2	1	2-2-79	REVISED	10/11	10/11/79
MINOR CHANGES					
1/5/81					
ADDED SEAMS CABLE NUMBERS AND TERMINATION INFO. OPERATIONS RECORD OF NO. 2. REV. PER UNIT AND GEN. REVISIONS PER ECR 51					
NO.	ECN NO.	DATE	ISSUED BY	APPROVED BY	REASON
1					
SCALE: EXCEPT AS NOTED					

GENERAL UNIT 1

SYSTEM SCHEMATIC
480V NORMAL AC AUXILIARY
POWER DISTRIBUTION SYSTEM

BELLEVILLE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

SUBMITTED: [Signature]
RECOMMENDED: [Signature]
APPROVED: [Signature]

INSPECTED AND APPROVED FOR ISSUE: [Signature]
KNOXVILLE 1-11-78
SGM1740-ED-05

NO.	DATE	ISSUED BY	APPROVED BY
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			