


NOTES:  
 1. FOR SYMBOLS AND ADDITIONAL NOTES SEE SHEET 01.  
 2. THE NORMAL (52-8502) AND ALTERNATE (52-8501) POWER DISTRIBUTION PANEL BREAKERS ARE MECHANICALLY INTERLOCKED TO PERMIT ONLY ONE OF THE BREAKERS TO BE CLOSED AT ANY GIVEN TIME.

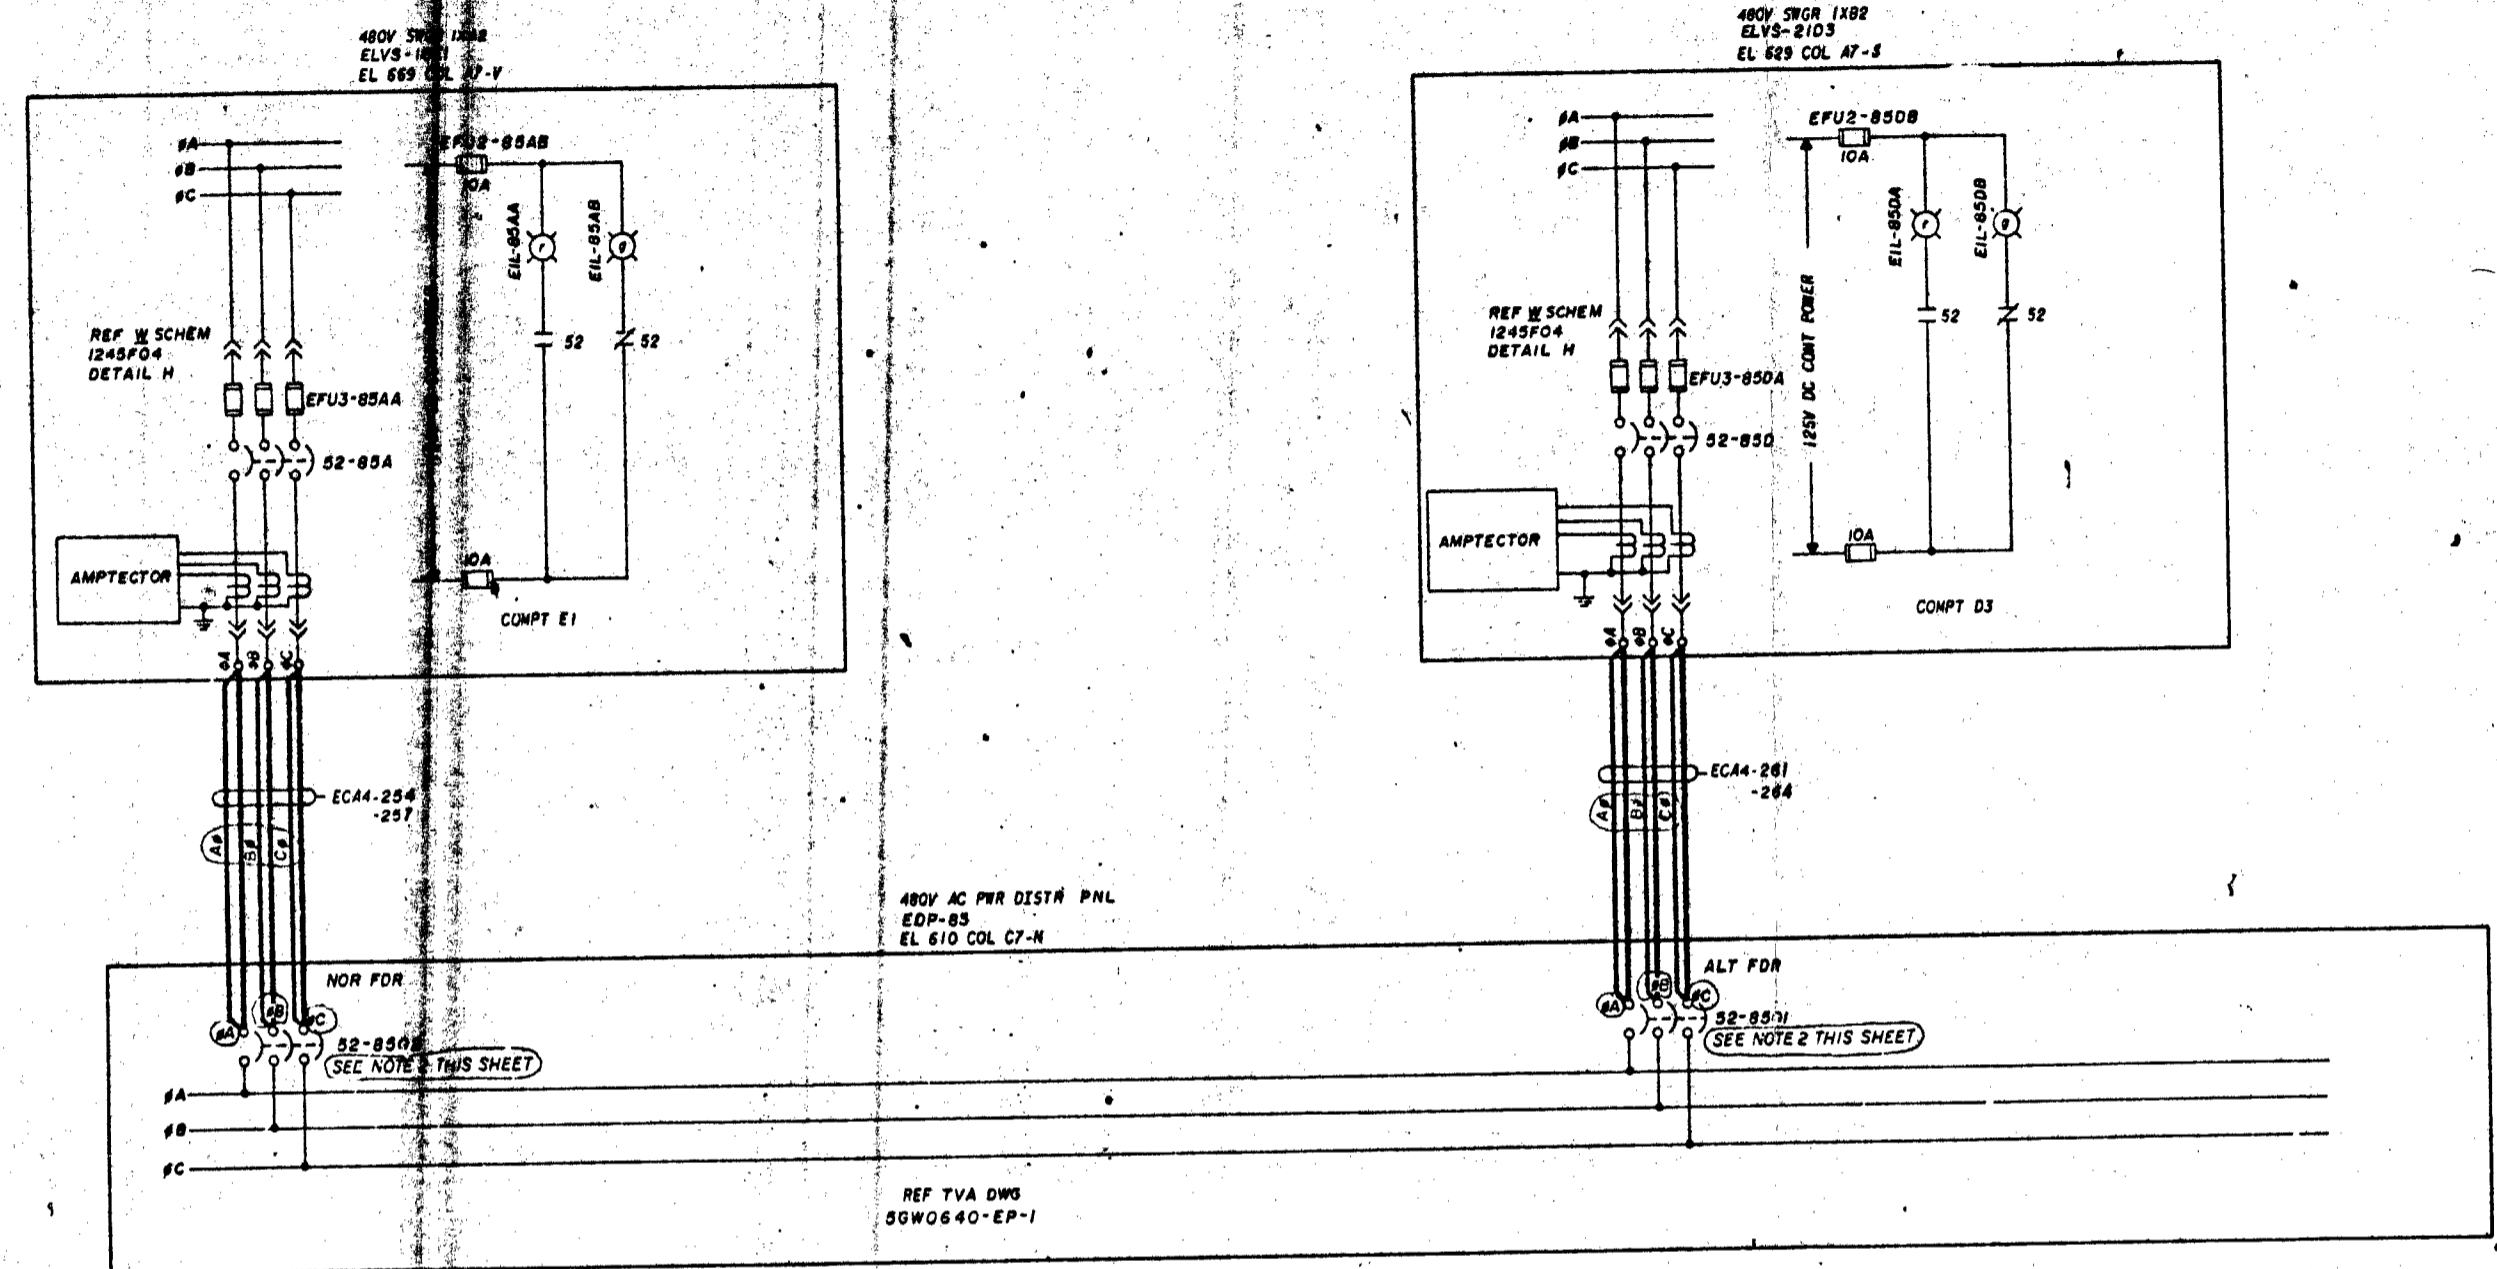

480V AC POWER DISTRIBUTION PANEL

PRC  
 APERTURE  
 CARD

Drawn # 58-435  
 Control # 8704050596  
 Date 7-25-87  
 of Documents  
 REGULATORY DOCKET FILE

REV	DATE	BY	DESCRIPTION
1	9-31-79	...	...
MINOR CHANGES:			
GENERAL REVISION PER ECN 51.			
ECN NO.	DATE	BY	DESCRIPTION
51	9-3-78	...	...
GENERAL			
UNIT I			
SYSTEM SCHEMATIC			
480 V NORMAL AC AUXILIARY			
POWER DISTRIBUTION SYSTEM			
BELLEFONTE NUCLEAR PLANT			
TENNESSEE VALLEY AUTHORITY			
DIVISION OF ENGINEERING DESIGN			
SUBMITTED	RECOMMENDED	APPROVED	
INSPECTED AND APPROVED FOR ISSUE	...		...
DESIGN PROJECT MANAGER	...		...

REV	DATE	BY	DESCRIPTION
1	...	...	...