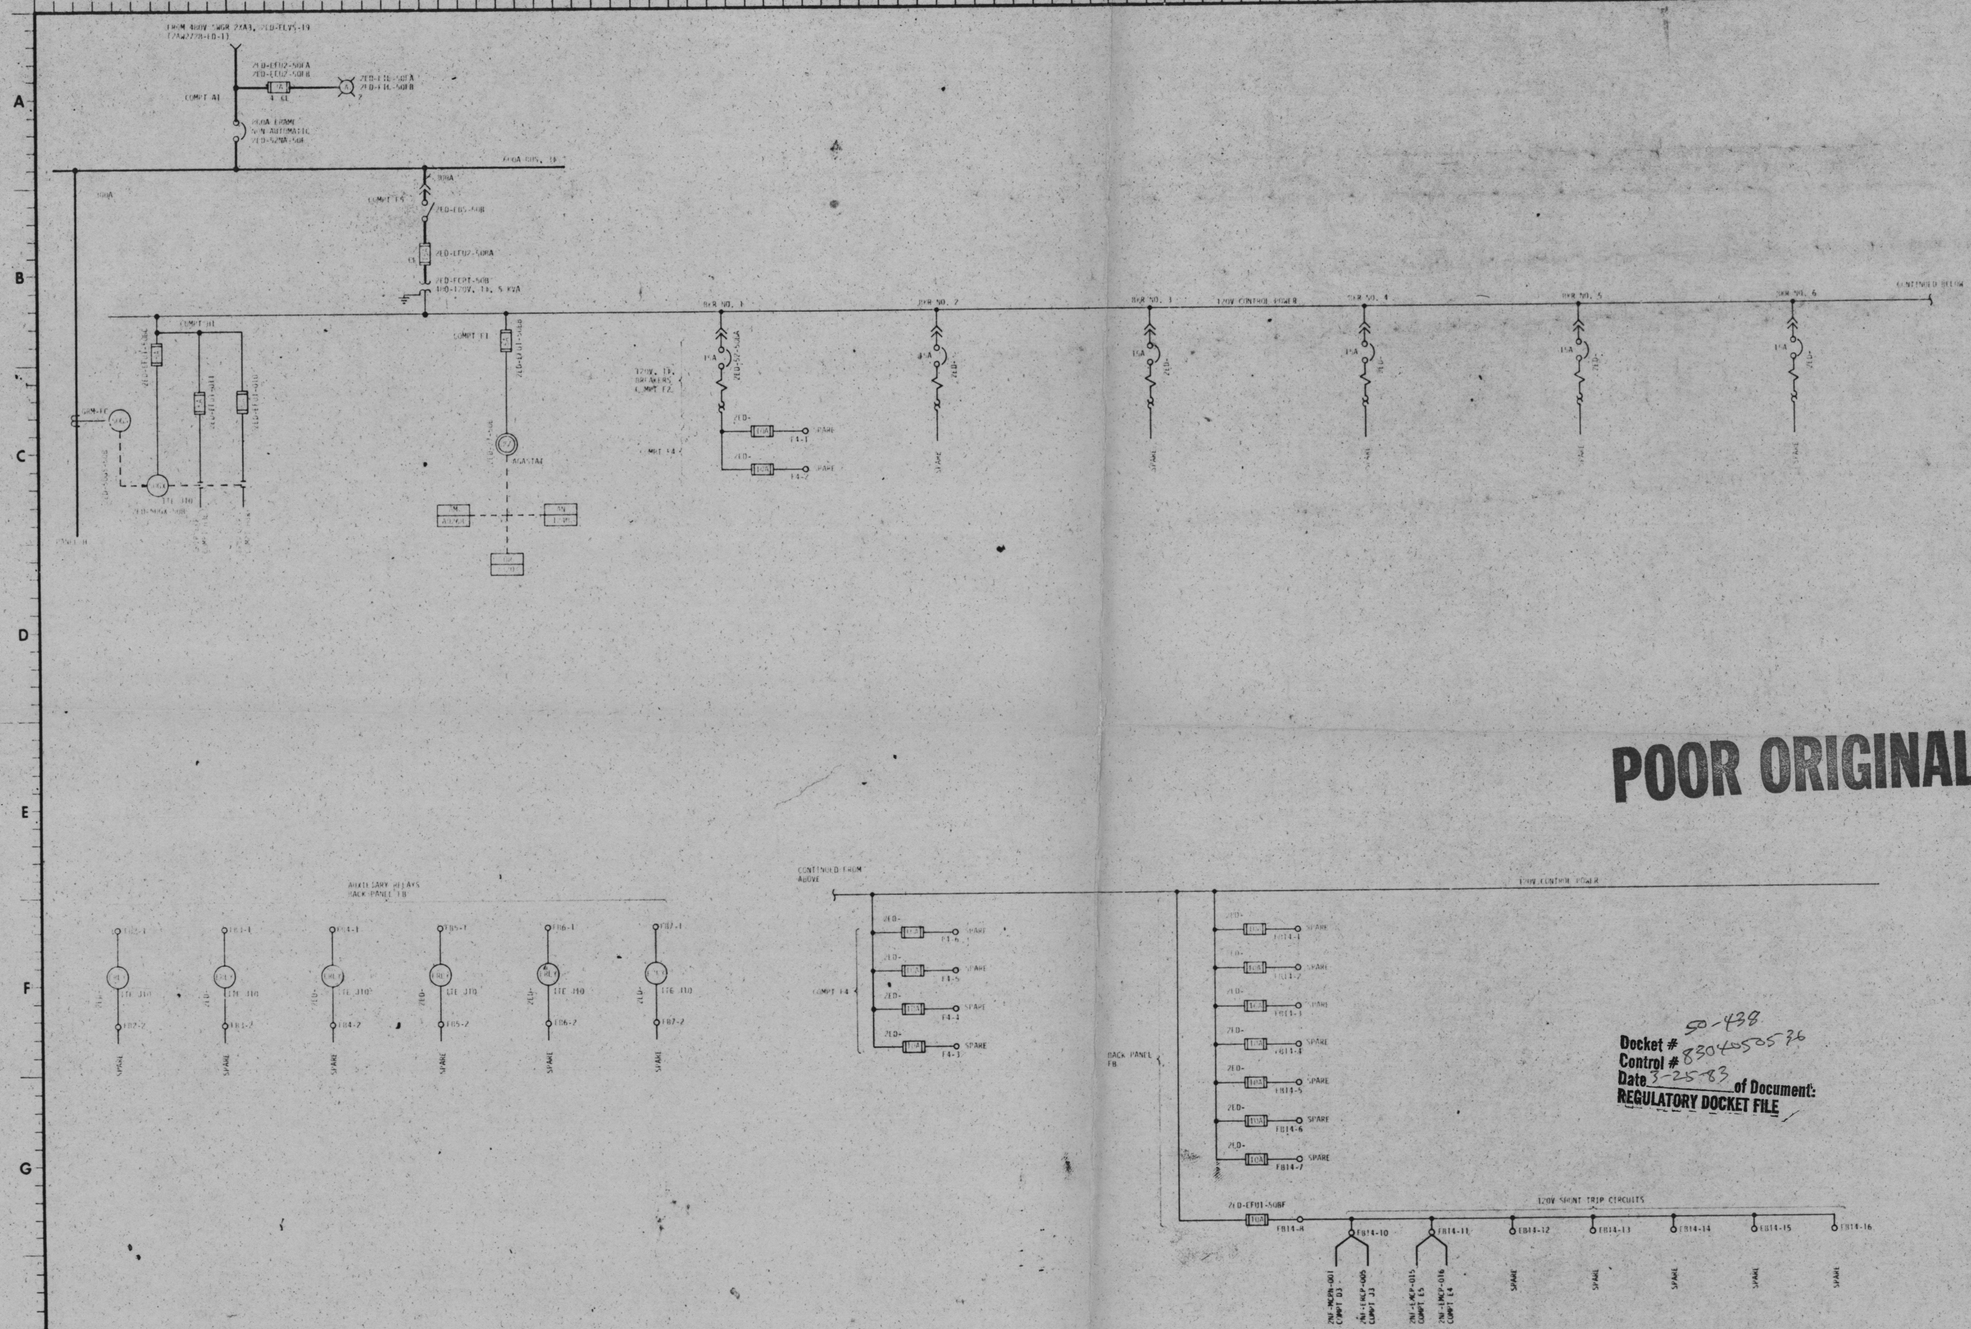

POOR ORIGINAL

Docket # 50-438
Control # 8304050576
Date 3-25-83 of Document:
REGULATORY DOCKET FILE

PRC APERTURE CARD

REV NO	ECN NO	DATE	DSGN	DRWN	CHKD	SUPV	ENGR	INSP	SLSM	RECM	APPD

DSGN
DRWN
CHKD
SUPV
INSP
ENGINEER

SCALE: NTS EXCEPT AS NOTED

AUXILIARY BUILDING
UNIT 2

SINGLE LINE
480V MCC 2A5
2ED-EMCC-50

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

N

SUBMITTED	RECOMMENDED	APPROVED

INSPECTED AND APPROVED FOR ISSUE

KNOXVILLE 8-5-82

88 E SAW2736-ED-03 R0

RECORD DRAWING AS CONSTRUCTED