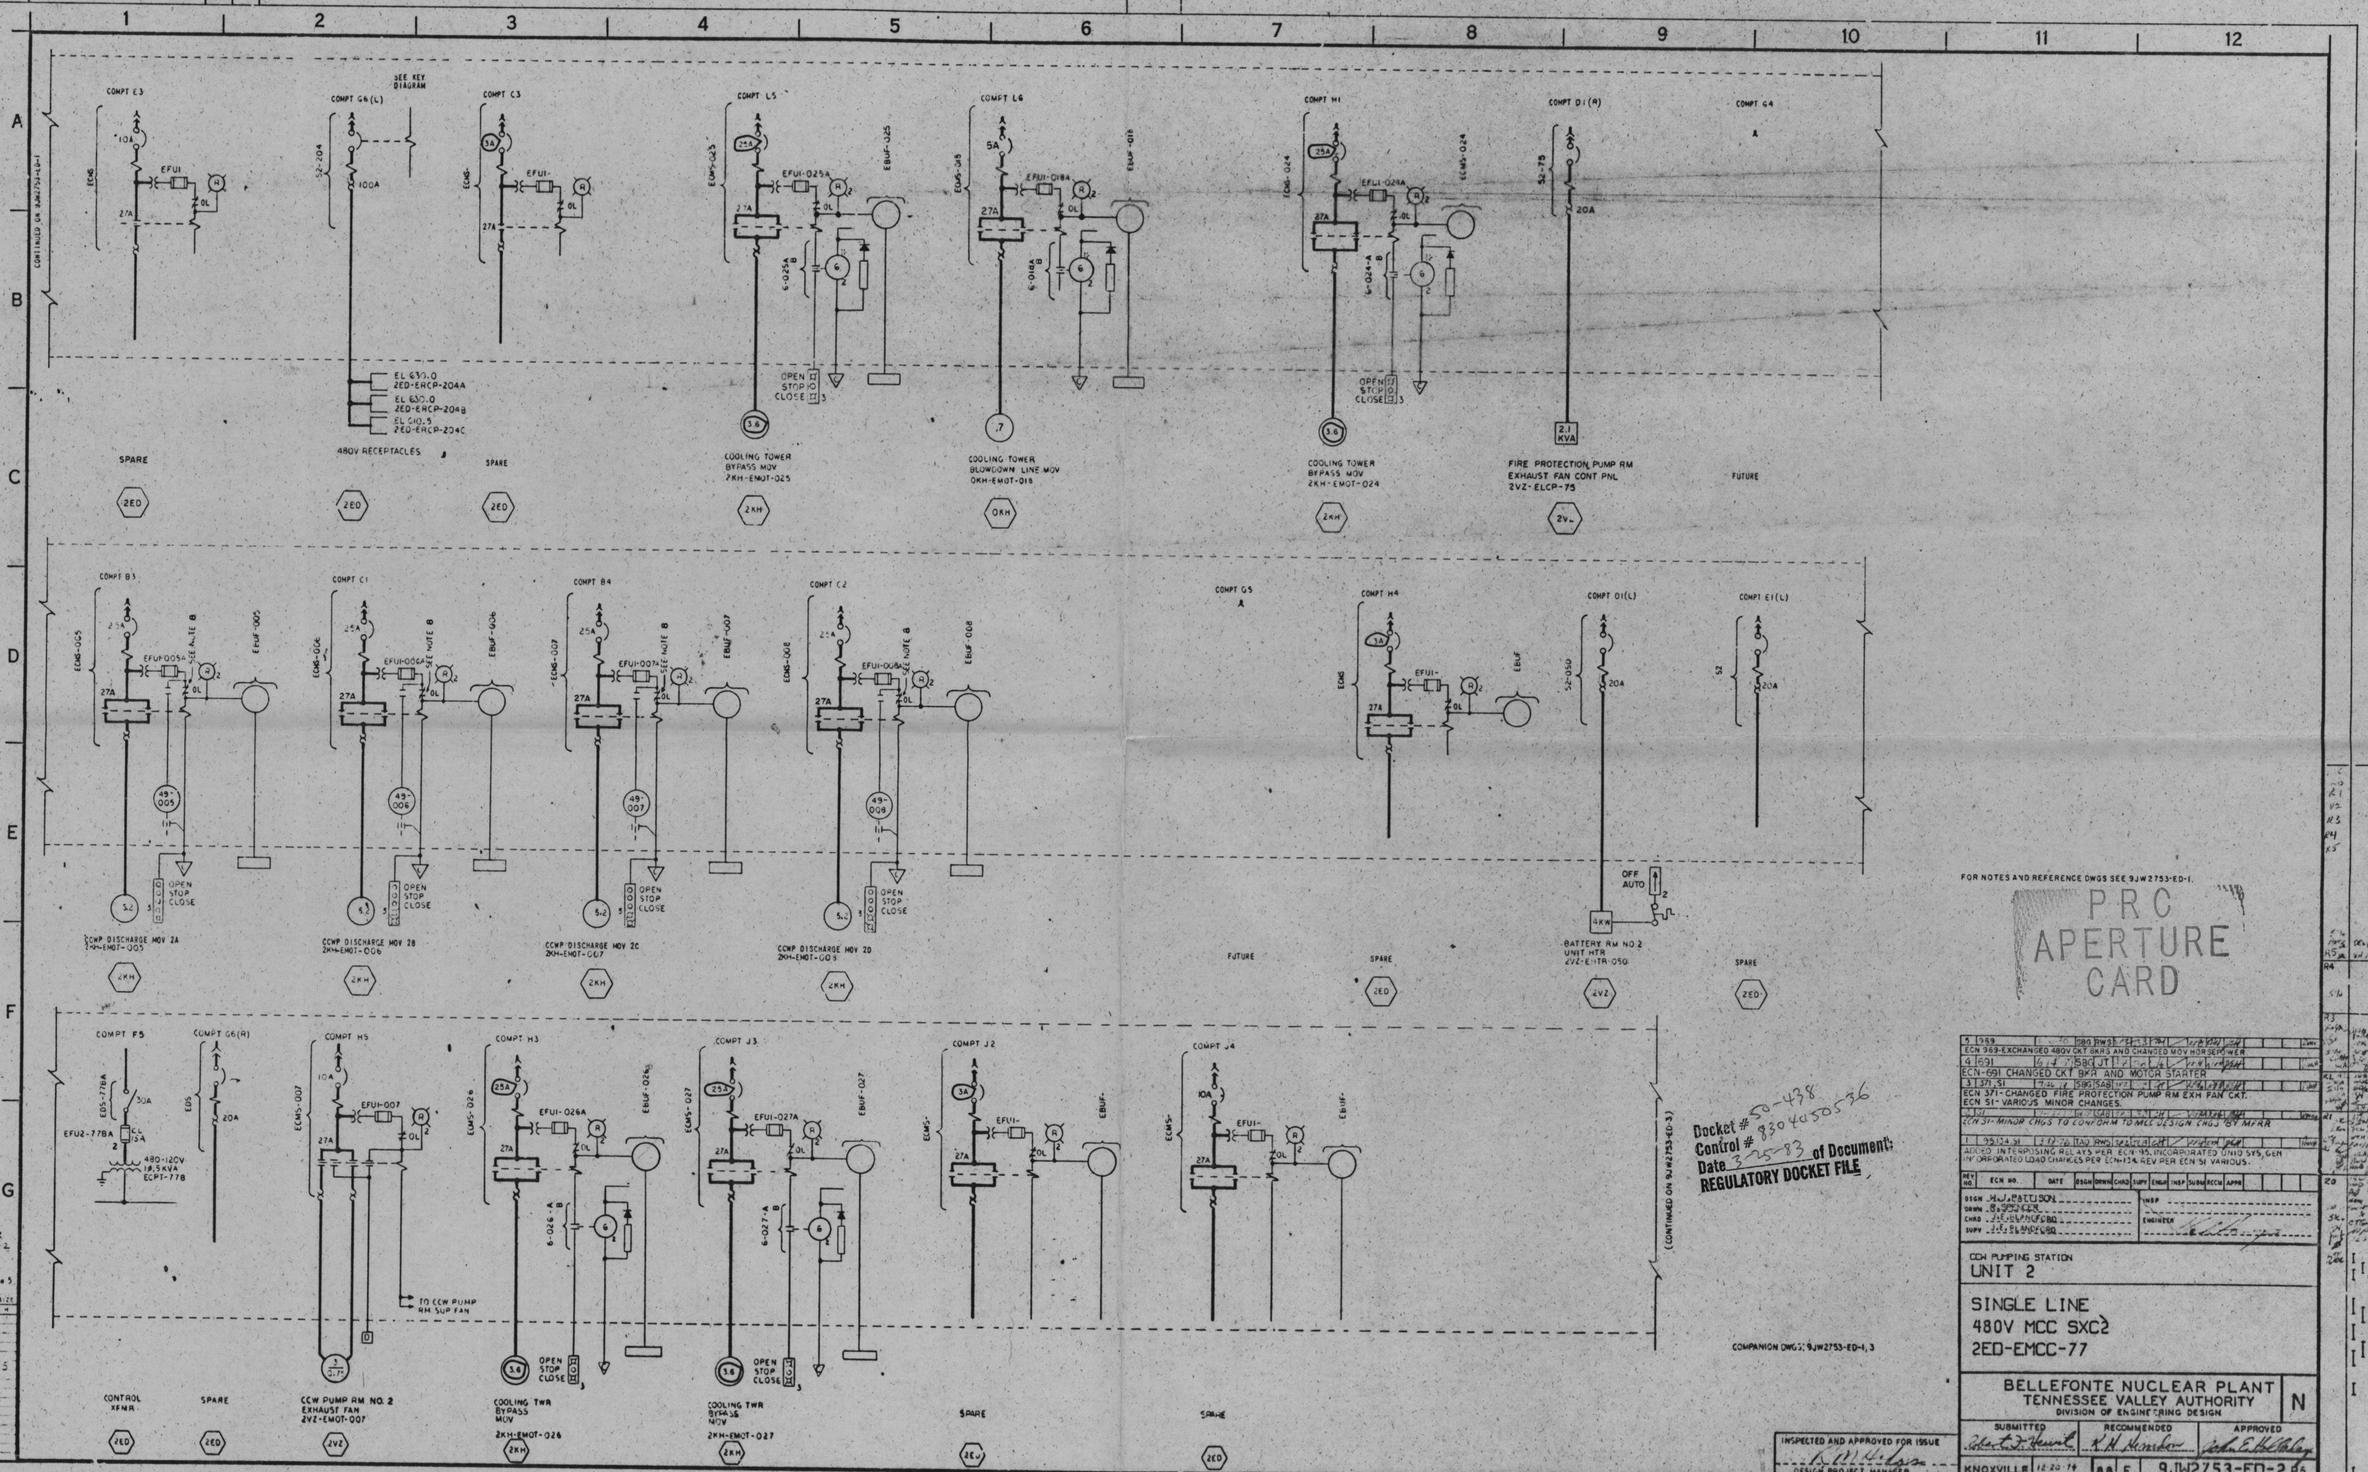

FOR NOTES AND REFERENCE DWGS SEE 9JW2753-ED-1.

PRC APERTURE CARD

Docket # 50-438
Control # 8304050536
Date 3-25-83 of Document:
REGULATORY DOCKET FILE

COMPANION DWGS: 9JW2753-ED-1, 3

REV NO.	ECN NO.	DATE	DSGN	DRWN	CHKD	SUPV	ENGR	INSP	SUBM	RECM	APPR
5	969	[illegible]	SBO	RWS	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]
	ECN 969-EXCHANGED 480V CKT BKRS AND CHANGED MOV HORSEPOWER										
4	691	[illegible]	SBG	JT	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]
	ECN-691 CHANGED CKT BKR AND MOTOR STARTER										
3	371, S1	[illegible]	SBG	SAB	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]
	ECN 371-CHANGED FIRE PROTECTION PUMP RM EXH FAN CKT. ECN S1-VARIOUS MINOR CHANGES.										
2	S1	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]
	ECN S1-MINOR CHGS TO CONFORM TO MCC DESIGN CHGS BY MFRR										
1	95134 S1	[illegible]	TAD	RWS	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]	[illegible]
	ADDED INTERPOSING RELAYS PER ECN-95. INCORPORATED UNID SYS, GEN INCORPORATED LOAD CHANGES PER ECN-134. REV PER ECN S1 VARIOUS.										

DSGN H.J. PATTISON
DRWN R. SPENCER
CHKD J.E. BLANDFORD
SUPV J.E. BLANDFORD
INSP
ENGINEER

CCW PUMPING STATION
UNIT 2

SINGLE LINE
480V MCC SXC2
2ED-EMCC-77

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

N

SUBMITTED	RECOMMENDED	APPROVED
[signature]	K.H. Hamilton	[signature]

KNOXVILLE 12-20-74 | 88 E | 9JW2753-ED-2 R5

INSPECTED AND APPROVED FOR ISSUE
[signature]
DESIGN PROJECT MANAGER

RECORD DRAWING AS CONSTRUCTED

THIS DRAWING IS UNDER CONFIGURATION CONTROL