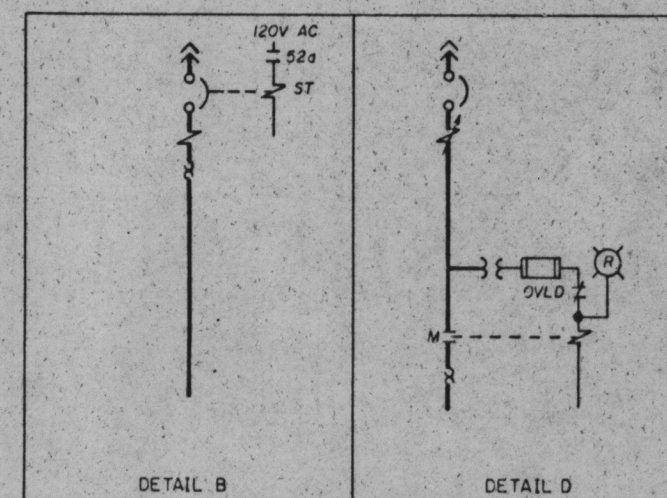


[illegible]

- | REFERENCED DRAWINGS AND DOCUMENTS | |
|---|---------------|
| PLANT AC AUXILIARY POWER SYSTEM SINGLE LINE | 26W0720-AP 01 |
| SINGLE LINE DIAGRAM 480V SWITCHGEAR 1X31 | 27W1727-ED-1 |
| 480V NORMAL AC AUXILIARY POWER DISTRIBUTION
SYSTEM SCHEMATIC | 56W1740-ED-28 |
| 480V MCC COMPARTMENT TYPICALS | 56W1747-AP |
| 48V MCC 191 COMPUTERIZED CIRCUIT SCHEDULE | 51CP1763-ED |

MAGNETIC TRIP ONLY CIRCUIT BREAKER
(ADJUSTABLE)

PRC
APERTURE
CARD

[illegible]

SCALE: NTS	EXCEPT AS NOTED
TURBINE BUILDING	
UNIT 1	

SINGLE LINE
480V MCC 1B1
1ED-EMCC-36


BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

SUBMITTED	RECOMMENDED	APPROVED
C. T. Garner	C. T. Garner	R. M. Hodges

KNOXVILLE	12-6-74	88 E	STW1733-ED-1	R
-----------	---------	------	--------------	---

THIS DRAWING
IS UNDER

Docket # 52-438
Control # 8304052536
Date 3-25-83 of Document:
REGULATORY DOCKET FILE

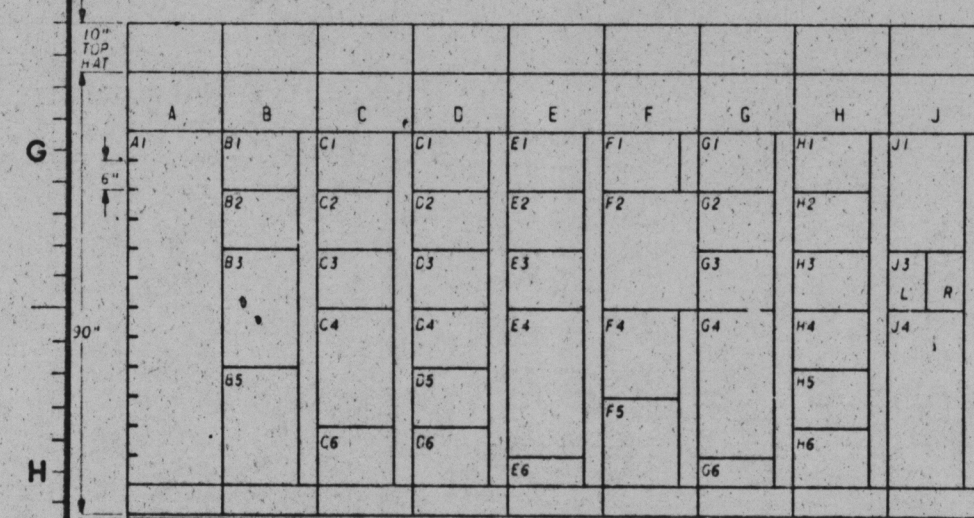

TEL 649 COL T6F

COMPANION DRAWINGS:
5TWI733-ED-03
5TWI733-ED-02 HAS BEEN VOIDED

INSPECTED AND APPROVED FOR ISSUE

[illegible][illegible]