NOTES:
1. FOR GENERAL NOTES, REFERENCE DWGS AND SYMBOLS SEE DWG 5TW1735-ED-01.

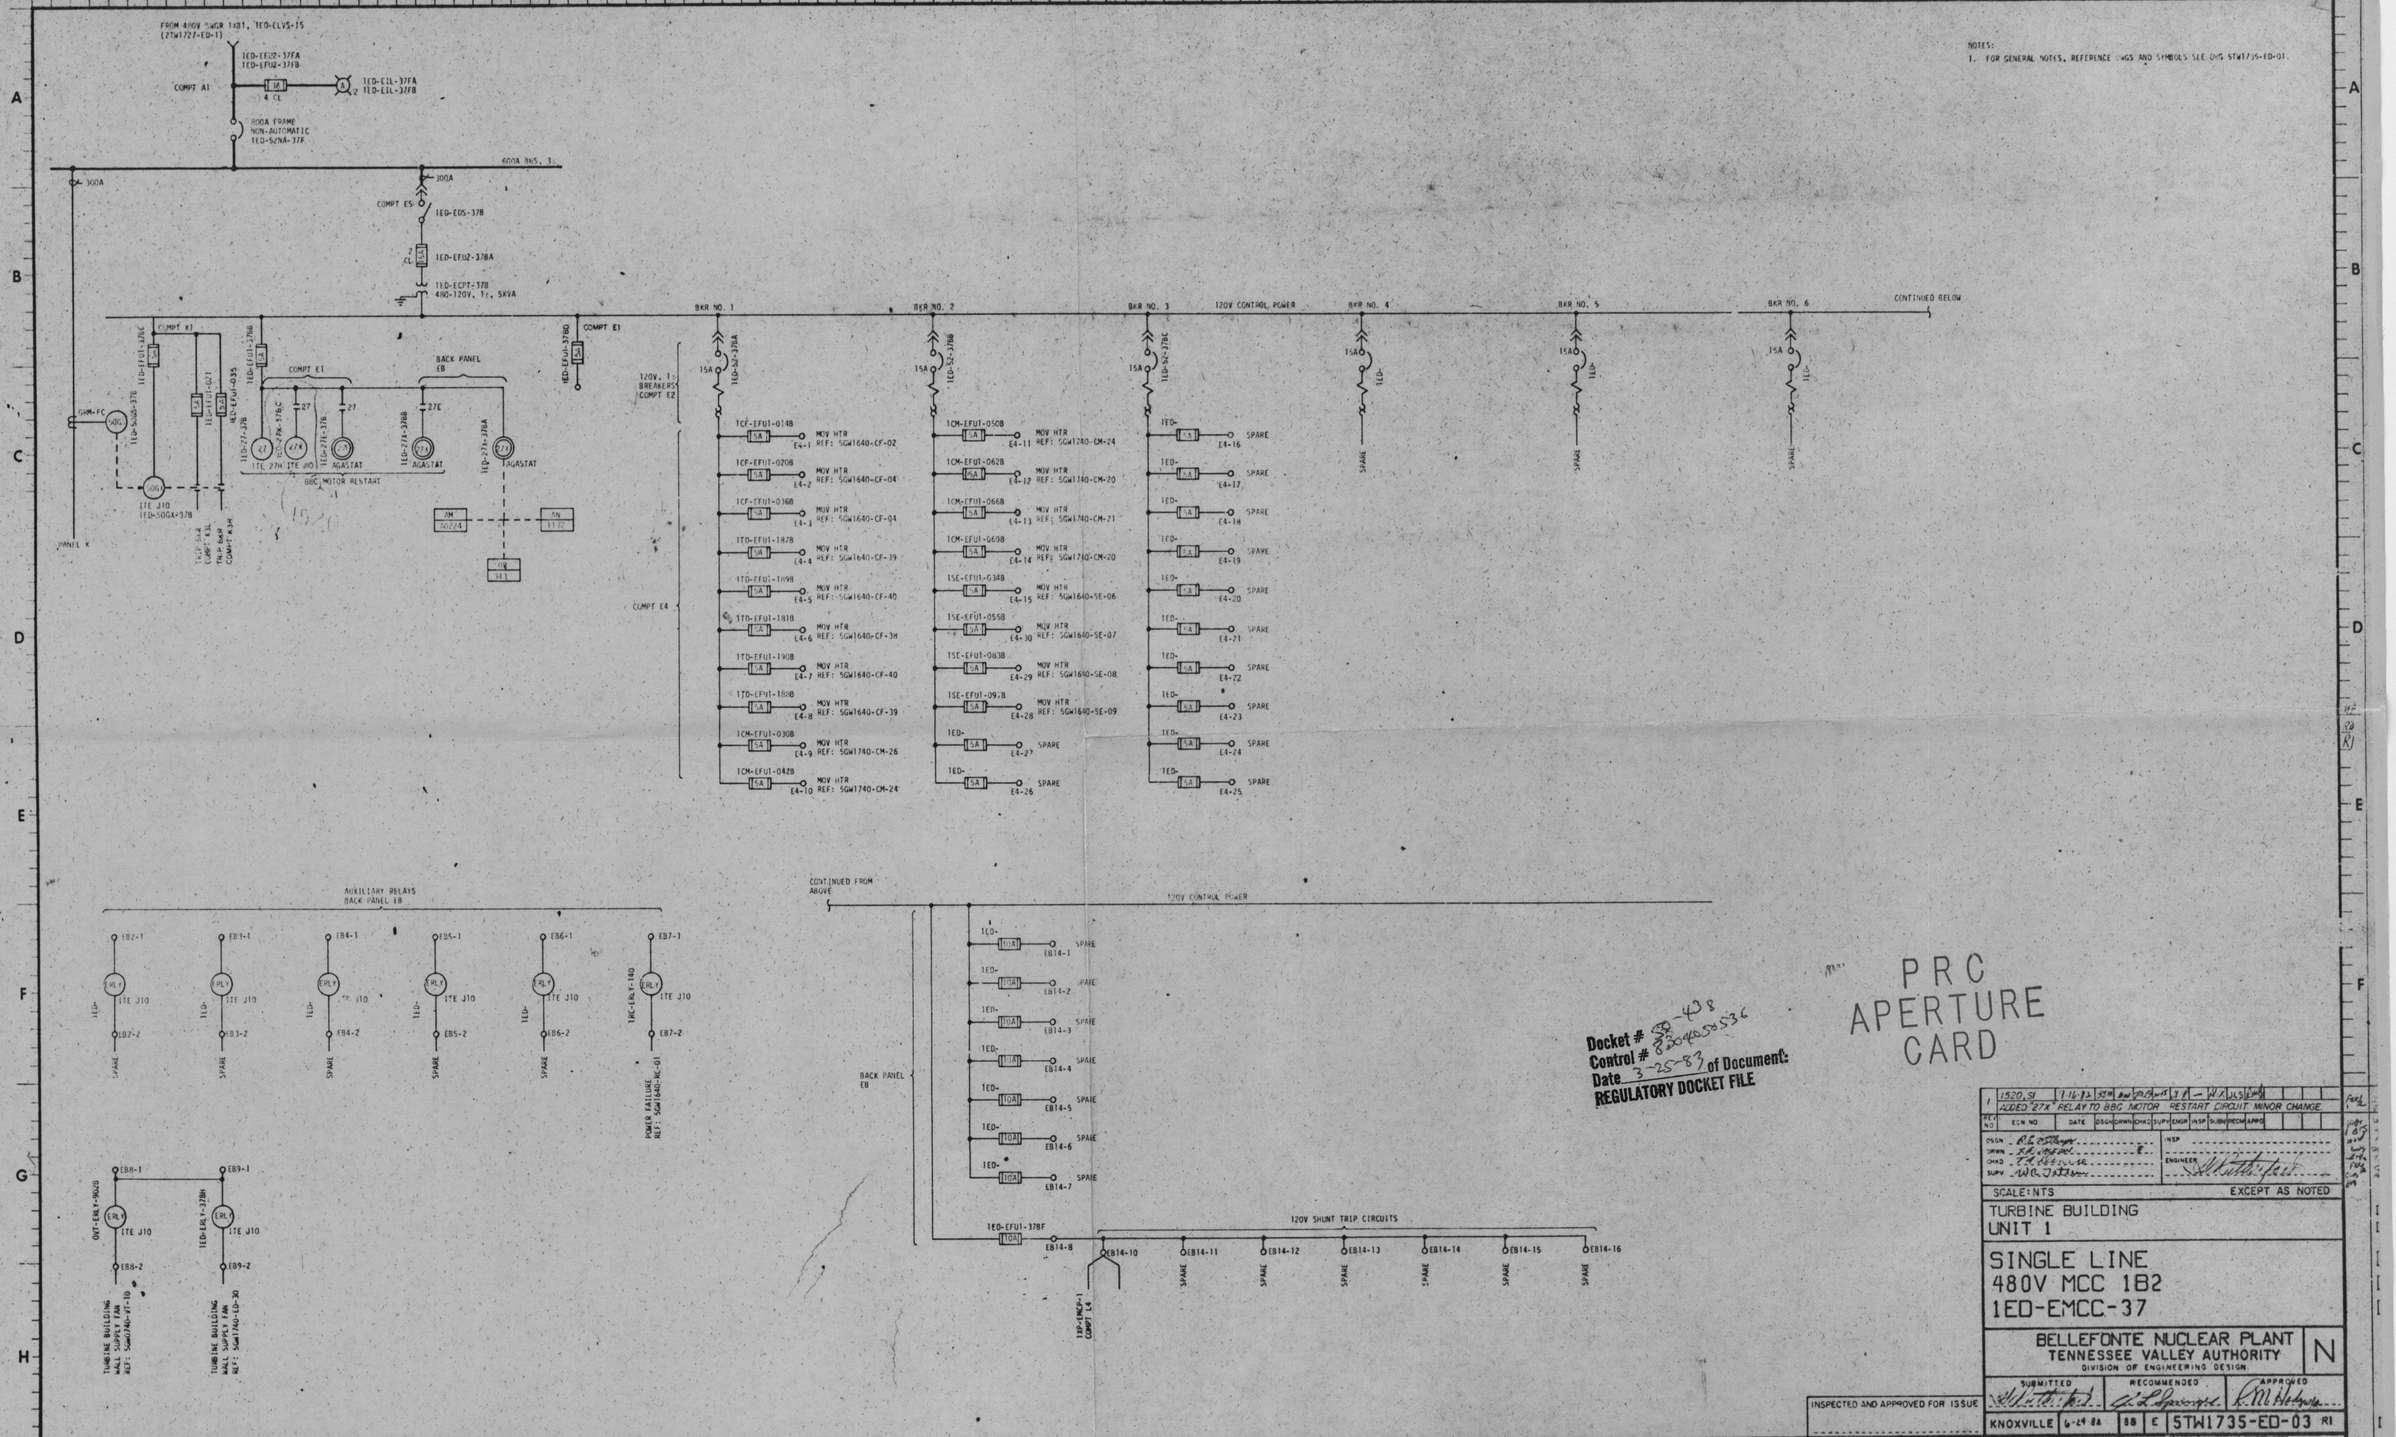

Docket # 50-438
Control # 8304050536
Date 3-25-83 of Document:
REGULATORY DOCKET FILE

PRC APERTURE CARD

REV NO	ECN NO	DATE	DSGN	DRWN	CHKD	SUPV	ENGR	INSP	SUBM	RECM	APPD
1	1520,51	1-16-83	RM								

ADDED "27X" RELAY TO BBC MOTOR RESTART CIRCUIT. MINOR CHANGE.

DSGN R.E. Cothran
DRWN
CHKD T.A. Lawrence
SUPV W.C. Jackson
INSP
ENGINEER

SCALE: NTS — EXCEPT AS NOTED

TURBINE BUILDING
UNIT 1

SINGLE LINE
480V MCC 1B2
1ED-EMCC-37

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

N

SUBMITTED — RECOMMENDED — APPROVED

KNOXVILLE 6-29-82 SB E 5TW1735-ED-03 R1

RECORD DRAWING AS CONSTRUCTED

INSPECTED AND APPROVED FOR ISSUE