NOTES:
1. FOR SYMBOLS AND ADDITIONAL NOTES SEE SHEET 01.
2. 52H CONTACTS ARE SHOWN IN THEIR OPEN POSITION AND THEIR DESIGNATION IS SUFFIXED WITH -IN OR -OUT TO INDICATE THEY ARE CLOSED WHEN THE BREAKER IS RACKED IN OR RACKED OUT RESPECTIVELY.

SYMBOLS:
- LOW VOLTAGE SWITCHGEAR TERMINAL
- MEDIUM VOLTAGE SWITCHGEAR TERMINAL

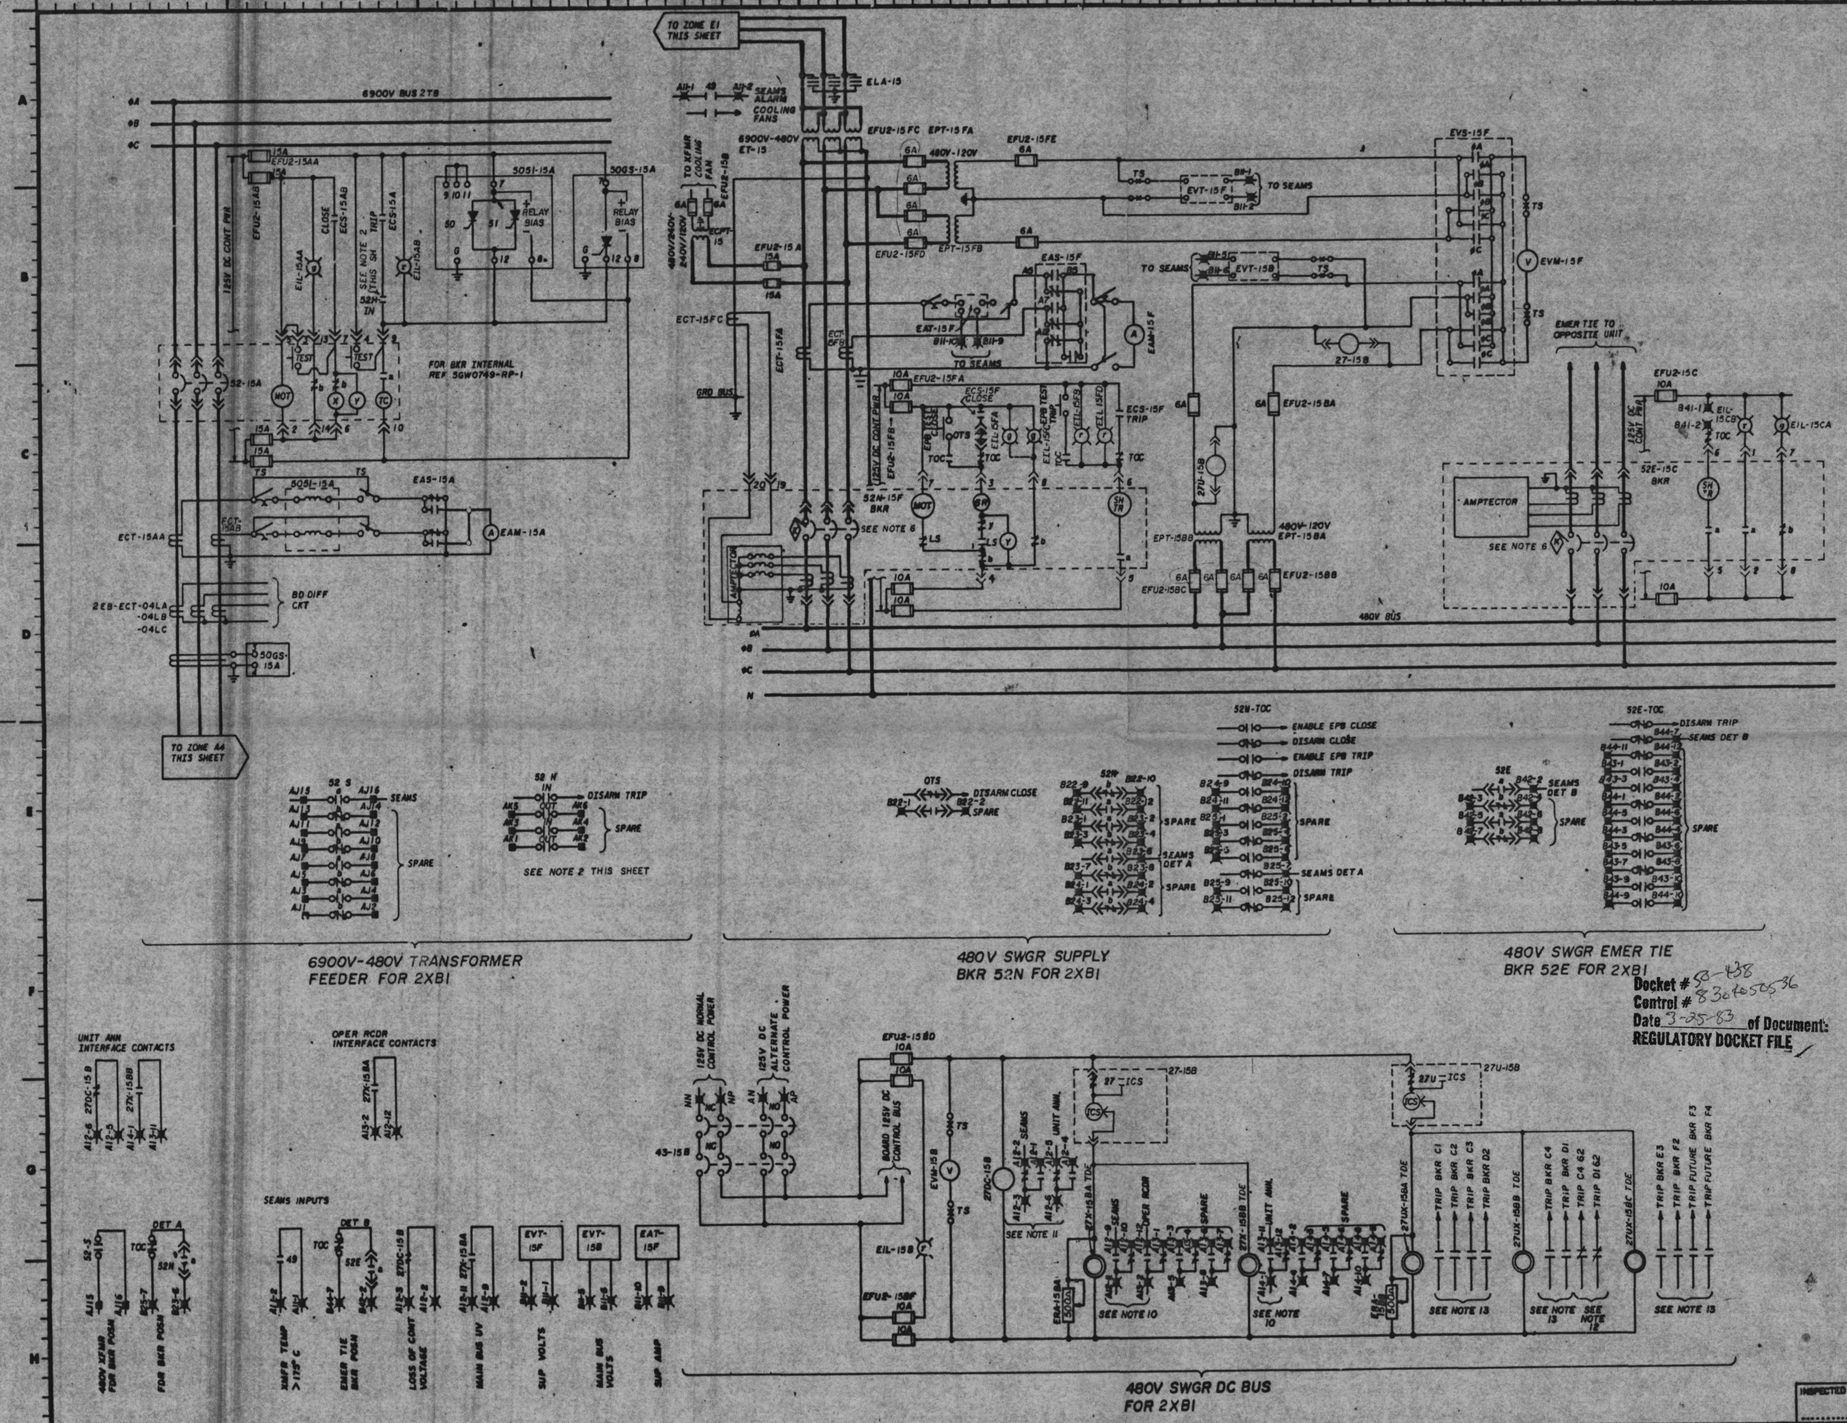

Docket # 50-438
Control # 8304050036
Date 3-25-83 of Document:
REGULATORY DOCKET FILE

PRC APERTURE CARD

2	11133	12-8-81	REPLACED 5 AMP FUSES WITH 6 AMP FUSES		
1	91	9-31-79	MINOR CHANGES.		

SCALE: EXCEPT AS NOTED

GENERAL
UNIT 2

SYSTEM SCHEMATIC
480V NORMAL AC AUXILIARY
POWER DISTRIBUTION SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

N

SUBMITTED / RECOMMENDED / APPROVED

KNOXVILLE 12-20-79 88 E 6GW2740-ED-14 R2

INSPECTED AND APPROVED FOR ISSUE