


REGULATORY DOCKET FILE
 Date of Document
 Control # 83-04052536
 Docket # 83-04052536
 50-143

LOOP UNID	ECI CAB UNID NO	COMPT PT NO	LOCATION OF TRANSMITTER LOCAL PNL UNID NO	RC SYS FLUID TEMP COMP	LEVEL MODIFIER/ISOLATION VALVE IFSV	ISOLATION VALVE IFSV	ERF PT NO.	CID	SSCS SLOT	CABINET
001B-B	IX-IS-		IX-ILPR-058-B	ITE-917B-E	001B-B	HI 971A-B LO 971B-B		NC-42	10	IX-IS-018-B
951-A	IX-IR-		IX-ILPR-061-A	ITE-902B-D	951A-A	HI 961A-A LO 961B-A		NC-37	11	IX-IR-018-A*
952-B	IX-IS-		IX-ILPR-063-B	ITE-917B-E	952A-B	HI 962A-B LO 962B-B		NC-43	11	IX-IS-018-B
953-A	IX-IR-		IX-ILPR-060-A	ITE-902B-D	953A-A	HI 963A-A LO 963B-A		NC-38	12	IX-IR-018-A
954-B	IX-IS-		IX-ILPR-062-B	ITE-917B-E	954A-B	HI 964A-B LO 964B-B		NC-44	12	IX-IS-018-B

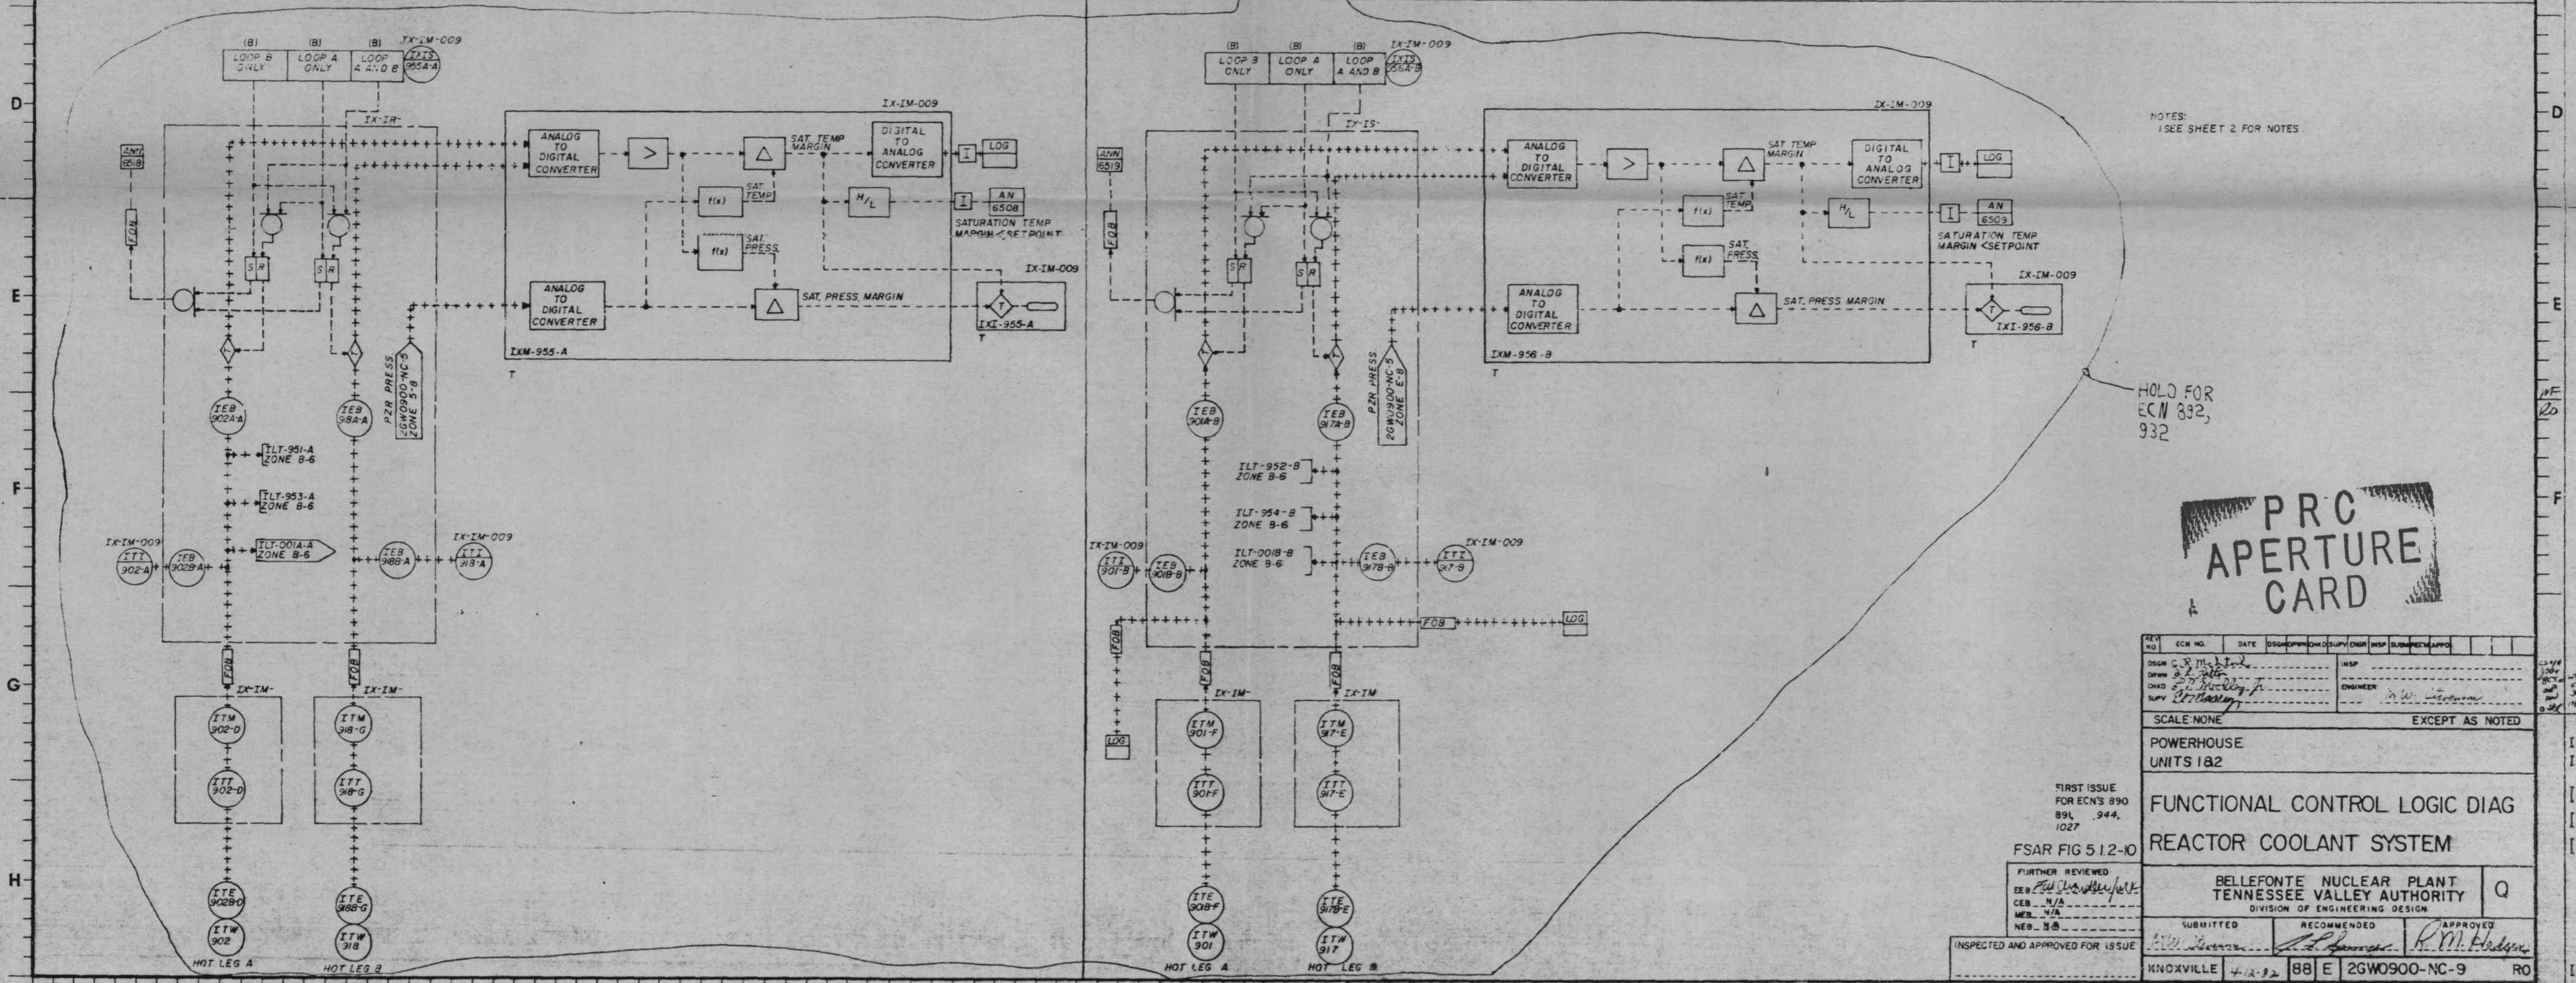

NOTES:
1. SEE SHEET 2 FOR NOTES.

HOLD FOR
ECN 892,
932

PRC APERTURE CARD

REV NO.	ECN NO.	DATE	DESIGNER	CHECKED	DATE	INSPECTOR	DATE	APPROVED	DATE
SCALE NONE								EXCEPT AS NOTED	
POWERHOUSE UNITS 1&2									
FUNCTIONAL CONTROL LOGIC DIAG									
REACTOR COOLANT SYSTEM									
Bellefonte Nuclear Plant Tennessee Valley Authority DIVISION OF ENGINEERING DESIGN									
SUBMITTED			RECOMMENDED			APPROVED			
KNOXVILLE			KNOXVILLE			KNOXVILLE			
88 E			2GW0900-NC-9			RO			