


NOTES:
1. FOR GENERAL NOTES AND REFERENCES REFER TO SGW0640-NO-01
2. FIELD TO PROVIDE AND INSTALL TERMINAL DESIGNATIONS A, B & C TO MAGNETIC CONTACTOR M

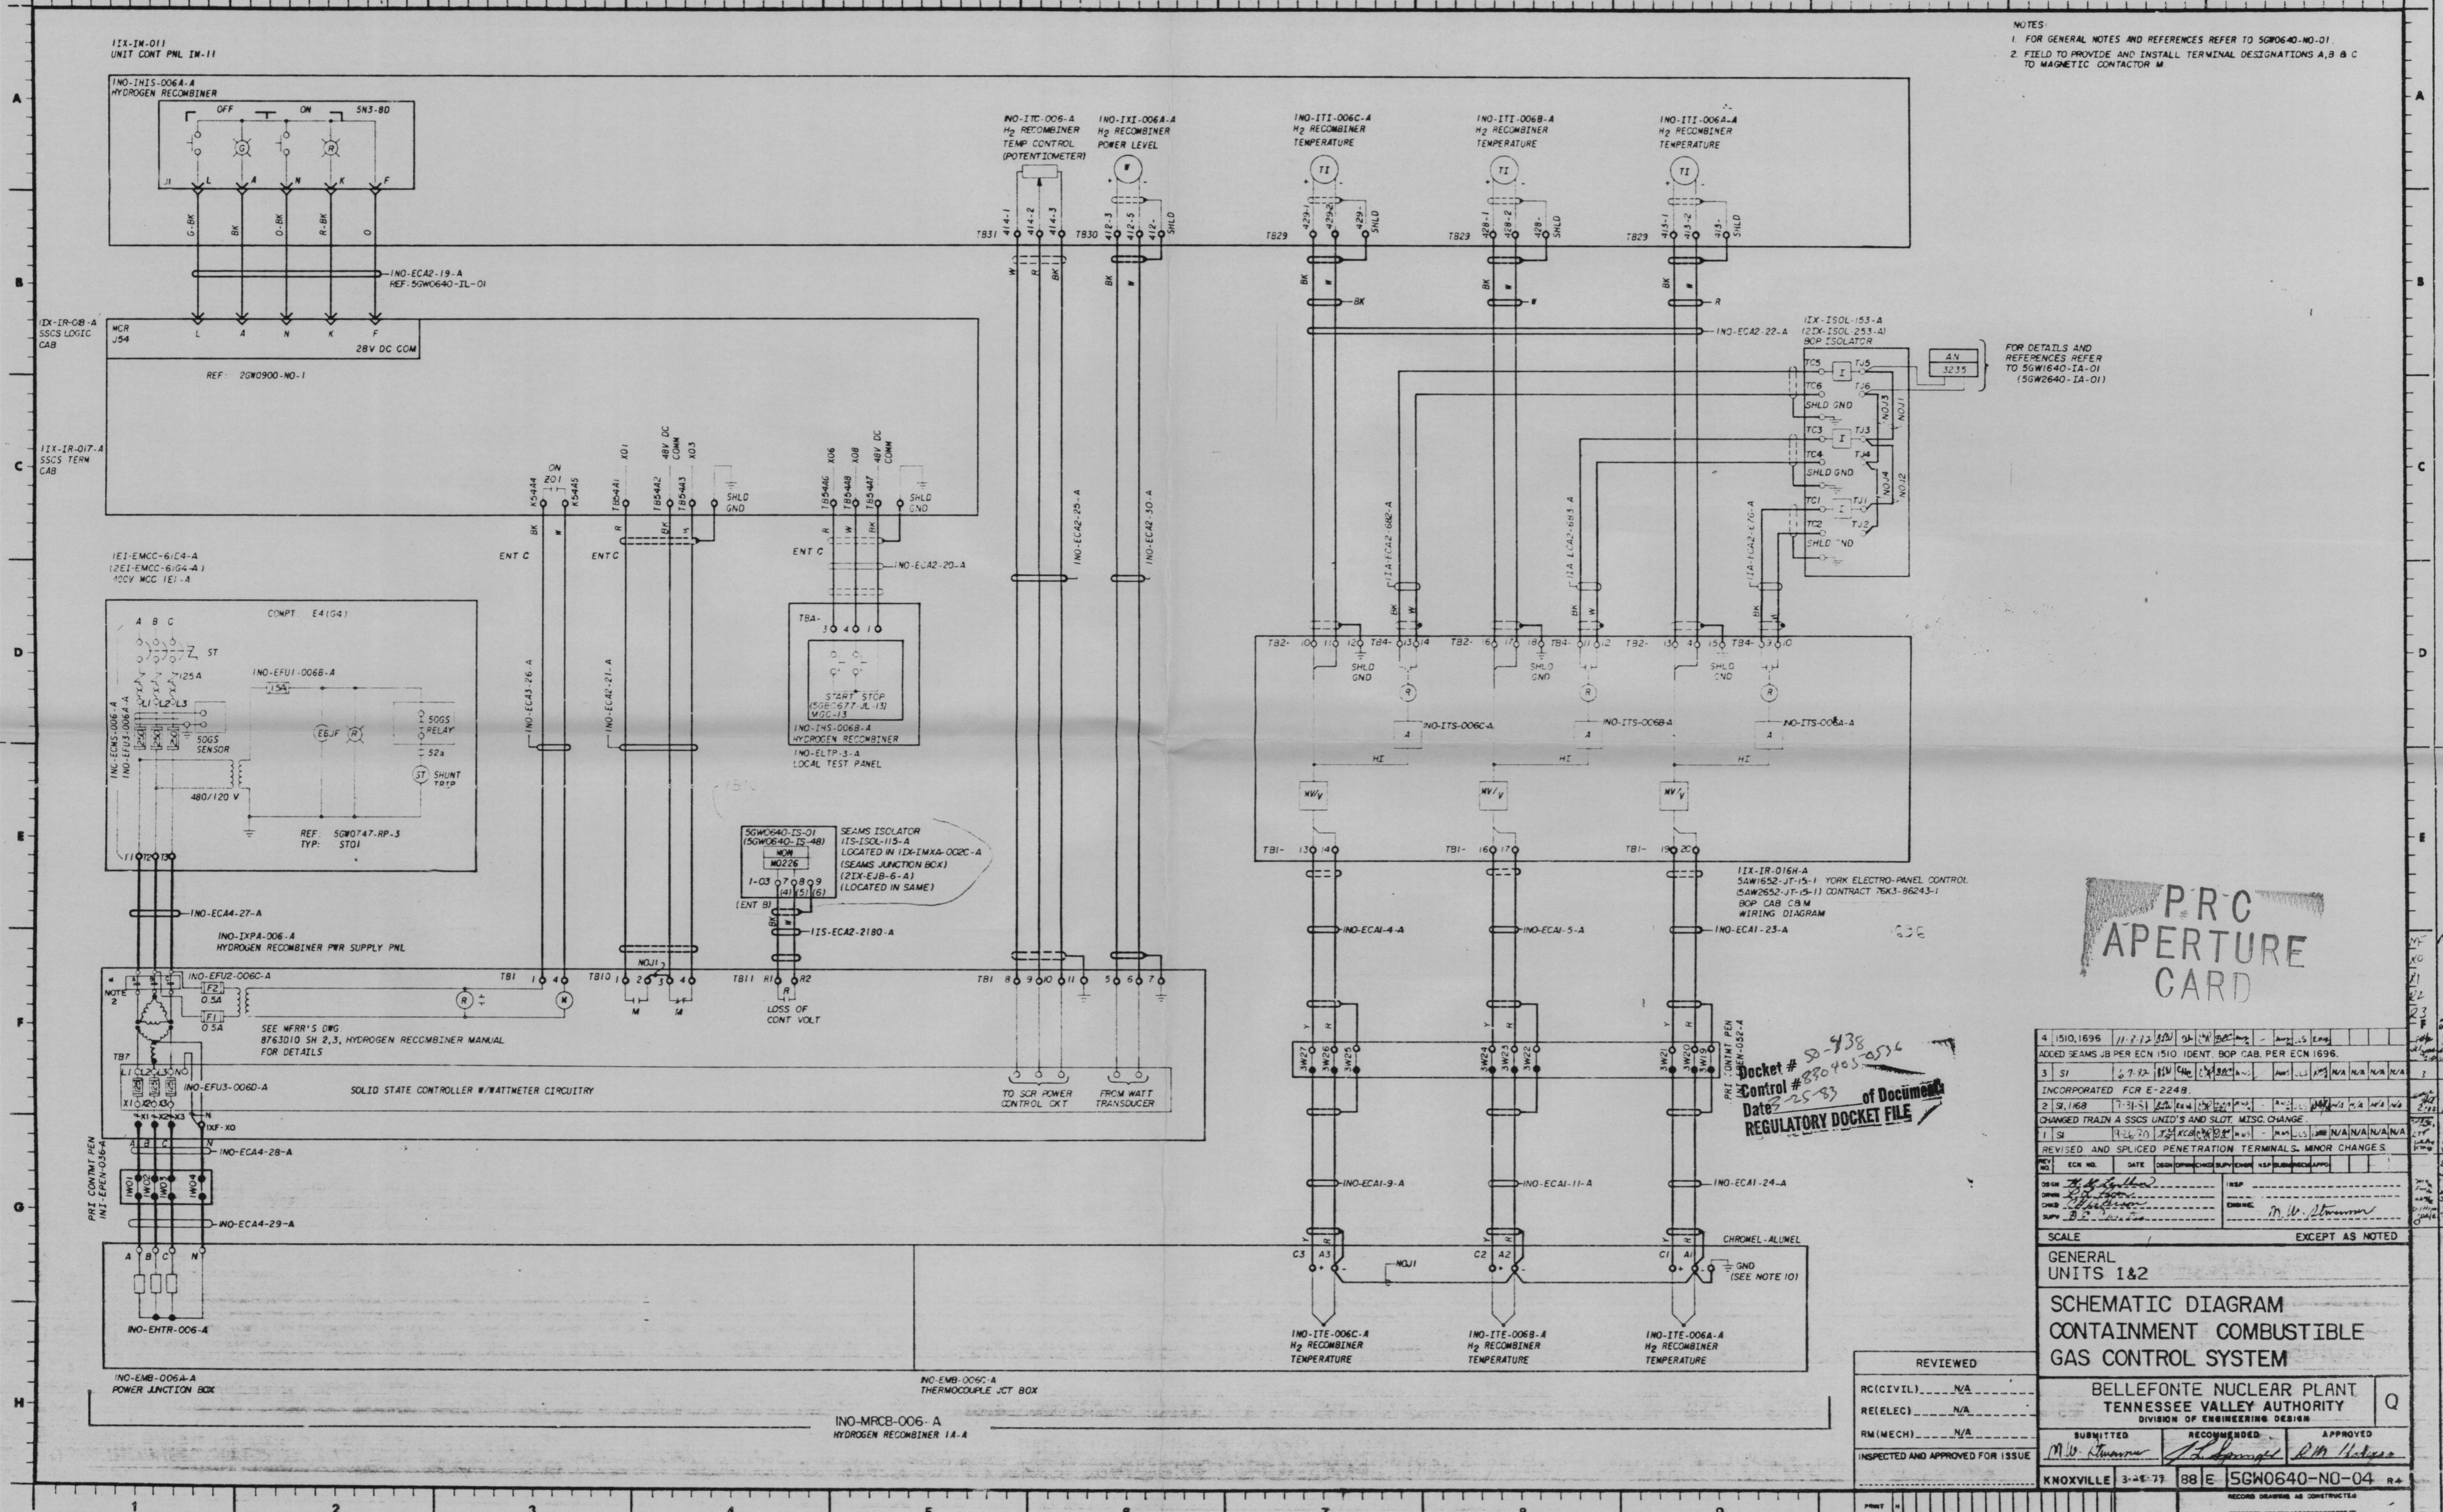

FOR DETAILS AND REFERENCES REFER TO SGW1640-IA-01 (SGW2640-IA-01)

PRC APERTURE CARD

Docket # 88-938
Control # 8804050516
Date 2-25-83
REGULATORY DOCKET FILE

REV	NO	DATE	BY	CHKD	APPV	REASON
1	1	11/2/73	SK	SK	SK	ADD SEAMS JB PER ECN 1510 IDENT. BOP CAB. PER ECN 1698.
2	2	7/22/74	SK	SK	SK	INCORPORATED FOR E-2248.
3	3	1/16/78	SK	SK	SK	CHANGED TRAIN A SSSS UNITS AND SLOT. MISC. CHANGE.
4	4	1/26/79	SK	SK	SK	REVISED AND SPLICED PENETRATION TERMINALS. MINOR CHANGES.

SCALE: EXCEPT AS NOTED

GENERAL UNITS 1&2

SCHMATIC DIAGRAM CONTAINMENT COMBUSTIBLE GAS CONTROL SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

REVIEWED: RC(CIVIL) N/A, RE(ELEC) N/A, RM(MECH) N/A

INSPECTED AND APPROVED FOR ISSUE: M.W. [Signature]

DATE: 3-28-79

88 E SGW0640-NO-04