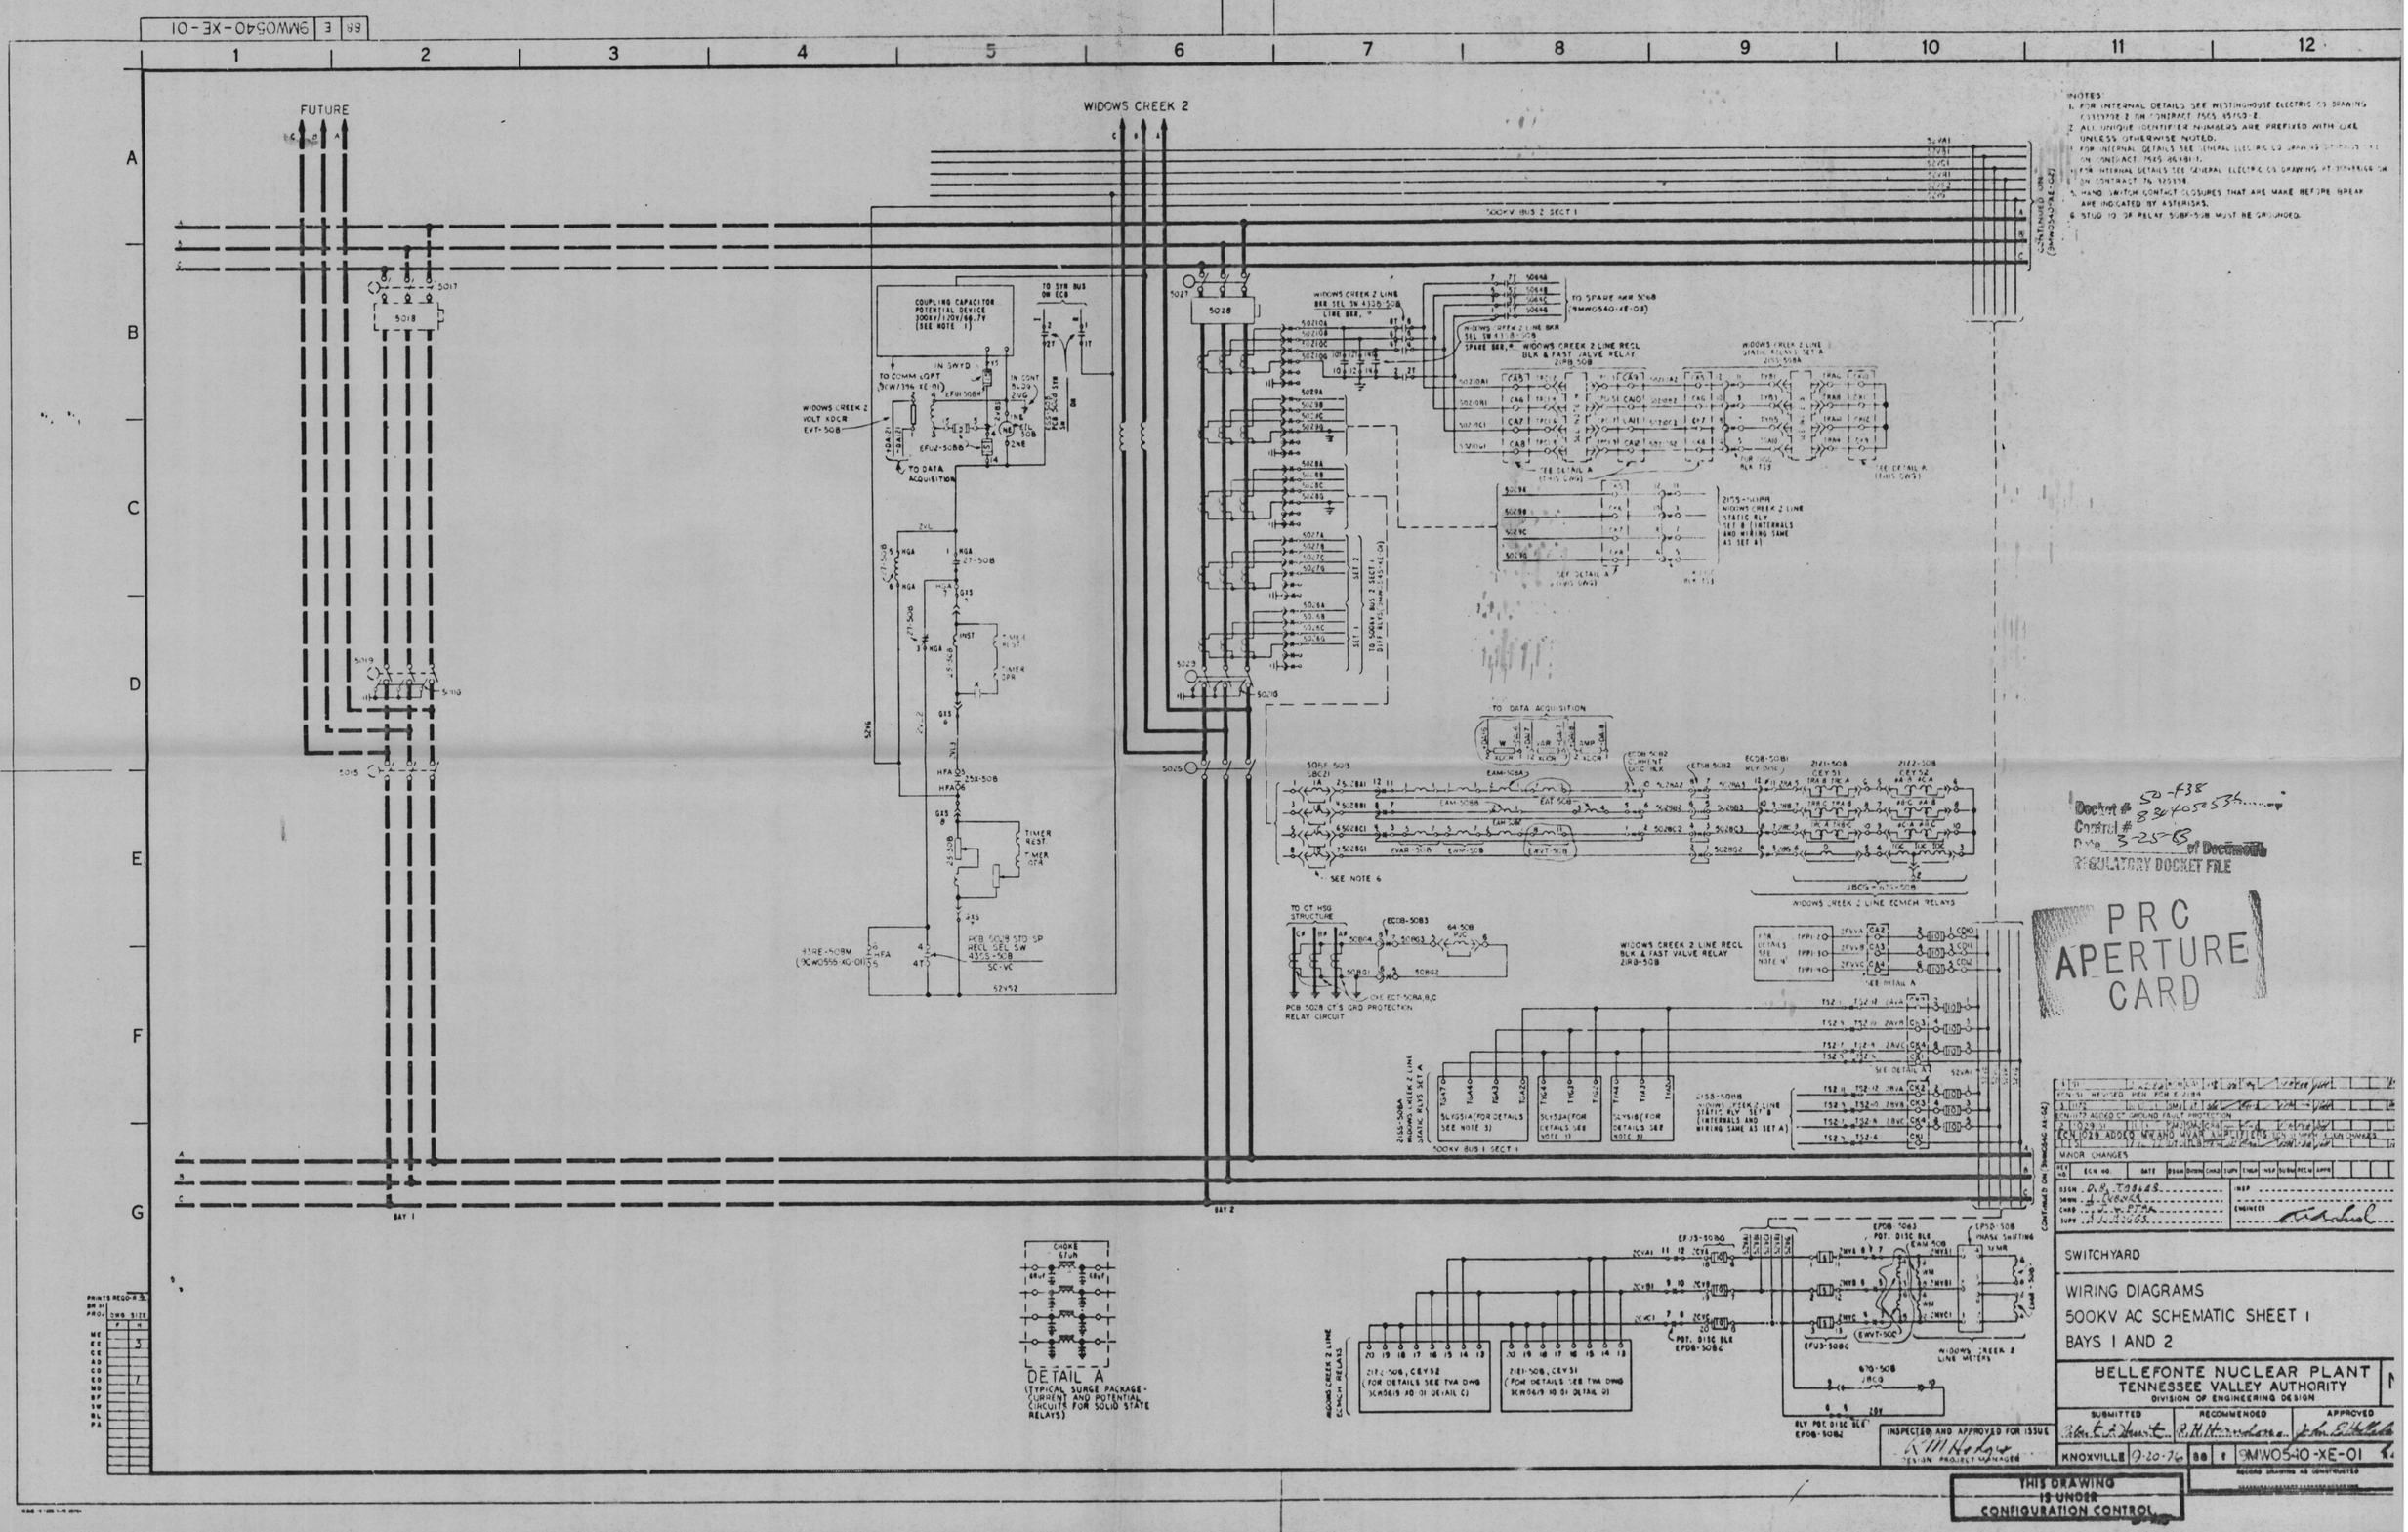

NOTES:
1. FOR INTERNAL DETAILS SEE WESTINGHOUSE ELECTRIC CO DRAWING C033970E-2 ON CONTRACT 75C5 85750-2.
2. ALL UNIQUE IDENTIFIER NUMBERS ARE PREFIXED WITH OXE UNLESS OTHERWISE NOTED.
3. FOR INTERNAL DETAILS SEE GENERAL ELECTRIC CO DRAWING [illegible] ON CONTRACT 75C5 86481-1.
4. FOR INTERNAL DETAILS SEE GENERAL ELECTRIC CO DRAWING [illegible] ON CONTRACT 76-925398.
5. HAND SWITCH CONTACT CLOSURES THAT ARE MAKE BEFORE BREAK ARE INDICATED BY ASTERISKS.
6. STUD 10 OF RELAY 50BF-50B MUST BE GROUNDED.

Docket # 50-438
Control # 8304050536
Date 3-25-83
of Documents
REGULATORY DOCKET FILE

PRC APERTURE CARD

MINOR CHANGES

SWITCHYARD

WIRING DIAGRAMS
500KV AC SCHEMATIC SHEET 1
BAYS 1 AND 2

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

SUBMITTED	RECOMMENDED	APPROVED

KNOXVILLE 9-20-76 88 1 9MW0540-XE-01

INSPECTED AND APPROVED FOR ISSUE
DESIGN PROJECT MANAGER

THIS DRAWING IS UNDER CONFIGURATION CONTROL