


A
B
C
D
E
F
G

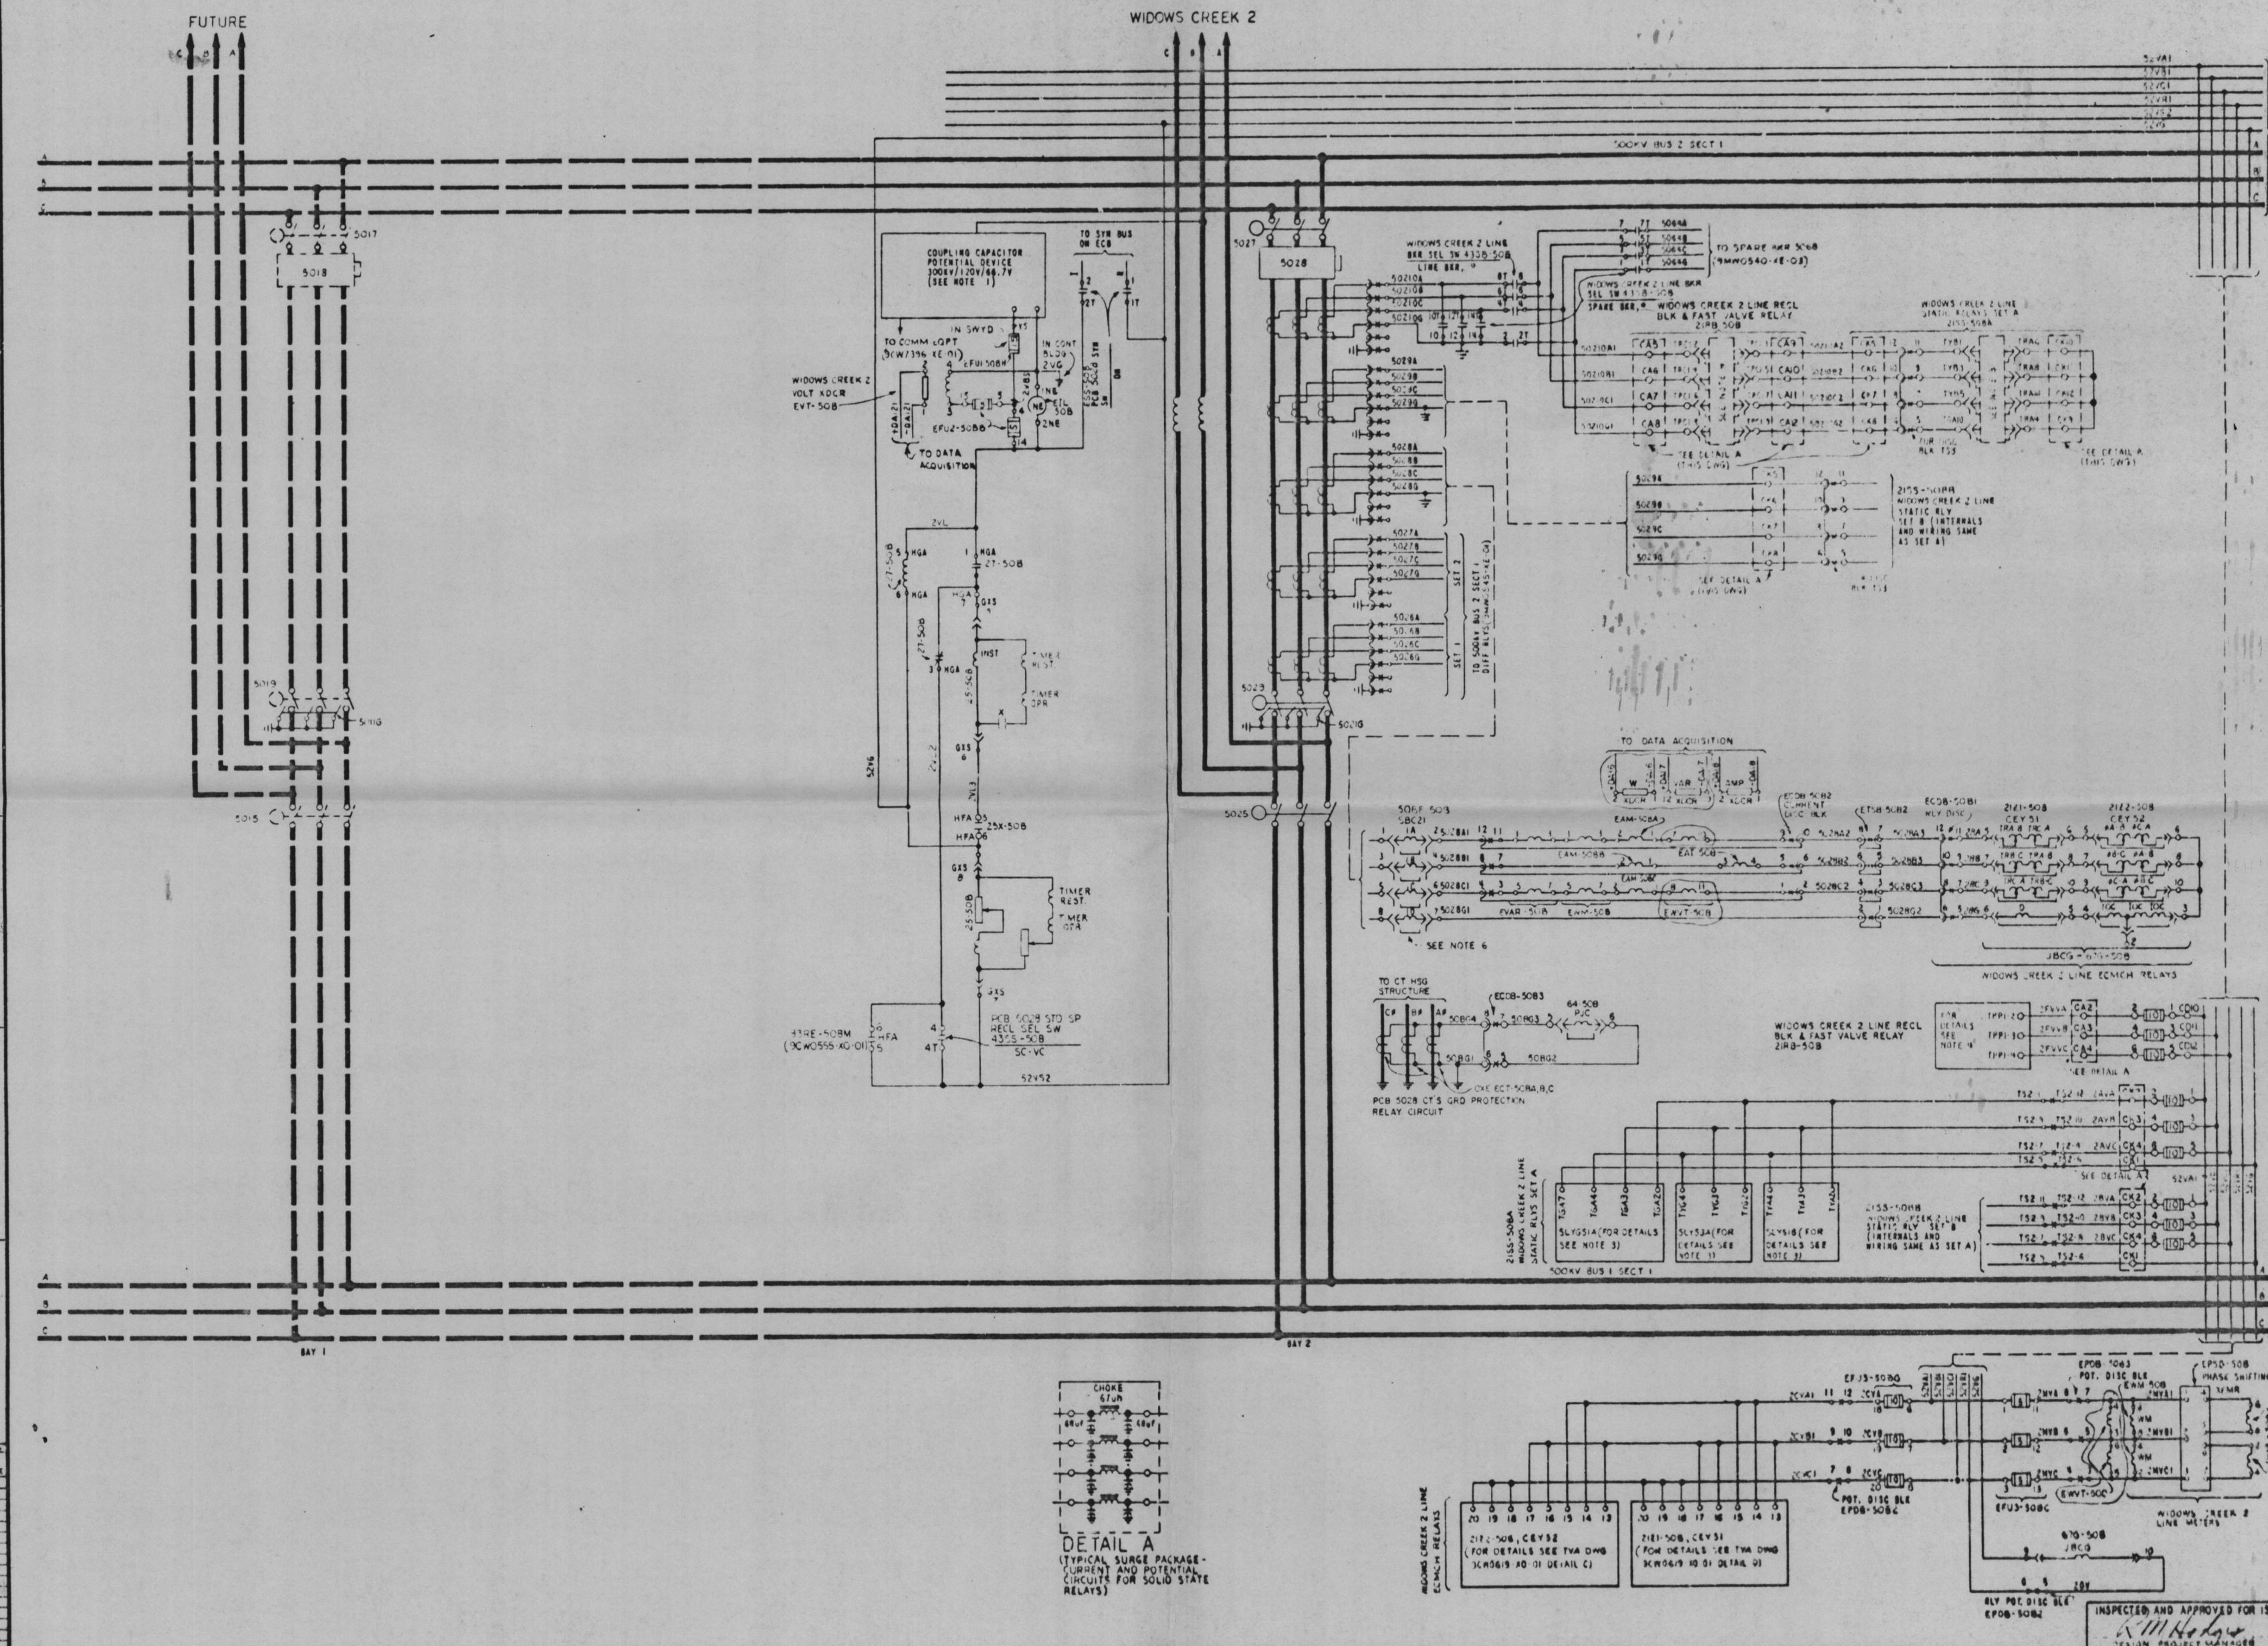

- NOTES:
- FOR INTERNAL DETAILS SEE WESTINGHOUSE ELECTRIC CO DRAWING 65117002 2 ON CONTRACT 7565 05/60 2
 - ALL IDENTIFYING IDENTIFIER NUMBERS ARE PREFIXED WITH LKX UNLESS OTHERWISE NOTED.
 - FOR INTERNAL DETAILS SEE GENERAL ELECTRIC CO DRAWING 65117001 ON CONTRACT 7565 05/60 1
 - FOR INTERNAL DETAILS SEE GENERAL ELECTRIC CO DRAWING 65117001 ON CONTRACT 76 05/60 8
 - HAND SWITCH CONTACT CLOSURES THAT MAKE BEFORE BREAK ARE INDICATED BY ASTERISKS.
 - STUD TO OF RELAY SUBP-508 MUST BE GROUNDING.

Docmt # 50-F38
 Control # 834058536
 Date 3-25-83
 REGULATORY DOCKET FILE


PRC
 APERTURE
 CARD

REV	DATE	BY	CHKD	APPD	DESCRIPTION
1	12/15/82	J. H. ...	J. H. ...	J. H.
2	1/15/83	J. H. ...	J. H. ...	J. H.
3	3/25/83	J. H. ...	J. H. ...	J. H.

SWITCHYARD
 WIRING DIAGRAMS
 500KV AC SCHEMATIC SHEET 1
 BAYS 1 AND 2
 BELLEFONTE NUCLEAR PLANT
 TENNESSEE VALLEY AUTHORITY
 DIVISION OF ENGINEERING DESIGN

SUBMITTED: [Signature]
 RECOMMENDED: [Signature]
 APPROVED: [Signature]

KNOXVILLE 9-20-76 88 9 MW0540-XE-01

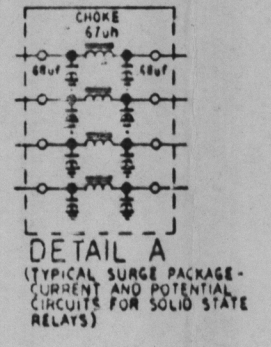

PRINTS REQUIRED

NO.	BY	DATE	REVISION
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			

THIS DRAWING IS UNDER CONFIGURATION CONTROL