


WIDOWS CREEK I

FUTURE

- NOTES:
- FOR INTERNAL DETAILS SEE WESTINGHOUSE ELECTRIC CO DRAWING 0033922-2 ON CONTRACT 7505-45760-2
 - ALL UNIQUE IDENTIFIERS ARE PREFIXED WITH 04E UNLESS OTHERWISE NOTED.
 - FOR INTERNAL DETAILS SEE GENERAL ELECTRIC CO DRAWING 014-8809 54.1 ON CONTRACT 7545-24481
 - FOR INTERNAL DETAILS SEE GENERAL ELECTRIC CO DRAWING 01-31248162 54.1 ON CONTRACT 76-020398
 - HAND SWITCH CONTACT CLOSURES THAT ARE MADE BEFORE BREAK ARE INDICATED BY ASTERISKS.
 - STUD ID OF RELAY 508F-509 MUST BE GROUNDED.
 - FOR CT GROUND PROTECTION SEE PCB 509B(04-0540-XE-01) WIRE NUMBER PREFIX AND RELAY NUMBER FOR PCB 509A WILL BE 503 AND 64-509 RESPECTIVELY.

ECN 1172

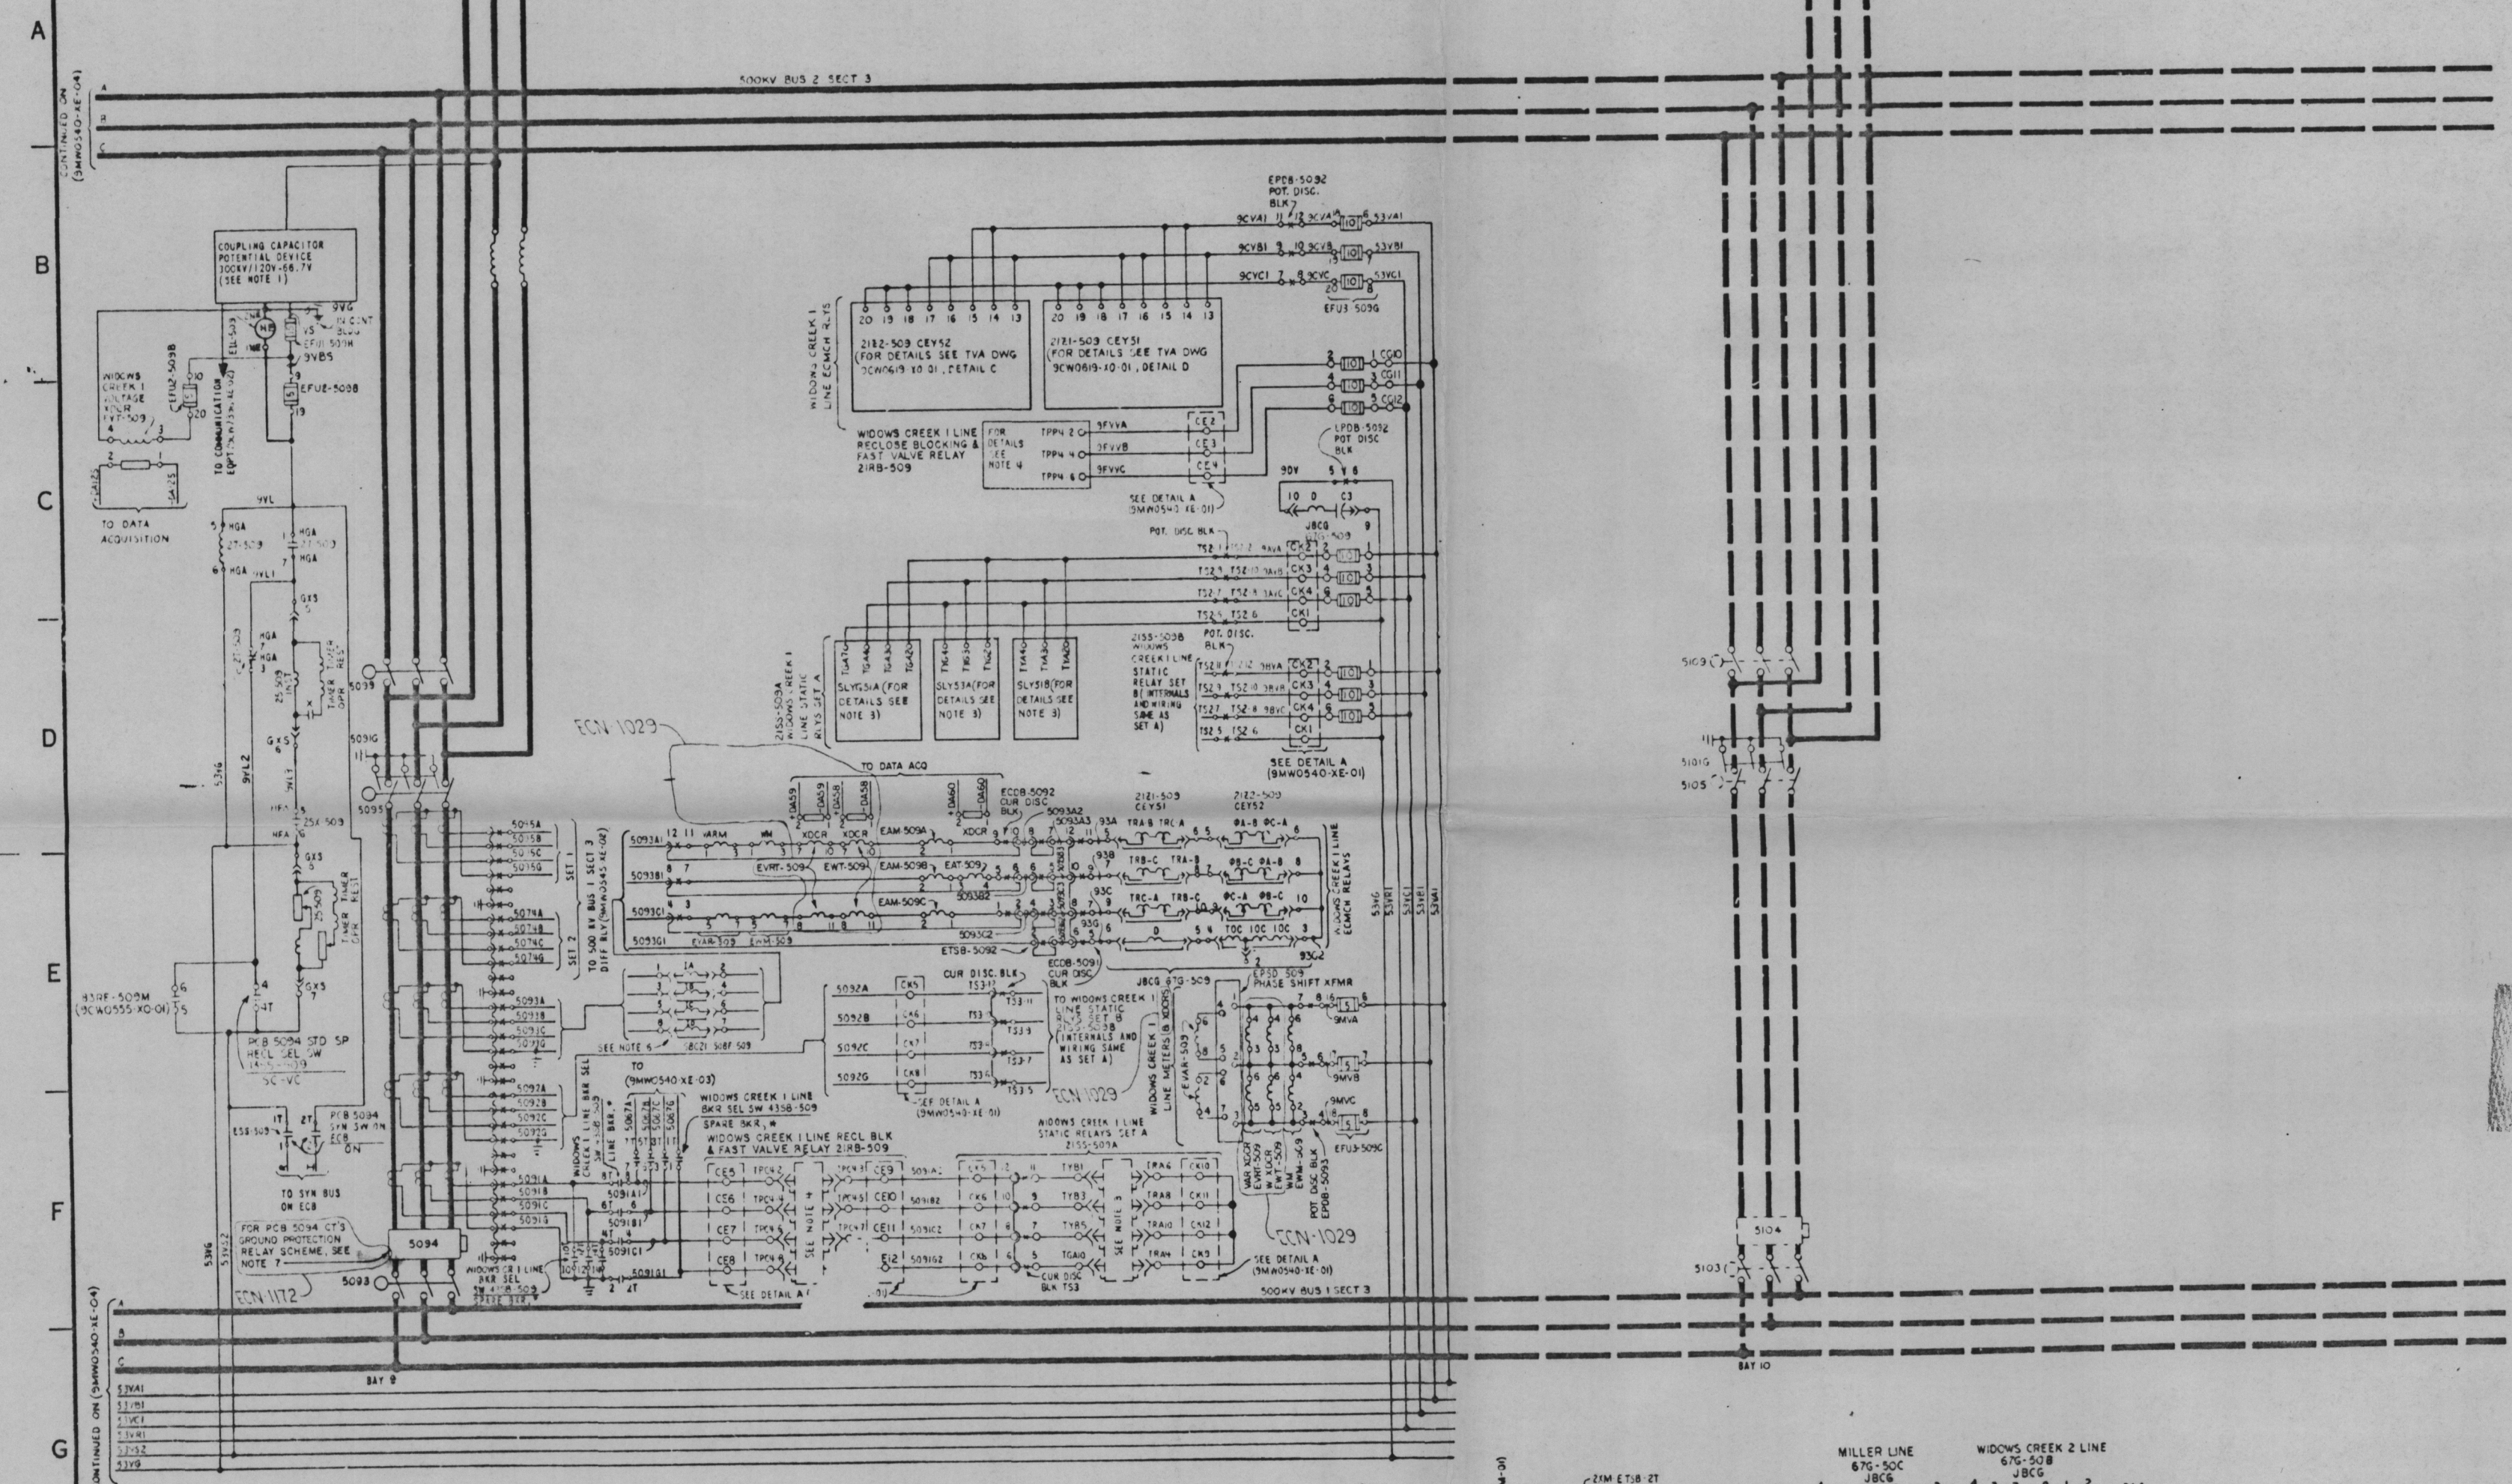

PRC APERTURE CARD

50-438
 8304052536
 3-25-83
 REGULATORY SECRET FILE

REV. NO.	ECN NO.	DATE	ISSUED BY	CHKD BY	APPV BY
4	1029, 1172	10-15-81	JRC	JT	CAB
3	1029	CHGS	DUE TO	DACODADA	ECN-1172
2	1029	ADDED	1W AND	MVAR	AMPLIFIER
1	1029	REVISED	500KV	PROTECTIVE	RELAY

SWITCHYARD


WIRING DIAGRAMS
 500KV AC SCHEMATIC SHEET 5
 BAYS 9 AND 10

BELLEFONTE NUCLEAR PLANT
 TENNESSEE VALLEY AUTHORITY
 DIVISION OF ENGINEERING DESIGN

SUBMITTED: [Signature]
 RECOMMENDED: [Signature]
 APPROVED: [Signature]

INSPECTED AND APPROVED FOR ISSUE: [Signature]
 DESIGN PROJECT MANAGER

KNOXVILLE 9-20-76 88 1 9MWO540-XE-05

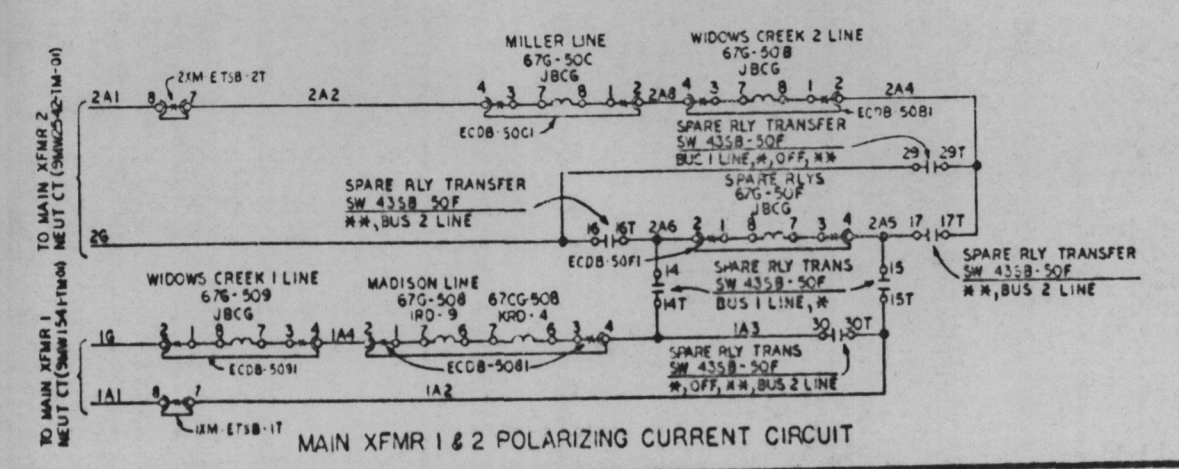

PRINTS REQUIRED

NO.	DATE	BY	REASON
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			