




### 500KV BUS 1 SECT 3 DIFFERENTIAL RELAYS SET 1

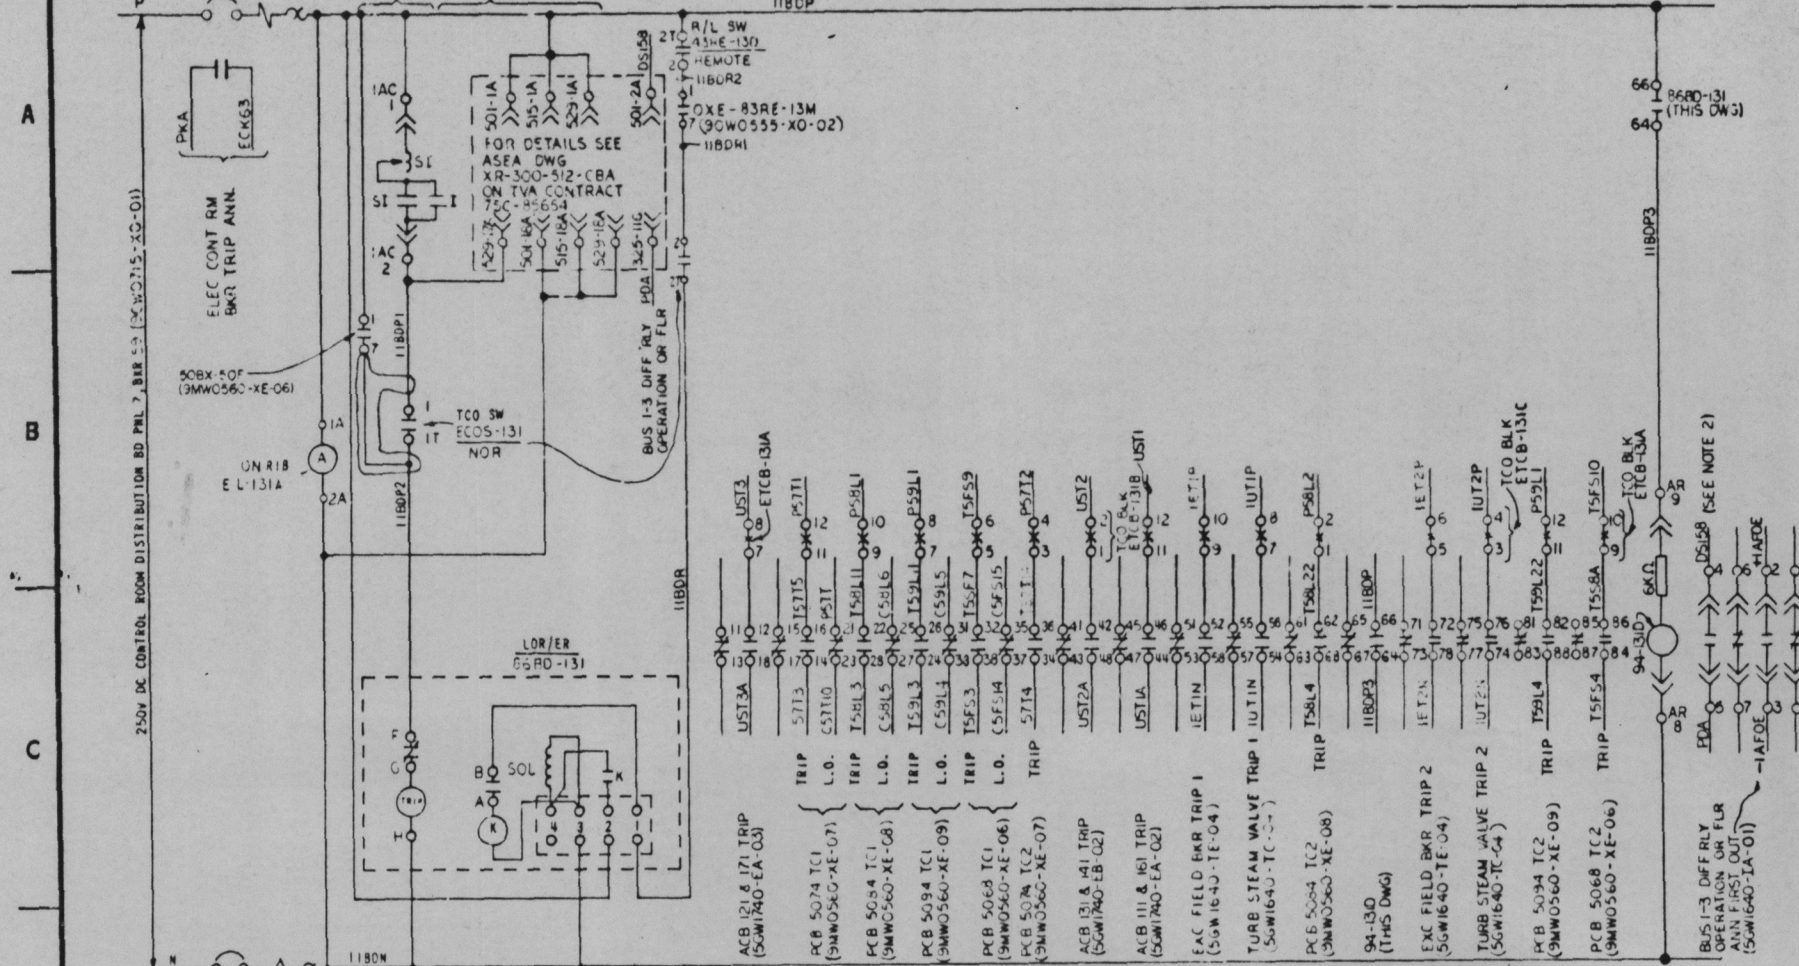


### 500KV BUS 1 SECT 3 DIFFERENTIAL RELAYS SET 2

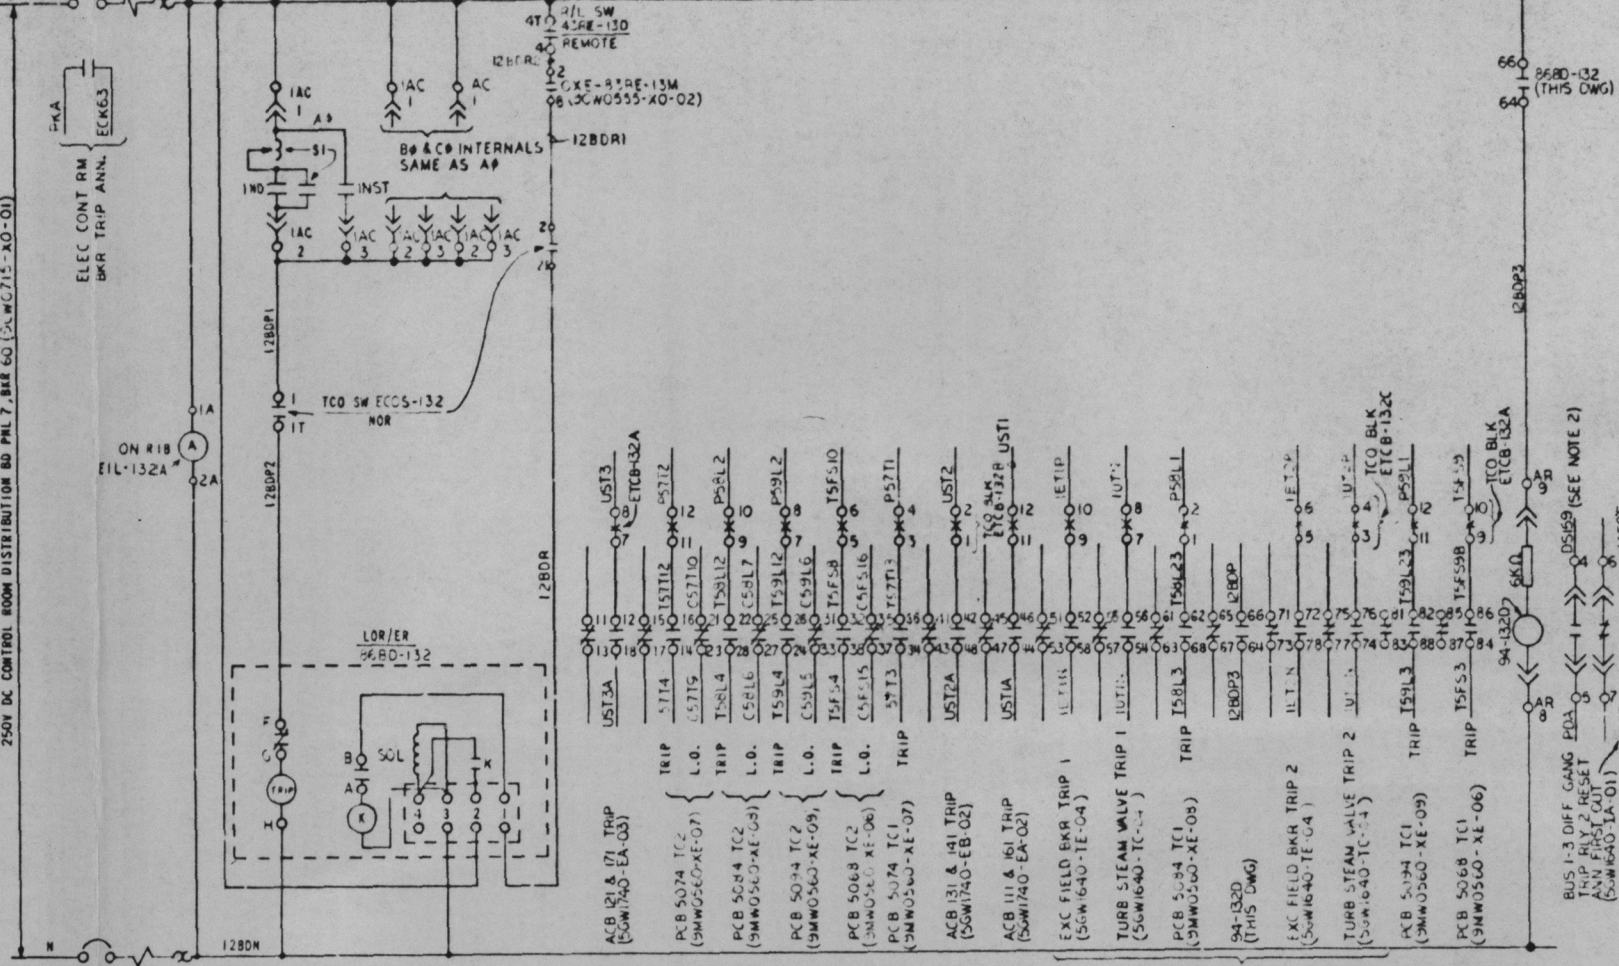

### 500KV BUS 2 SECT 1 DIFFERENTIAL RELAYS SET 1

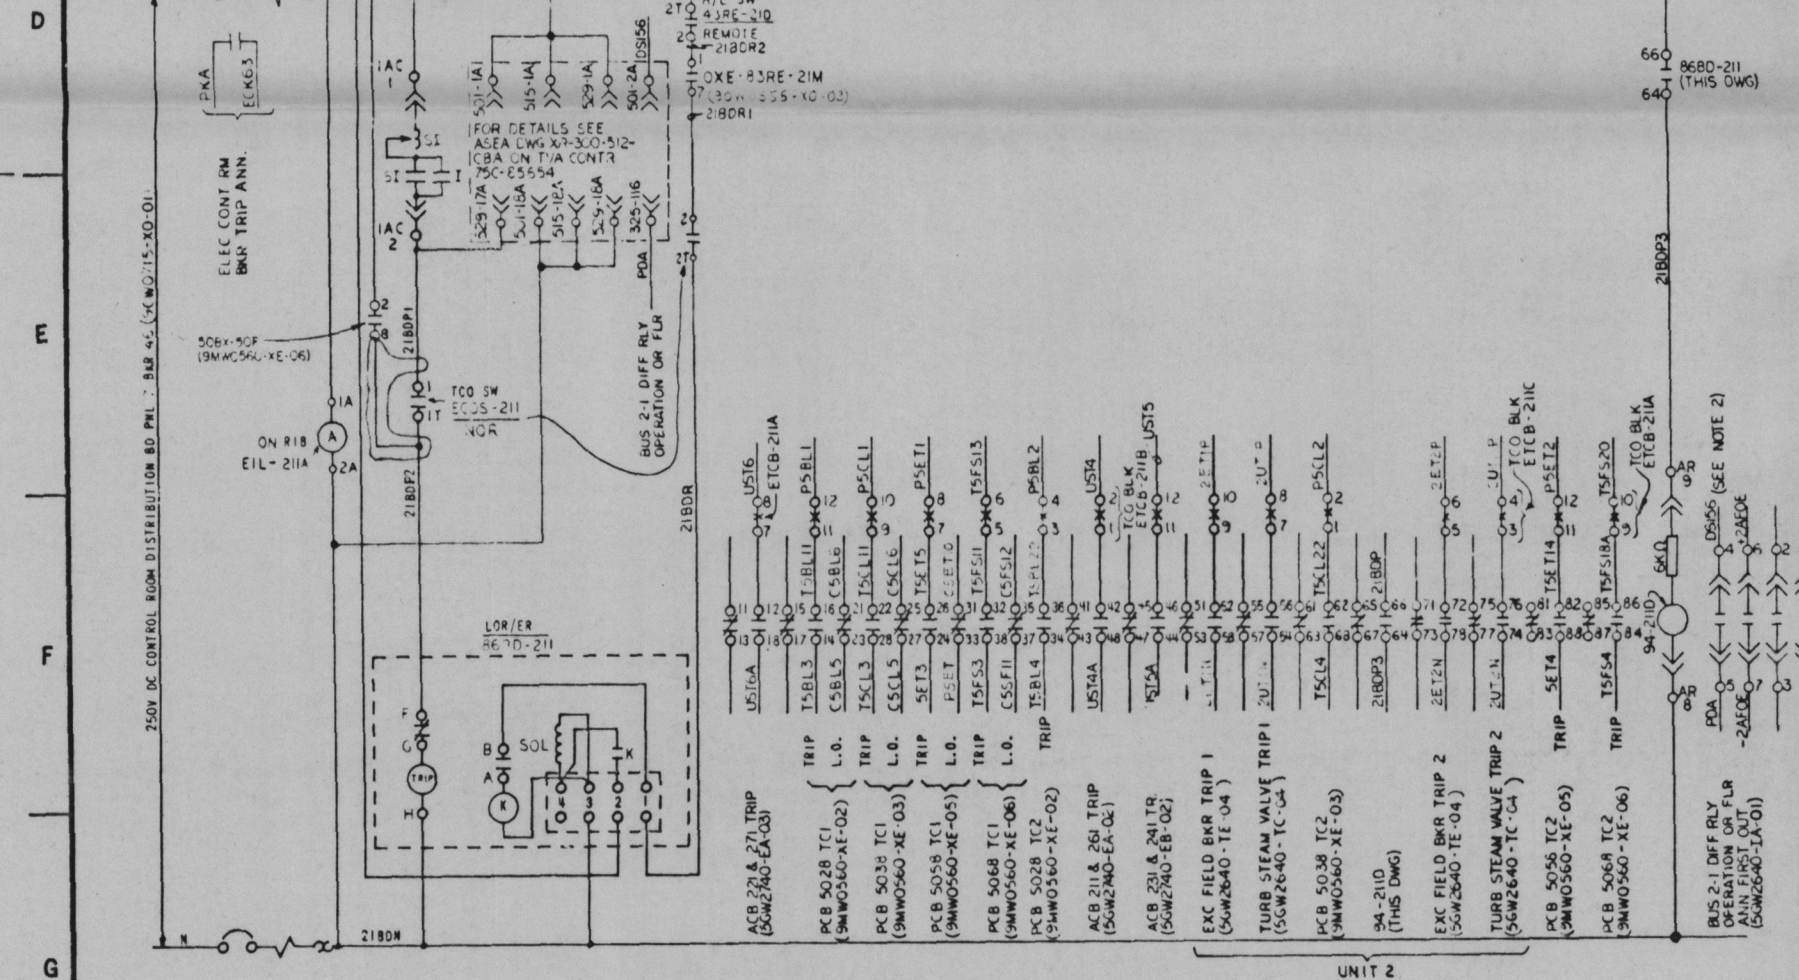

### 500KV BUS 2 SECT 1 DIFFERENTIAL RELAYS SET 2

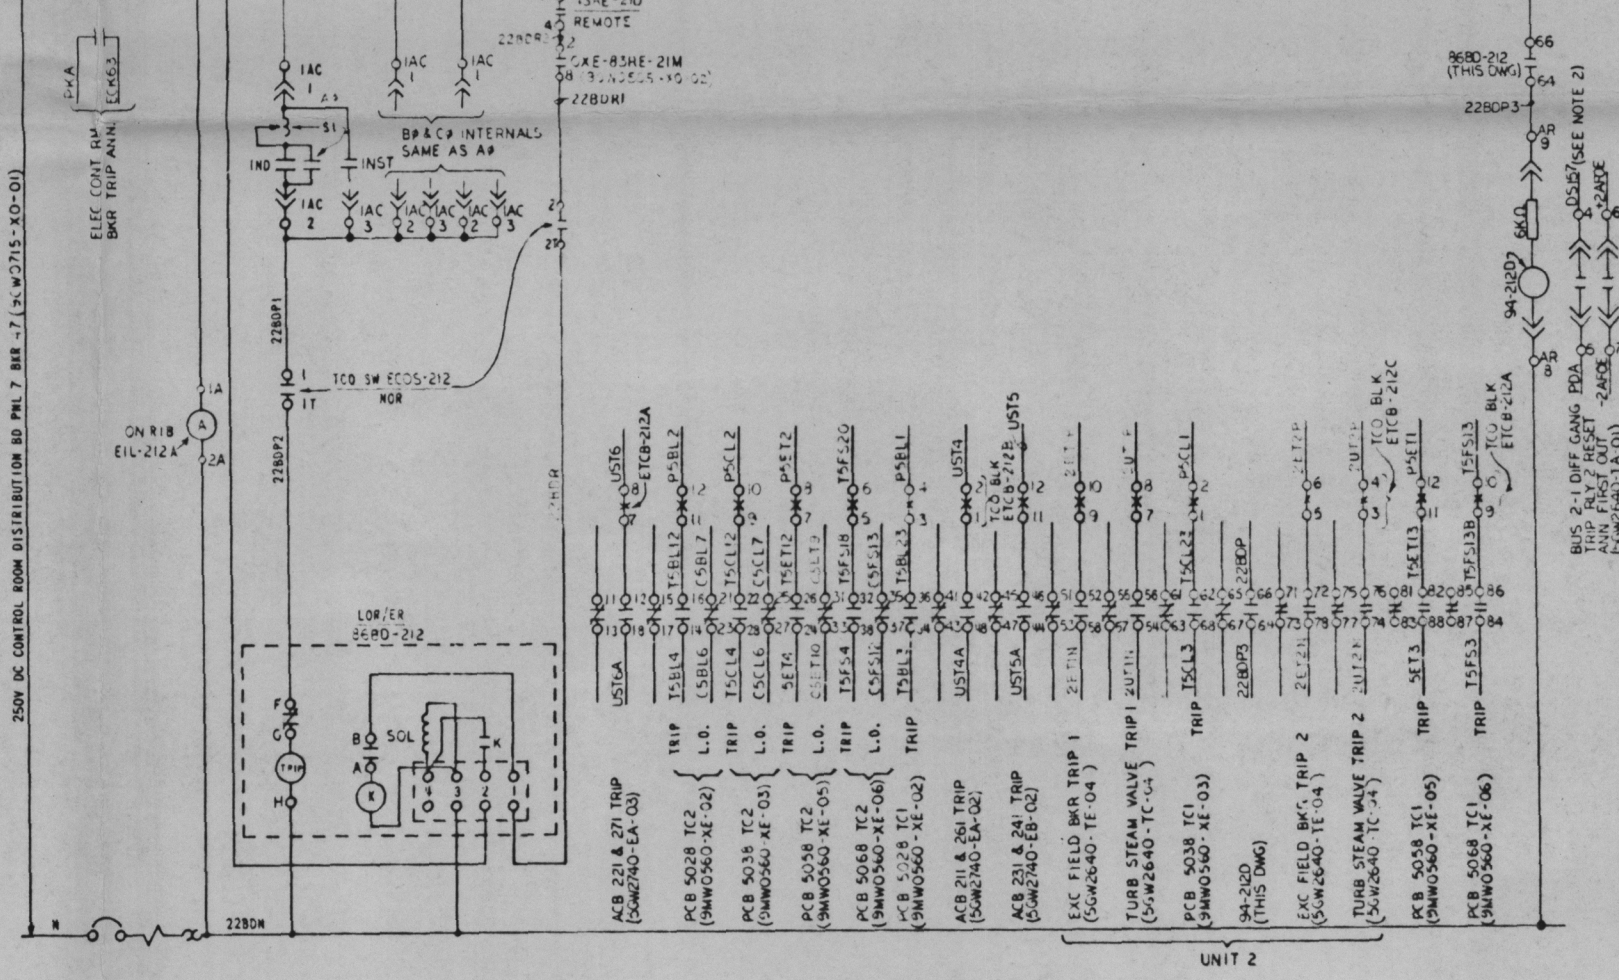

NOTES:  
 1. ALL UNIQUE NUMBERS SHOWN WILL HAVE THE PREFIX '0X6' UNLESS OTHERWISE INDICATED.  
 2. RESET STATUS, IN ADDITION TO BEING SENT TO THE ADCC OPERATOR, WILL ALSO BE PLACED ON THE OPERATIONS RECORDER IN THE MAIN CONTROL ROOM.

PRC APERTURE CARD

REV	NO.	DATE	DESCRIPTION	BY	CHKD	APPD
1	1	11/17/78	REVISED PER PRC E-2131			
2	2	11/17/78	REVISED PER PRC E-2131			
3	3	11/17/78	REVISED PER PRC E-2131			
4	4	11/17/78	REVISED PER PRC E-2131			
5	5	11/17/78	REVISED PER PRC E-2131			

CONTROL BUILDING  
 WIRING DIAGRAM  
 250 VDC MAIN CONTROL SCHEMATIC  
 500 KV BUS DIFFERENTIAL RELAYS

BELLEFONTE NUCLEAR PLANT  
 TENNESSEE VALLEY AUTHORITY  
 DIVISION OF ENGINEERING DESIGN

SUBMITTED: *[Signature]*  
 RECOMMENDED: *[Signature]*  
 APPROVED: *[Signature]*  
 INSPECTED AND APPROVED FOR ISSUE: *[Signature]*