
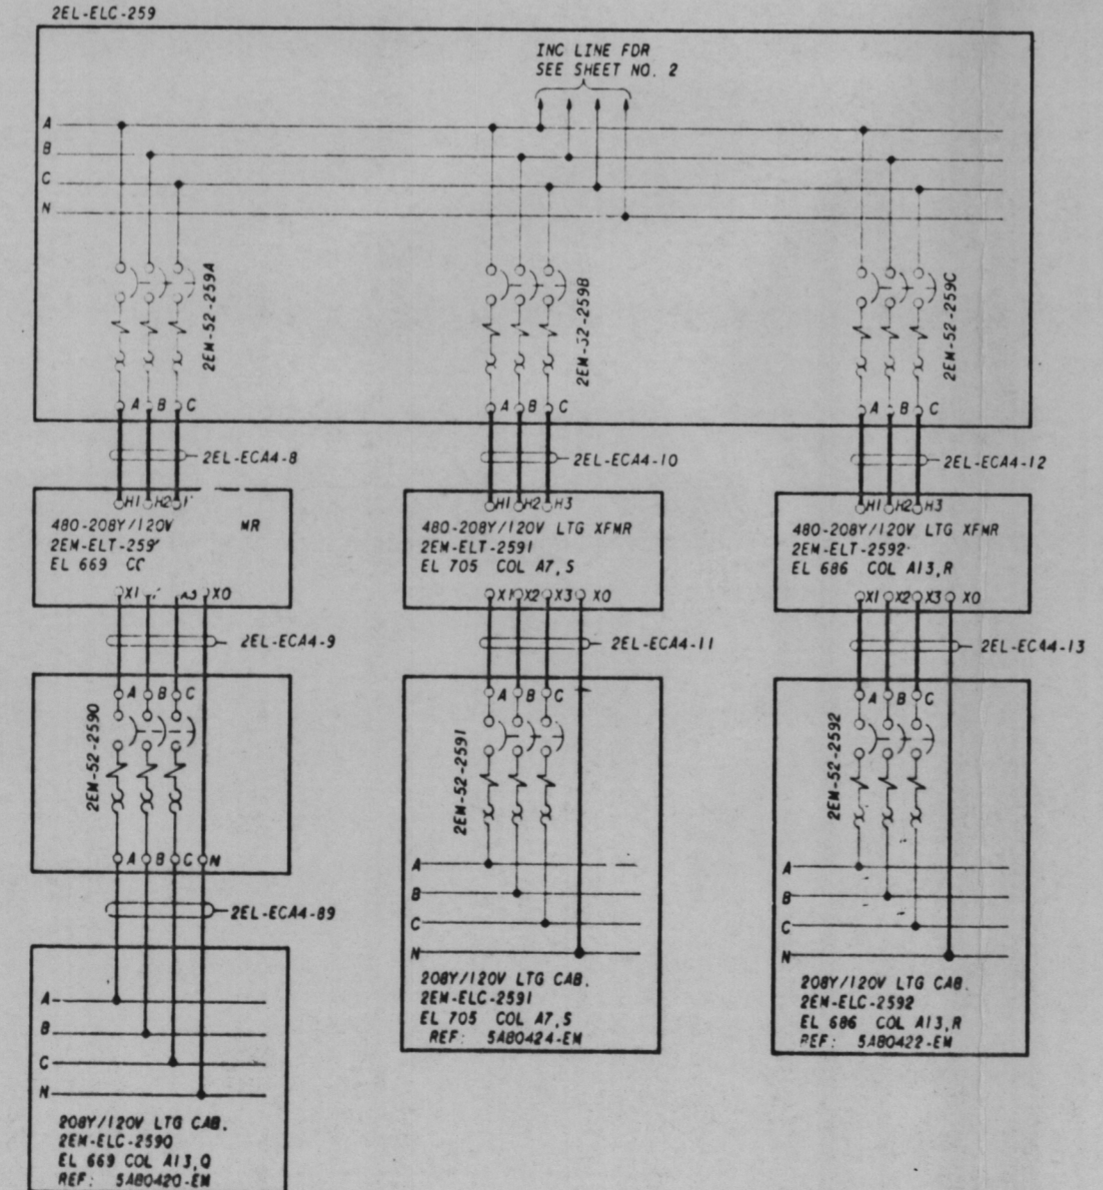
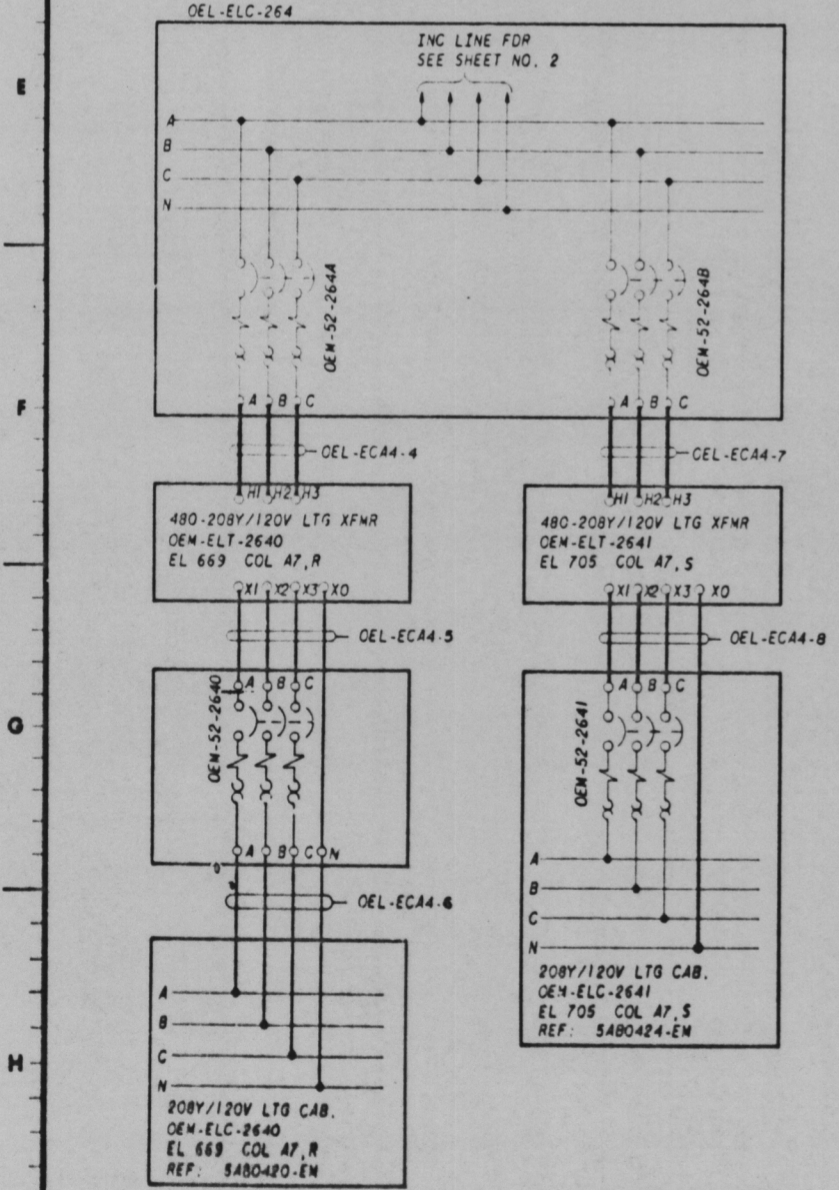
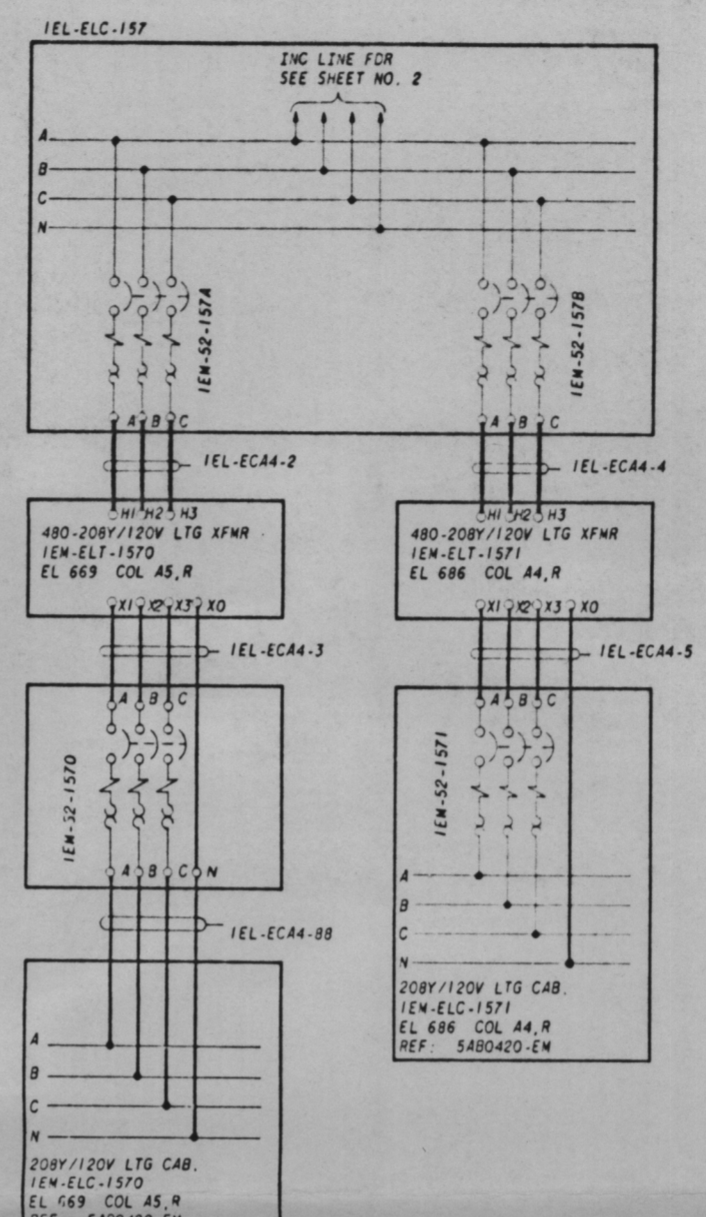
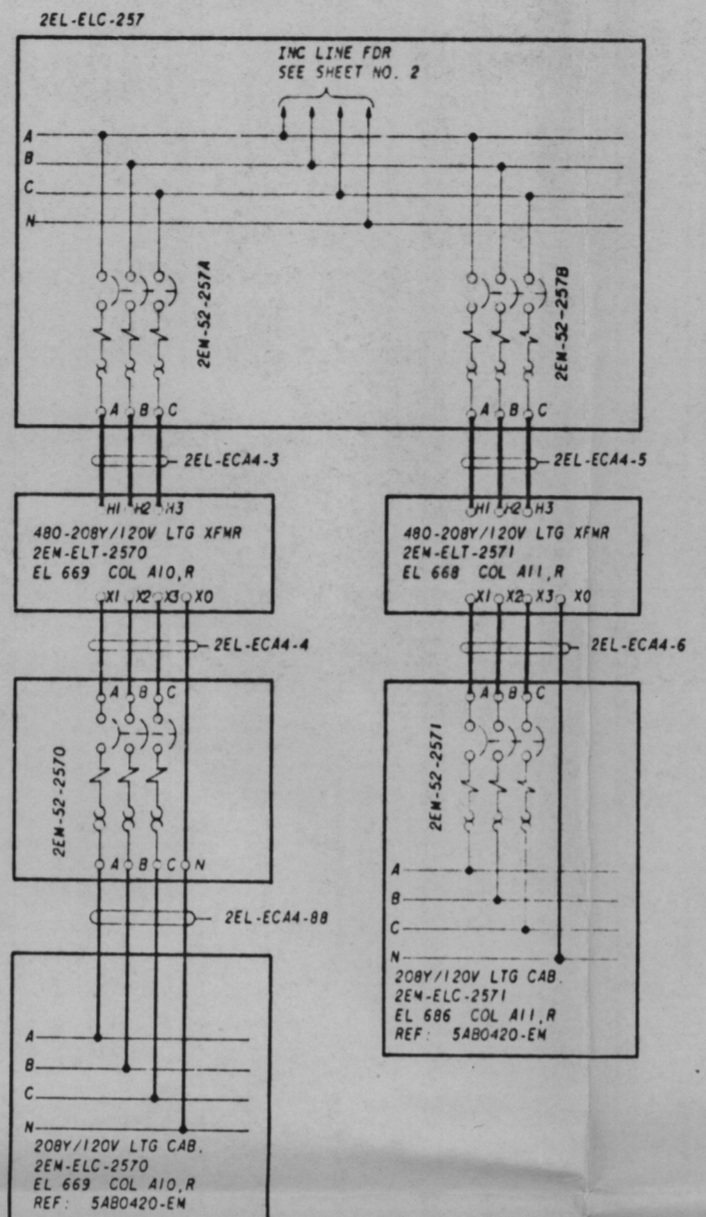


NOTES:
1. FOR GENERAL NOTES AND SYMBOLS SEE DWG SGW0747-EL-01.

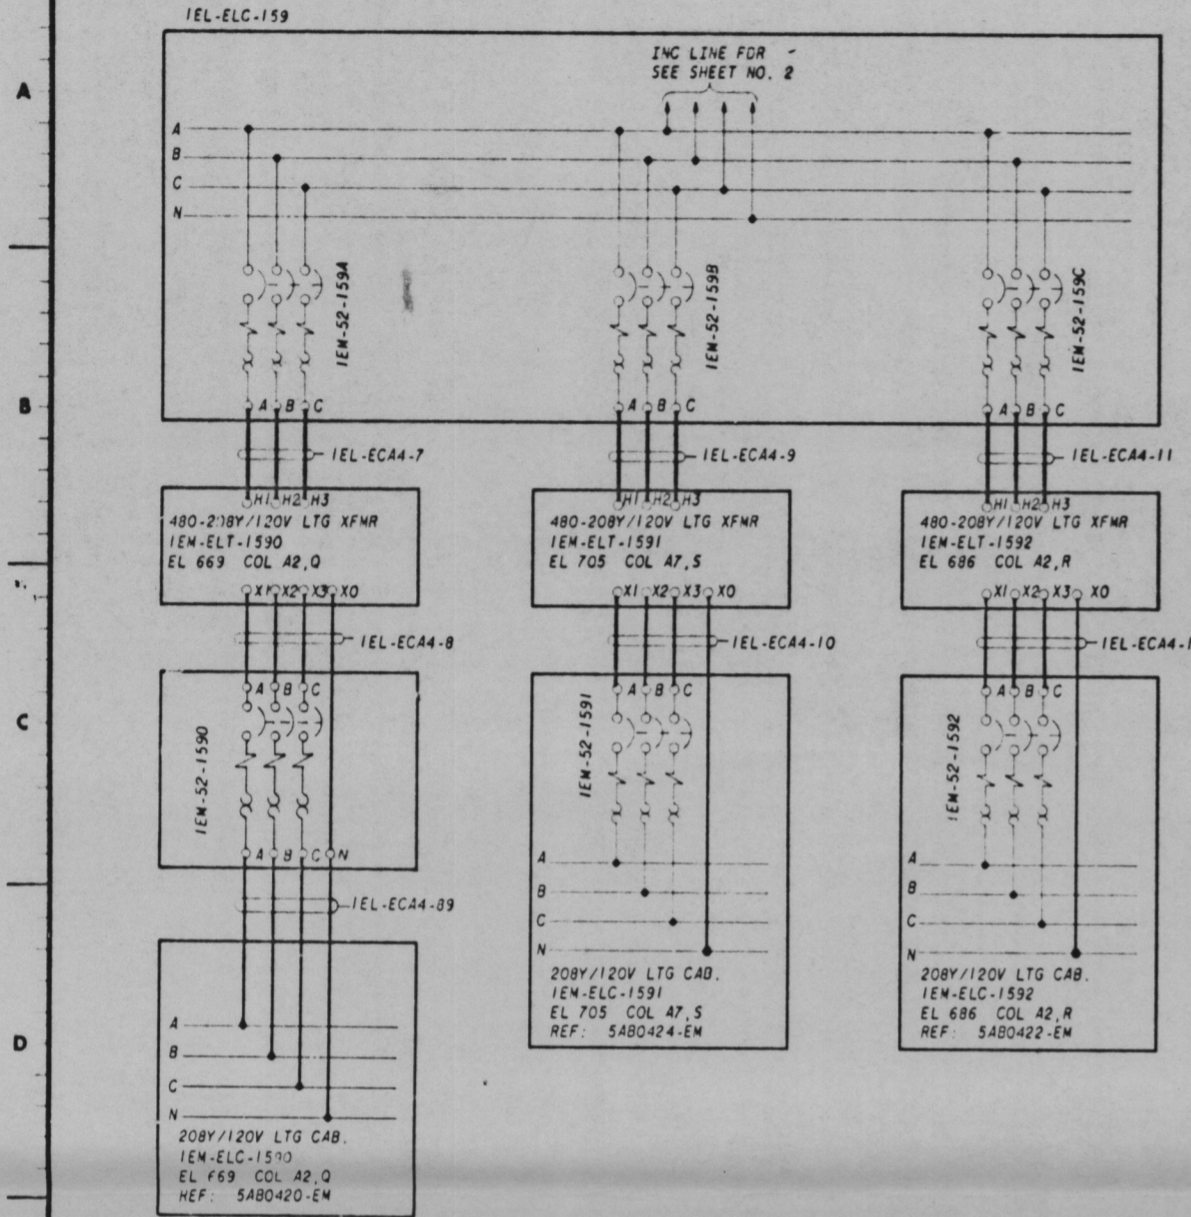

480V LIGHTING CABINET
BRANCH FEEDERS FOR
208Y/120V LIGHTING SYSTEM

PRC
APERTURE
CABINET

Doc # 52-438
Control # 8304050536
Date 3-25-83 of Document
REGULATORY DOCKET FILE

| REV NO | ECN NO | DATE | DESIGN | CHKD | APP'D | SLIP | ENGR | NSP | SLIP | REC'D | LPD |
|--------|--------|------|--------|------|-------|------|------|-----|------|-------|-----|
| 01 | | | AC | | | | | | | | |
| 02 | | | AC | | | | | | | | |
| 03 | | | AC | | | | | | | | |
| 04 | | | AC | | | | | | | | |

SCALE: EXCEPT AS NOTED

GENERAL
UNITS 1 & 2
WIRING DIAGRAM
NORMAL AC
LIGHTING FEEDERS

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

SUBMITTED: [Signature]
RECOMMENDED: [Signature]
APPROVED: [Signature]

INSPECTED AND APPROVED FOR ISSUE

KNOXVILLE 2-7-78 88 E SGW0747-EL-03 RO