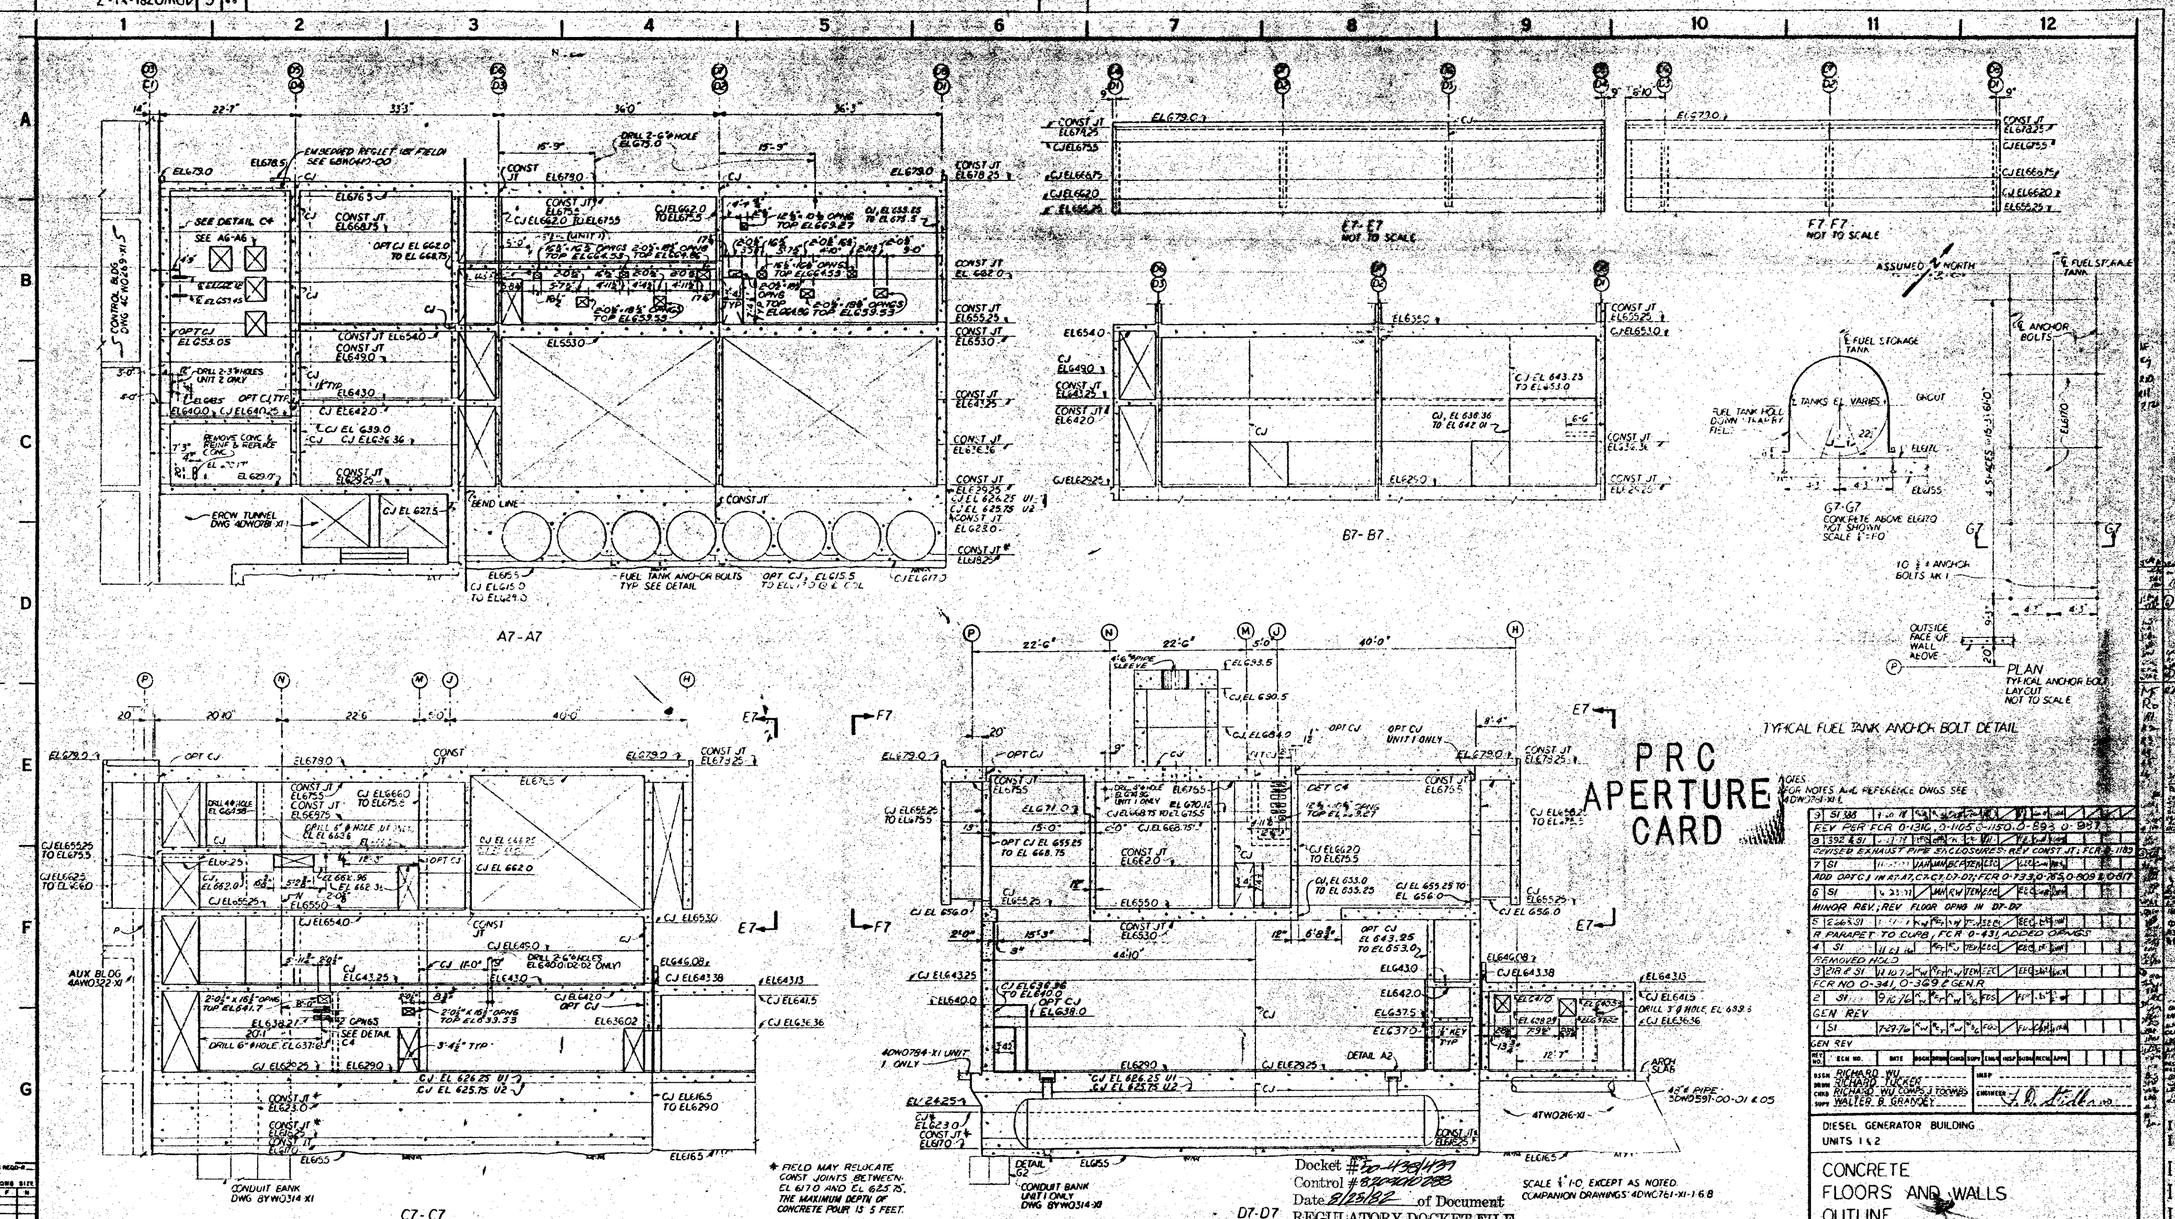
A7-A7
B7-B7
C7-C7
D7-D7
E7-E7
F7-F7
NOT TO SCALE
PLAN
TYPICAL ANCHOR BOLT LAYOUT
NOT TO SCALE
TYPICAL FUEL TANK ANCHOR BOLT DETAIL
PRC APERTURE CARD
POOR ORIGINAL
Docket #50-438/439
Control #8204200288
Date 8/25/82 of Document
REGULATORY DOCKET FILE
* FIELD MAY RELOCATE CONST JOINTS BETWEEN EL 617.0 AND EL 625.75. THE MAXIMUM DEPTH OF CONCRETE POUR IS 5 FEET.
SCALE 1/4" = 1'-0" EXCEPT AS NOTED.
COMPANION DRAWINGS: 4DWC761-XI-168
DIESEL GENERATOR BUILDING
UNITS 1 & 2
CONCRETE
FLOORS AND WALLS
OUTLINE
BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN
KNOXVILLE
4DW0781-XI-7
RECORD DRAWING AS CONSTRUCTED