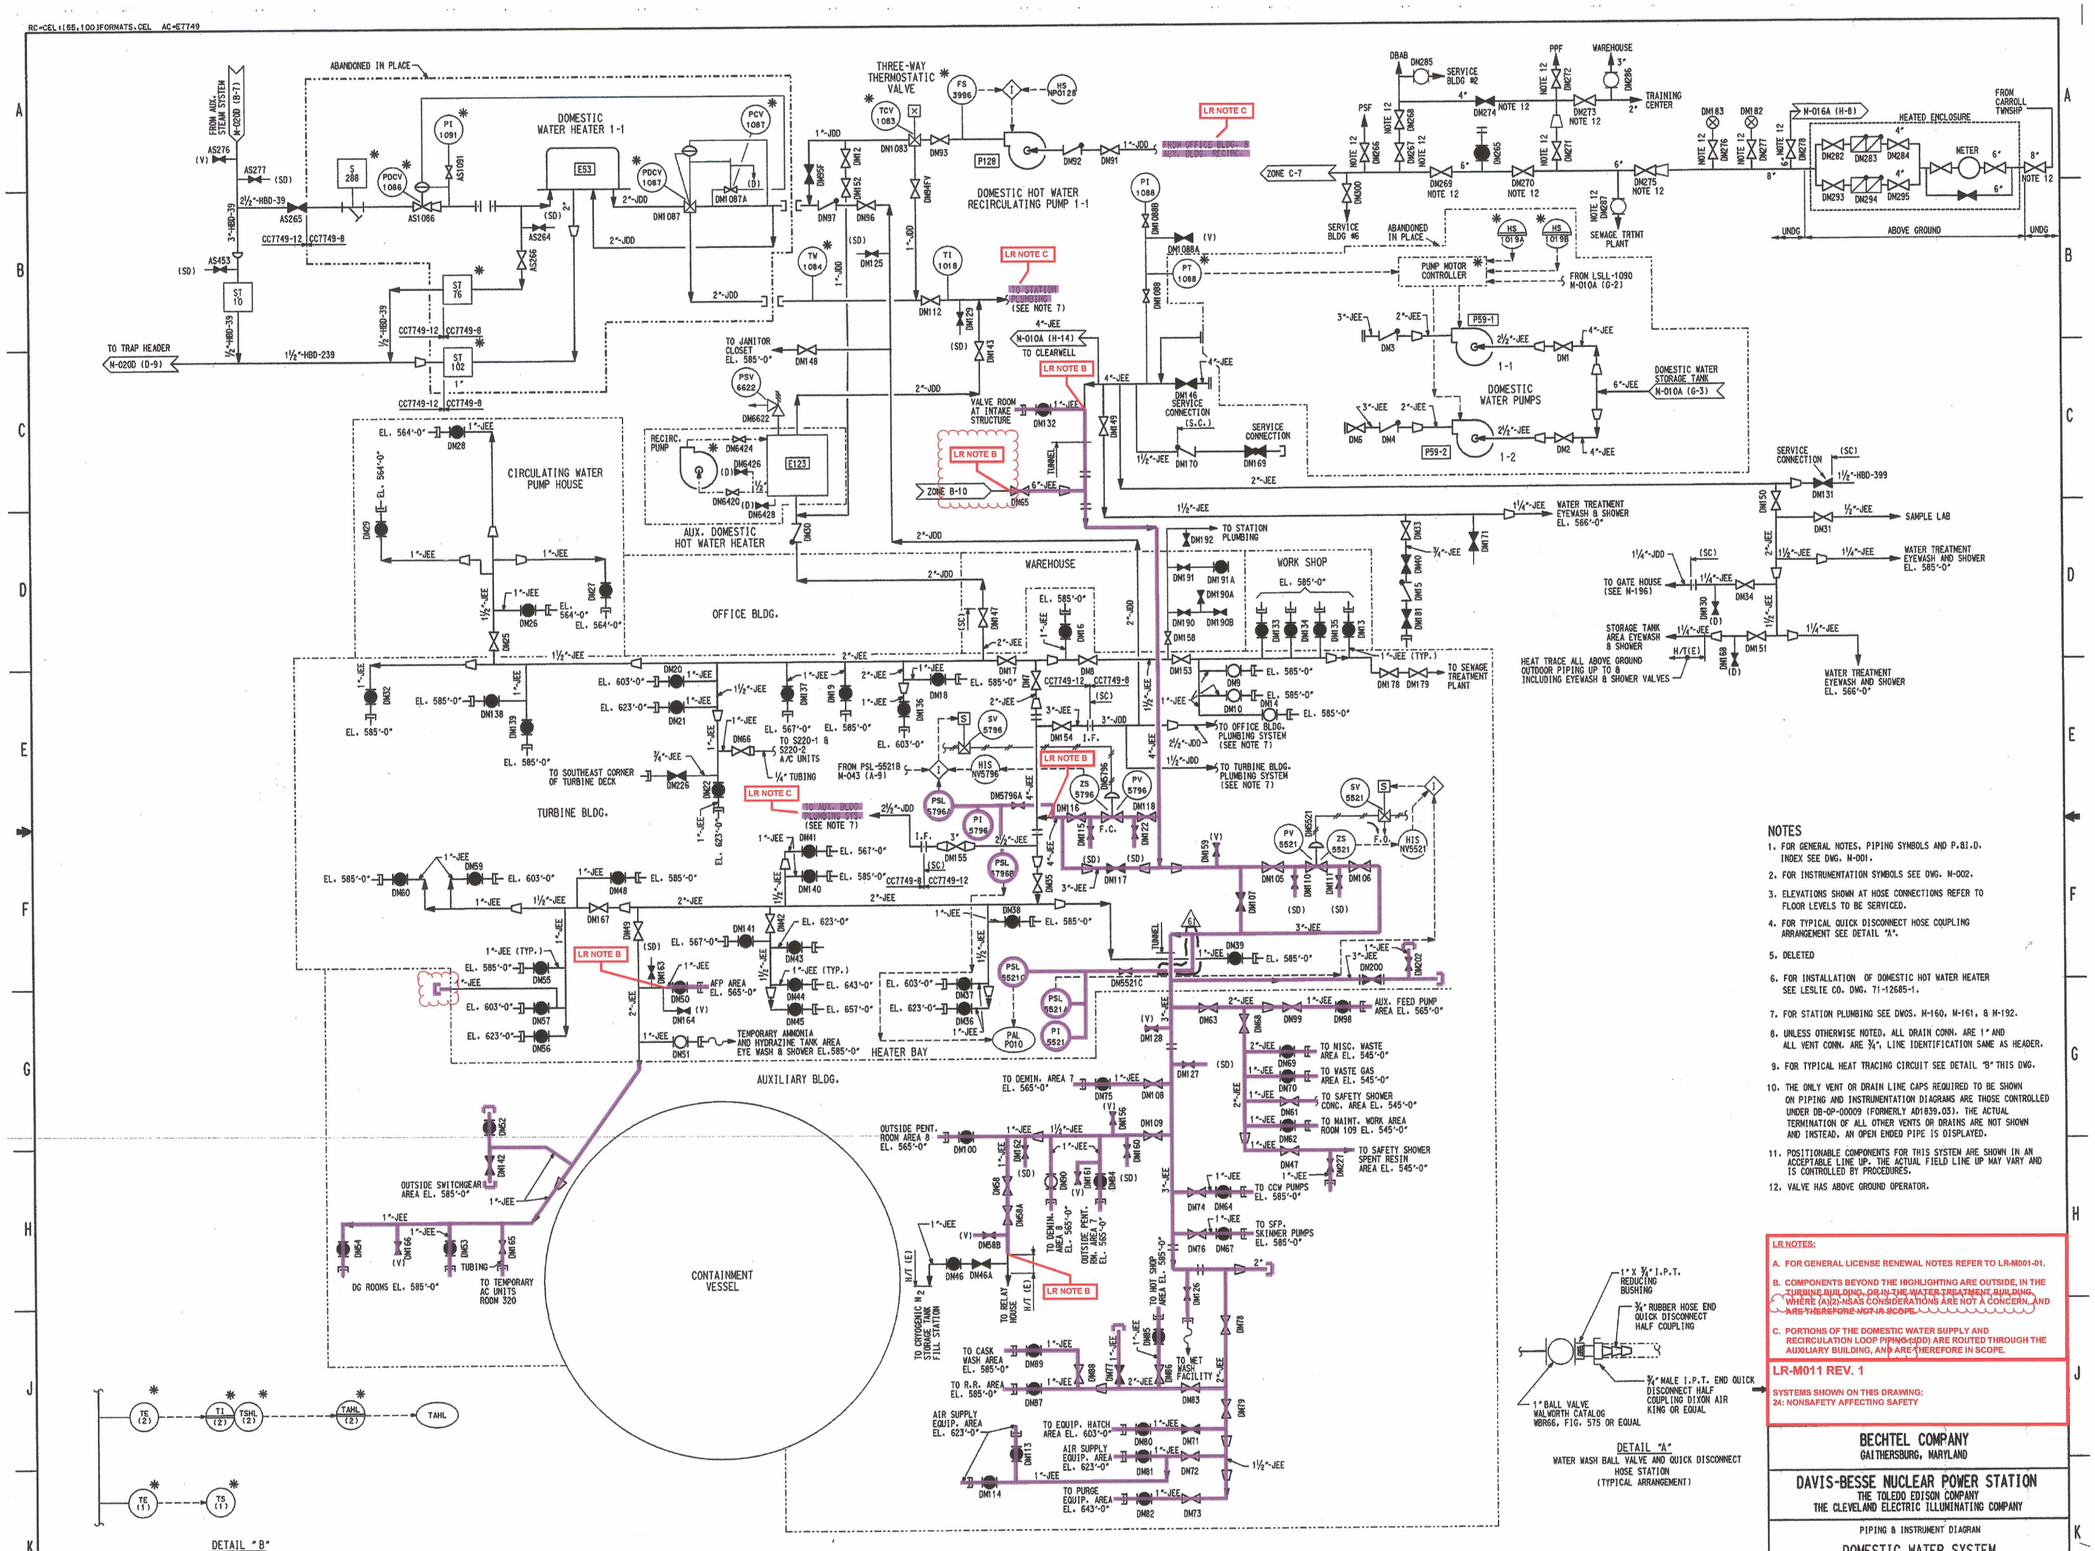

NOTES

1. FOR GENERAL NOTES, PIPING SYMBOLS AND P.&I.D. INDEX SEE DWG. N-001.
2. FOR INSTRUMENTATION SYMBOLS SEE DWG. N-002.
3. ELEVATIONS SHOWN AT HOSE CONNECTIONS REFER TO FLOOR LEVELS TO BE SERVICED.
4. FOR TYPICAL QUICK DISCONNECT HOSE COUPLING ARRANGEMENT SEE DETAIL "A".
5. DELETED
6. FOR INSTALLATION OF DOMESTIC HOT WATER HEATER SEE LESLIE CO. DWG. 71-12685-1.
7. FOR STATION PLUMBING SEE DWGS. M-160, M-161, & M-192.
8. UNLESS OTHERWISE NOTED, ALL DRAIN CONN. ARE 1" AND ALL VENT CONN. ARE 3/4", LINE IDENTIFICATION SAME AS HEADER.
9. FOR TYPICAL HEAT TRACING CIRCUIT SEE DETAIL "B" THIS DWG.
10. THE ONLY VENT OR DRAIN LINE CAPS REQUIRED TO BE SHOWN ON PIPING AND INSTRUMENTATION DIAGRAMS ARE THOSE CONTROLLED UNDER DB-OP-00009 (FORMERLY AD1839.03). THE ACTUAL TERMINATION OF ALL OTHER VENTS OR DRAINS ARE NOT SHOWN AND INSTEAD, AN OPEN ENDED PIPE IS DISPLAYED.
11. POSITIONABLE COMPONENTS FOR THIS SYSTEM ARE SHOWN IN AN ACCEPTABLE LINE UP. THE ACTUAL FIELD LINE UP MAY VARY AND IS CONTROLLED BY PROCEDURES.
12. VALVE HAS ABOVE GROUND OPERATOR.

LR NOTES:

A. FOR GENERAL LICENSE RENEWAL NOTES REFER TO LR-M001-01.

B. COMPONENTS BEYOND THE HIGHLIGHTING ARE OUTSIDE, IN THE TURBINE BUILDING, OR IN THE WATER TREATMENT BUILDING, WHERE (A)(2) HSAS CONSIDERATIONS ARE NOT A CONCERN, AND ARE THEREFORE NOT IN SCOPE.

C. PORTIONS OF THE DOMESTIC WATER SUPPLY AND RECIRCULATION LOOP PIPING (SDD) ARE ROUTED THROUGH THE AUXILIARY BUILDING, AND ARE THEREFORE IN SCOPE.

LR-M011 REV. 1

SYSTEMS SHOWN ON THIS DRAWING:
24: NONSAFETY AFFECTING SAFETY

BECHTEL COMPANY
GAITHERSBURG, MARYLAND

DAVIS-BESSE NUCLEAR POWER STATION
THE TOLEDO EDISON COMPANY
THE CLEVELAND ELECTRIC ILLUMINATING COMPANY

PIPING & INSTRUMENT DIAGRAM
DOMESTIC WATER SYSTEM

JOB No.	DRAWING No.	REV.
7749	M-011	61

DFN=/I/PIDS/M011.DGN DB 03-30-07 14 34X44 "E" SIZE

202