

## PMSTPCOL PEmails

---

**From:** Eudy, Michael  
**Sent:** Tuesday, March 29, 2011 8:22 AM  
**To:** Roach, Edward; Hinson, Charles; Stutzcage, Edward  
**Cc:** Wunder, George; Tonacci, Mark; STPCOL  
**Subject:** FW: 12.02-20 revised response  
**Attachments:** 12\_02-20-RR-00\_Draft-14.pdf

**Importance:** High

Here is STP's revised RAI response for the Spent Fuel Term issues.

If staff will be able to give comments to STP during tomorrow mornings call, please let me know later today.

Mike

---

**From:** Stephens, Scot [<mailto:scstephens@STPEGS.COM>]  
**Sent:** Tuesday, March 29, 2011 8:10 AM  
**To:** Eudy, Michael  
**Cc:** Mookhoek, William  
**Subject:** 12.02-20 revised response

Good morning, Mike. Please see attached.

Regards,

*Scot Stephens*

*Licensing Engineer/Corrective Actions Program Coordinator*

*STP 3 & 4*

*4000 Avenue F, Bay City, TX 77414*

*361-972-4789 (direct)*

*979-864-6302 (mobile)*

**Hearing Identifier:** SouthTexas34Public\_EX  
**Email Number:** 2749

**Mail Envelope Properties** (9E28710E0B702149AEC663972863644073C07C2571)

**Subject:** FW: 12.02-20 revised response  
**Sent Date:** 3/29/2011 8:21:56 AM  
**Received Date:** 3/29/2011 8:21:58 AM  
**From:** Eudy, Michael

**Created By:** Michael.Eudy@nrc.gov

**Recipients:**

"Wunder, George" <George.Wunder@nrc.gov>  
Tracking Status: None  
"Tonacci, Mark" <Mark.Tonacci@nrc.gov>  
Tracking Status: None  
"STPCOL" <STP.COL@nrc.gov>  
Tracking Status: None  
"Roach, Edward" <Edward.Roach@nrc.gov>  
Tracking Status: None  
"Hinson, Charles" <Charles.Hinson@nrc.gov>  
Tracking Status: None  
"Stutzcage, Edward" <Edward.Stutzcage@nrc.gov>  
Tracking Status: None

**Post Office:** HQCLSTR01.nrc.gov

<b>Files</b>	<b>Size</b>	<b>Date &amp; Time</b>
MESSAGE	631	3/29/2011 8:21:58 AM
12_02-20-RR-00_Draft-14.pdf	727939	

**Options**

**Priority:** High  
**Return Notification:** No  
**Reply Requested:** No  
**Sensitivity:** Normal  
**Expiration Date:**  
**Recipients Received:**

## RAI 12.02-20

### QUESTION:

The staff has reviewed the information provided in the revised response to RAI 12.02-14. On the basis of this review, the staff has the following questions, regarding this RAI.

1. The response includes STP 3&4 FSAR revisions to ABWR DCD Tables 12.2-5a and 12.2-5b as well as new Tables 12.2-31 (SFP Peak Gamma Radiation Source) and 12.2-32 (SFP Peak Neutron Source). These new tables provide the source term for the Spent Fuel Pool (SFP) based on 270% of the core load one day post shutdown. However, the response does not include a source term for radionuclides (corrosion and fission products) contained in the SFP water. This information is necessary to perform radiation dose calculations for workers standing on the fuel handling bridge and to completely satisfy Tables 12.2-5a and 12.2-5b of the ABWR DCD, which state that the SFP radiation source and geometry information is the applicant's responsibility. Also, Regulatory Guide 1.206, Section C.I.12.2.1 "Contained Sources", states that the applicant is to provide the models, parameters, and bases for all values used to calculate source magnitudes, for normal and accident conditions. Please provide this SFP water source term information and include it in the STP 3&4 FSAR.
2. A figure was included in the RAI response showing a vertical cut view of the SFP. Some of the dimensions on the figure appear to be inconsistent with the spent fuel storage shielding dimensions shown in Table 12.2-5c of the ABWR DCD and STP 3&4 FSAR. In addition, this figure does not include some of the dimensions and spatial relationships needed by the staff to perform a shielding calculation. Specifically, there appears to be an inconsistency between the depth of water above the fuel assemblies as shown in the SFP figure and the depth of water as indicated in Table 12.2-5c. In addition, the figure does not show the minimum distance between the top of a raised fuel assembly at maximum height and the SFP water surface, the height of the SFP fuel pool bridge above the water surface, and the location of refueling personnel during refueling operations on the fuel pool bridge. In order for the staff to be able to perform an accurate deep dose equivalent calculation for a person standing on the fuel pool bridge, please provide an updated figure of the SFP, addressing these items.
3. As stated in the response to 1. above, additional information is needed in order to perform a radiation dose calculation for workers standing on the fuel handling bridge. During refueling operation ANSI/ANS-57.1-1992 states that fuel handling equipment shall be designed so that the operator will not be exposed to >2.5 mrem/hr (25  $\mu$ Sv/hr) from an irradiated fuel unit, control component, or both, elevated to the up-position interlock with the pool at normal operating water level. Verify that the maximum dose rate to an operator on the fuel handling bridge will not exceed the 2.5 mrem/hr criteria stated in this ANSI/ANS standard.
4. Regulatory Guide 1.206, Section C.I.12.3.2, states that the applicant should provide information regarding the shielding of each radiation source. Section C.I.12.1.3 of this Regulatory Guide also states that applicants should describe how operating procedures will be used to ensure doses are kept ALARA. The RAI response does not provide a description of any design features/access controls that will be used to limit the dose rate to individuals working in the Spent Fuel Pool area. Please provide a description of any design features/access controls (such as installing additional shielding to the fuel handling bridge/refueling machine to lower dose rates to the operator on the

fuel handling bridge and minimizing the personnel stay times on the refueling bridge) that will be used, to ensure that the dose to refueling personnel are maintained ALARA during refueling operations.

5. ABWR DCD Chapter 12 figures provide radiation zone maps for areas adjacent to the spent fuel storage room. Please confirm that the dose rates in areas adjacent to the SFP room will be no higher than what is indicated in the ABWR DCD Chapter 12 figures and include any changes in estimated dose rates in the Chapter 12 FSAR radiation zone maps.

## **REVISED RESPONSE:**

This response replaces in its entirety NINA's response to RAI 12.02-20, dated January 3, 2011, in letter U7-C-STP-NRC-110003. Changes to the initial response are extensive. Therefore, changes are not indicated by revision bars.

This response provides information regarding radiation dose rates from the Spent Fuel Pool (SFP). The response provides SFP dimensions and calculated results for the dose rate to workers on the refueling machine trolley platform from the highest activity irradiated fuel bundle elevated to the maximum up-position, with water coverage of 8.5 ft from the top of the fuel assembly active fuel region. Additionally, tables are provided that list the peak gamma and neutron sources and radionuclides in the SFP. These tables are contained in a new STP 3&4 COLA FSAR Appendix 12B shown below.

1. The new Appendix 12B shows a representative SFP rack modules layout drawing (Figure 12B-1), with a capacity of 2365 bundles, which is conservative for a dose calculation compared to the maximum 270% (2354) bundles allowed in the SFP, as specified in FSAR Section 9.1. As discussed in the appendix, the radioisotope inventory and gamma and neutron sources, as a function of time post-irradiation, were calculated with the NRC-endorsed ORIGEN-S Code. The supporting proprietary calculations are referenced in this revised response as References 1 and 2.

The Fuel Pool Cooling and Cleanup (FPC) system described in FSAR Subsections 9.1.3 and 12.3.1.4.3 maintains the SFP water at a very low radioactive nuclide level. In support of this statement, data from an operating ABWR plant has been used. This information is also provided in new Appendix 12B in Section 12B.5 and Table 12B-7.

FSAR Tables 12.2-5a and 12.2-5b will be revised as shown after the response to question 3 below to reflect the representative SFP geometry information. Gray highlighting shows the changes.

2. ABWR DCD Table 12.2-5c shows spent fuel storage with 7.4 m of water above the fuel elements stored in the racks at the bottom of the pool in the fully seated storage position. This is consistent with ABWR DCD Figure 12.3-10, which shows the depth of the spent fuel storage pool as 11.9 m (31.7 m – 19.8 m). Reducing this value by the length of the active spent fuel (3.8 m) plus an additional conservative 0.4 m for the support portions of the bundle and rack seat height at the pool bottom, and approximately 0.3 m for pool water surface level depth below the operating floor results in slightly more than 7.4 m of water above the top of the active spent fuel seated in the racks.

As requested, the following information is provided. The refueling machine design discussed in Reference 4 shows the trolley platform approximately 8.8 ft (2.7 m) above the refueling floor. The refueling machine will have both local and remote controls. An improvement over some other machines allows the operator to locally control motions of the bridge, trolley, and all hoists and grapples from the trolley platform as opposed to operation of auxiliary hoists from the lower bridge. The remote control system consoles will be located in a control room on the refueling floor, providing the operator with all required functions for automatic control of fuel handling. As discussed in FSAR Subsection 9.1.4.1, the fuel grapple design will maintain adequate water shielding of at least 8.5 ft (2.6 m) over the top of the active fuel.

3. Section 12.2 of the ABWR DCD includes two items marked “applicant,” in Tables 12.2-5a and -5b, for spent fuel source term and source term geometry. The NRC staff requested that these two “applicant” items (which are effectively another COL Information Item) be addressed in RAI 12.02-20. NINA’s response to this RAI describes how NINA developed the source term and defined the geometry in response to these items. The following points are pertinent to these items:
- The “applicant” items required specific information be provided that was not directly available in the DCD, hence additional detailed analysis of the spent fuel was required. This was done as a stand alone assessment to address the “applicant” items and is being included in the COLA as supplemental information.
  - The response to the “applicant” items is self contained and stands on its own. It is based on relevant information from the DCD (e.g. core thermal power, maximum burn up, # of spent fuel assemblies in the SFP, etc) and conservative assumptions (e.g. 2 year fuel cycle, 10% bump up) to develop an accurate but conservative basis for a spent fuel pool source term.
  - In order to assess the source term of the fuel in the full spent fuel pool racks, it is necessary to determine the source for most of the spent fuel at long cooling times (up to 10 years) to generate enough spent fuel to fill the racks. That level of information is not available in DCD Table 12.2-3b, which only provides overall core source terms with decay times up to one month. Thus a detailed analysis was required to develop that information.
  - As part of this RAI it is also requested that an analysis for operator doses based on spent fuel movement operations be provided by STPNOC. DCD Table 12.2-3b only provides overall core source terms. In order to determine the maximum source term for any spent fuel assembly being moved by the fuel handling machine, it was necessary to model the core and extract the information for the most radioactive spent fuel assemblies. Therefore a stand alone response is required.
  - NINA calculated the radiation dose rate from the highest activity irradiated fuel bundle as follows:

The STP 3 & 4 core is rated at 3926 MWt. It consists of 872 fuel bundles, 320 of which are installed as new assemblies each refueling.  $3926\text{MWt} / 872$  bundles equals a core average of 4.502 MWt per bundle. This average, however, consists of once, twice, and thrice burned bundles.

The highest radiation source is from a fuel bundle in the once-burned batch (also called first batch in Reference 1 of the References for this RAI response; see page 21), as is shown on Appendix Table 12B-5.

The STP 3&4 core design as discussed in Reference 1 (see page 21) indicates that the average burnup of the once-burned batch is approximately 23 GWd/MTU, or 5.703 MWt/bundle. This value is 1.27 times the average per bundle across the entire core.

To conform with the maximum relative assembly power peaking factor of 1.40 for the ABWR as reported in DCD Table 1.3-1, 10% was added to the calculated dose from the once-burned batch of 1.27 times the core average. The net effect is equivalent to using a bundle source at 1.4 times the core average. However, it is noted that the maximum relative assembly power peaking factor of 1.40 corresponds to an 18-month cycle core design. It is expected that a 24-month cycle core would result in a higher peaking factor than for the 18-month cycle core identified in the DCD. Westinghouse experience in the design of the ABWR core indicates a maximum radial peaking factor of 1.65 for a 24-month cycle core.

To ensure an absolute maximum activity bundle is reported, an additional 20% margin was added to the 10% margin, resulting in a bundle source of over 1.65 times the core average. The dose rate at the operating trolley platform from this highest activity fuel bundle, elevated to the maximum up-position in the SFP with water coverage of 8.5 ft (2.6 m) from the top of the fuel assembly active fuel region is approximately 1.2 mrem/hr. This dose rate from the maximum activity bundle with 30% margin added is clearly bounding for any assembly from the 18-month cycle core with a 1.40 peaking factor that will be moved by the refueling operator, and is appreciably below the criteria of 2.5 mrem/hr (25  $\mu$ Sv/hr) stated in ANSI/ANS - 57.1 – 1992, subsection 6.3.4.1.5. The supporting proprietary calculation is discussed in Reference 3 (see page 21). This dose rate, to an operator on the trolley platform at 8.8 ft (2.7 m) above the refueling floor, would be considerably less if credit is given to reduction because of the additional 1 ft (0.3 m) of air space between the water surface and refueling floor, and attenuation through the refueling machine lower structure and platform.

STP 3&4 COLA Part 2, Tier 2, Section 12.4 will be revised as shown below. Gray highlighting shows the changes.

### 12.4.2 Reactor Building Dose

STD DEP 9.1-1

STD DEP Admin

*The following provides the basis by which the Reactor Building dose estimates for occupational exposure were made.*

- (2) ABWR refueling is accomplished via an automated refueling bridge machine. All operations for refueling are accomplished ~~from an enclosed automation center off the refueling floor~~ as described in Section 9.1.4.2.7.1. Time for refueling is reduced from a typical 4,400 person-hours down to 2,000 person-hours and from

*an effective dose rate of 25  $\mu\text{Gy/h}$ / $\mu\text{Sv/h}$  to less than 2  $\mu\text{Gy/h}$ / $\mu\text{Sv/h}$ . The dose rate from the highest activity irradiated fuel bundle elevated to the maximum up-position in the spent fuel pool (SFP) with water coverage of 8.5 ft (2.6 m) from the top of the fuel assembly active fuel was calculated. The dose rate at the refueling machine trolley platform 8.8 ft (2.7 m) above the refueling floor is approximately 1.2 mrem/hr (12  $\mu\text{Sv/hr}$ ). This dose rate of 1.2 mrem/hr (12  $\mu\text{Sv/hr}$ ) is conservative because of the additional 1 ft (0.3 m) of air space between the water surface and refueling floor, and the attenuation through the refueling machine lower structure and platform. Additionally, it is below the criteria of 2.5 mrem/hr from an irradiated fuel unit, control component, or both, as required by ANSI/ANS-57.1-1992. Note that this value does not include dose from radionuclides contained in Spent Fuel Pool water, which is expected to be no greater than 0.7 mrem/hr. at approximately 1.2 meters above the Refueling Floor, based on data from currently operating plants utilizing the ABWR Spent Fuel Pool design. This value takes no credit for attenuation through Refueling Machine construction material or the additional distance to the Refueling Machine trolley platform, which adds additional conservatism.*

**Table 12.2-5a Radiation Sources—Radiation Sources**

Source Table	For	Drawing	Location	Approximate Geometry
Applicant See Appendix 12B	Spent Fuel Storage	12.3-6 12.3-10	(R4,RF) RF	See Drawings <sup>+++</sup> 14.0m x 9.4m x 11.9m deep (pool) 10.7m x 9.0m x 4.5m (fuel racks)  Active Fuel Assembly dimensions: 0.152m (6in) square x 3.8m height

<sup>+++</sup> Applicant to develop spent fuel storage facilities design drawings showing geometry of facilities.

**Table 12.2-5b Radiation Sources—Source Geometry**

Component	Assumed Shielding Source Geometry
Spent Fuel Storage	Applicant <sup>***</sup> Spent fuel source evenly dispersed over volume of racks in the pool

<sup>\*\*\*</sup> Applicant to develop spent fuel storage facilities design drawings showing the shielding source geometry.

Appendix 12B will be added to STP 3&4 COLA, Part 2, Tier 2, as shown below in a future revision. The entire appendix contains gray highlighting to show the changes from COLA Revision 5.



## 12B Spent Fuel Pool Geometry and Dose Rate Calculation

This Appendix provides site-specific information regarding the Spent Fuel Pool (SFP) geometry and methodology used to generate SFP radiation sources and dose rate assessments. This Appendix supplements the SFP radiation source information in Section 12.2, specifically Tables 12.2-5a and 12.2-5b.

The SFP geometry is provided in FSAR Section 12.2, Tables 12.2-5a and 12.2-5b; and FSAR Section 12.3, Figures 12.3-6 and 12.3-10. The SFP storage rack has the capacity for 2365 BWR fuel assemblies. The size and configuration of the storage rack are given in Figure 12B-1, which shows an irregular rectangular cross-section area extended to 10.7 m x 9.0 m. The fuel storage rack is situated at the lowest level of the SFP, where the total height of water is 11.6 m.

### 12B.1 Core Source Determination

The STP 3 & 4 core rated power is 3926 MWt. The core load consists of 872 fuel assemblies, with average enrichment of 4.2%. The reload batch size is 320 fuel assemblies. The equilibrium core is assumed to operate on a two-year fuel cycle, with approximately 704 effective-full-power-days (EFPD) of operation for each cycle. The core is composed of three batches of fuel, with varying residence time and burnup at the end of cycle (EOC). The latest batch of fresh fuel assemblies will be placed at high power density locations during operation and will average 23 GWD/T at EOC. The second oldest batch will have resided in the core for one cycle prior to the current cycle and will have an average of 43 GWD/T at EOC. The oldest batch will have resided in the core for two cycles prior to the current cycle and on average accumulated 51 GWD/T at EOC. Radiation sources of the equilibrium core, as well as the discharge batch, are calculated using the code ORIGEN-S of the SCALE system (Reference 12B.6-1).

In addition to fuel elements, the mass of supporting structural materials is also included in the ORIGEN-S calculations. Therefore the calculated radiation source includes contributions from activation and corrosion products as well as fission products and actinides. In addition, a safety margin of 10% is added to the calculated radiation source, to bound the power peaking factor and uncertainties in structural material specification. The resulting equilibrium core gamma source is shown in Table 12B-1.

### 12B.2 SFP Fuel Source Determination

The SFP radiation source is calculated using the maximum capacity of the storage rack. Under normal operating conditions, the maximum number of fuel assemblies accommodated by the storage rack is 1493, leaving enough room for a full core offload in the event of unexpected operating conditions. The maximum SFP radiation source when the storage rack is filled to its capacity will include the full equilibrium core radiation source conservatively assumed to be at one-day post shutdown plus the sources of existing fuel assemblies in the SFP. The existing fuel assemblies in the SFP are assumed to be the discharged batches from an equilibrium core at decay times of two-



years, four-years, six-years, eight-years, and ten-years. Calculation of these sources has been described in 12B.1 above. Similar to the core radiation source, an extra 10% safety margin is added to the calculated results for conservatism. The resulting SFP peak gamma source and peak neutron source are given in Tables 12B-2 and 12B-3, respectively. The major radionuclides that provide the peak SFP source are listed in Table 12B-4.

### 12B.3 SFP Dose Rate Assessment

The SFP radiation source is used for the shielding design and analysis to ensure radiation levels at neighboring areas surrounding the SFP meet the design criteria. A simplified model of a rectangular parallelepiped of (8.1 m x 8.1 m x 11.2 m) is assumed to represent the SFP. The SFP peak radiation source is assumed to be homogenized over the bottom 3.8 m of the SFP to represent the active fuel length of a typical BWR fuel assembly. There are 2 m thick concrete walls surrounding the SFP on all sides. The floor of the SFP is 2 meters thick as well. The dose rate calculations are carried out with the point-kernel shielding code QAD-CGGP-A (Reference 12B.6-2). The calculated dose rate results indicate all the areas surrounding the SFP meet the reactor building (R/B) radiation zone limits. Figure 12B-2 shows the dose rate profile for a set of detectors along the centerline of the SFP perpendicular to the water surface. Dose rate at the water surface is approximately 0.001  $\mu\text{Rem/hr}$  ( $1\text{E-}5$   $\mu\text{Sv/hr}$ ). The dose rates assessed are due to fuel assemblies in the SFP alone. Contributions from contaminants in the SFP water are not included.

### 12B.4 Single Bundle Refueling Operator Dose Rate Assessment

The maximum calculated radiation dose rate to the refueling operator from a single raised fuel assembly is calculated as follows:

As discussed in 12B.1 above, the core is rated at 3926 MWt. It consists of 872 fuel bundles, 320 of which are installed as new assemblies each refueling.  $3926\text{MWt} / 872$  bundles equals a core average of 4.502MWt per bundle. This average, however, consists of once, twice, and thrice burned bundles.

The core design indicates that the average burnup of the once-burned batch is approximately 23 GWd/MTU, or 5.703 MWt/bundle. This value is 1.27 times the average per bundle across the entire core. To obtain the highest activity bundle for determining the refueling source term, an additional 30% was added to the calculated dose rate from the once-burned batch of 1.27 times the core average. The net effect is equivalent to using a bundle source of 1.65 times the core average for this highest activity fuel assembly. The dose rate is bounding for any assembly that will be moved by the refueling operator. (The calculated gamma source of a single bundle with one-cycle residency is compared with that of three-cycle residency in Table 12B-5, which further confirms that peak source has been chosen for the refueling dose rate assessment.)

Similar to the SFP dose rate assessment, QAD-CGGP-A is used for the single bundle dose rate calculations. Three separate calculations are performed to address the

contributions from the active fuel region, the top fuel node where the power density is lower than the core average, and the assembly handle where it is assumed that majority of the activation products accumulate. The radiation source input for each of these components and the fuel assembly dimensions in the calculation model are presented in Table 12B-6.

It is assumed that the fuel assembly is lifted to a height of 8.5 ft (2.6 m) below the pool water surface with the operator on the refueling machine trolley platform at a minimum of 8.8 ft (2.7 m) above the water surface. The resulting peak dose rate at 8.8 ft (2.7 m) above the water surface is approximately 1.2 mRem/hr, located at a radial distance from the fuel assembly of approximately 140 cm (4.6 ft) as shown in Figure 12B-3. Even when the maximum fuel pool water source (see Section 12B.5 below) is added, the dose rate remains below 2.5 mRem/hr. For an operator standing on the trolley platform, the dose rate will be less than that shown in Figure 12B-3; therefore the design criteria of ANSI/ANS-57.1-1992 has been satisfied.

## 12B.5 Spent Fuel Pool Radionuclides and Dose

The Fuel Pool Cooling and Cleanup (FPC) system described in FSAR Subsections 9.1.3 and 12.3.1.4.3 maintains the SFP water at a low radioactive nuclide level. In support of this statement, representative data from an operating ABWR plant is presented. Measurements at 1.2 m above the refueling floor indicate a maximum of 0.007 mSv/hr (0.7 mrem/hr) during plant outages with 1) fuel assemblies fully seated in the storage racks, and 2) maximum levels of measured radionuclides in the SFP water. This maximum dose rate is measured at 1.2 m (3.9 ft) above the refueling floor. During routine operations, the dose rate is expected to be less for normal operation of the FPC system. Also, the dose rate is considerably less at the operating trolley platform due to the increased distance from 1.2 m (3.9 ft) to 2.7 m (8.8 ft) and attenuation through the refueling machine lower structure and platform. A listing of SFP water radionuclides for a representative ABWR is summarized in Table 12B-7.

## 12B.6 References

- 12B.6-1 NUREG/CR-0200, "ORIGEN-S: SCALE System Module to Calculate Fuel Depletion, Actinide Transmutation, Fission Product Buildup and Decay, and Associated Radiation Source Terms," Rev 7, May 2004.
- 12B.6-2 CCC-645, "QAD-CGGP-A: Point Kernel Code System for Neutron and Gamma-Ray Shielding Calculations Using the GP Buildup Factor," Oak Ridge National Laboratory, December 1995.
- 12B.6-3 CN-REA-10-53, "STP Units 3 & 4 ABWR Spent Fuel Pool Radiation Source", Revision 1, Westinghouse Electric Company LLC, December 15, 2010.

**Table 12B-1: Gamma Source\* of an Equilibrium Core vs. Time Post-Shutdown**

Energy Range (MeV)	Gamma Source (MeV/s-MW)	
	1-Day	30-Day
0.02 - 0.035	1.4E+14	2.7E+13
0.035 - 0.05	1.3E+14	3.2E+13
0.05 - 0.075	1.1E+14	2.6E+13
0.075 - 0.125	1.6E+15	5.5E+13
0.125 - 0.175	4.5E+14	1.2E+14
0.175 - 0.25	1.0E+15	3.6E+13
0.25 - 0.40	1.9E+15	1.4E+14
0.40 - 0.90	1.1E+16	3.9E+15
0.90 - 1.35	1.5E+15	2.1E+14
1.35 - 1.80	3.4E+15	6.9E+14
1.80 - 2.20	2.5E+14	5.3E+13
2.20 - 2.60	2.5E+14	5.1E+13
2.60 - 3.00	4.9E+12	1.1E+12
3.00 - 3.50	1.9E+12	4.5E+11
3.50 - 4.00	1.3E+10	3.3E+07
4.00 - 4.50	2.1E+09	2.5E+06
4.50 - 5.00	1.8E+10	1.6E+06
5.00 - 10.00	1.3E+08	2.8E+06
<b>Total</b>	<b>2.2E+16</b>	<b>5.4E+15</b>

\* Based on rated power 3926 MWt and approximately 704 effective-full-power-days (EFPD) of operation each cycle. 10% safety margin added to ORIGEN-S results.

**Table 12B-2: SFP Peak Gamma Source (MeV/s) vs Time Post-Shutdown**

Energy Group	Energy Range (MeV)	1-Day	1-Year	2-Year
1	0.02 - 0.035	5.5E+17	3.9E+16	2.5E+16
2	0.035 - 0.05	5.1E+17	4.1E+16	2.3E+16
3	0.05 - 0.075	4.5E+17	4.1E+16	2.4E+16
4	0.075 - 0.125	6.2E+18	8.5E+16	5.1E+16
5	0.125 - 0.175	1.8E+18	8.3E+16	4.1E+16
6	0.175 - 0.25	3.9E+18	5.6E+16	3.2E+16
7	0.25 - 0.40	7.4E+18	1.2E+17	6.8E+16
8	0.40 - 0.90	4.5E+19	3.6E+18	2.5E+18
9	0.90 - 1.35	6.0E+18	2.1E+17	1.5E+17
10	1.35 - 1.80	1.3E+19	8.3E+16	5.1E+16
11	1.80 - 2.20	9.9E+17	4.7E+16	2.0E+16
12	2.20 - 2.60	9.7E+17	4.1E+15	2.0E+15
13	2.60 - 3.00	1.9E+16	7.3E+14	3.6E+14
14	3.00 - 3.50	7.6E+15	1.0E+14	5.1E+13
15	3.50 - 4.00	5.2E+13	1.1E+11	7.0E+10
16	4.00 - 4.50	8.4E+12	2.4E+10	2.3E+10
17	4.50 - 5.00	6.9E+13	1.6E+10	1.5E+10
18	5.00 - 10.00	5.4E+11	2.7E+10	2.5E+10
<b>Total</b>		<b>8.8E+19</b>	<b>4.4E+18</b>	<b>3.0E+18</b>

Note: The data represent one full core offload plus existing pool batches. 10% safety margin is added.

**Table 12B-3: SFP Peak Neutron Source**

Energy Group	Neutron Energy (KeV)	(n/s) 1-Day Post-Shutdown
1	1.0E-08 – 1.0E-05	1.0E-02
2	1.0E-05 – 3.0E-05	8.0E-03
3	3.0E-05 – 5.0E-05	1.4E-00
4	5.0E-05 – 1.0E-04	1.2E-00
5	1.0E-04 – 2.25E-04	9.5E+00
6	2.25E-04 – 3.25E-04	8.7E+00
7	3.25E-04 – 4.0E-04	7.9E+00
8	4.0E-04 – 8.0E-04	5.1E+01
9	8.0E-04 – 1.0E-03	2.7E+01
10	1.0E-03 – 1.13E-03	2.6E+01
11	1.13E-03 – 1.3E-03	3.1E+01
12	1.3E-03 – 1.77E-03	9.7E+01
13	1.77E-03 – 3.05E-03	3.3E+02
14	3.05E-03 – 0.01	2.9E+03
15	0.01 – 0.03	1.5E+04
16	0.03 – 0.1	9.3E+04
17	0.1 – 0.55	1.3E+06
18	0.55 – 3.0	1.7E+07
19	3.0 – 17.0	2.3E+08
20	17.0 – 100.0	3.2E+09
21	100 – 400	2.1E+10
22	400 – 900	4.7E+10
23	900 – 1400	4.7E+10
24	1400 – 1850	3.8E+10
25	1850 – 3000	7.2E+10
26	3000 – 6430	6.5E+10
27	6430 – 2.0E+04	5.9E+09

Note: The data represent one full core offload plus existing pool batches. 10% safety margin is added.

**Table 12B-4: Peak Source Radioisotopes in the Spent Fuel Assemblies**

Isotopes	Curies	Isotopes	Curies
I-131	1.07E+08	Sr-92	3.25E+05
I-132	1.36E+08	Y-91	1.46E+08
I-133	1.09E+08	Y-91M	1.56E+07
I-134	6.20E+00	Y-92	4.81E+06
I-135	1.79E+07	Y-93	3.35E+07
<b>Total I</b>	<b>3.71E+08</b>	Zr-93	3.78E+02
		Zr-95	2.02E+08
Na-24	3.19E+03	Nb-95M	2.24E+06
P-32	3.16E+04	Nb-95	1.99E+08
Cr-51	1.76E+07	Mo-99	1.67E+08
Mn-54	7.62E+05	Tc-99M	1.60E+08
Mn-56	6.13E+04	Tc-99	2.61E+03
Fe-55	6.38E+06	Ru-103	1.75E+08
Fe-59	3.88E+05	Rh-103M	1.75E+08
Co-58	9.22E+05	Ru-106	6.63E+07
Co-60	1.54E+05	Rh-106	6.63E+07
Ni-63	1.71E+05	Ag-110M	3.50E+05
Cu-64	1.59E+04	Ag-110	4.77E+03
Zn-65	3.70E+01	Te-129M	5.68E+06
Sr-89	1.11E+08	Te-129	5.21E+06
Sr-90	1.51E+07	Te-131M	1.44E+07
Y-90	1.55E+07	Te-131	2.89E+06
Sr-91	2.46E+07	Te-132	1.32E+08
<b>Total</b>	<b>1.93E+08</b>	Ba-137M	1.89E+07
		Ba-140	1.93E+08
Kr-83m	6.41E+04	La-140	2.06E+08
Kr-85m	7.52E+05	Ce-141	1.90E+08
Kr-85	1.89E+06	Ce-144	1.61E+08
Kr-87	1.27E+02	Pr-144M	2.25E+06
Kr-88	2.30E+05	Pr-144	1.61E+08
<b>Total Kr</b>	<b>2.94E+06</b>	W-187	1.91E+05
		Np-239	1.65E+09
Xe-131m	1.25E+06	Pu-239	5.03E+04
Xe-133m	6.63E+06	<b>Total</b>	<b>4.16E+09</b>
Xe-133	2.28E+08		
Xe-135m	2.92E+06	Cs-134	2.65E+07
Xe-135	5.84E+07	Cs-135	8.82E+01
<b>Total Xe</b>	<b>2.98E+08</b>	Cs-136	5.21E+06
<b>Noble Gas Totals</b>	<b>3.00E+08</b>	Cs-137	2.01E+07
		<b>Total Cs</b>	<b>5.18E+07</b>

Note: The data represent one full core offload plus existing pool batches. 10% safety margin is added.



**Table 12B-5 Single Bundle Gamma Source (MeV/s) Comparison**

Decay Time	Once Burned	Thrice Burned
1 Day	1.1E+17	5.8E+16
30 Days	2.6E+16	1.5E+16
1 Year	2.1E+15	3.6E+15
2 Years	1.0E+15	2.4E+15
3 Years	7.0E+14	1.8E+15


**Table 12B-6 Single Bundle Source for Dose Assessment (Photons/s)**

Energy Group	Energy Range (MeV)	Enriched Fuel Region	Top Node	Handle
1	0.02 - 0.035	2.5E+16	1.9E+14	6.0E+13
2	0.035 - 0.05	1.5E+16	1.1E+14	7.4E+12
3	0.05 - 0.075	8.4E+15	7.0E+13	8.7E+12
4	0.075 - 0.125	7.0E+16	1.1E+15	7.4E+12
5	0.125 - 0.175	1.6E+16	1.1E+14	2.2E+13
6	0.175 - 0.25	2.2E+16	2.7E+14	3.4E+12
7	0.25 - 0.40	2.8E+16	3.2E+14	3.5E+13
8	0.40 - 0.90	8.7E+16	6.4E+14	4.8E+14
9	0.90 - 1.35	6.0E+15	4.2E+13	1.6E+13
10	1.35 - 1.80	1.1E+16	8.0E+13	1.6E+12
11	1.80 - 2.20	4.9E+14	3.4E+12	4.2E+11
12	2.20 - 2.60	5.4E+14	3.7E+12	1.2E+10
13	2.60 - 3.00	8.9E+12	6.6E+10	5.5E+10
14	3.00 - 3.50	3.2E+12	2.2E+10	1.6E+09
15	3.50 - 4.00	2.1E+10	1.3E+08	2.5E+07
16	4.00 - 4.50	3.1E+09	1.7E+07	1.7E+04
17	4.50 - 5.00	2.3E+10	1.3E+08	1.3E+05
18	5.00 - 10.00	1.1E+08	6.0E+05	6.0E+02
<b>Total</b>		<b>2.9E+17</b>	<b>2.9E+15</b>	<b>6.4E+14</b>
<b>Source Height (cm)*</b>		<b>366</b>	<b>15</b>	<b>15</b>

\* Bundle cross-section is 15.24 cm x 15.24 cm (6 in x 6 in).

Table 12B-7 SFP Water Radionuclides

Nuclide	Bq/cm <sup>3</sup>	Nuclide	Bq/cm <sup>3</sup>
Cr-51	9.4E-02	Nb-95	8.1E-03
Mn-54	9.7E-02	Cs-134	1.4E-02
Mn-56	3.6E-02	Cs-137	7.7E-03
Co-58	5.1E-01	Sb-124	5.1E-01
Co-60	1.3E+00	Sb-125	3.4E-02
Cu-64	1.0E-01		

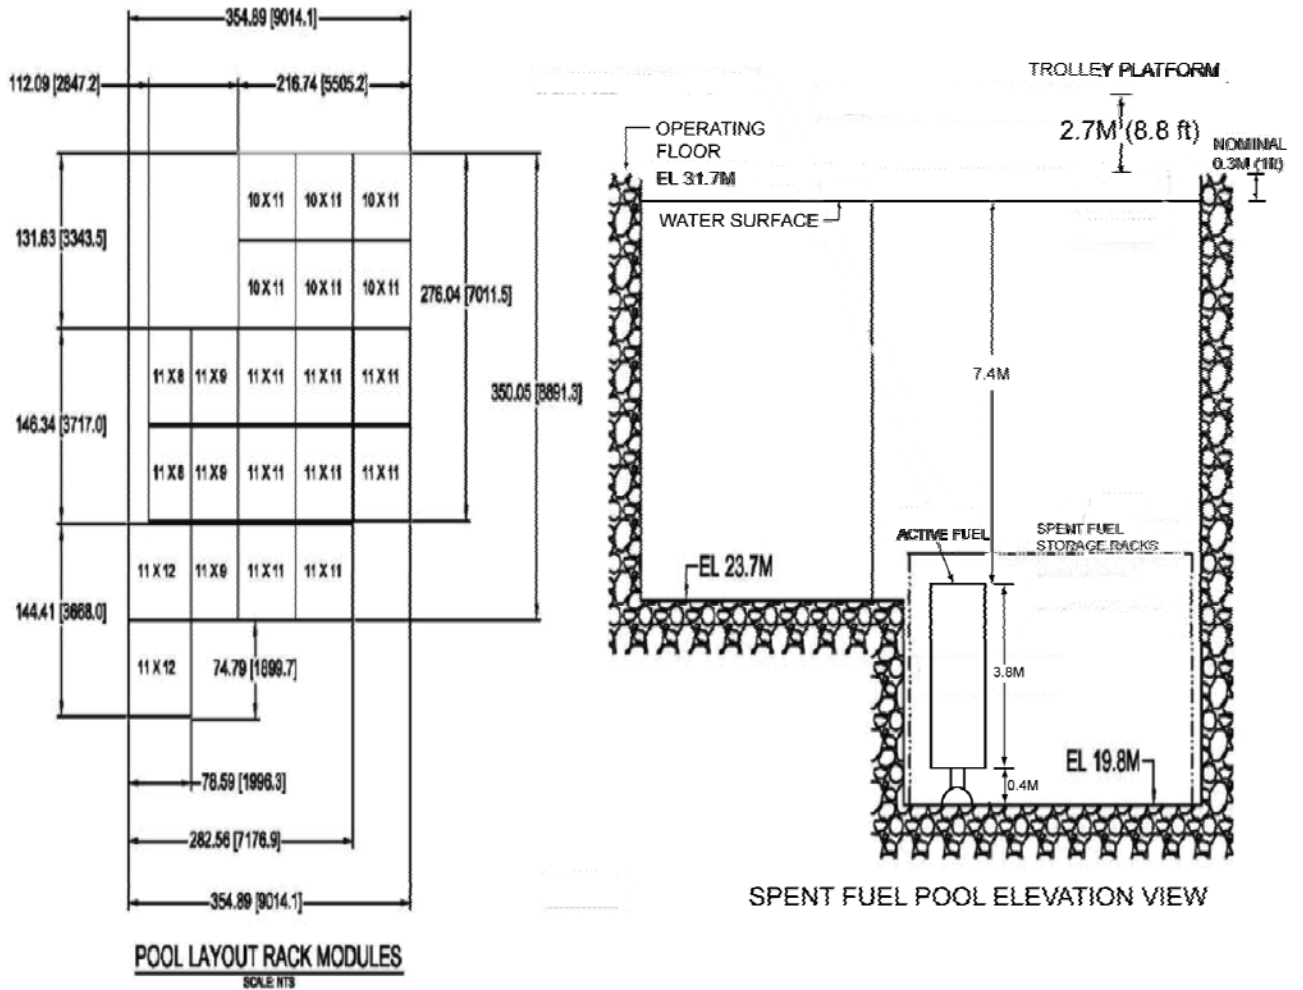

NOTE: DESIGN DIMENSIONS ARE IN INCHES.  
DIMENSIONS IN BRACKETS [ ] ARE A REFERENCE MILLIMETER EQUIVALENT.

Figure 12B-1 SFP Layout and Dimensions


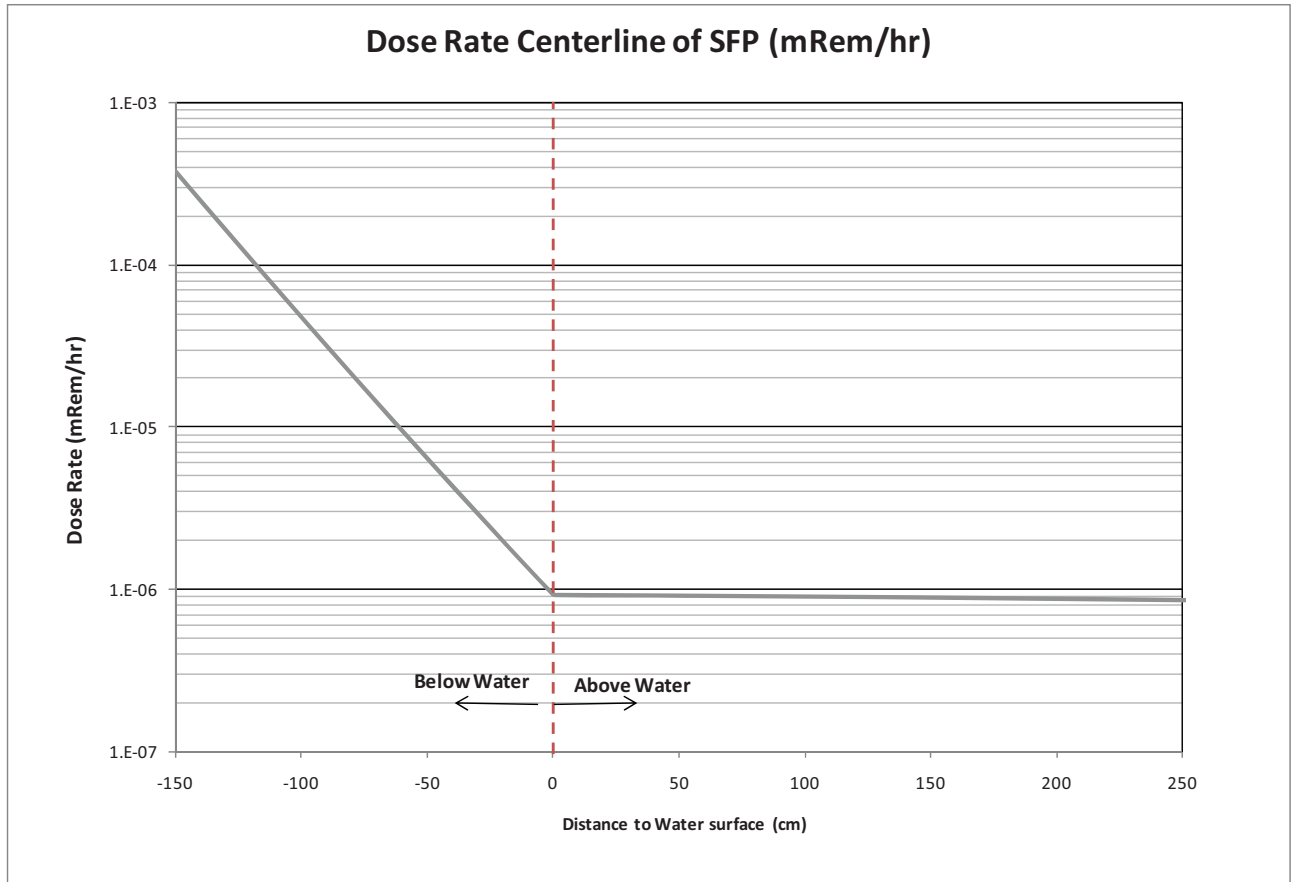


Figure 12B-2 SFP Centerline Dose Rate

**Total Dose Rate\* From a Single Bundle in the SFP  
at Platform level = 8.5 feet (water) + 8.8 feet**

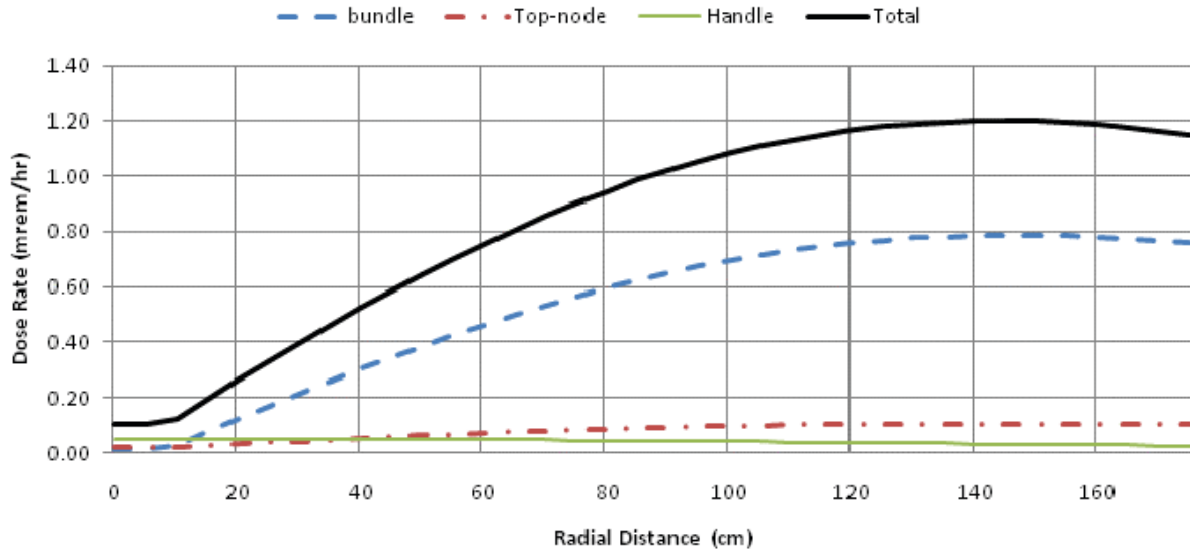

\* 30% safety margin is added

**Figure 12B-3 Maximum Single Bundle Dose Rate at Refueling Platform**

4. The STP 3&4 Operational Radiation Protection Program is addressed in the FSAR. Specifically, in Section 12.5S, Nuclear Energy Institute Report NEI 07-03A, “Generic FSAR Template Guidance for Radiation Protection Program Description” and NEI 07-08A, “Generic FSAR Template Guidance for Ensuring that Occupational Radiation Exposures are as Low as is Reasonably Achievable (ALARA),” are incorporated by reference. The guidance contained in these two documents will be used to develop and implement the Radiation Protection and ALARA programs for STP 3&4, including refueling and spent fuel handling activities.

NEI 07-03A provides the following sections that include guidance for procedures addressing shielding and dose to workers:

- Section 12.5.4.1 “Radiological Surveillance”
- Section 12.5.4.2 “Methods to Maintain Exposures ALARA”
- Section 12.5.4.4 “Access Control”
- Section 12.5.4.5 “Radiation Work Permits”
- Section 12.5.4.6 “Personnel Monitoring”
- Section 12.5.4.7 “Dose Control”
- Section 12.5.4.9 “Respiratory Protection”
- Section 12.5.4.11 “Radiation Protection Training”

NEI 07-08A provides the following guidance for ensuring that occupational radiation exposures are ALARA in Section 12.1.3:

- Radiation protection training, the radiation protection plan, the RWP system, and procedure reviews all help to ensure that radiation exposure of personnel is maintained ALARA. The following examples illustrate the incorporation of ALARA work practices.
- Personnel required to be monitored for radiation exposure in accordance with 10 CFR 20.1502 are assigned TLDs to establish exposure history.
- Workers are provided with direct-reading dosimeters on jobs, so that the worker can determine accumulated exposure at any time during a job.
- Dose rate meters are used as needed to identify elevated dose rates.
- Pre-job briefs are used to review radiological surveys and to plan work before personnel enter a radiation area. Written procedures provide guidelines regarding the amount of detail to be included in the pre-job briefings.
- For work involving high radiation areas, high collective doses, high levels of removable contamination relative to site posting criteria for contamination areas, or known or suspected airborne radioactivity areas.



- Work is preplanned to minimize personnel exposure as defined in ALARA program procedures.
  - Radiation protection personnel provide coverage as required by radiation protection procedures.
  - On complex jobs in high radiation areas, dry-run training may be utilized. In some cases, mockups are used to familiarize workers with the operations that they are to perform. These techniques are beneficial to improving worker efficiency and minimizing the amount of time spent in the radiation field.
  - As practical, work area entry and exit points are established in areas with low radiation levels. This is done to minimize dose accumulated while changing.
  - Protective clothing and respiratory equipment: Control points are also established to minimize the spread of removable contamination from the job site.
  - Individuals working in radiologically controlled areas are trained to be aware of the varying intensities of radiation fields within the general vicinity of their job locations, and are instructed to remain in the areas of lower radiation levels as much as possible, consistent with performing their assigned tasks.
  - For high radiation area jobs, maps, postings, and/or detailed instructions are provided to clearly delineate the source of radiation or to alert personnel concerning the location of elevated dose rates. Provided with this information, workers will be cognizant of their immediate radiological environment and will minimize their stay times in areas of elevated dose rates, thus maintaining exposures ALARA.
  - Protective clothing and respiratory equipment prescribed by radiation protection personnel are commensurate with the radiological hazards involved. These requirements cannot be modified without the permission of radiation protection personnel. Consideration is given to the discomfort of workers to minimize the effect of protective efforts on efficiency and the time spent in a radiation area.
  - Special tools or jigs are used on jobs when their use permits the job to be performed more efficiently or prevents errors, thus reducing the time spent in a radiation area.
  - Where applicable, special tools are used to increase the distance from the source to the worker, thereby reducing the exposure received.
  - Consideration is given to the use of remote monitoring of personnel with various combinations of audio, visual, and dose information to reduce exposure of personnel. Direct communications (e.g., radios) may be used to further enhance radiation protection.
  - Permanent shielding is used, where practicable, to reduce radiation exposure at the work site and in designated "waiting areas" for personnel during periods when they are not actively involved in the work.
  - On some jobs, temporary shielding such as lead sheets draped or strapped over a pipe or concrete blocks stacked around a piece of equipment is used. Temporary shielding is used only if the estimated total exposure, which includes exposure received during installation and removal, is reduced. Experience with such operations is used in developing guidelines in this area.

These program components are discussed primarily in FSAR Sections 12.3, 12.5, 12.5S, 13.1, and 13.2, and elsewhere throughout the FSAR.

Specifically, for fuel handling in the SFP area, this RAI requests information regarding shielding, a description of how operating procedures will be used to ensure doses are kept ALARA, and a description of design features/access controls that will be used to limit the dose rate to individuals working in the SFP area.

The above discussion of the STP 3&4 Operational Radiation Protection Program fully addresses procedures to ensure doses are kept ALARA.

As discussed in the response to 3. above, the 8.5 ft (2.6 m) water cover from the top of the active maximum irradiated bundle is sufficient to ensure the dose rate to refueling operators is less than 2.5 mrem/hr. Note that administrative controls will require temporary shielding as warranted to maintain doses ALARA. However, installation of additional shielding to the refueling machine is not warranted. An improvement over some other machines is that the operator locally controls motion of the bridge trolley, and all hoists and grapples at the trolley platform as opposed to operation of auxiliary hoists from the lower height bridge. Access control, monitoring, and stay times for personnel in the refueling area will be procedurally controlled with radiation work permits (RWPs) required as also discussed above.

Another design provision in addition to the shielding, automated refueling handling machine, radiation monitoring and alarms, and controls is the design of the Fuel Pool Cooling and Cleanup (FPC) system described in FSAR Subsections 9.1.3 and 12.3.1.4.3. This system reduces radiation dose rates and further clarifies water for increased visibility, thus reducing worker stay time for fuel movement activities. FSAR Table 12.2-16 reflects the radionuclide removal capability of the FPC demineralizers.

No COLA change is required as a result of this response.

5. ABWR DCD Tier 2 Figure 12.3-6, Reactor Building Radiation Zone Map for Full Power & Shutdown Operation at Elevation 18100mm and Figure 12.3-10, Reactor Building Radiation Zone Map for Full Power and Shutdown Operation, Section A-A, provide the radiation zone maps for areas adjacent to the SFP. NINA has calculated the radiation dose rates in these areas by modeling the 270% full core loading in close proximity to the SFP walls for a conservative dose rate to the adjacent rooms. The dose rates were calculated using the point-kernel code, QAD, with a concrete wall thickness of 2 m consistent with DCD Table 12.2-5c, with results as follows. The calculated values were increased by 10% to provide an added safety margin. The supporting proprietary calculation is referenced below as Reference 2.

<b>Room/Area</b>	<b>DCD Figure</b>	<b>Location</b>	<b>DCD Zone Dose Rate</b>	<b>Calculated Dose Rate</b>
Stairwell Large Component Hatch	12.3-6	R5, RF	<5 mrem/hr (< 50 μSv/h)	< 0.71 mrem/hr
Miscellaneous Electrical Component Area	12.3-6	R3, RF	<5 mrem/hr (< 50 μSv/h)	< 0.36 mrem/hr
Below SFP (FCS Room, Penetration Room, Upper Drywell).	12.3-10	RE, RF, RG	<5 mrem/hr (< 50 μSv/h)	< 0.35 mrem/hr

The above results demonstrate that the dose rates in rooms/areas adjacent to the SFP are bounded by those given in the DCD.

No COLA change is required as a result of this response.

#### References for RAI 12.02-20 Response

The following references support information provided in this response and can be made available for NRC review upon request.

1. CN-REA-10-53, Revision 1, STP Units 3&4 ABWR Spent Fuel Pool Radiation Source, Wang S., December 15, 2010.
2. CN-REA-10-64, Revision 0, STP Units 3&4 ABWR Spent Fuel Pool Dose Rates, Wang S., October 15, 2010.
3. CN-REA-10-67, Revision 0, Dose Rate Evaluation from a Single ABWR Fuel Bundle in STP Units 3&4 Spent Fuel Pool, Song, P., October 10, 2010.
4. U7-RB-M-SPEC-RFM-0001. STP Units 3&4 Equipment Requirement Specification for Refueling Machine, Revision B, Filing Number RS-5129772, December 26, 2008.