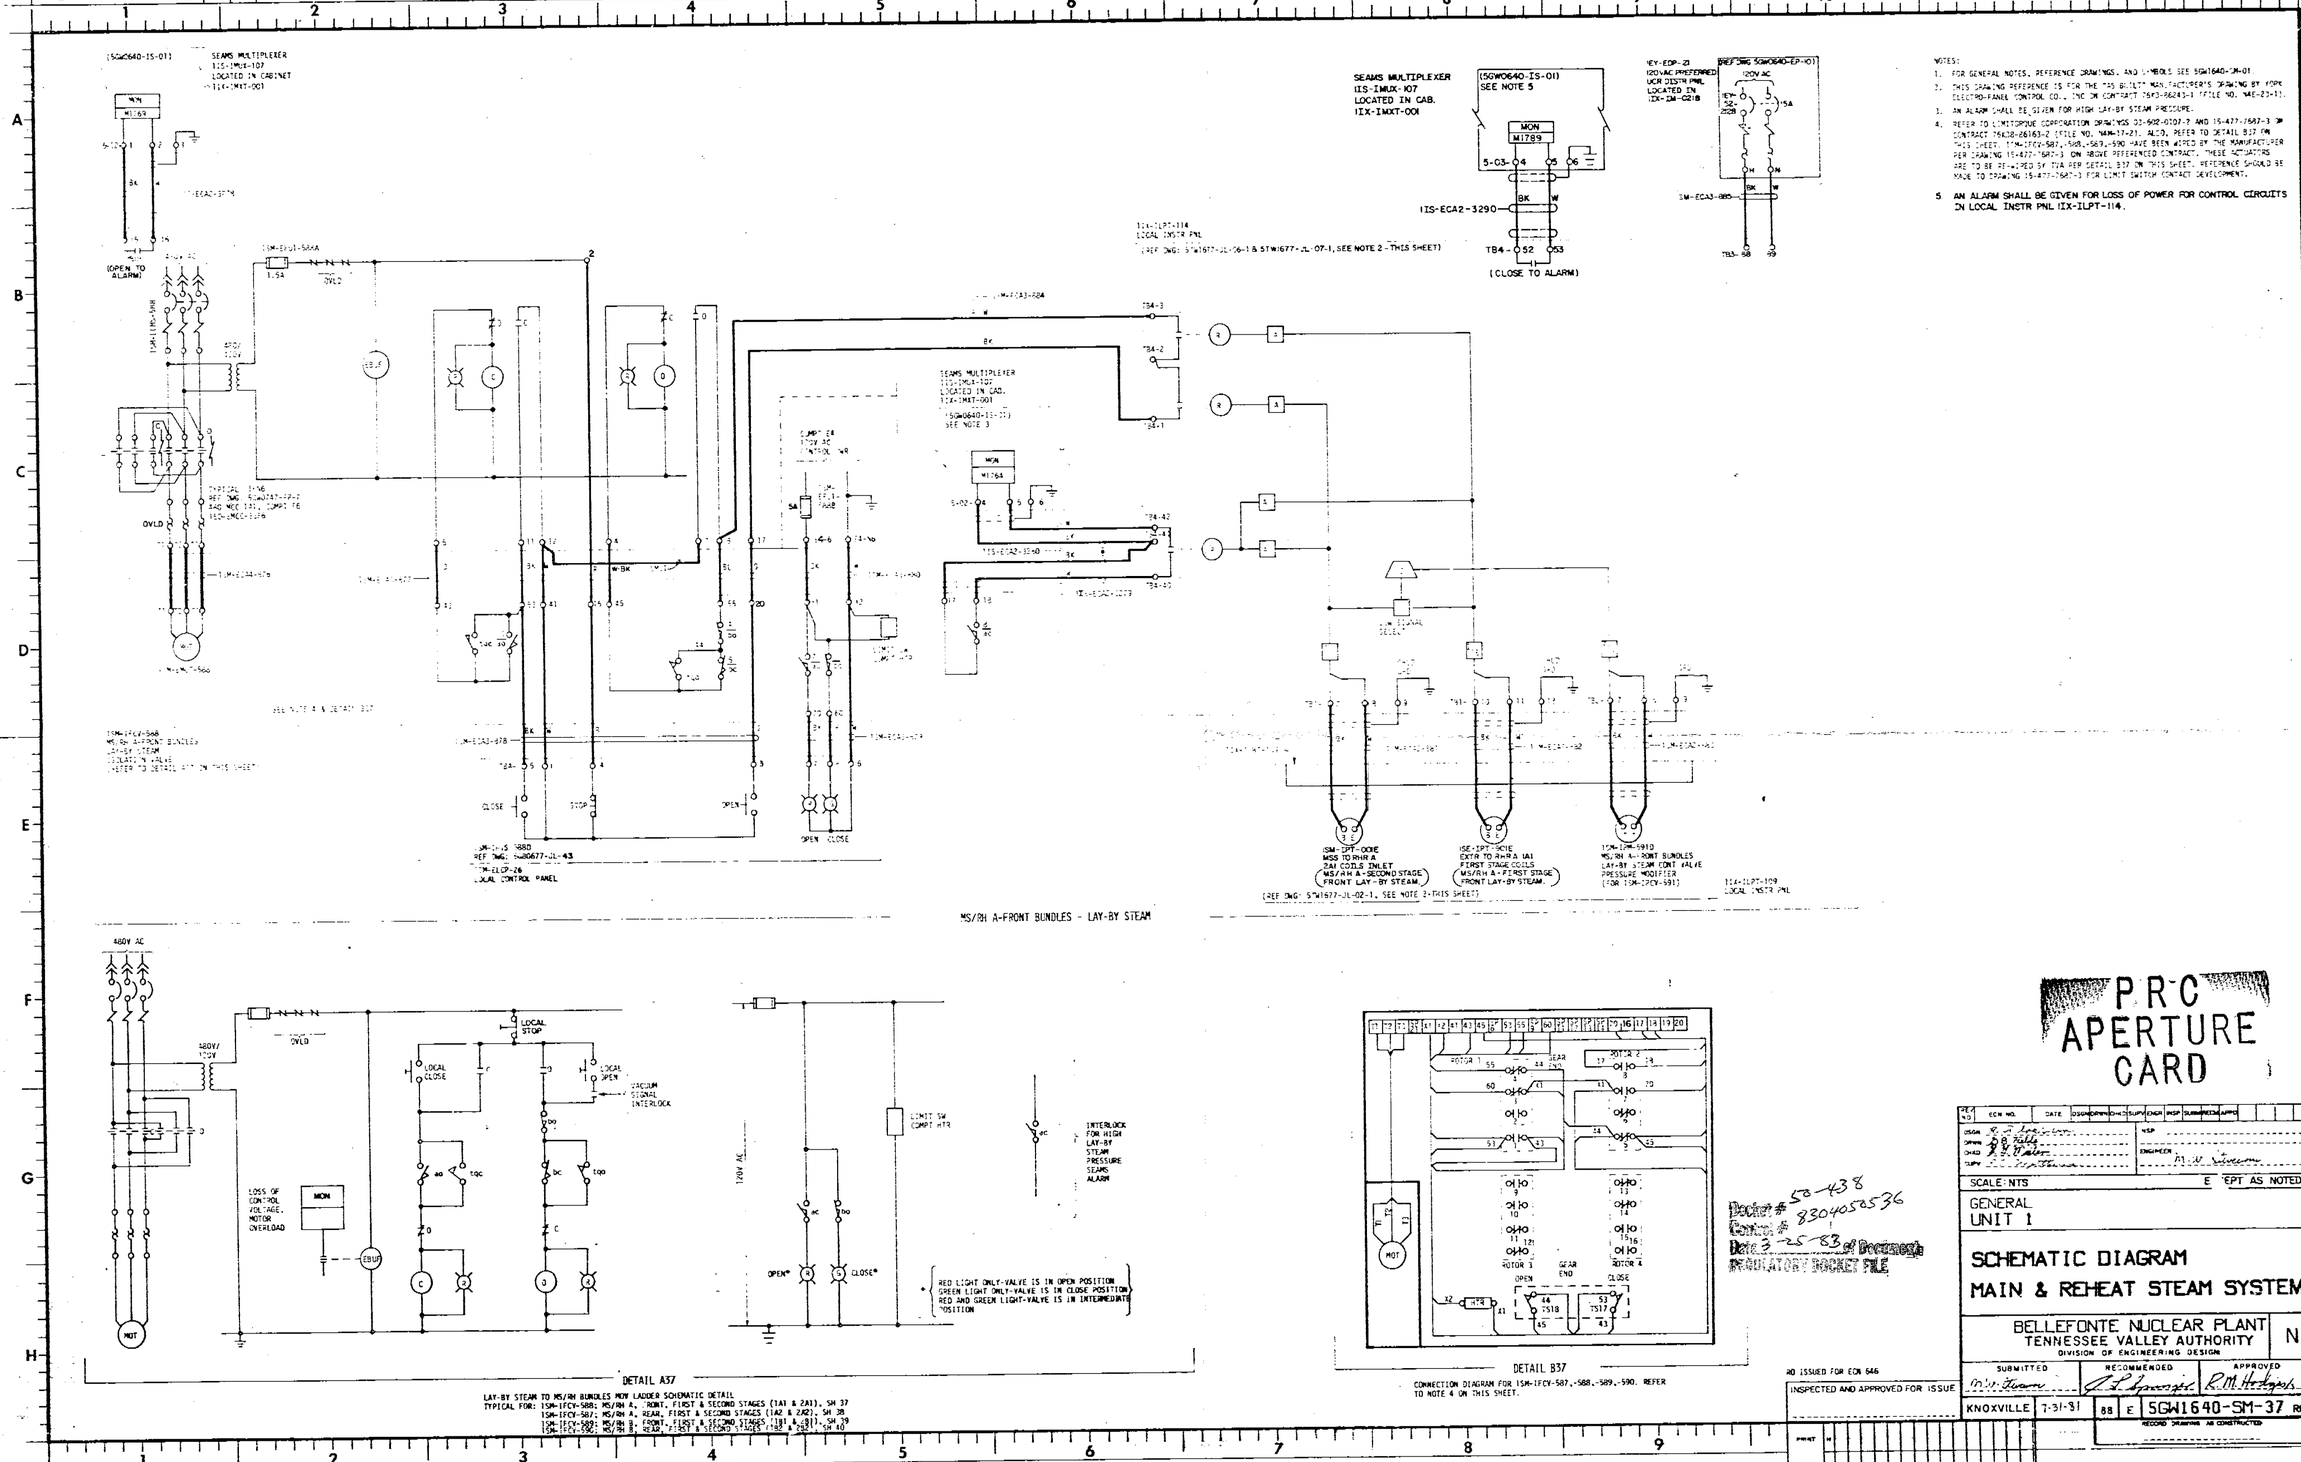
SEAMS MULTIPLEXER
1IS-IMUX-107
LOCATED IN CABINET
1IX-IMXT-001
(5GW0640-IS-01)
SEE NOTE 5
MON
M1789
1IS-ECA2-3290
TB4-52
TB4-53
(CLOSE TO ALARM)
1EY-EDP-21
120VAC PREFERRED
UCR DISTR PNL
LOCATED IN
1DX-2M-0218
120V AC
1M-ECA3-880
TB3-58
TB3-59
(OPEN TO ALARM)
OVLD
1SM-IFCV-588
MS/RH A-FRONT BUNDLES
LAY-BY STEAM
ISOLATION VALVE
(REFER TO DETAIL B37 ON THIS SHEET)
1SM-IFCV-587
MS/RH A-REAR
LAY-BY STEAM
ISOLATION VALVE
(REFER TO DETAIL B37 ON THIS SHEET)
1SM-IFCV-589
1SM-IFCV-590
1SM-IFCV-591
1SM-IFCV-592
1SM-IFCV-593
1SM-IFCV-594
1SM-IFCV-595
1SM-IFCV-596
1SM-IFCV-597
1SM-IFCV-598
1SM-IFCV-599
1SM-IFCV-600
1SM-IFCV-601
1SM-IFCV-602
1SM-IFCV-603
1SM-IFCV-604
1SM-IFCV-605
1SM-IFCV-606
1SM-IFCV-607
1SM-IFCV-608
1SM-IFCV-609
1SM-IFCV-610
1SM-IFCV-611
1SM-IFCV-612
1SM-IFCV-613
1SM-IFCV-614
1SM-IFCV-615
1SM-IFCV-616
1SM-IFCV-617
1SM-IFCV-618
1SM-IFCV-619
1SM-IFCV-620
1SM-IFCV-621
1SM-IFCV-622
1SM-IFCV-623
1SM-IFCV-624
1SM-IFCV-625
1SM-IFCV-626
1SM-IFCV-627
1SM-IFCV-628