


HAR COL 2.4-3


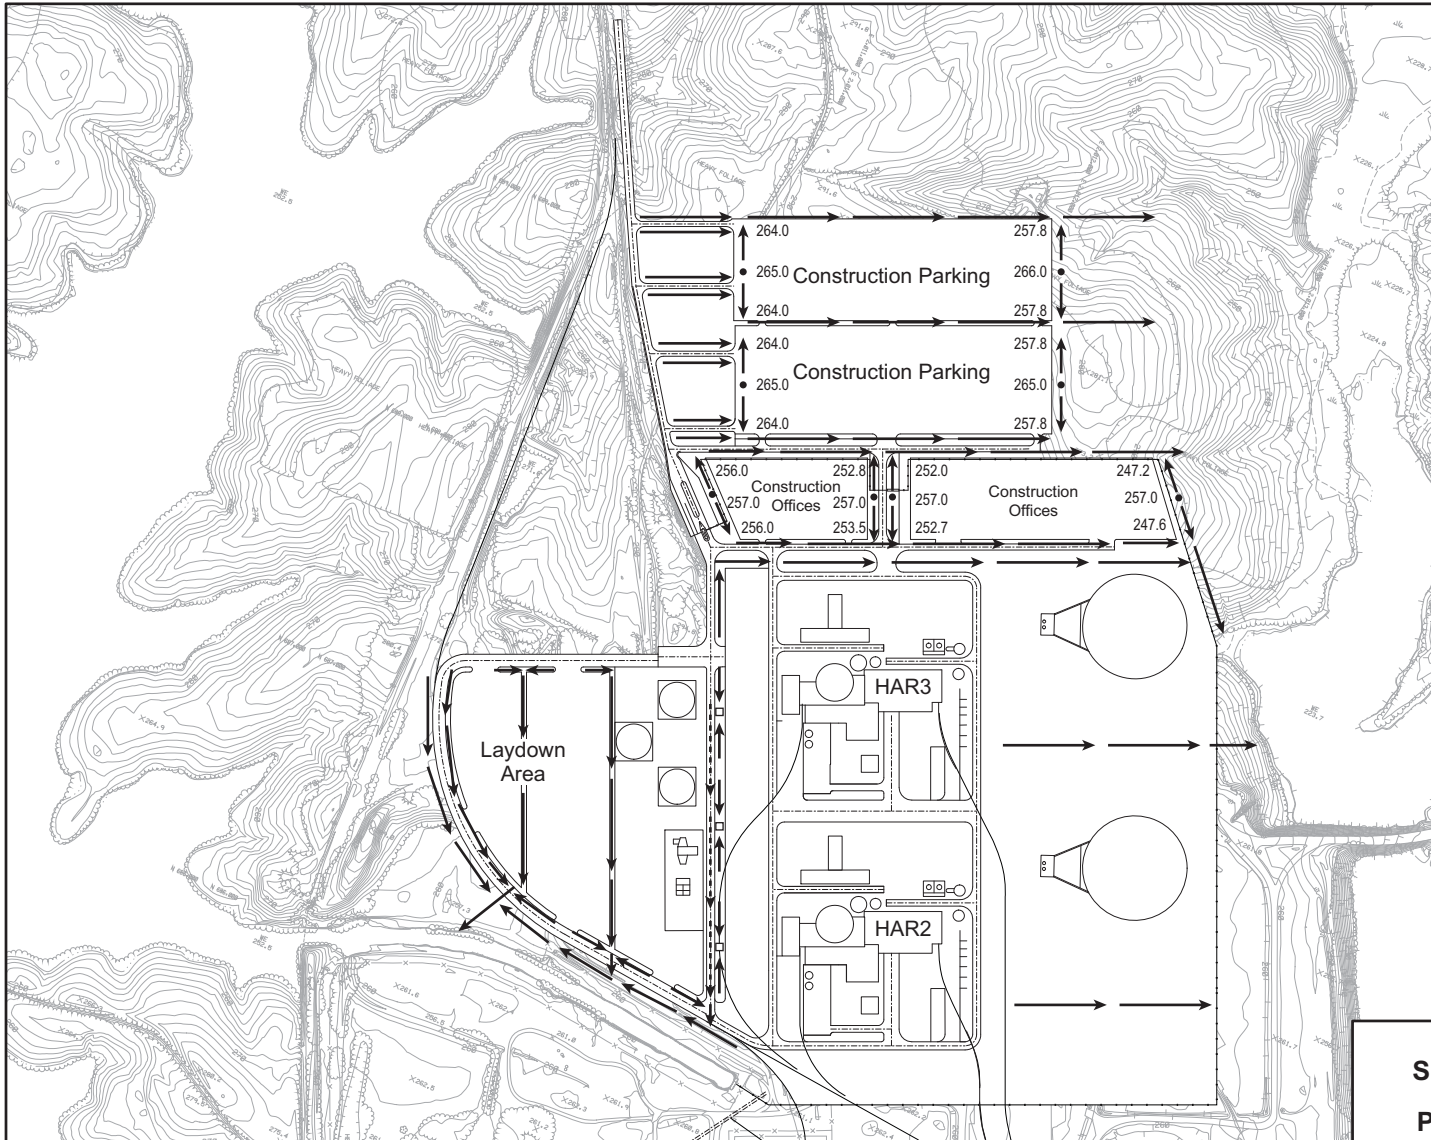


LEGEND

- Direction of Surface Water Flow
- - - - -→ Direction of Piped Water Flow
- Ditch High Point
- Ditch Drop Inlet
- 266.0 Ditch Elevation (feet NGVD29)

NOTES

1. HAR 2 and HAR 3 proposed nominal grade elevation is 260-feet NGVD29.
2. Area surfacing will consist of crushed stone in contractor parking, laydown areas, and equipment areas.
3. All plant roads and entrance roads will be asphalt paved.
4. Stormwater Drainage Ditches slope at 0.5 feet per 100 feet.



Progress Energy Carolinas
**Shearon Harris Nuclear Power Plant
 Units 2 and 3**
Part 2, Final Safety Analysis Report
 New Hill, North Carolina

Site Drainage Map with HAR2 and HAR3

FIGURE 2.4.1-205