



NITROGEN GAS COMPRESSOR 003 INLET PRESS., CWG-IPT-121

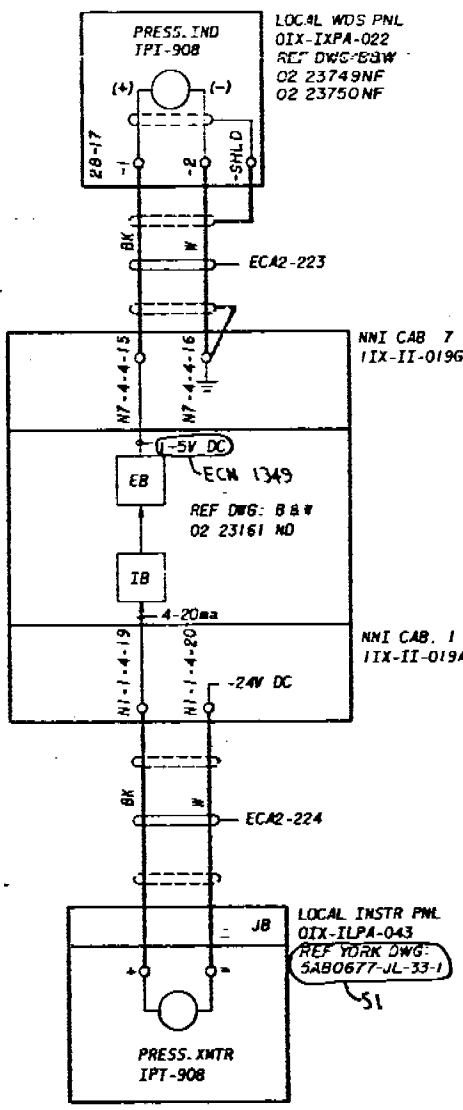

TRITIATED AUX BLDG SUMP TK PUMPS 008,009 DISCH PRESS,IPT-908

PLANT DISCH OUTLET FLOW, IFT-904

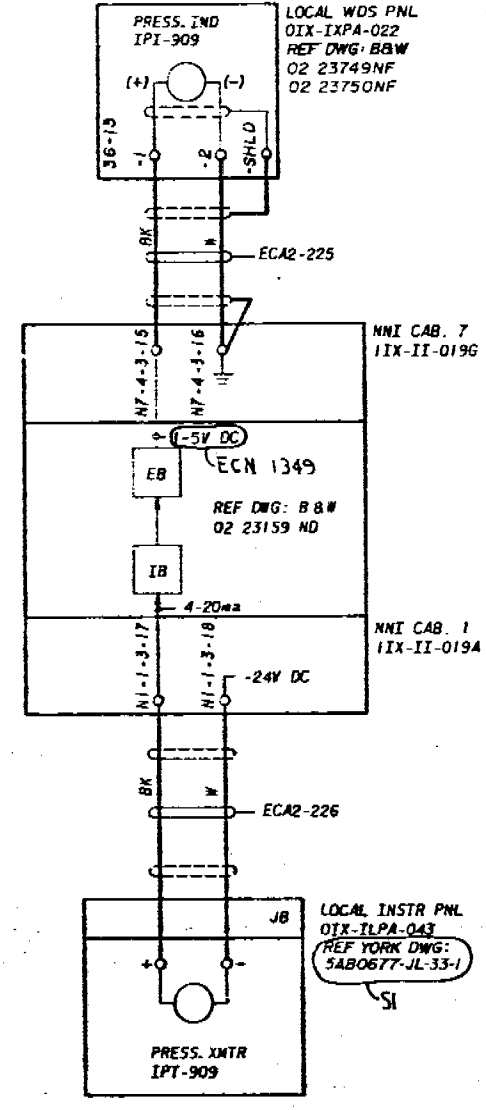

NON-TRITIATED AUX BLDG SUMP TK PUMPS 010,011 DISCH PRESS,IPT-909

WASTE GAS COMPRESSORS INLET PRESS.,CWG-IPT-094

NOTES:
1. FOR GENERAL NOTES AND SYMBOLS, SEE SGW0740-WD-01

PRC APERTURE CARD

Sheet # 30-138
Control # 82040523C
Date 3-25-83
REGULATORY DOCKET FILE

REVISIONS TABLE with columns for REV NO, DATE, DESCRIPTION, and initials.

Engineering drawing header table containing drawing title (SYSTEM SCHEMATIC WASTE DISPOSAL SYSTEM), project name (BELLEFONTE NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY), drawing number (88E SGW0740-WD-19), and revision control table.