




LOCAL WDS PNL
OIX-IXPA-022
REF DWG: 02 23749 NF
BBW 02 23751 NF

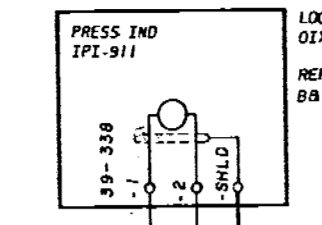


LOCAL WDS PNL
OIX-IXPA-022
REF DWG: 02 23749 NF
BBW 02 23751 NF

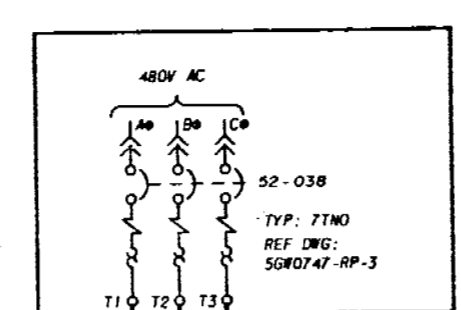


480V MCC SKF3
COMPT E2(R)
1ED-EMCC-57E2

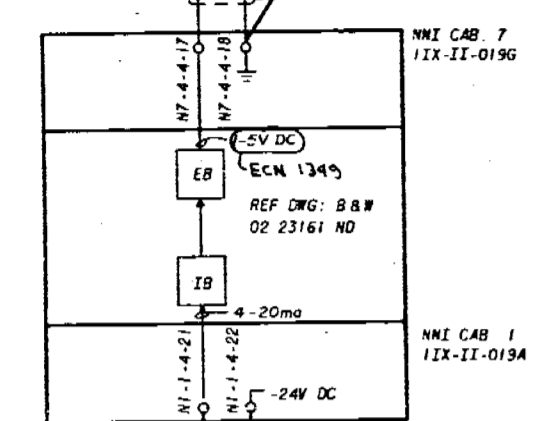


NMI CAB 7
IIX-II-019G

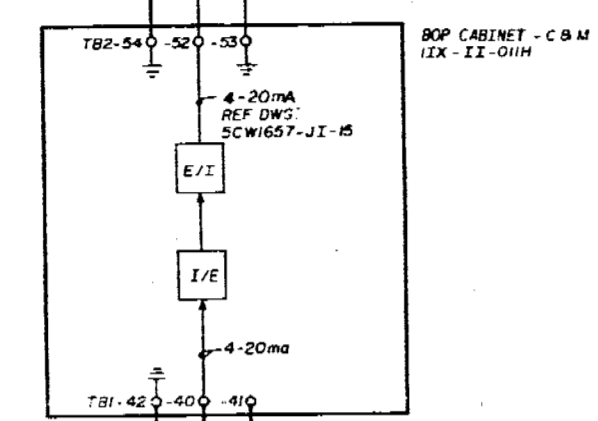

BOP CABINET - C B M
IIX-II-011H

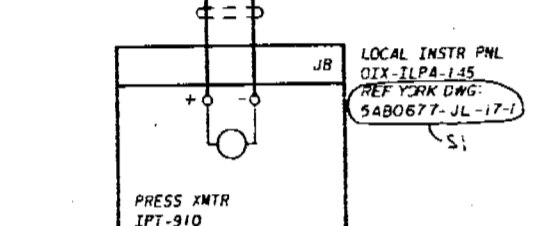


LOCAL INSTR PNL
OIX-ILPA-145
REF YORK DWG: 5480677-JL-17-1

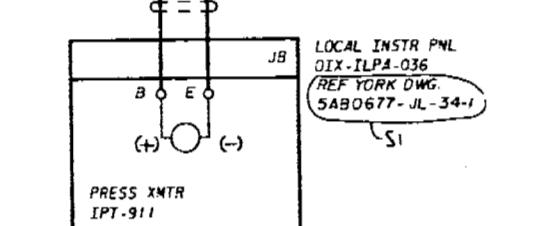

LOCAL INSTR PNL
OIX-ILPA-036
REF YORK DWG: 5480677-JL-34-1


WASTE EVAP DSTLT TRANS PUMPS
O18, O19 DISCH PRESS, IPT-910

AUX WASTE EVAP DSTLT TRANS PUMPS
O20, O21 DISCH PRESS, IPT-911

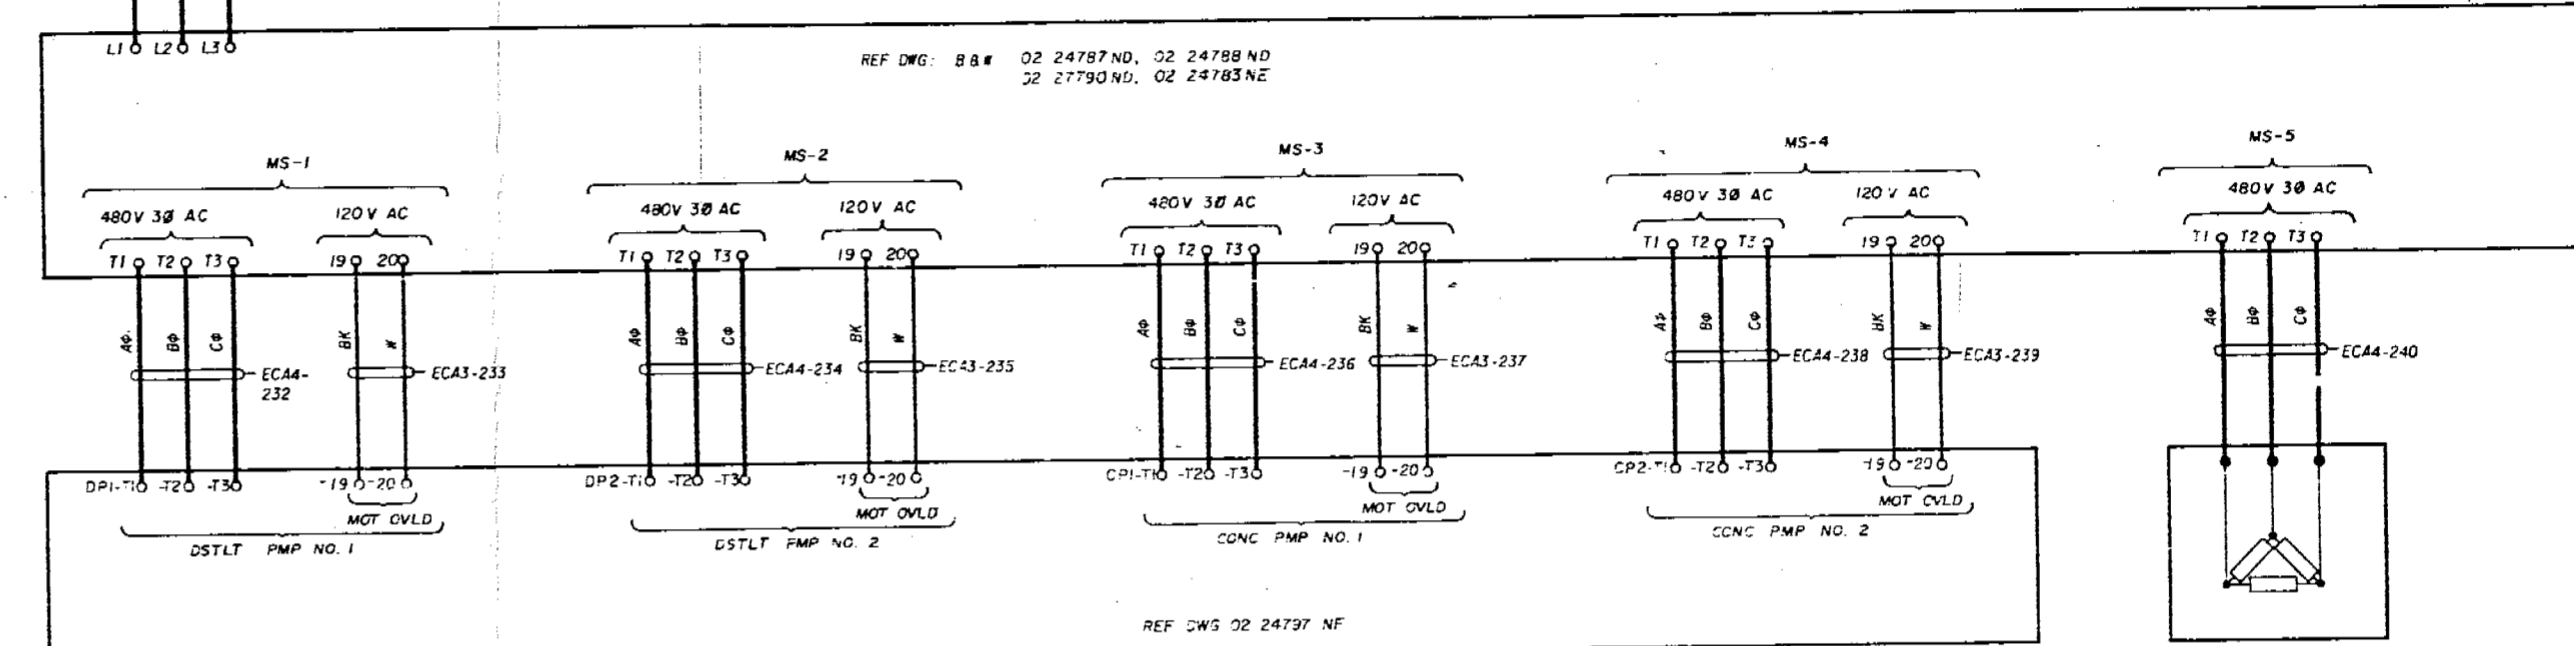

WASTE EVAP PACKAGE, MEVP-038
(FOR REST OF PACKAGE SEE BELOW AND SHEET 21)

LOCAL WASTE EVAPORATOR PNL
OIX-IXPA-010

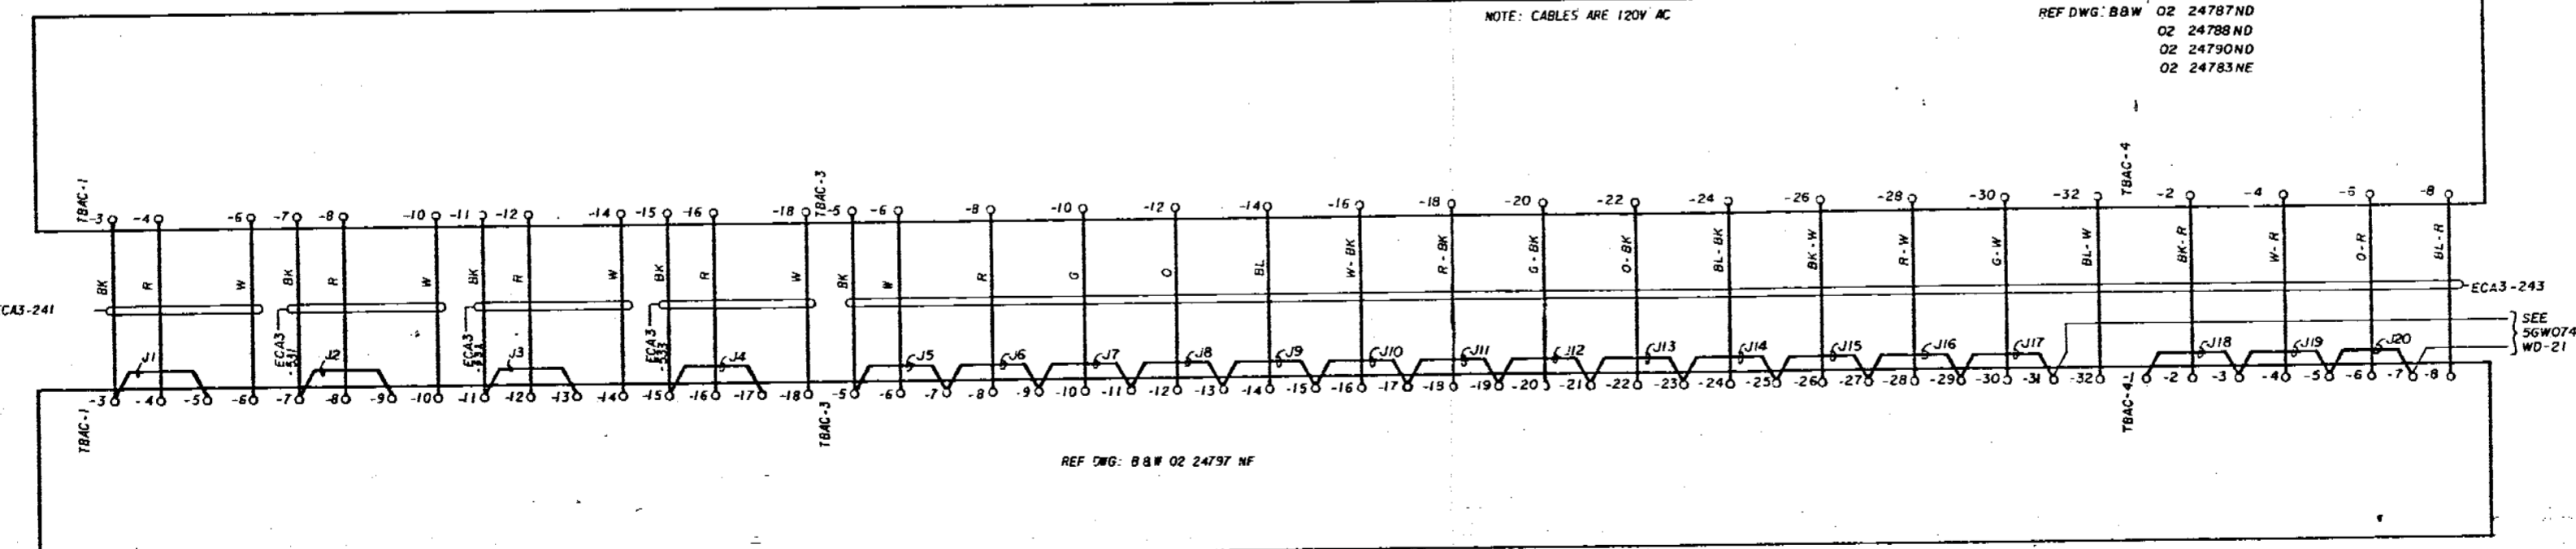

WASTE EVAP PACKAGE, MEVP-038
(FOR REST OF PACKAGE SEE ABOVE AND SHEET 21)

WASTE EVAP
SKID MOUNTED 120V AC JB
EMCP-038B

NOTES:
1. FOR GENERAL NOTES AND SYMBOLS, SEE 56W0740-WD-01

PRC
APERTURE
CARD

Revision table with columns for REV NO, DATE, and description of changes.

Approval table with columns for ECH NO, DATE, and names of reviewers.

SCALE: NONE EXCEPT AS NOTED

GENERAL
UNITS 1 & 2
SYSTEM SCHEMATIC
WASTE DISPOSAL SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

INSPECTED AND APPROVED FOR ISSUE
KNOXVILLE 12-15-78 88 E 56W0740-WD-20

Handwritten notes: 50-488, 8307050536, REGULATORY DOCKET FILE

Small table with columns for PRINT, SIZE, and other technical specifications.