



11X-IXPA-007
TITRATION ROOM PANEL


NOTES:
1. FOR GENERAL NOTES AND REFERENCE DRAWINGS,
REFER TO SGM1740-YQ-01

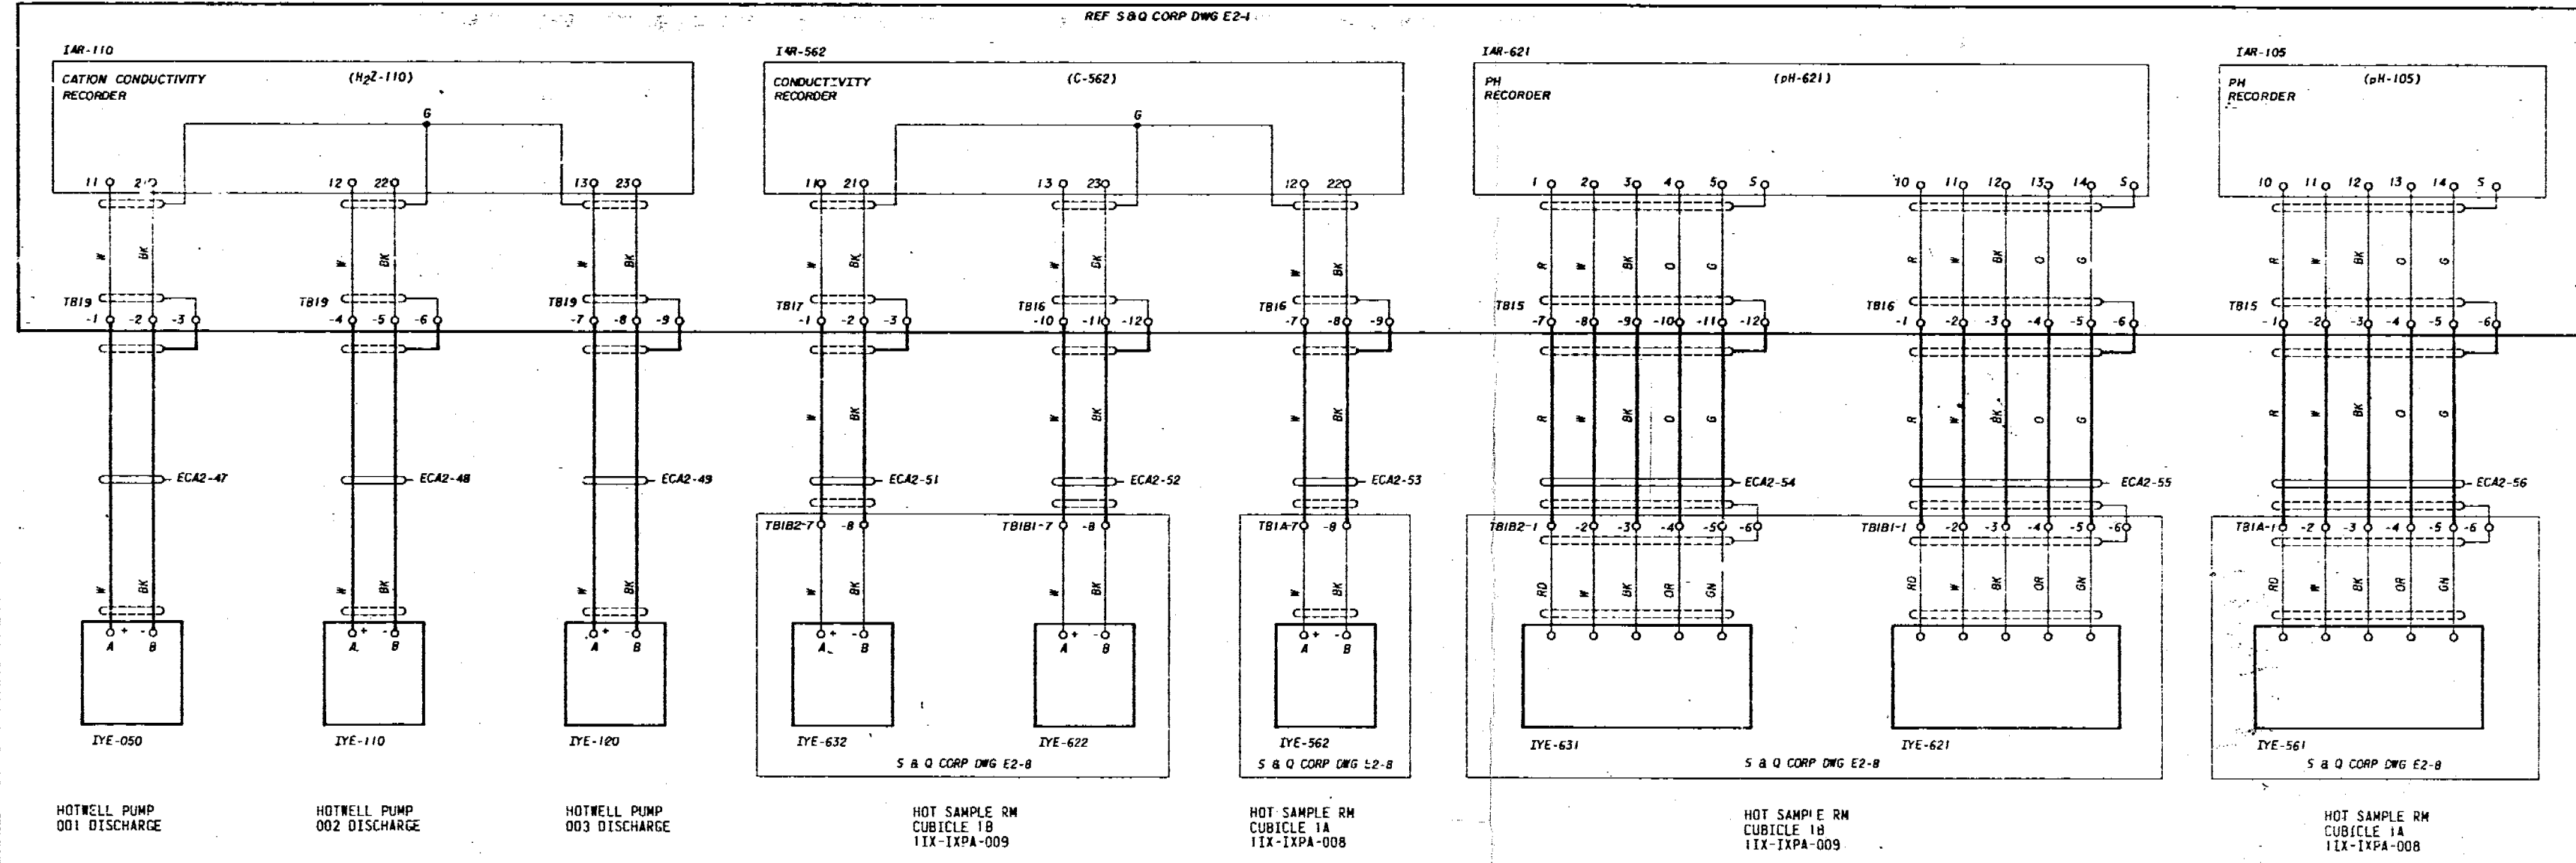



SAMPLING AND WATER QUALITY SYSTEM
UNIT 1 ANNUNCIATOR
LOCATED IN TITRATION ROOM PANEL
11X-IXPA-007

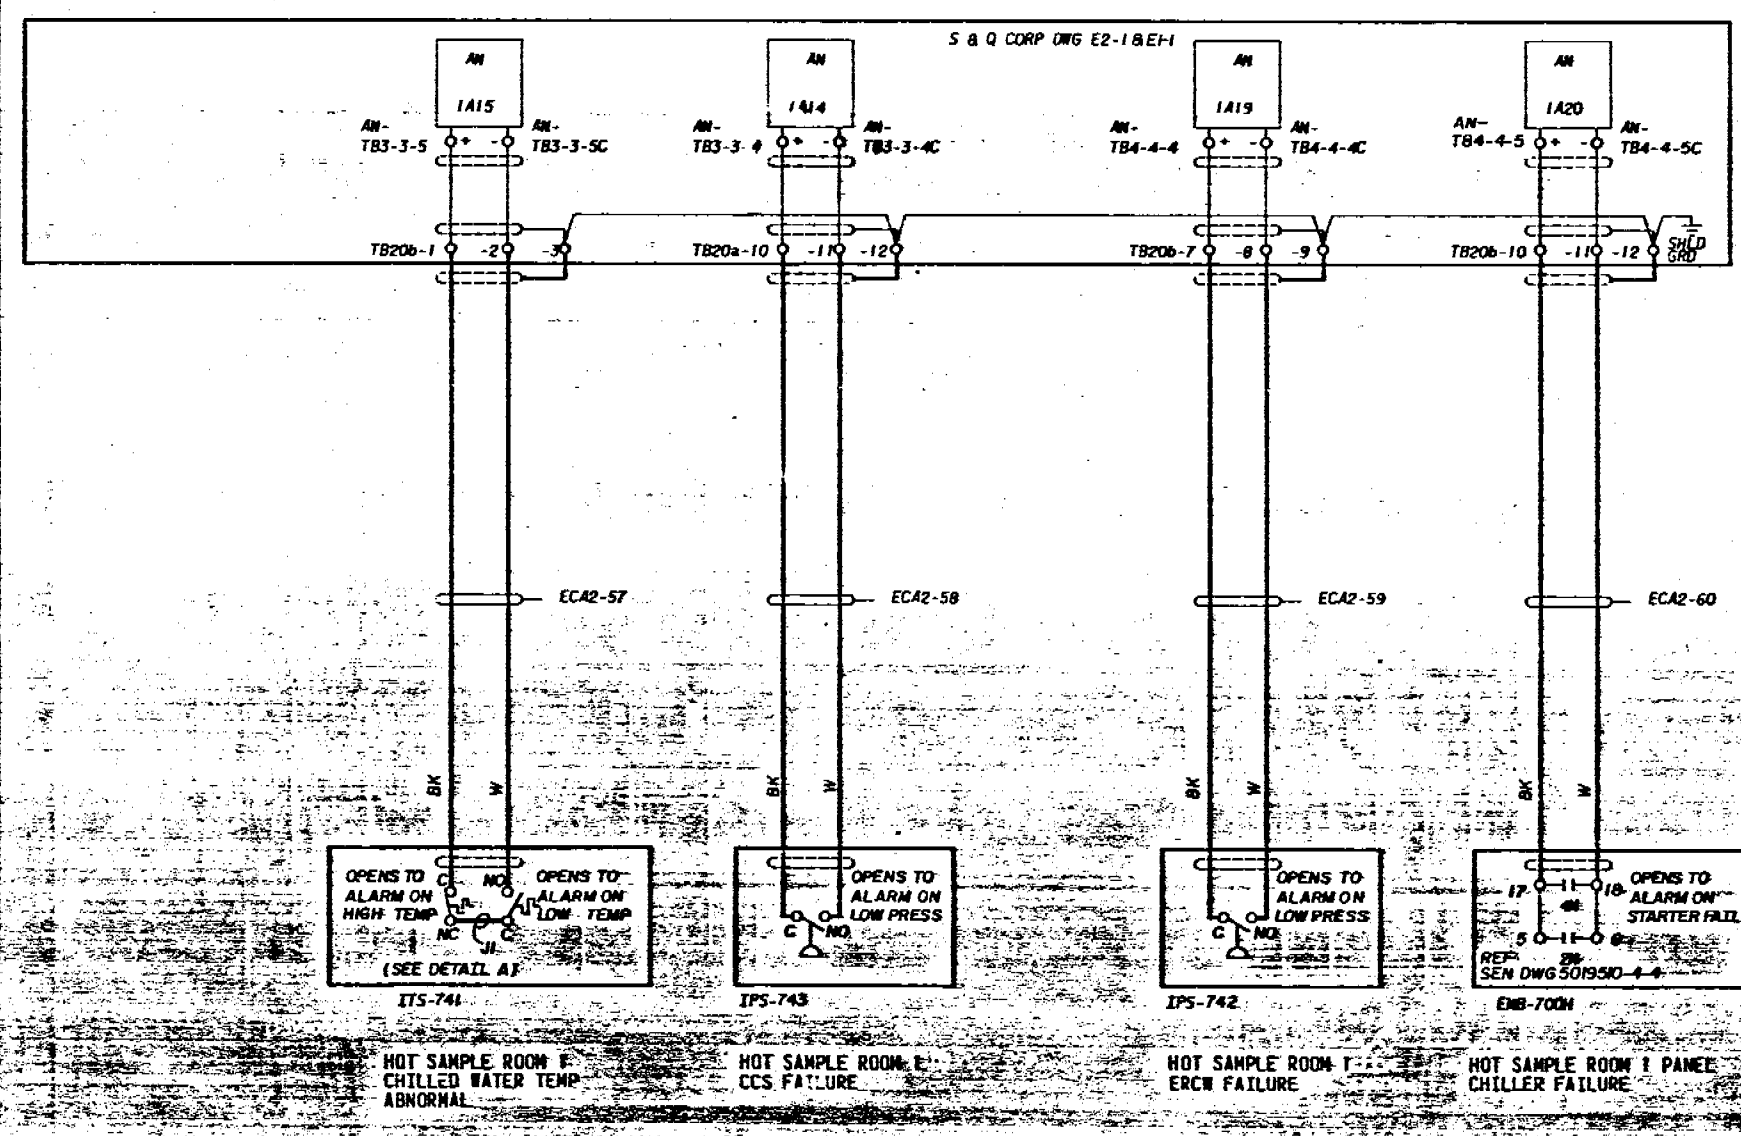

11X-II-0270
UNIT 1 ANNUNCIATOR TERMINATION CABINET

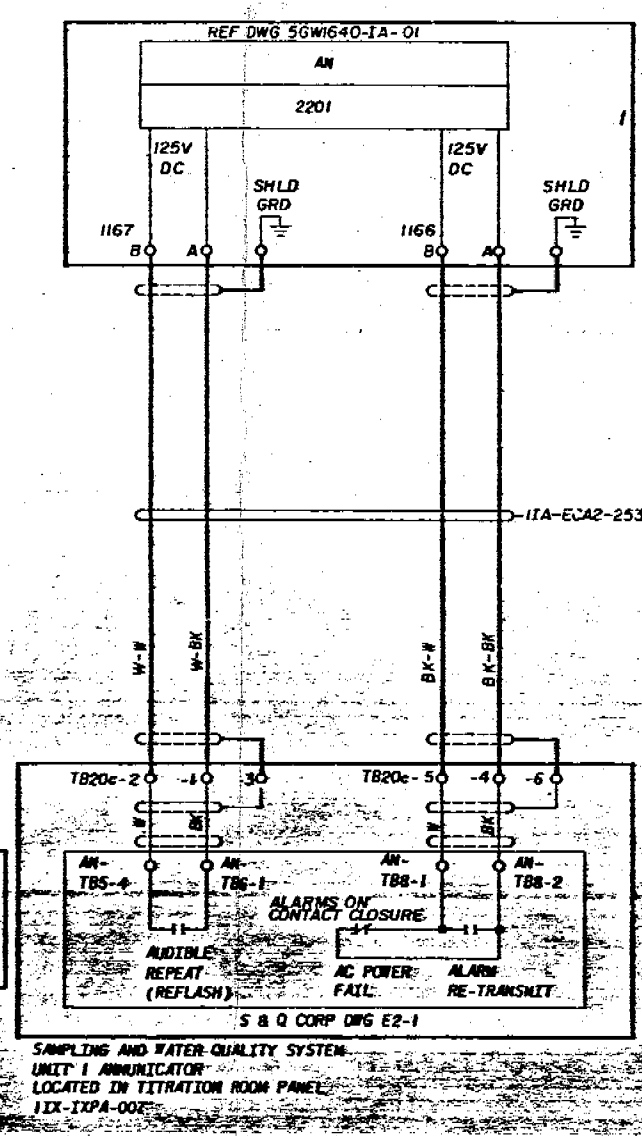

480V MCC SIXES COMPT G4
IED-EMCC-5764

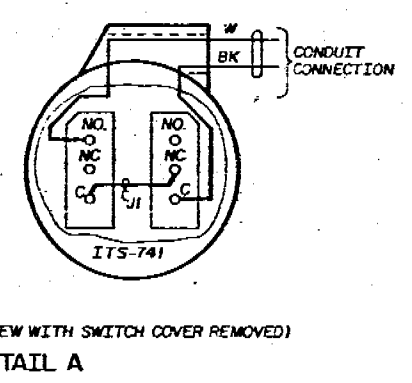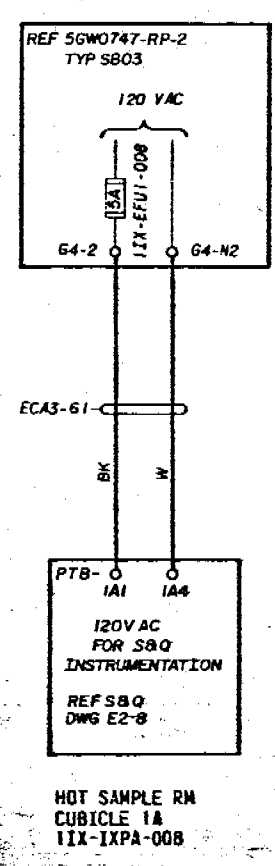

PRC
APERTURE
CARD

3	SI	11/7/80	CHANGED DETAIL A AND DELETED EL. B COL AND MINOR CHANGES		
2	SI	10/15/79	MINOR CHANGES		
1	SI	3/8/79	ADDED TERMINATIONS, REMOVED COL. B EL. AND MINOR CHANGES PER SI		
REV	ECN NO.	DATE	DESCRIPTION	DESIGNED BY	APP. BY
				<i>J. B. Hester</i>	<i>J. B. Hester</i>
				<i>W. R. Stovall</i>	<i>W. R. Stovall</i>
SCALE			EXCEPT AS NOTED		
GENERAL UNIT I					
SYSTEM SCHEMATIC					
SAMPLING AND WATER QUAL SYS					
BELLEFONTE NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN					
SUBMITTED		RECOMMENDED		APPROVED	
<i>W. R. Stovall</i>		<i>W. R. Stovall</i>		<i>R. M. Holgers</i>	
KNOXVILLE		2-1-79		88 E SGM1740-YQ-05 RB	

Docket # *88-138*
Control # *2854650536*
Date *2-1-79* of Document
REGULATORY DOCKET FILE

INSPECTED AND APPROVED FOR ISSUE

2-1-79

RECORDS MARKING AS CONSTRUCTION