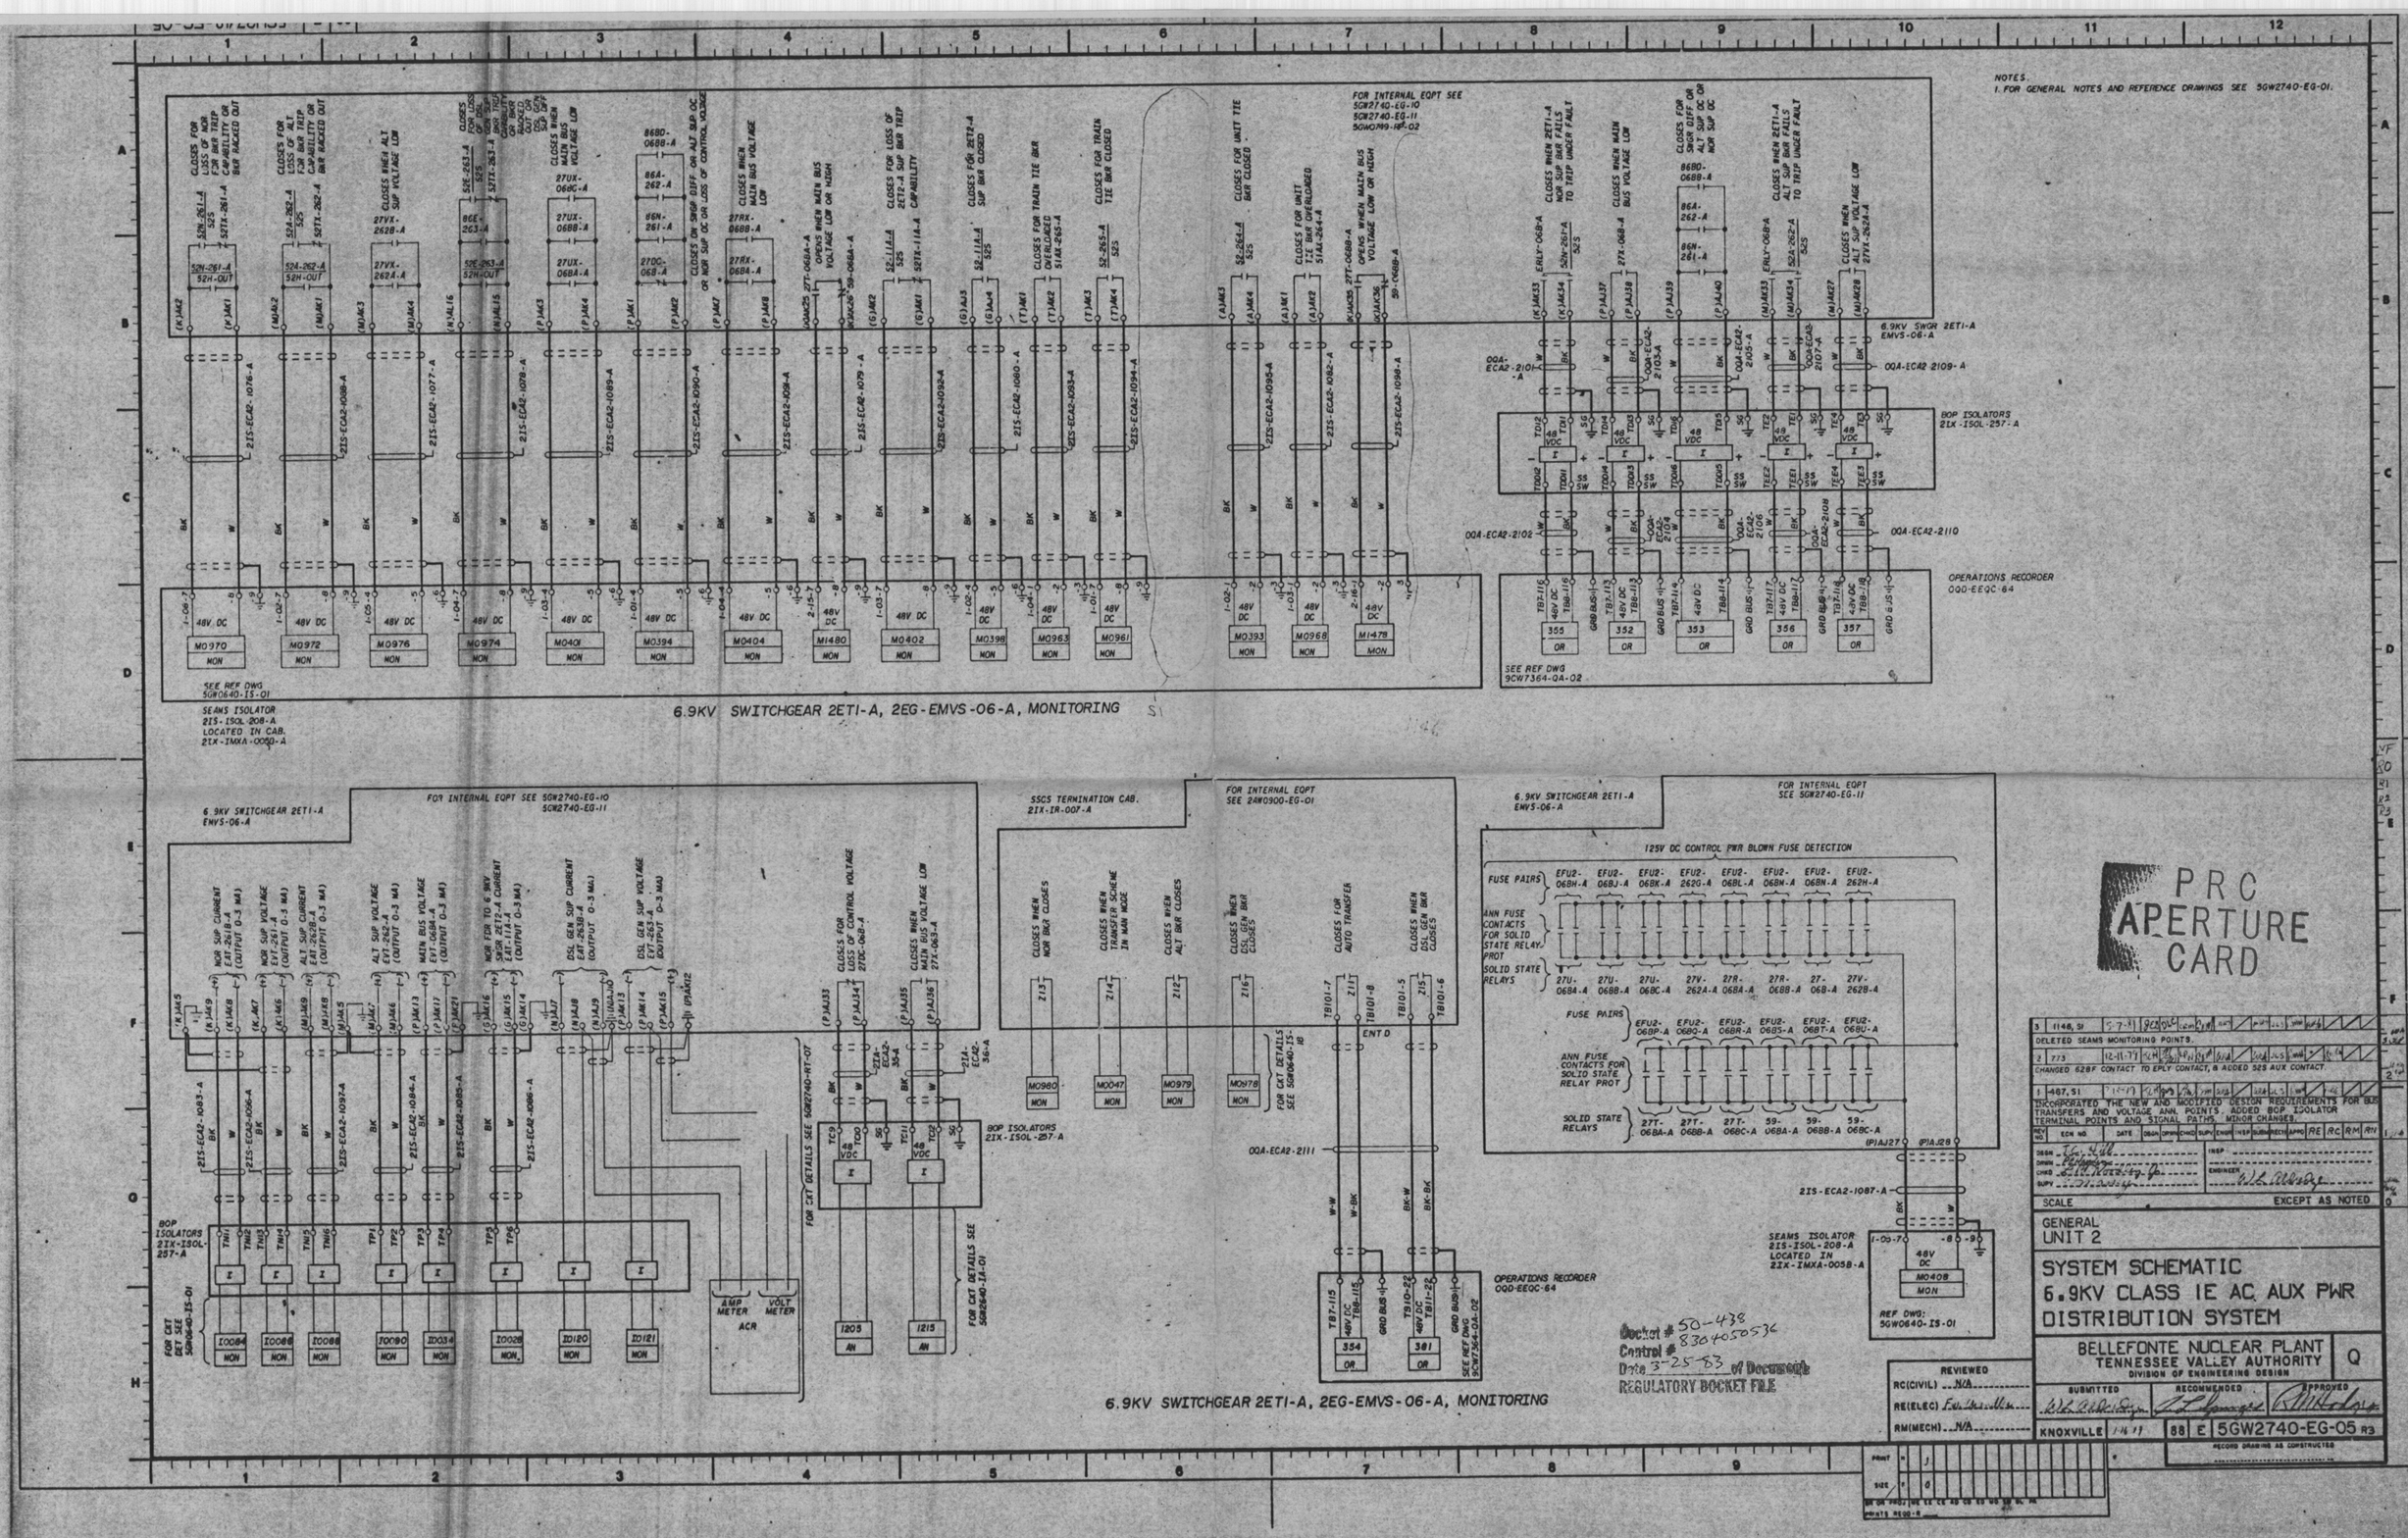
NOTES.
1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE 5GW2740-EG-01.
6.9KV SWITCHGEAR 2ET1-A, 2EG-EMVS-06-A, MONITORING
6.9KV SWITCHGEAR 2ET1-A, 2EG-EMVS-06-A, MONITORING
PRC APERTURE CARD
DELETED SEAMS MONITORING POINTS.
CHANGED 628F CONTACT TO EPLY CONTACT, & ADDED 525 AUX CONTACT.
INCORPORATED THE NEW AND MODIFIED DESIGN REQUIREMENTS FOR BUS TRANSFERS AND VOLTAGE ANN. POINTS. ADDED BOP ISOLATOR TERMINAL POINTS AND SIGNAL PATHS. MINOR CHANGES.
SCALE
EXCEPT AS NOTED
GENERAL
UNIT 2
SYSTEM SCHEMATIC
6.9KV CLASS 1E AC AUX PWR
DISTRIBUTION SYSTEM
BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN
Q
KNOXVILLE
5GW2740-EG-05
REVIEWED
RC(CIVIL) N/A
RE(ELEC)
RM(MECH) N/A
Docket # 50-438
Control # 8304050536
Date 3-25-83 of Document
REGULATORY DOCKET FILE