



NOTES:
1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE 5GW2740-EG-01.

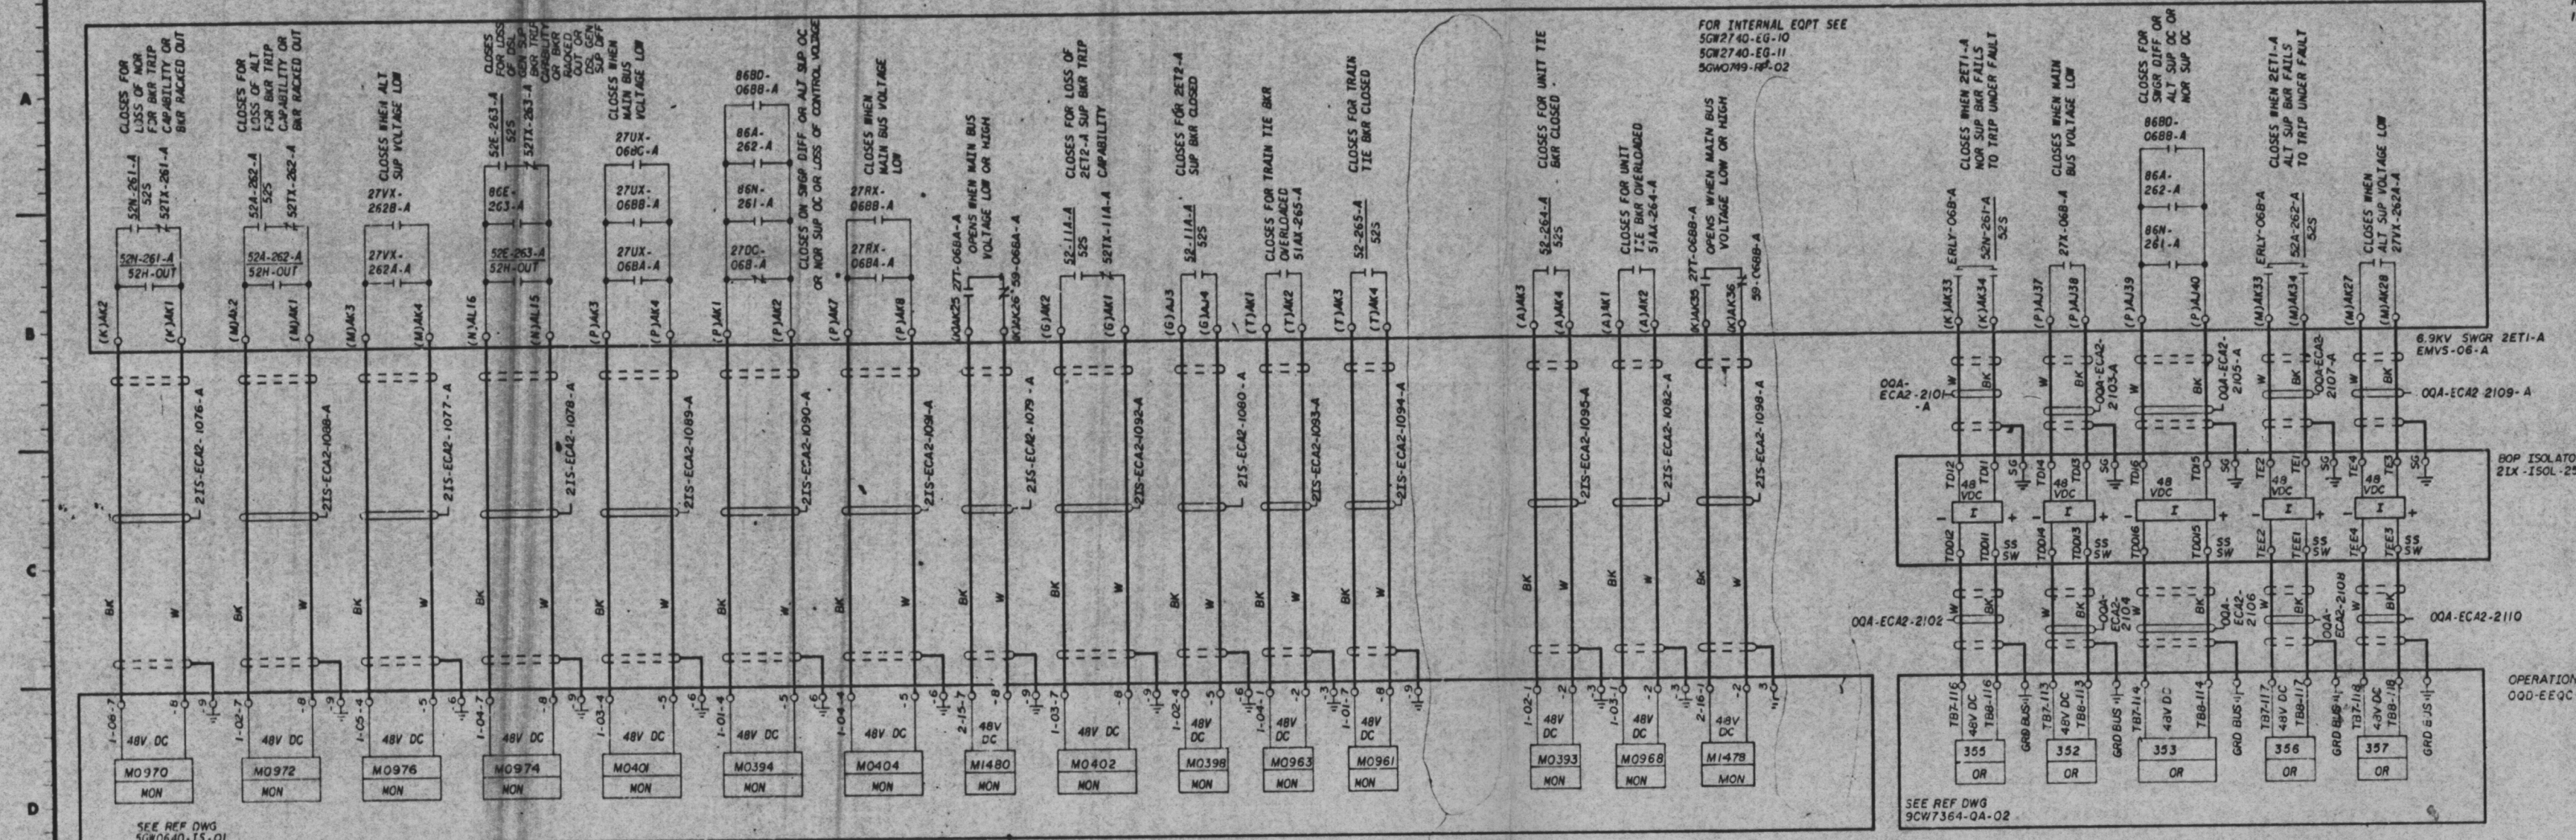

6.9KV SWITCHGEAR 2E1-A, 2EG-EMVS-06-A, MONITORING

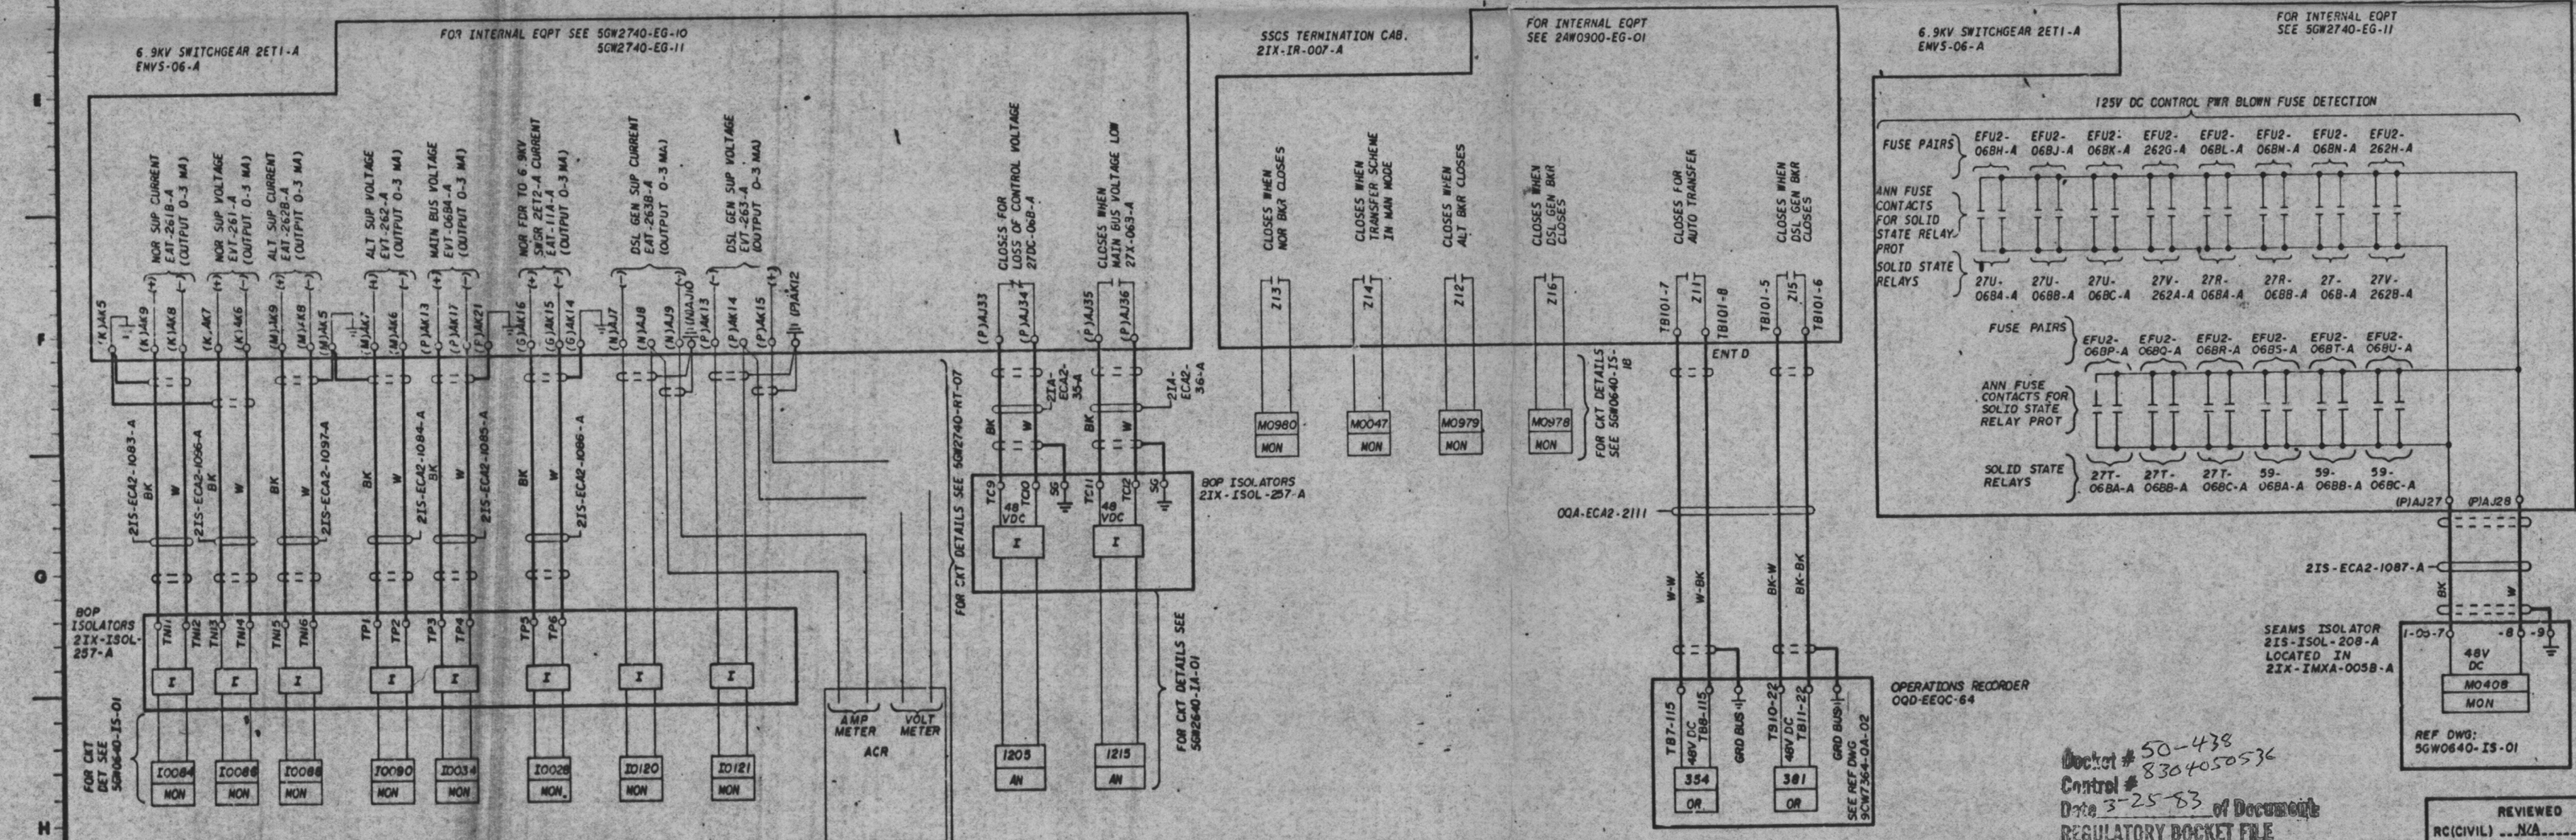

6.9KV SWITCHGEAR 2E1-A, 2EG-EMVS-06-A, MONITORING

PRC
APERTURE
CARD

1	1148, 51	5-7-81	92054	GEN	2	1148, 51	5-7-81	92054	GEN	2
2	773	12-11-77	1411	CHG	2	773	12-11-77	1411	CHG	2
3	1487, 91	11-17-77	1411	CHG	3	1487, 91	11-17-77	1411	CHG	3

DELETED SEAMS MONITORING POINTS.
CHANGED 62BF CONTACT TO EPLY CONTACT, & ADDED 52S AUX CONTACT.

1487, 91 INCORPORATED THE NEW AND MODIFIED DESIGN REQUIREMENTS FOR BUS TRANSFERS AND VOLTAGE ANN. POINTS. ADDED BOP ISOLATOR TERMINAL POINTS AND SIGNAL PATHS. MINOR CHANGES.

SCALE	EXCEPT AS NOTED
GENERAL	UNIT 2
SYSTEM SCHEMATIC	
6.9KV CLASS 1E AC, AUX PWR DISTRIBUTION SYSTEM	
BELLEFONTE NUCLEAR PLANT	
TENNESSEE VALLEY AUTHORITY	
DIVISION OF ENGINEERING DESIGN	
REVIEWED	RC(CIVIL) ... N/A
RE(ELEC)	... [Signature]
RM(MECH)	... N/A
SUBMITTED	... [Signature]
RECOMMENDED	... [Signature]
APPROVED	... [Signature]
KNOXVILLE	1-4-77
88	5GW2740-EG-05

Doc # 50-438
Control # 8304050536
Date 3-25-83
REGULATORY BOCKET FILE

PRINT	J
SIZE	D
NO. OF PAGES	14
NO. OF SHEETS	14
POINTS	REQD - 8