



MAIN CONTROL ROOM  
PANEL  
17R-2N-001

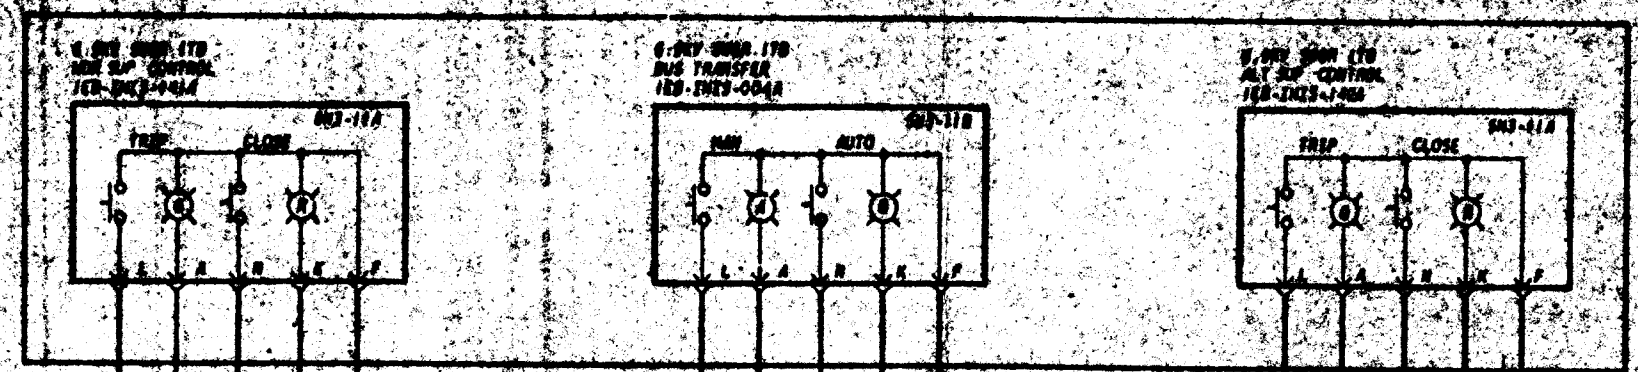

NOTES:  
1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE 240140-01-01  
2. FOR DETAILING SYSTEMS DEVELOPMENT SEE 240140-01-02



SSCS LOGIC CAB  
11X-11-012  
COL CSM EL 619

SSCS TERMINATION CAB  
11X-11-013  
COL CSM EL 629




FOR INTERNAL EOPT SEE 210000-EB-02


FOR INTERNAL EOPT SEE 210000-EB-02

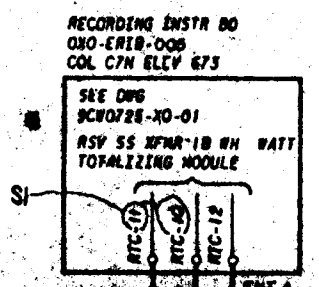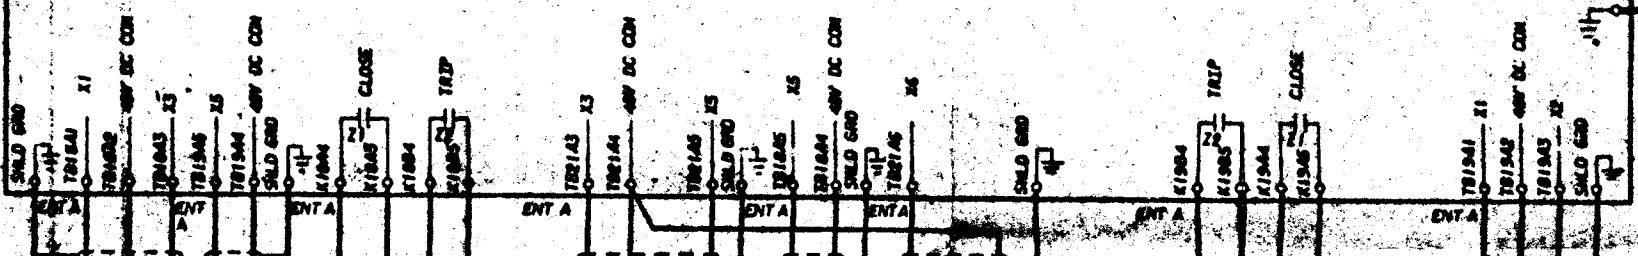


RECORDING INSTR 80  
DND-ER18-004  
COL C7N ELEV 673




REC CONT 80  
08E-EC8-008  
COL C7N EL 673




AUTO LOAD  
TAP CHANGER

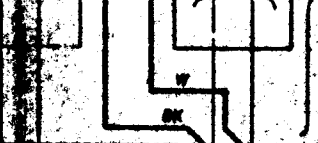


6.9KV SWGR 17C  
PANEL 8  
1EB-EM5-02N  
COL T2A EL 640




SEE DND  
240140-EB-04  
DIFF CT'S ON  
NON SUPPLY



RSV SS  
55 55 18  
DIFF RELAYS




INITIATES RSV  
55 55 18  
DIFF AUX ALY




Bucket # 50-438  
Control # 2304050536  
Date 5-25-63  
of Document  
REGULATORY DOCKET FILE  
**PRO  
APERTURE  
CARD**

INITIATES SVVD  
UNIT TRIP RLY



FOR INTERNAL EOPT  
SEE 240140-EB-04

1. RSV SWITCHING 17B  
240140-04  
COL T2A EL 640




CONTROL FOR TRANSFER IN  
48-048




LOCATED IN  
PANEL (8)  
17R-2N-001



17B SWGR 17C  
17B-2N-001  
LOCATED ON  
17B SWGR  
DISTRIBUTION PANEL  
17B-2N-001  
COL T2A EL 640



17C SWGR 17C  
17C-2N-001  
LOCATED ON  
17C SWGR  
DISTRIBUTION PANEL  
17C-2N-001  
COL T2A EL 640



6.9KV SWGR 17B, 1EB-EM5-04

REVISIONS	
NO.	DATE
1	5-25-63
GENERAL	
UNIT 1	
SYSTEM SCHEMATIC	
6.9KV NORMAL AC AUX POWER	
DISTRIBUTION SYSTEM	
BELLEFONTE NUCLEAR PLANT	
TENNESSEE VALLEY AUTHORITY	
DIVISION OF ENGINEERING	
APPROVED	DESIGNED
<i>[Signature]</i>	<i>[Signature]</i>
DRAWN BY: <i>[Signature]</i>	