



MAIN CONTROL ROOM
PANEL
11X-21-001

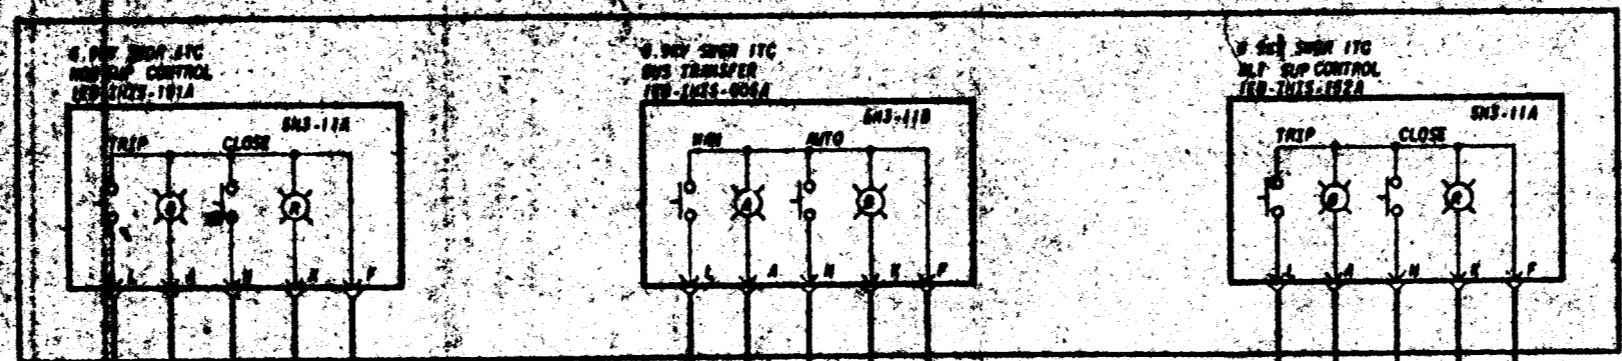

SSCS LOGIC CAB
111-21-013
COL. CDR. EL. 000

SSCS TERMINATION CAB
111-21-013
COL. CDR. EL. 000

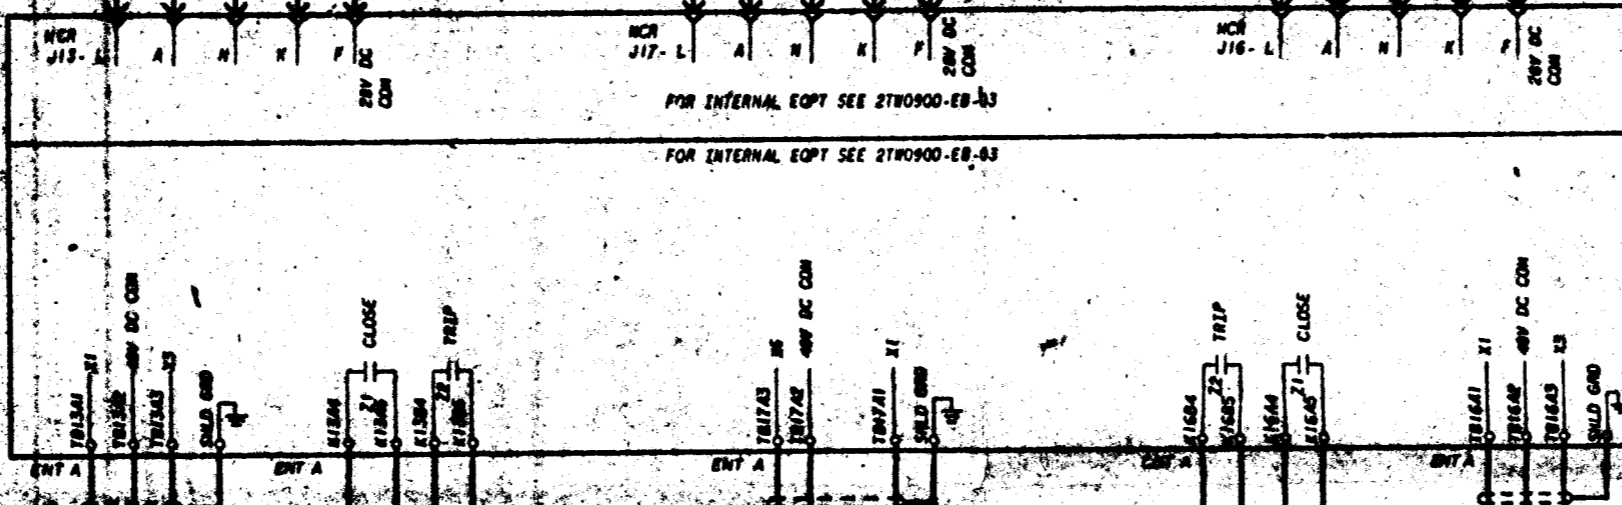

ITB BOARD
DIFF RELAYS

ITB BOARD
DIFF RELAYS

PANEL (A)
EMVS-000

LOCATED IN
PANEL (A)
EMVS-004

PANEL (B)
EMVS-000

6.9KV SWGR ITC, 11X-EMVS-05

NOTES:
1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE 210100-EB-01
2. FOR MONITORING SYSTEMS DEVELOPMENT SEE 210100-EB-02

Docket # 50-438
Control # 830450536
Date 3-25-83
of Documents
BUREAU OF DOCUMENTS

PRC
APERTURE
CARD

REVISIONS	
NO.	DATE
1	11/11/82
DRAWN BY: [Signature]	
CHECKED BY: [Signature]	
APPROVED BY: [Signature]	
TITLE: SYSTEM SCHEMATIC	
SUBTITLE: 6.9KV NORMAL AC AUX POWER DISTRIBUTION SYSTEM	
PROJECT: BELLEFONTS NUCLEAR PLANT	
SHEET NO. 1	
DATE: 11/11/82	

FOR INTERNAL COPY
SEE 210100-EB-09

6.9KV SWGR ITC
EMVS-05
COL. T24 EL. 040

NOT FOR BUS
11X-21-013
LOCATED ON
11X-21-013
DISTRIBUTION PANEL
11X-21-013
COL. A01 EL. 000

ALT FOR BUS
11X-21-013
LOCATED ON
11X-21-013
DISTRIBUTION PANEL
11X-21-013
COL. A01 EL. 000