






MAIN CONTROL ROOM  
PANEL  
11X-21-001

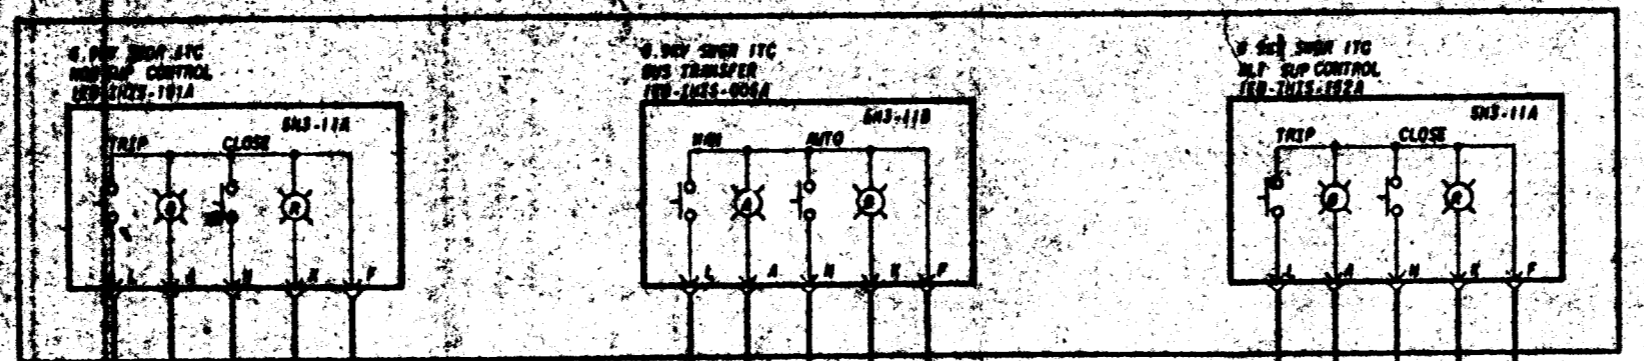


SSCS LOGIC CAB  
111-11-013  
COL. CDR. EL. 000

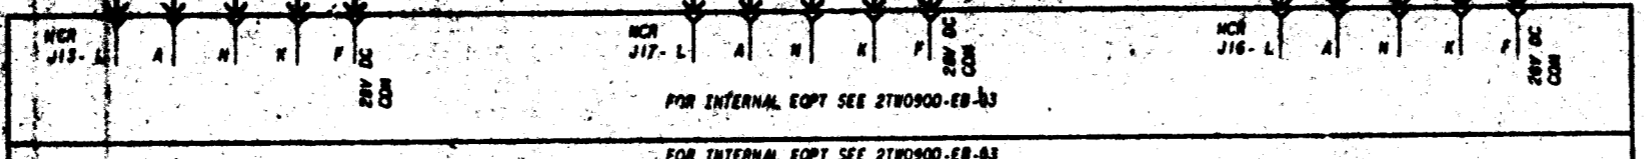

SSCS TERMINATION CAB  
111-11-013  
COL. CDR. EL. 000

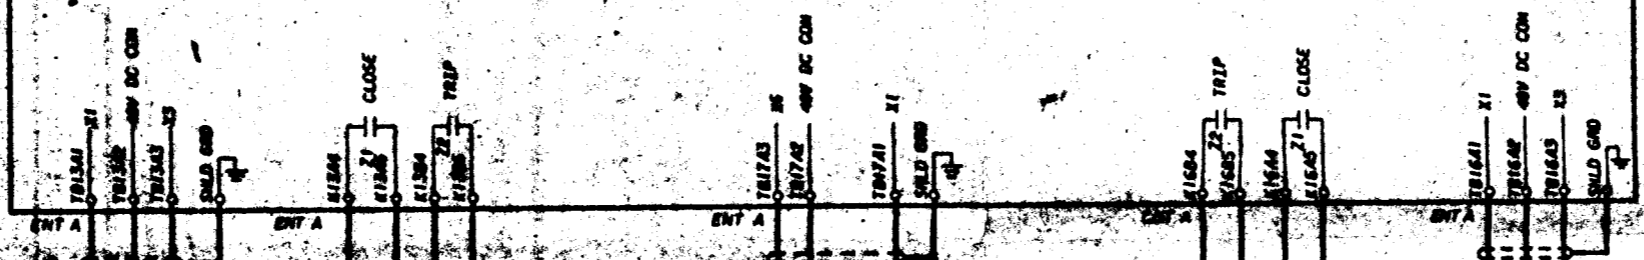


FOR CMT DETAILS SEE 50M1740-EB-08



FOR CMT DETAILS SEE 50M1740-EB-08

Docket # 50-438  
Control # 830450536  
Date 3-25-83  
of Documents  
BUREAU OF DOCUMENTS

PRC  
APERTURE  
CARD

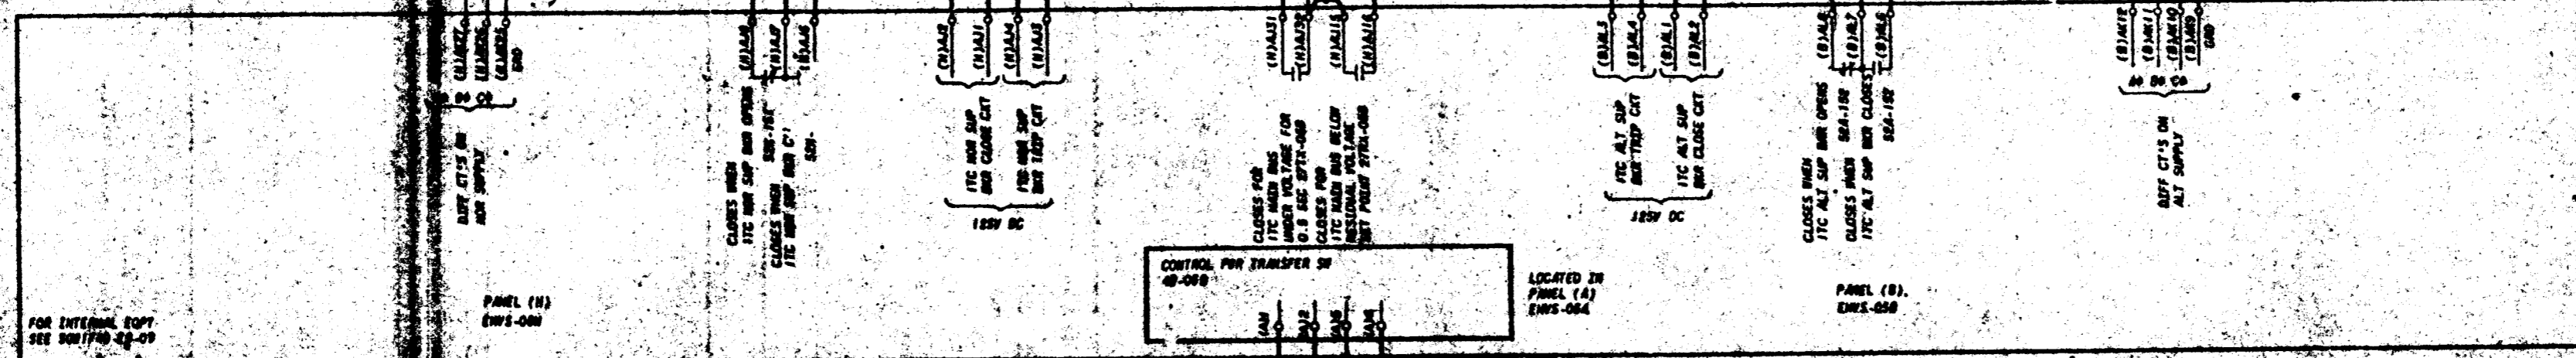

FOR INTERNAL COPY  
SEE 50M1740-EB-09

6.9KV SWGR ITC  
EMVS-05  
COL. T24 EL. 640

NOT FOR BUS  
11X-21-001  
LOCATED ON  
120V DC POWER  
DISTRIBUTION PANEL  
11X-21-013  
COL. A01 EL. 000

ALT FOR BUS  
11X-21-001  
LOCATED ON  
120V DC POWER  
DISTRIBUTION PANEL  
11X-21-013  
COL. A01 EL. 000

6.9KV SWGR ITC, EB-EMVS-05

REVISIONS	
NO.	DATE
1	3-25-83
DRAWN BY: J. G. GILBERT	
CHECKED BY: J. G. GILBERT	
APPROVED BY: J. G. GILBERT	
TITLE: SYSTEM SCHEMATIC	
SUBTITLE: 6.9KV NORMAL AC AUX POWER DISTRIBUTION SYSTEM	
PROJECT: BELLEFONTS NUCLEAR PLANT	
OPERATOR: TENNESSEE VALLEY AUTHORITY	
DIVISION: DIVISION OF ENGINEERING	
DATE: 3-25-83	