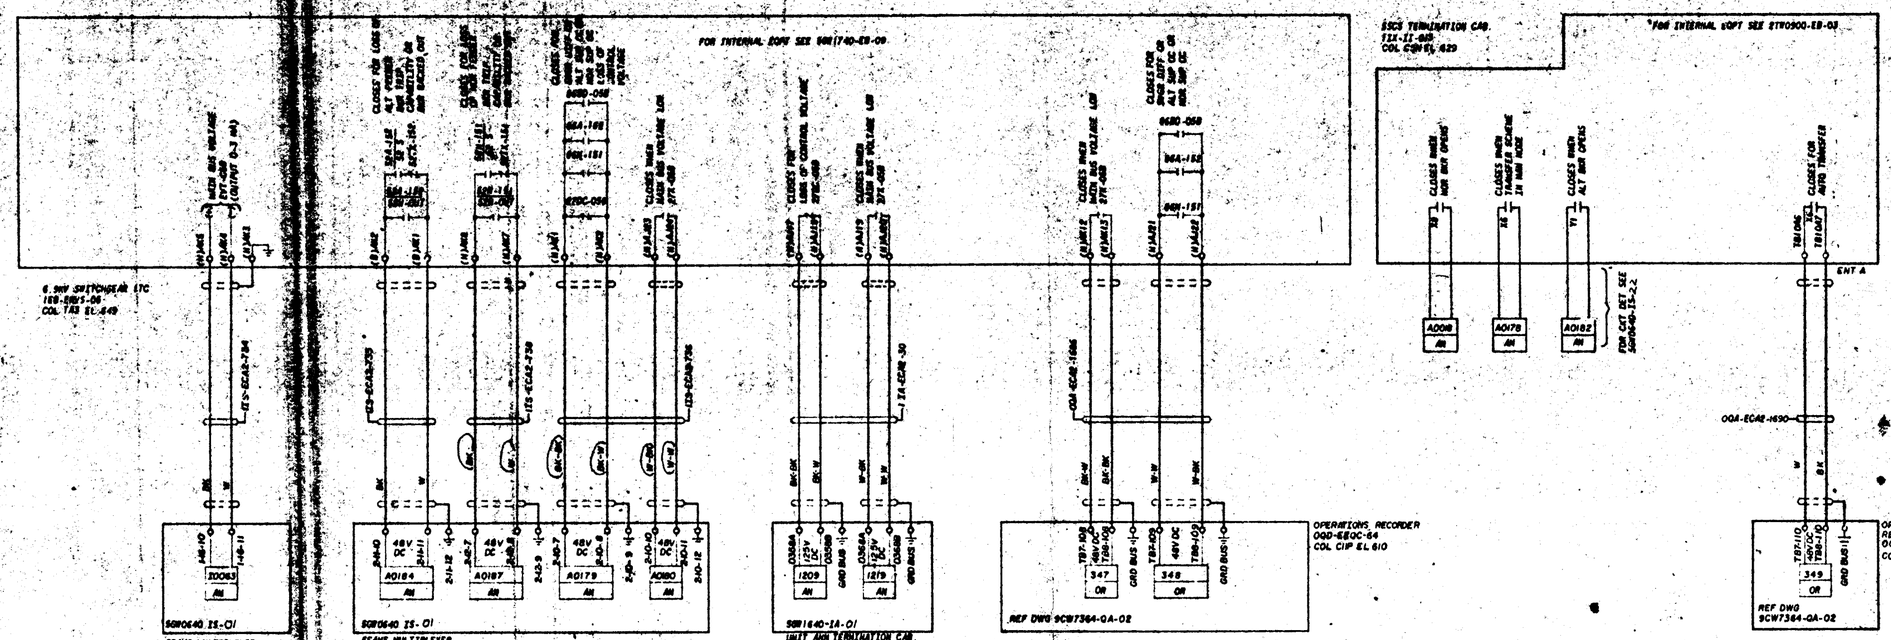

6.9KV SWITCHGEAR ITC, EMVS-05, MONITORING

Doc'ts # 50-438
Control # 8304050536
Date 3-25-83 of Document
REGULATORY DOCKET FILE

PRC APERTURE CARD

2	S1	MINOR CHANGES.
1	S1	ADDED MONITORING PT NO, BEAMS, UNIT ANN, OPERATIONS RCDR NOTATION, BEAMS CABLE NO, CABLE COLOR CODES PER S1.
REV. NO.	NOTE	

DRAWN J.C. HILL
DESIGN
CHECKED
APP. CAUDILL

SCALE: NOT TO SCALE

GENERAL
UNIT 1

SYSTEM SCHEMATIC
6.9KV NORMAL AC AUX POWER
DISTRIBUTION SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

SUBMITTED
KINGSTREE 10-10-77 DATE