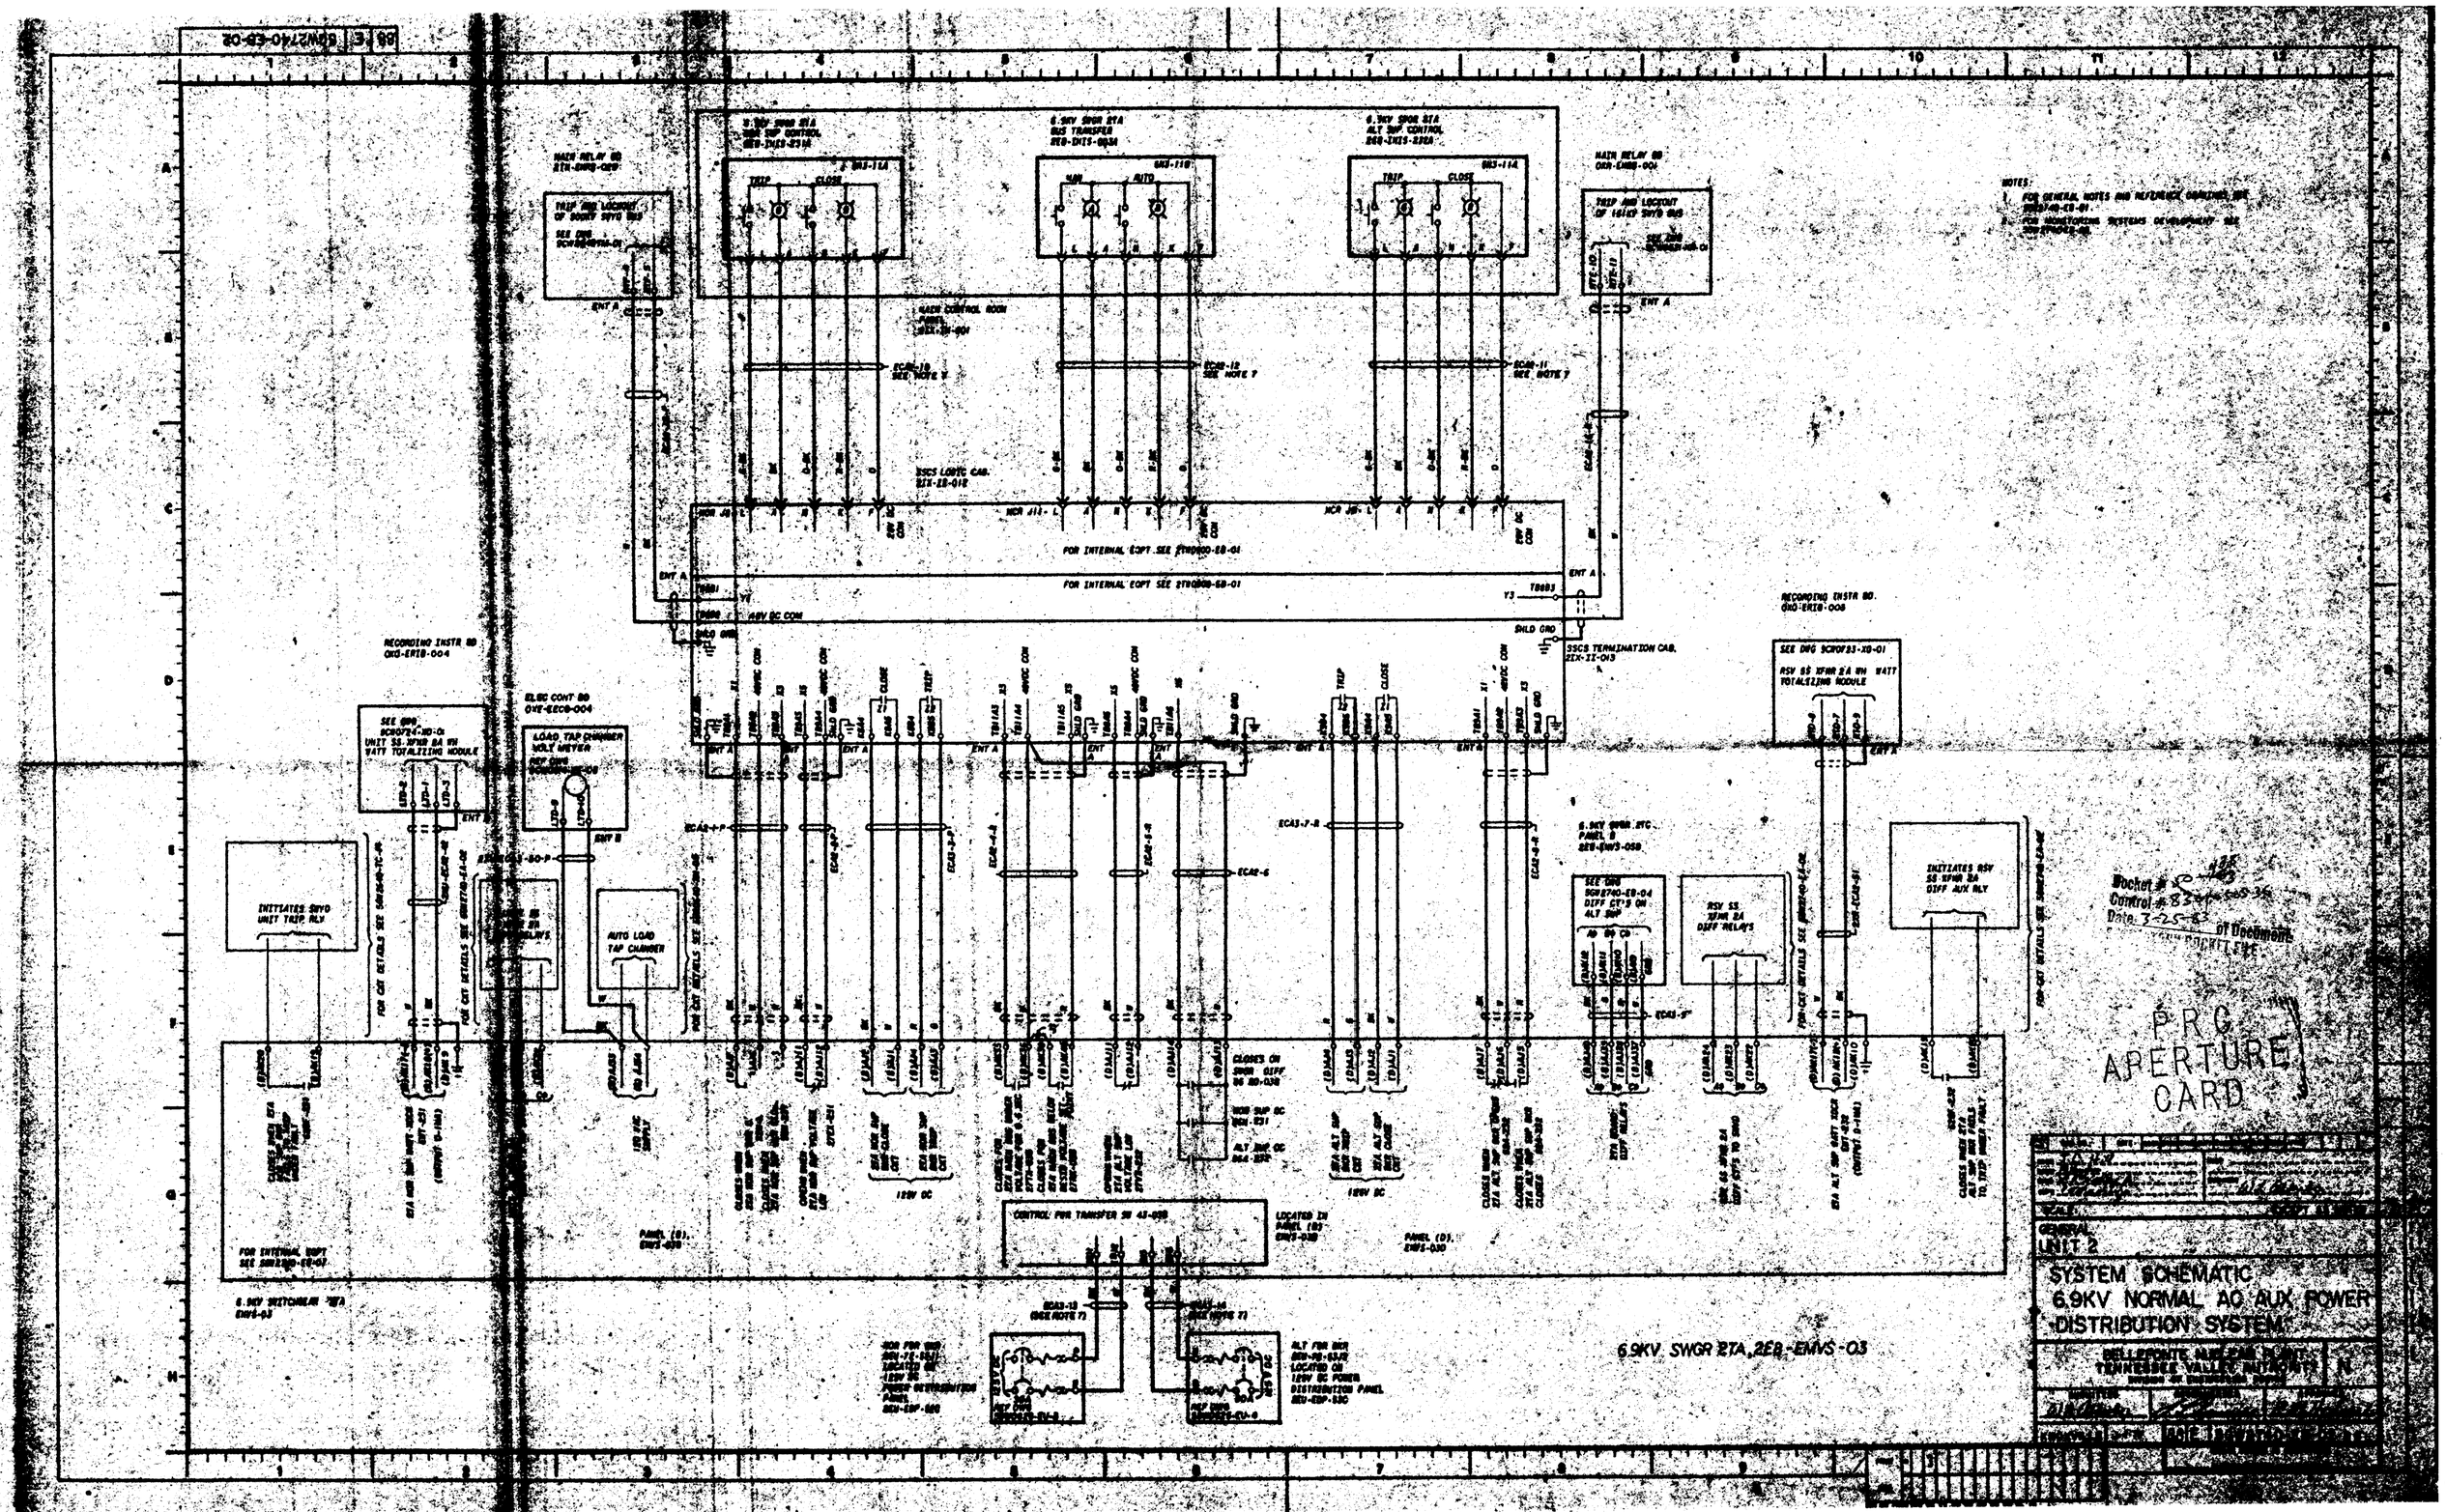

NOTES:
1. FOR GENERAL NOTES AND REFERENCE DRAWINGS SEE
2. FOR MONITORING SYSTEMS DEVELOPMENT SEE
MAIN RELAY BD
TRIP AND LOCKOUT OF 161KV SWYD BUS
MAIN CONTROL ROOM PANEL
SSCS LOGIC CAB.
FOR INTERNAL EQPT SEE
SSCS TERMINATION CAB.
RECORDING INSTR BD
ELEC CONT BD
LOAD TAP CHANGER VOLT METER
INITIATES SWYD UNIT TRIP RLY
AUTO LOAD TAP CHANGER
RSV SS XFMR 2A DIFF RELAYS
INITIATES RSV SS XFMR 2A DIFF AUX RLY
CONTROL PWR TRANSFER SW 43-03B
6.9KV SWGR 2TA,2EB-EMVS-03
Docket #
Control #
Date 3-25-83
PRC APERTURE CARD
GENERAL
UNIT 2
SYSTEM SCHEMATIC
6.9KV NORMAL AC AUX POWER DISTRIBUTION SYSTEM
BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY