
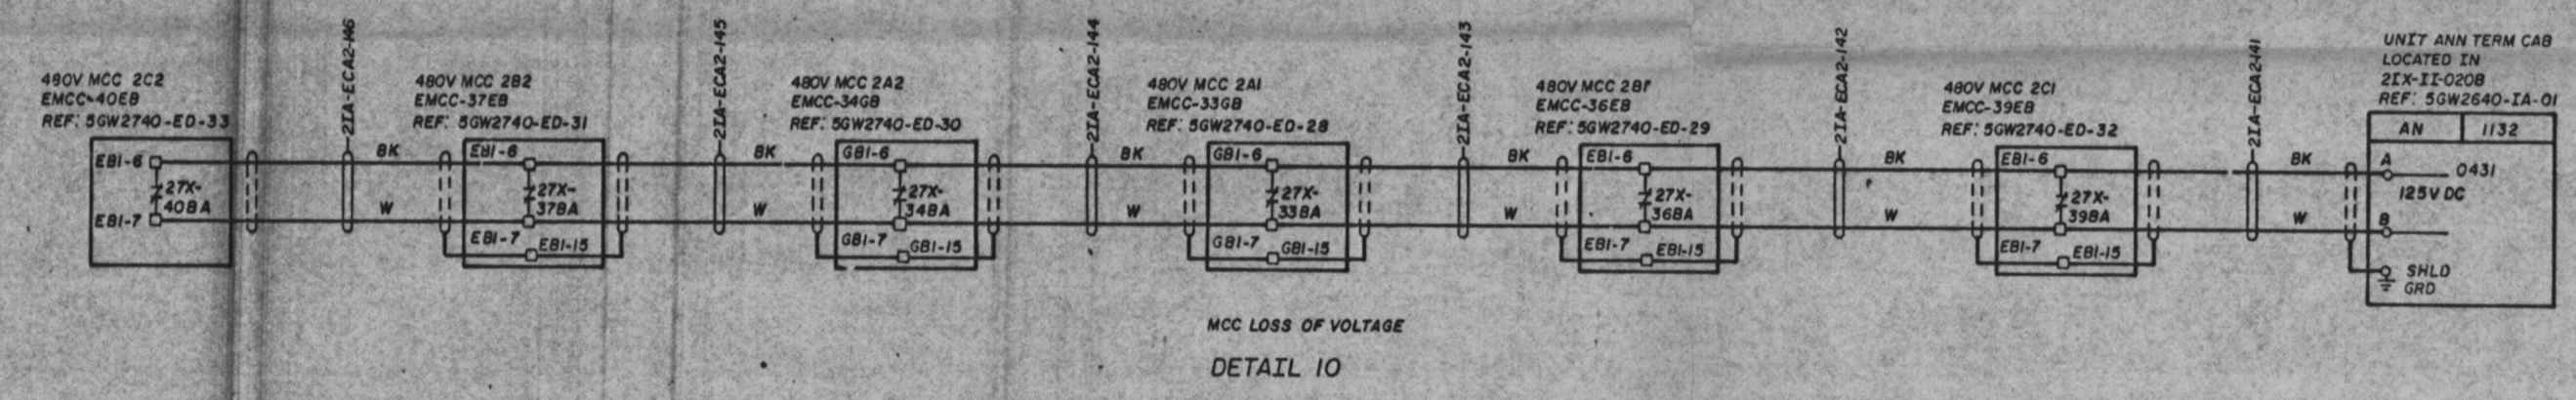


FCR E-1928

NOTES:
 1. FOR GENERAL NOTES AND SYMBOLS SEE 5GW2740-ED-01
 2. 60 AMP POWER RECEPTACLE CONNECTOR PIGTAILS MAY BE REDUCED TO A MINIMUM OF 4 AWG IF REQUIRED.

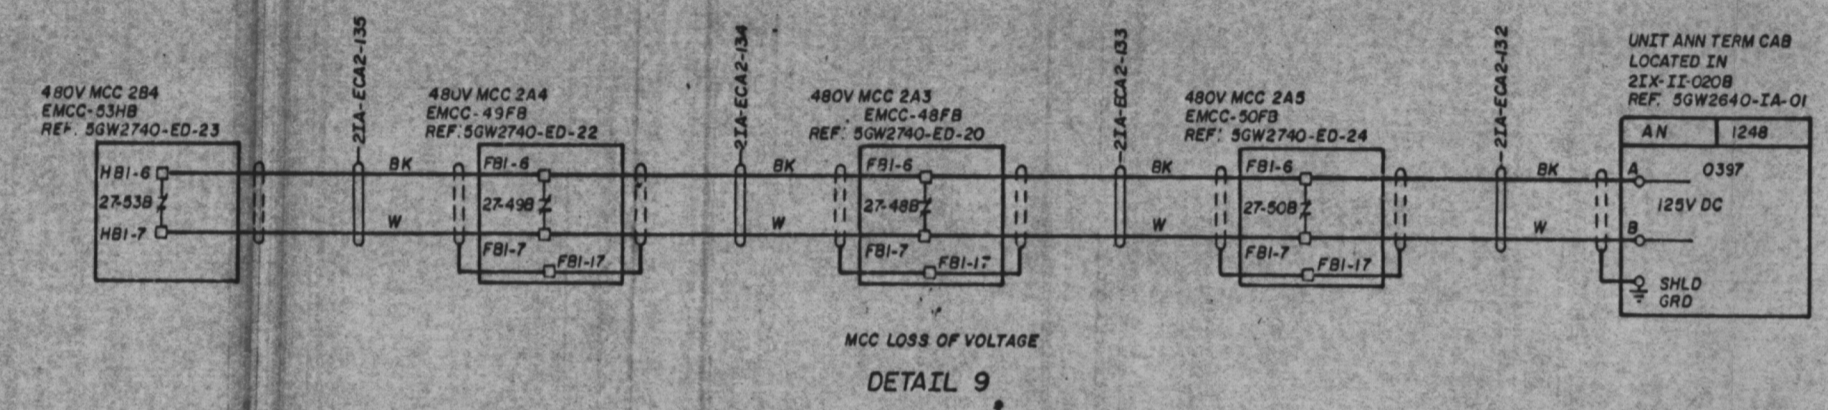

PRC APERTURE CARD

Doc # 50-138
 Control # 83040 SD 536
 Date 5-25-82 of Document
 REGULATORY DOCKET FILE

REV	NO.	DATE	BY	CHKD	APPD	APPD
1	1	5-25-82	W.A. Anderson			
INCORPORATED FOR E-928						
SCALE EXCEPT AS NOTED						
GENERAL UNIT 2						
SYSTEM SCHEMATIC 480V NORMAL AC AUX POWER DISTRIBUTION SYSTEM						
BELLEFONTE NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN						
SUBMITTED		RECOMMENDED		APPROVED		
W.A. Anderson		J.P. Pennington		R.M. Anderson		
KNOXVILLE 12-12-78 88 E 5GW2740-ED-34						

INSPECTED AND APPROVED FOR ISSUE	DATE