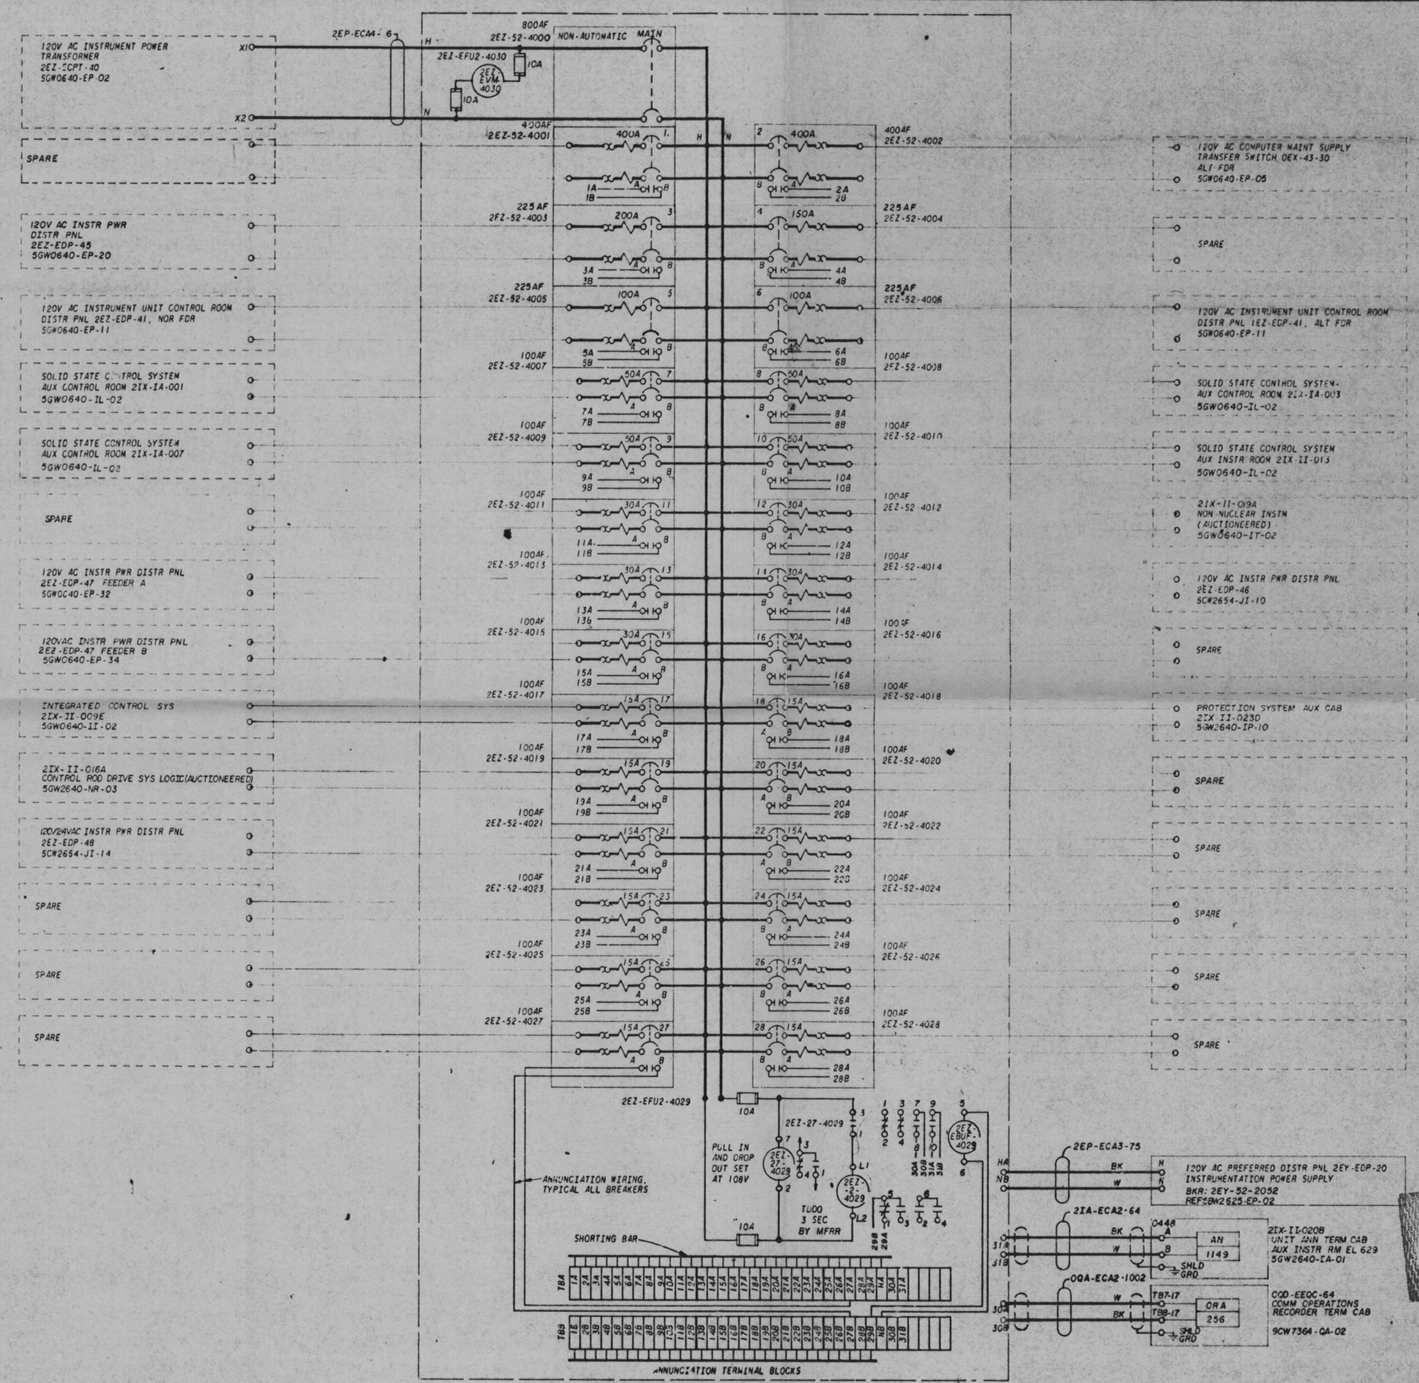

GENERAL NOTES AND REFERENCES ON 5GW0640-EP-03

120V AC COMPUTER MAINT SUPPLY TRANSFER SWITCH OEX-43-30 ALT FDR 5GW0640-EP-05
SPARE
120V AC INSTRUMENT UNIT CONTROL ROOM DISTR PNL 1EZ-EDP-41, ALT FDR 5GW0640-EP-11
SOLID STATE CONTROL SYSTEM AUX CONTROL ROOM 21X-IA-003 5GW0640-IL-02
SOLID STATE CONTROL SYSTEM AUX INSTR ROOM 21X-II-013 5GW0640-IL-02
21X-II-019A NON-NUCLEAR INSTM (AUCTIONEERED) 5GW0640-IT-02
120V AC INSTR PWR DISTR PNL 2EZ-EDP-46 5GW2654-JI-10
SPARE
PROTECTION SYSTEM AUX CAB 21X-II-023D 5GW2640-IP-10
SPARE
SPARE
SPARE
SPARE
SPARE
SPARE

Docket # 50-438
Control # 8304050536
Date 3-25-83 of Document
REGULATORY DOCKET FILE

PRC APERTURE CARD

REV NO	ECN NO	DATE	DSGN	DRWN	CHKD	SUPV	ENGR	INSP	SU/MA	RLCH	APPD
3	S1										
INCORPORATED FCR E-2183											
2	1140										
REVISED LOAD REMOVED LOCATIONS											
1	51,689,690										
REVISED LOADS AND BKR. SIZES ADDED MON POINTS AND CABLES											

DSGN / DRWN / CHKD / SUPV / INSP / ENGINEER

GENERAL

UNITS 1&2

SCHEMATIC DIAGRAM
250V NORMAL DC POWER
DISTRIBUTION SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

N

SUBMITTED	RECOMMENDED	APPROVED

KNOXVILLE 3-9-78 | 88 | E | 5GW0640-EP-04 R3

RECORD DRAWING AS CONSTRUCTED

INSPECTED AND APPROVED FOR ISSUE

THIS DRAWING IS UNDER