

000-EEOC-64
COMMUNICATIONS OPERATIONS
RECORDER TERMINATION CABINET
COL C12N EL 610 (90W7364-QA-01)

11X-11-0208
UNIT ANNUNCIATOR
SCH 1640-11A-422-J
COL C4N(C10N) EL 629





000-EEOC-64
COMMUNICATIONS OPERATIONS
RECORDER TERMINATION CABINET
COL C12N EL 610 (90W7364-QA-01)

11X-11-0208
UNIT ANNUNCIATOR TERM CAB
SCH 1640-11A-422-J
COL C4N(C10N) EL 629

SYMBOLS:
AN UNIT ANNUNCIATOR (XXXX POINT NUMBER)
ORA COMMUNICATIONS OPERATIONS RECORDING AND ANNUNCIATION (XXXX POINT NUMBER)

- NOTES:
- THIS DRAWING SHOWS INTERCONNECTION OF INSTRUMENT CONTROL ANNUNCIATION, LIGHTING CIRCUITS AND BATTERY CIRCUITS SHOWN FOR UNIT 1, UNIT 2 SIMILAR EXCEPT AS NOTED AND SHOWN IN PARENTHESIS.
 - 26V TURBINE DISTRIBUTION PANELS ARE PROVIDED AS PART OF 850V NORMAL BAT BO. ON CONTRACT 7543-86429.
 - 26V TURBINE BATTERY CHARGERS ARE PROVIDED ON CONTRACT 7643-8642-2.
 - 26V TURBINE BATTERIES ARE PROVIDED ON CONTRACT 7743-8644-4.
 - ALL ANNUNCIATION CONTACTS ARE CLOSE TO ALARM.

- REFERENCE DWS:
- SBW1625-EP SINGLE LINES
 - SW2626-EP KEY DIAGRAM
 - SGC0600-EP CABLE SCHEDULES
 - SGC1600-EP
 - SGC2600-EP

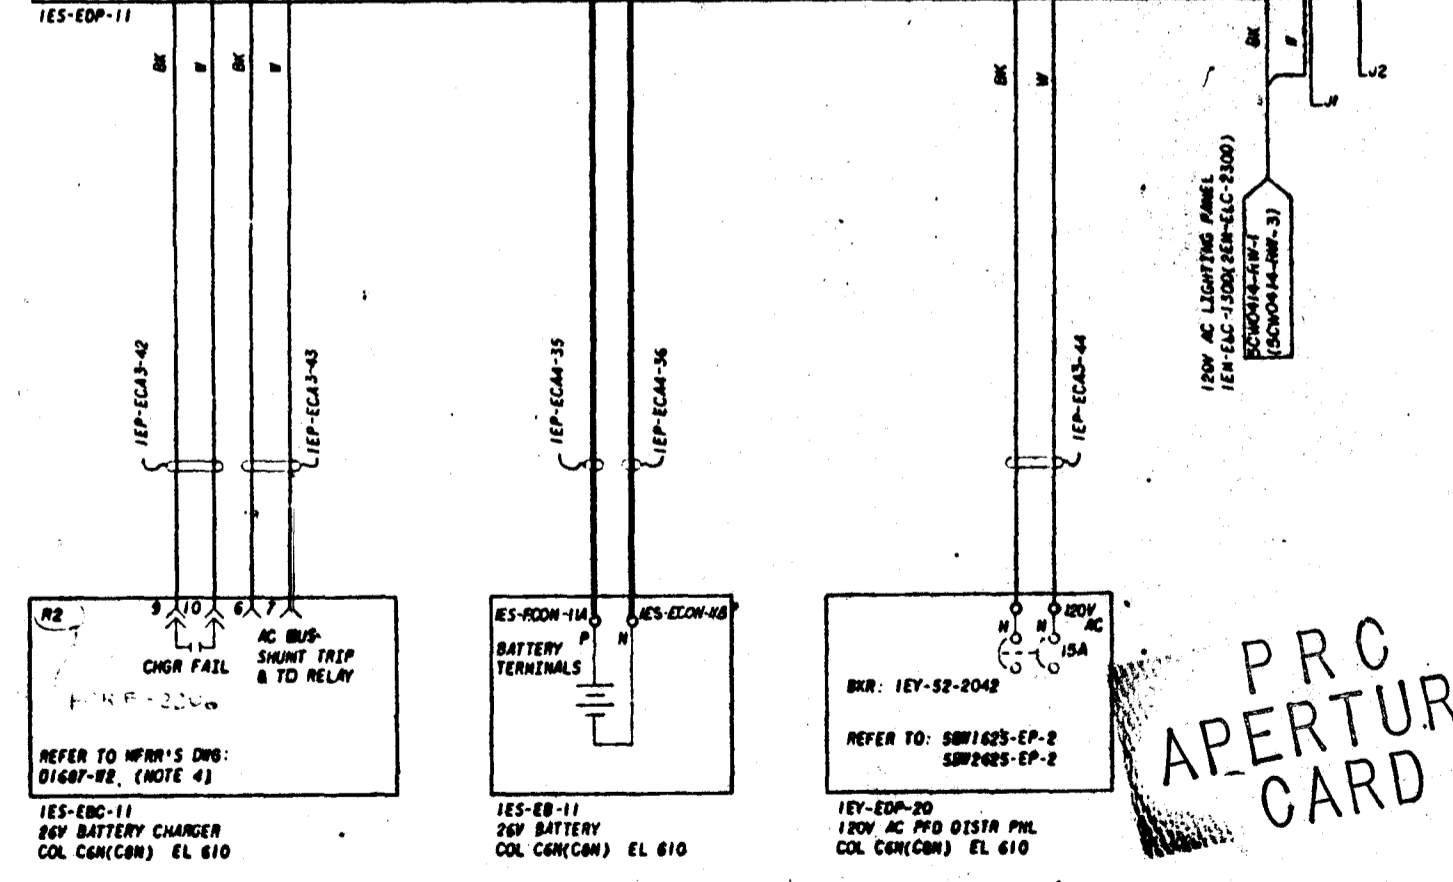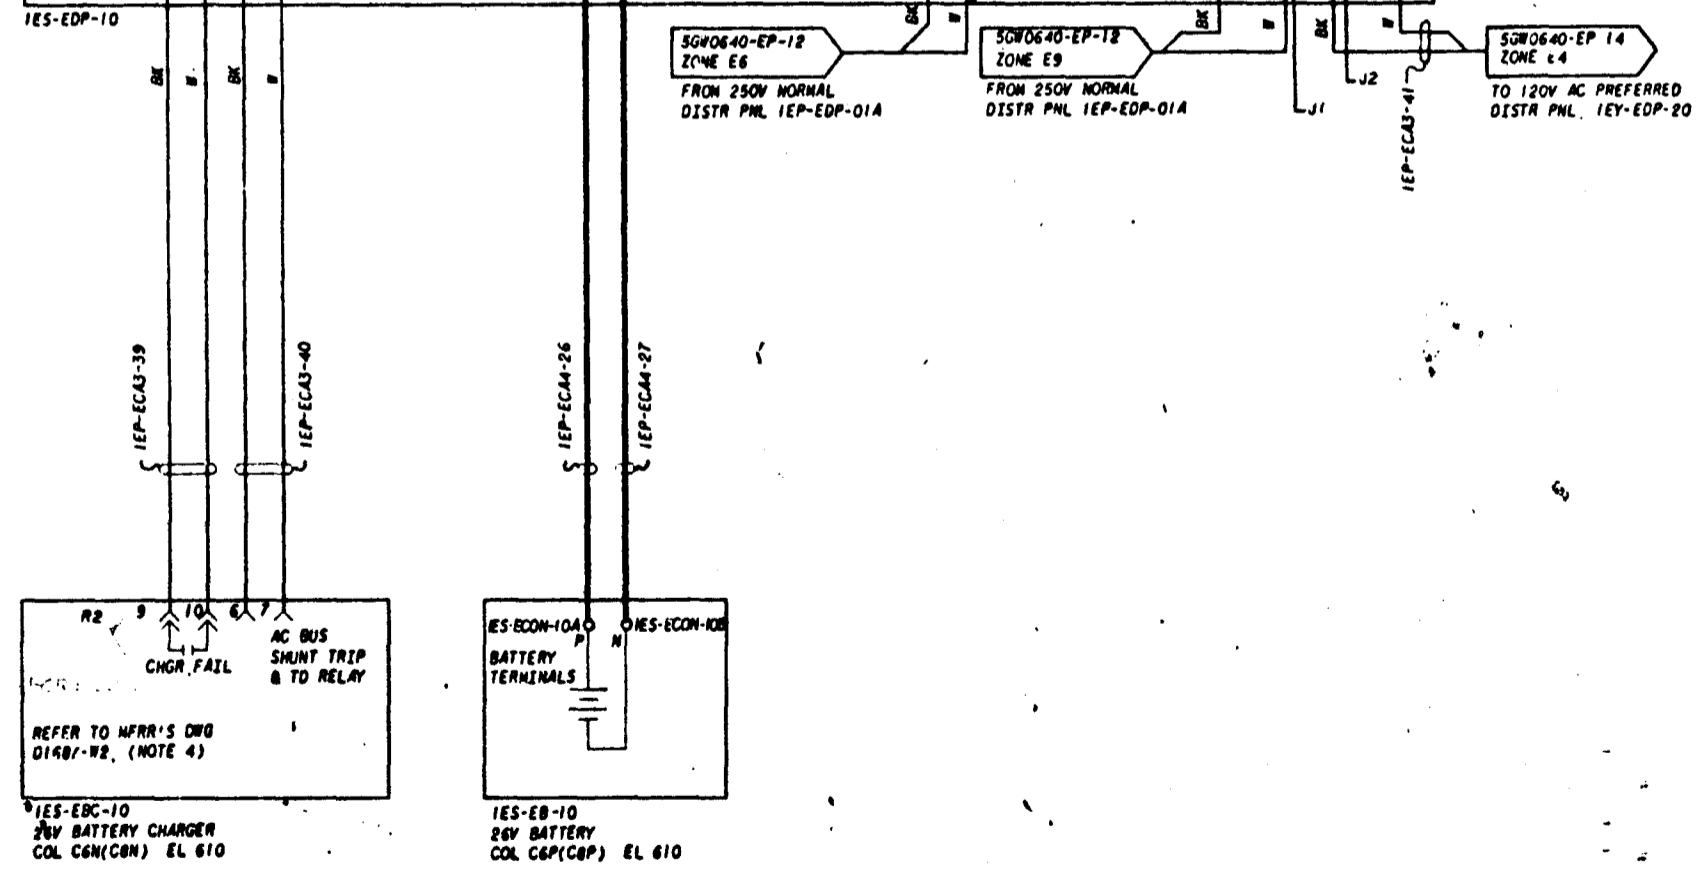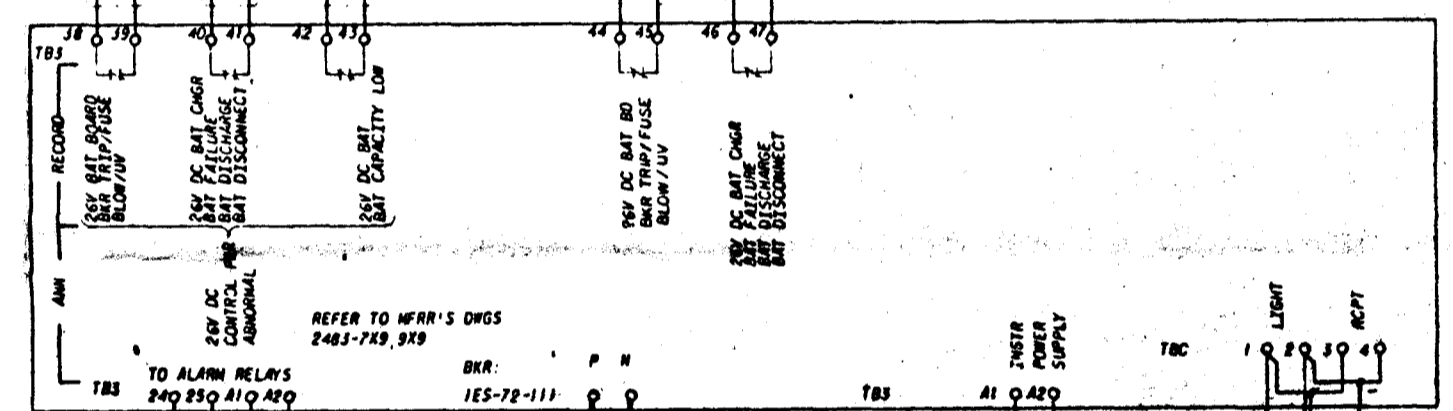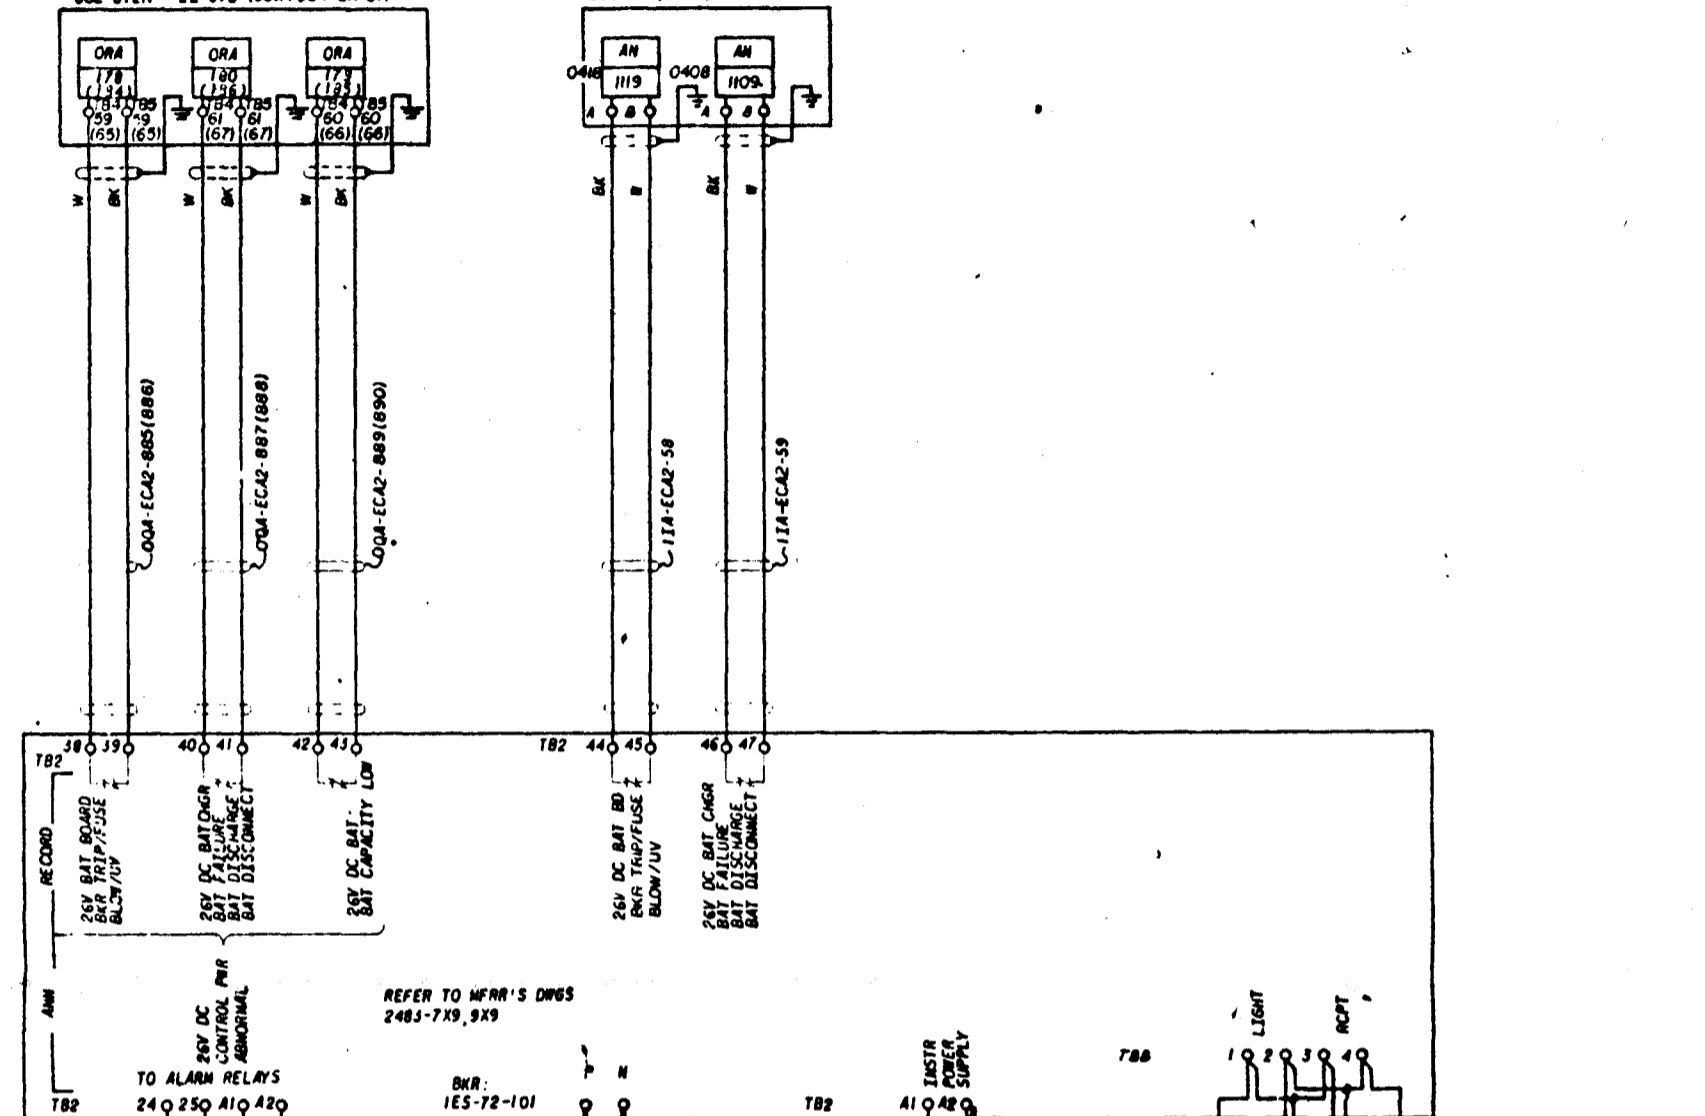

Docket # 58-438
Control # 8304058536
Page 3-25-83 of Documents
REGULATORY DOCKET FILE

PRC
APERTURE
CARD

3	SI	12	1	10/10/83						
INCORPORATED FOR E-2206										
2	SI	11	1	10/10/83						
REVISED JUMPER NUMBERS, AND COLOR CODES										
1	SI	10	1	10/10/83						
REVISED CABLE NOS RELEASED MONITORING SYSTEMS TERMINATIONS										
NO	ECH NO	DATE	BY	REASON	APPROVED	REVISION	DESCRIPTION	DATE	BY	REASON
SCALE EXCEPT AS NOTED										
GENERAL										
UNITS 1&2										
SCHEMATIC DIAGRAM										
250V NORMAL DC POWER										
DISTRIBUTION SYSTEM										
BELLEFONTE NUCLEAR PLANT										
TENNESSEE VALLEY AUTHORITY										
DIVISION OF ENGINEERING DESIGN										
SUBMITTED										
INSPECTED AND APPROVED FOR ISSUE										
KNOXVILLE 1-2-77 88 E SGM0640-EP-13 ns										

COPIATION DWS:
SGM0640-EP-1, 2, 12, 14

THIS DRAWING IS UNDER CONFIGURATION CONTROL