
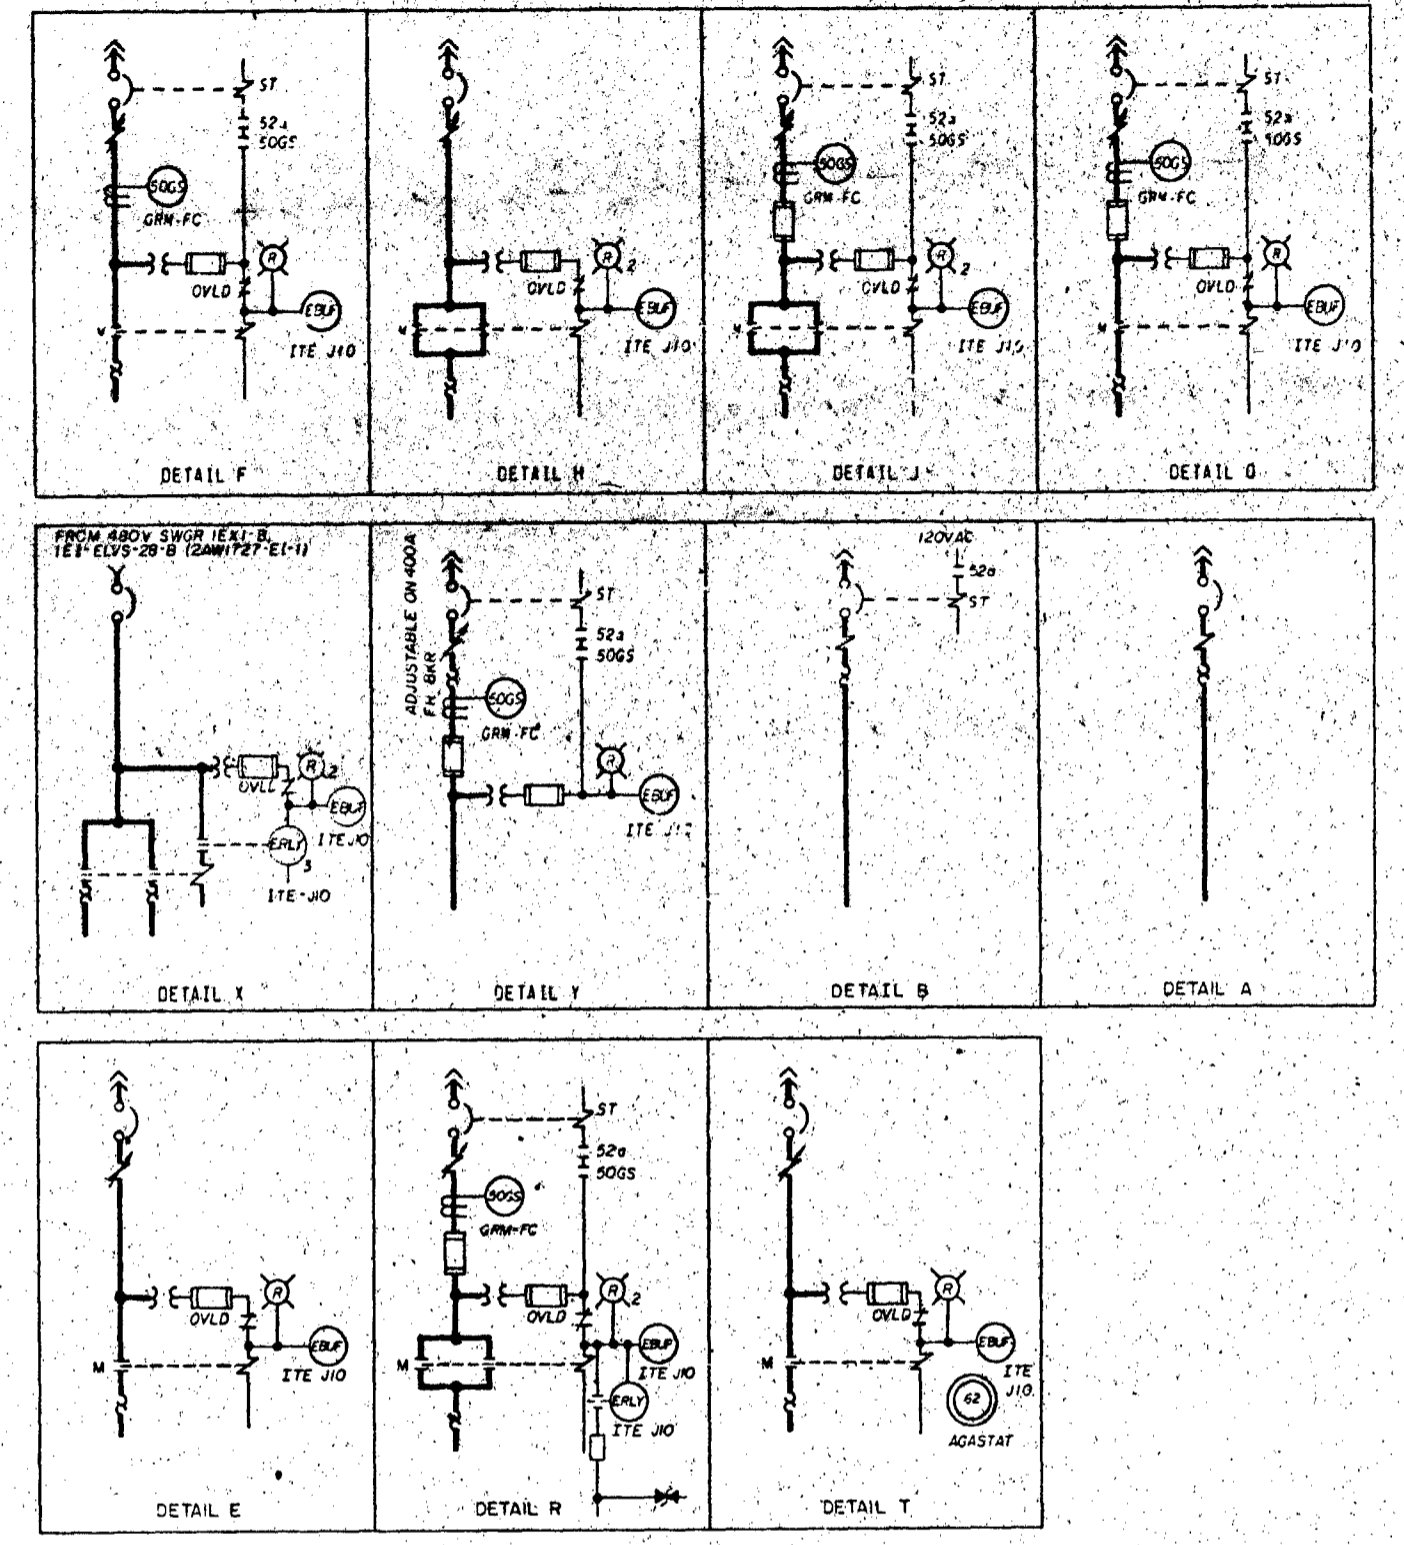



Table with columns: COMPT NO, LOAD, UNID, DETAIL, LOAD SIZE, SCHEMATIC DWG REFERENCE. Contains items like MAIN BREAKER, SPARE, RB CC INLET ISOLATION MOV, etc.

Table with columns: COMPT NO, LOAD, UNID, DETAIL, LOAD SIZE, SCHEMATIC DWG REFERENCE. Contains items like SFC PUMP B CROSS FEED, HYDROGEN RECIRCULATION FAN, etc.

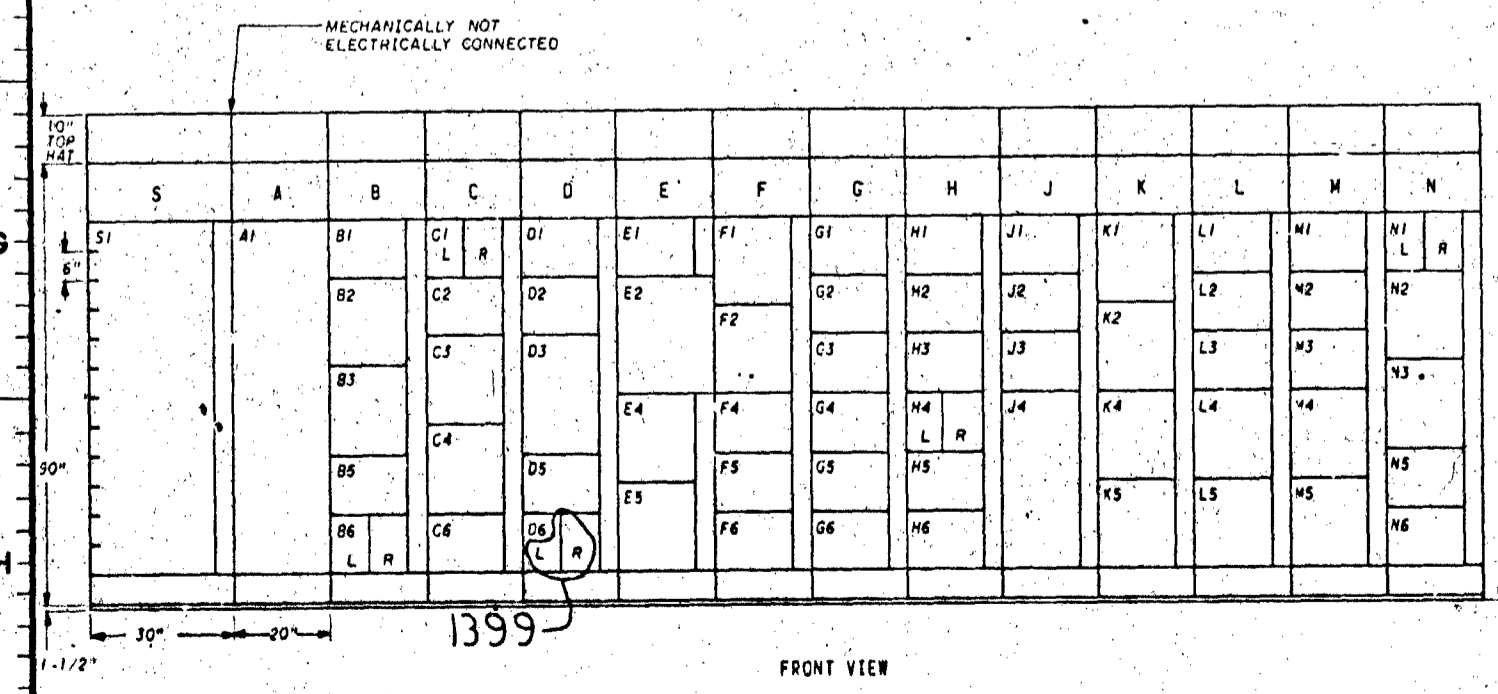

- NOTES
1. 480V MOTOR CONTROL CENTER PROVIDED ON YEA CONTRACT NO 76X5-86242 BY SGG/VE.
2. ALL WOLDED CASE 480V CIRCUIT BREAKERS ARE 15000 WITH AN INTERRUPTING RATING OF NOT LESS THAN 25,000 MVA SYMMETRICAL AMPS AT 480V CIRCUIT BREAKERS SHOWN WITH SHUNT TRIP COILS...

- REFERENCED DRAWINGS AND DOCUMENTS
PLANT AC AUXILIARY POWER SYSTEM SINGLE LINE...
SINGLE LINE DIAGRAM 480V SWITCHGEAR EX-1-B...
480V CLASS F AC AUXILIARY POWER DISTRIBUTION SYSTEM SCHEMATIC...

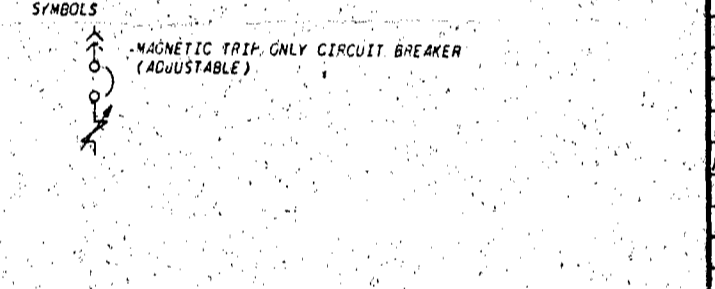

Docket # 8-438
Control # 8304050526
REGULATORY DOCKET FILE

P.R.C. APERTURE CARD

COMPANION DWG. SAW1733-EE-03 SAW1733-EI-02 HAS BEEN VOIDED

Approval and signature block. Includes fields for SUBMITTED, RECOMMENDED, APPROVED, and INSPECTED AND APPROVED FOR ISSUE. Signatures of O.T. Gorman, G.P. Gorman, and R.M. Gorman. Date: 12-6-74.

Revision table with columns: NO., REV. NO., DATE, DESCRIPTION. Shows revisions 1 through 5.

SAW1733-EI-01
EXCEPT AS NOTED
AUXILIARY BUILDING UNIT 1
SINGLE LINE 480V MCC 1E1-B 1E1-EMCC-66-B

BELLEFONTE NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN
KNOXVILLE, TN 37902
THIS DRAWING IS UNDER CONFIGURATION CONTROL