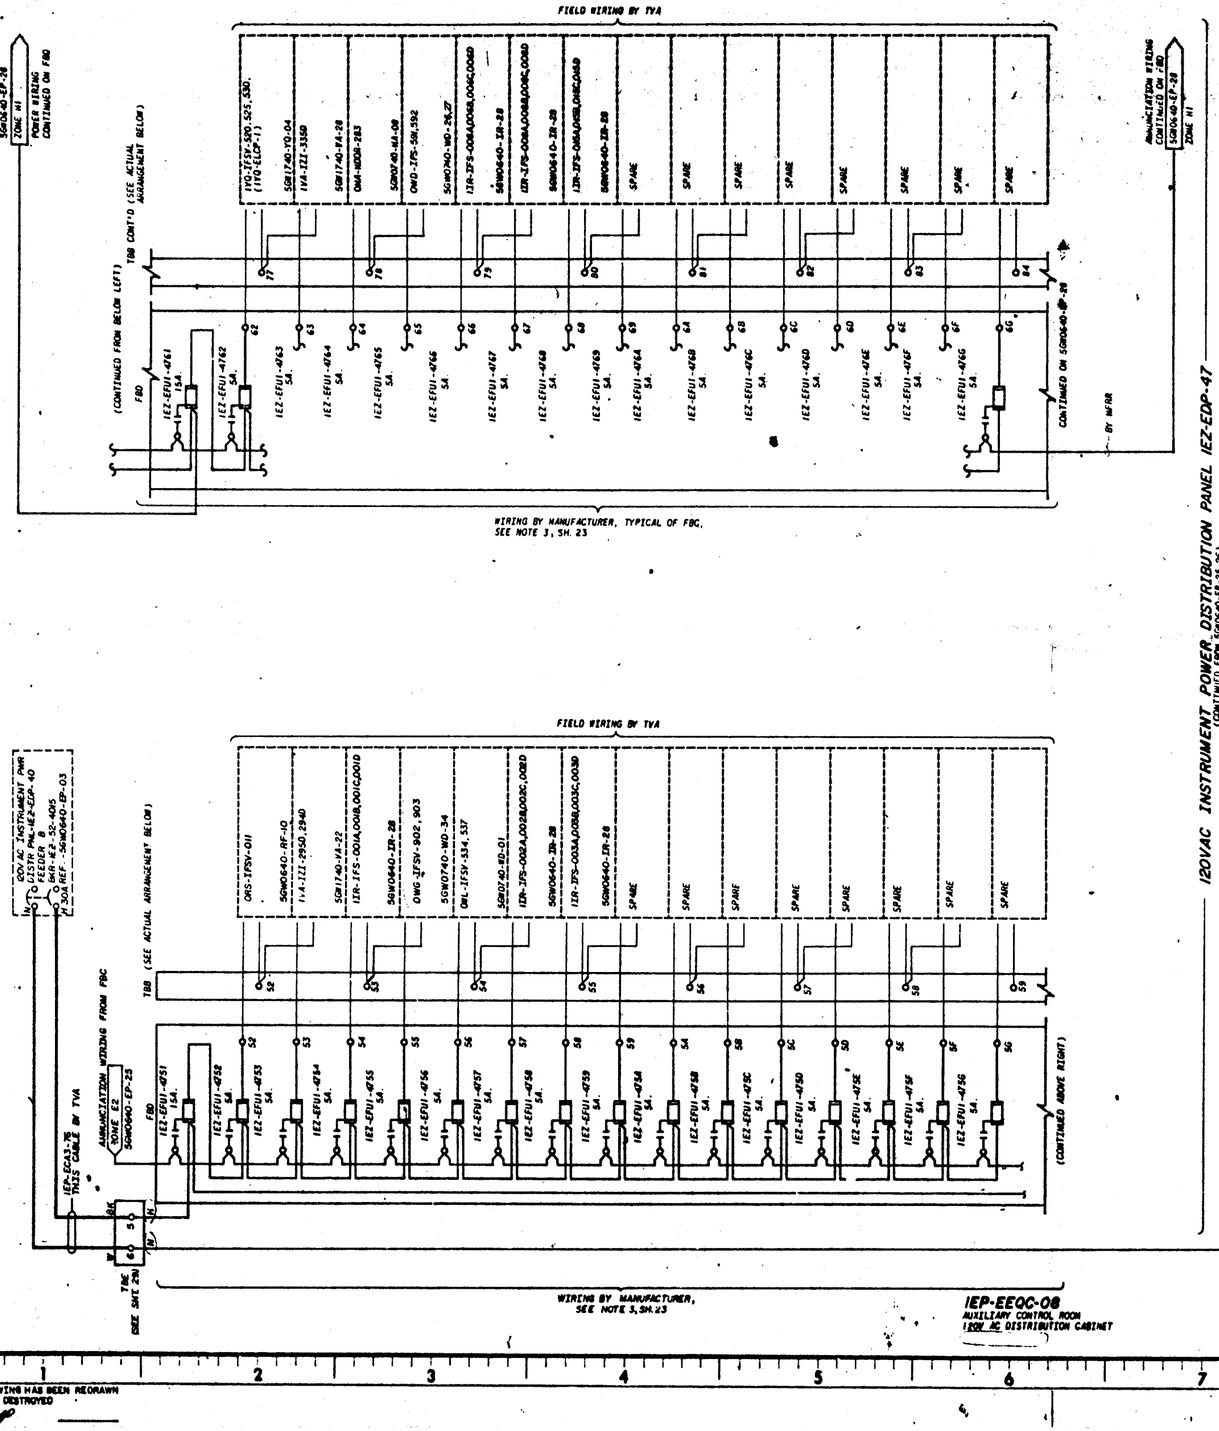

120VAC INSTRUMENT POWER DISTRIBUTION PANEL 1EZ-EDP-47

(CONTINUED FROM SGW0640-EP-25,26) (CONTINUED ON SGW0640 EP-28)

FIELD WIRING BY TVA



NOTES:
1. FOR GENERAL NOTES REFERENCES, REFER TO SGW0640-EP-03.
2. THIS DRAWING SUPERSEDES GOULD DRAWING 048-53049003 SHEET 3 CONTRACT TBK-1-823F05, FOR CONTRACT DOCUMENTATION.

COMPANION DWGS: SGW0640-EP-23-26,28,29 SAS-40F3-EP-01

IEP-EEQC-08 AUXILIARY CONTROL ROOM 120V AC DISTRIBUTION CABINET

Docket #50-438 Control #8304050536 Date 3-25-83 of Documents REGULATORY DOCKET FILE

PRC APERTURE CARD

2	1140				
MISC CHANGES					
1	51.690				
REDRAWN, ADDED FUSE LOADS, POWER FOR B.					
NO.	ECN NO.	DATE			
DRN	C.G. PETERSON		MGR		
DES	D.C. SCHULTZ, M.C. PATTON				
TRC	D.C. CRAWLEY		ENGINEER	N.B. STEVENSON	
QA	D.C. CRAWLEY				

SCALE: NTS — EXCEPT AS NOTED

GENERAL
UNITS 1&2

SCHEMATIC DIAGRAM 250 VDC NORMAL POWER DISTRIBUTION SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

N

SUBMITTED	RECOMMENDED	APPROVED
D.V. Jones		

INSPECTED AND APPROVED FOR ISSUE

KNOXVILLE 7-11-77 | 88 | E | SGW0640-EP-27 R2

THIS DRAWING HAS BEEN REDRAWN ORIGINAL DESTROYED 9-11-79