120VAC INSTRUMENT POWER DISTRIBUTION PANEL 1EZ-EDP-47

(CONTINUED FROM SQN0640-EP-25, 26, 27)

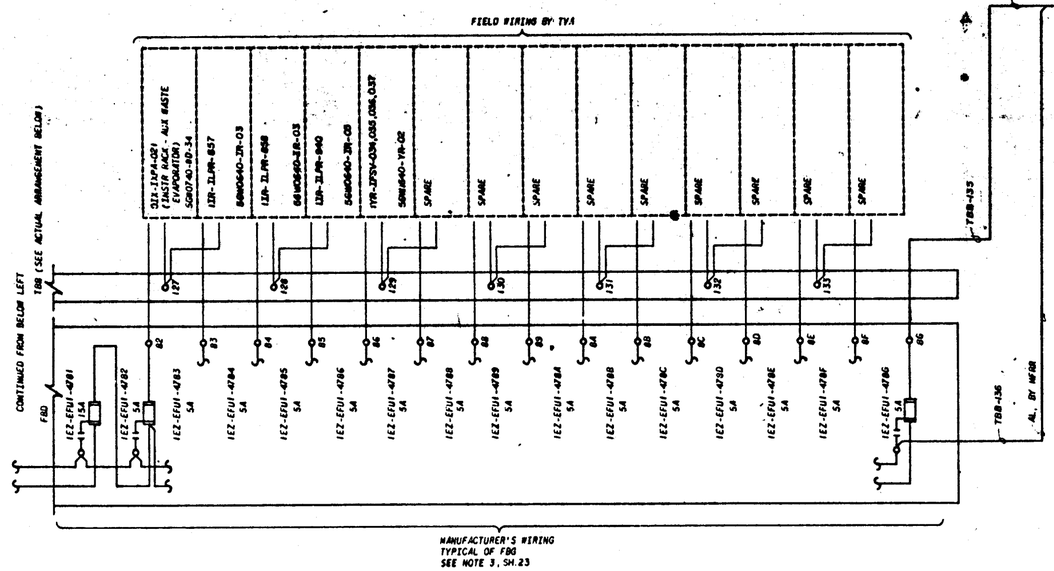

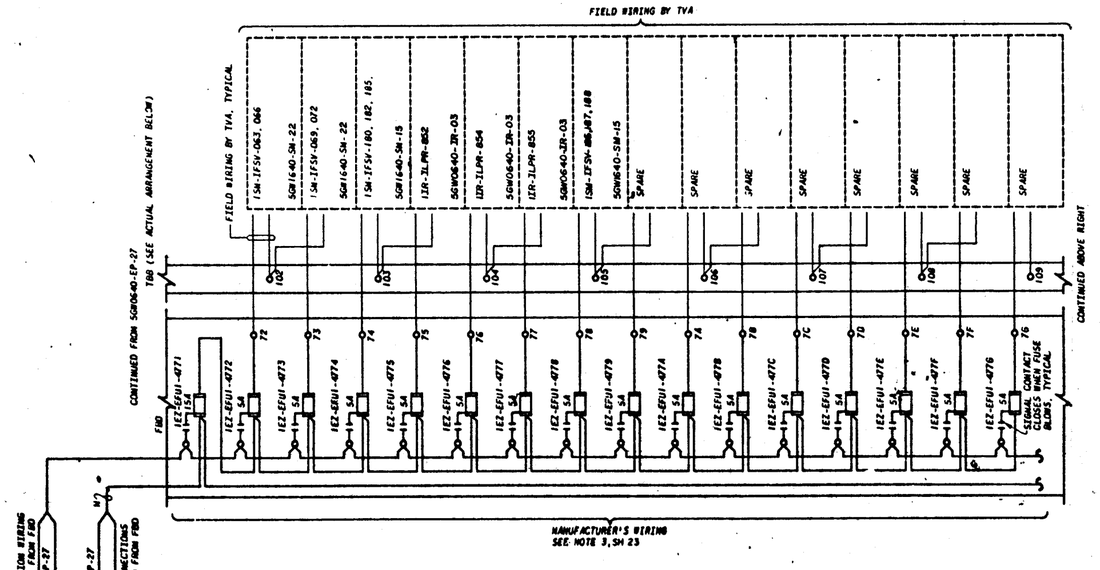

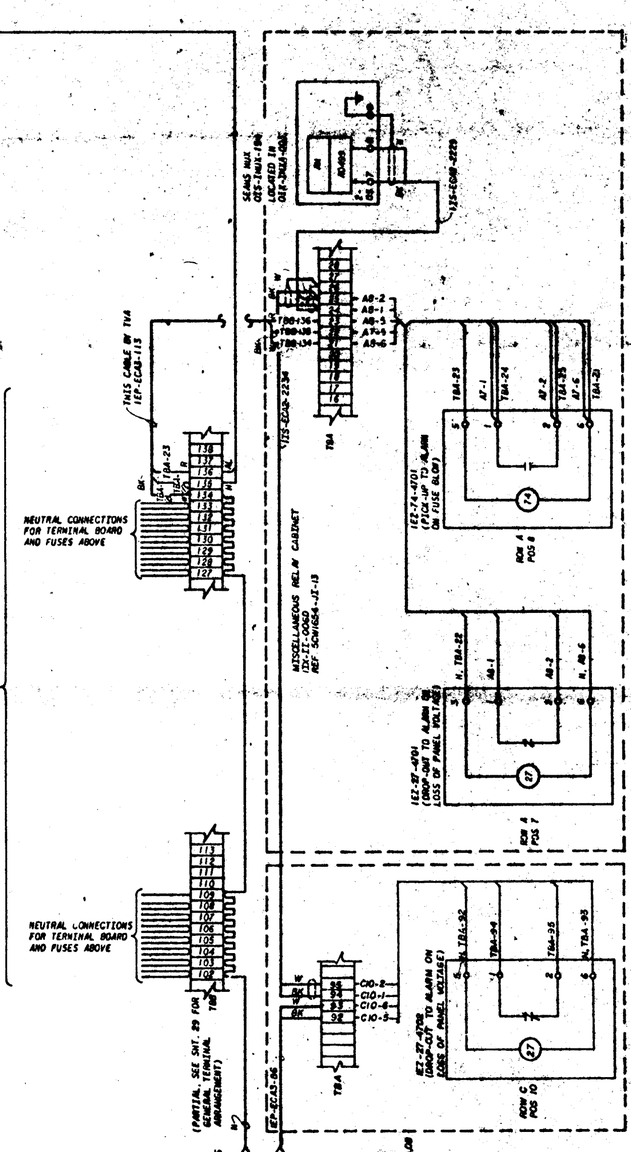

NOTES:

1. FOR GENERAL NOTES AND REFERENCES REFER TO SQN0640-EP-23.
2. MISCELLANEOUS RELAY CABINET IIX-II-006C AND IIX-II-006D ARE PROVIDED ON TVA CONTRACT TVA-821364. WIRING BETWEEN CABINETS IS BY TVA.
3. THIS DRAWING SUPERSEDES COULD DRAWING 048-5304903, SHEET 4, CONTRACT TBK4-823706. FOR CABINET DOCUMENTATION.

REFERENCE DRAWINGS:
SCH1654-JI-06,08,13 ------ WIRING DIAGRAM, MISC RELAY CABINETS

IEP-EEQC-08
AUXILIARY CONTROL ROOM
120V AC DISTRIBUTION CABINET

Docket # 50-438
Control # 8304050536
Date 3-25-83 of Document
REGULATORY DOCKET FILE

PRC APERTURE CARD

2	11-4-0	5-5-21		
MISC CHANGES.				
1	S1, 690	11-1-1		
REDRAWN, ADDED FUSE LOADS, MON POINT, CABLES, ALARM RELAY,				
NO.	ECN NO.	DATE		

DSGN C.O. PETERSON
DTGN J.G. BEASLEY, JR. [illegible]
CHK J.G. HEARN
SUPV J.G. SAUNDERS
MGR
ENGINEER M.R. STEVENSON

SCALE: NTS — EXCEPT AS NOTED

GENERAL
UNITS 1&2

SCHEMATIC DIAGRAM 250 VDC NORMAL POWER DISTRIBUTION SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

N

SUBMITTED	RECOMMENDED	APPROVED
M.R. Stevenson	[signature]	R.M. Hodges

KNOXVILLE | 7-12-77 | 88 | E | SQN0640-EP-28 R2

INSPECTED AND APPROVED FOR ISSUE

THIS DRAWING HAS BEEN REDRAWN OR ORIGINAL DESTROYED
9-10-79