




NOTES
 1. FOR GENERAL NOTES AND REFERENCES, REFER TO SGM0640-EP-32.
 2. 2E2-EDP-47 IS PART OF 120V AC INSTRUMENT POWER DISTRIBUTION SYSTEM I.E., A SINGLE-PHASE, SINGLE-POINT GROUND SYSTEM, TRANSFORMER SUPPLIED.
 3. THIS DRAWING SUPERSEDES ONLY DRAWING 044-4304-000, SHEET 3, CONTRACT 1964-08705, FOR CABINET DOCUMENTATION.

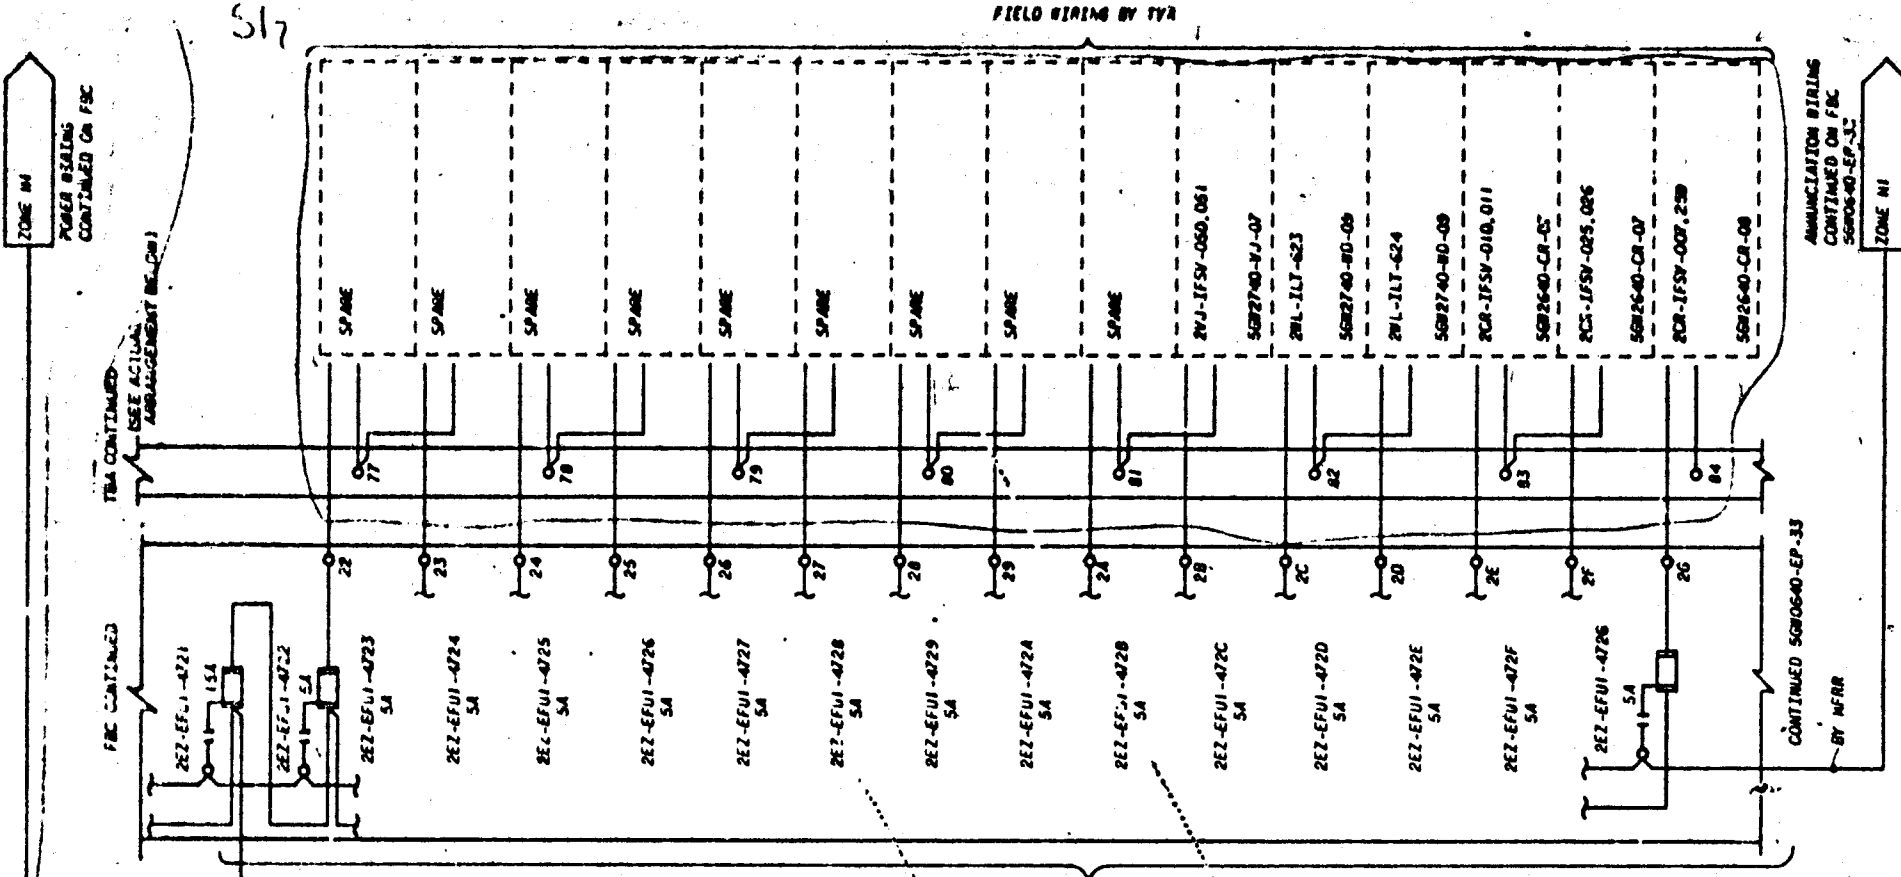

120V AC INSTRUMENT POWER DISTRIBUTION PANEL 2E2-EDP-47
 (CONTINUED ON SGM0640-EP-32, 34, 35)

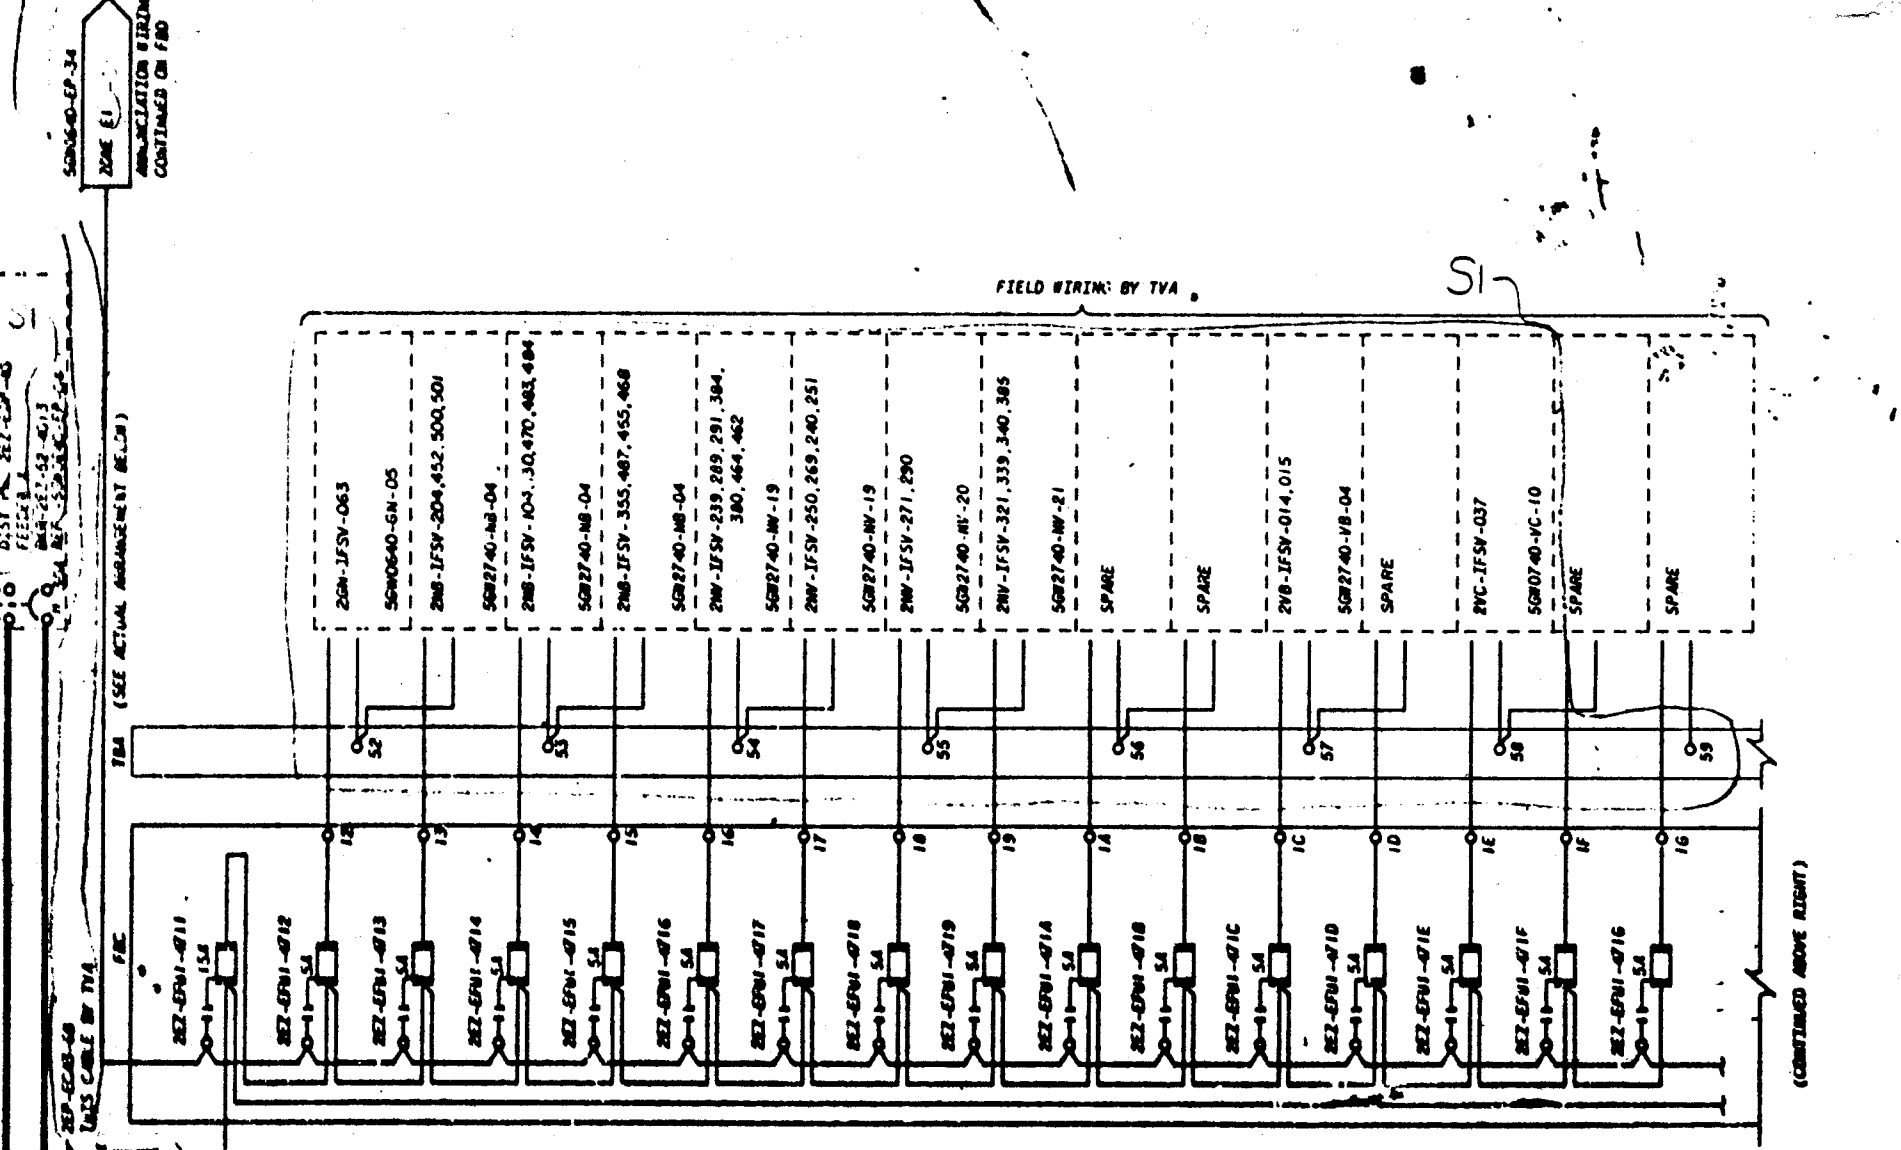

2E2-EEOC-08
 AUXILIARY CONTROL ROOM
 120V AC DISTRIBUTION CABINET

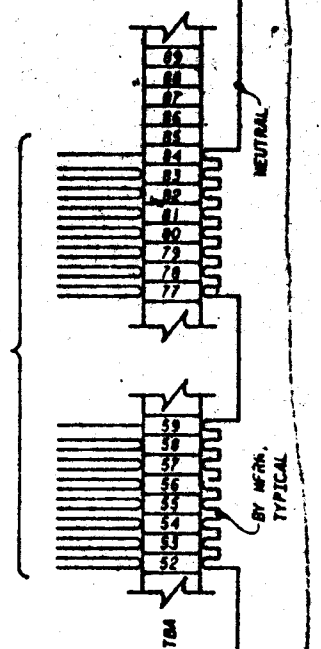

PRC
 APERTURE
 CARD

Doc # 50 438
 Control # 8304050534
 Date 3-25-83 of Document
 REGULATORY DOCKET FILE

COMPARISON DWS:
 SGM0640-EP-30, 31, 33-36

1	81,890	1-5-80	REVISED	BY: J.S.	CHK: J.S.
REWORK: ADDED FUSE LOADS, CABLE NO., ADDED TIE, REMOVED WIRING TO FIB AND TIB, ADDED TIB					
NO.	ECN NO.	DATE	DESCRIPTION	BY	CHK
1	81,890	1-5-80	REVISED	J.S.	J.S.
2	81,890	3-25-83	REVISED	J.S.	J.S.
SCALE: GENERAL UNITS 1 & 2					
SCHEMATIC DIAGRAM 250V DC NORMAL POWER DISTRIBUTION SYSTEM					
BELLEFONTE NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN					
DESIGNED BY	RECOMMENDED BY	APPROVED BY			
J.S.	J.S.	J.S.			
KNOXVILLE					
88 E SGM0640-EP-32 81					