


NOTES:
 1. FOR GENERAL NOTES AND REFERENCES, REFER TO 5GMO640-EP-30.
 2. THIS DRAWING SUPERSEDES COULD DRAWING 5GMO640-EP-30, SHEET 4, CONTRACT P&I-823P06, FOR CABINET DOCUMENTATION.

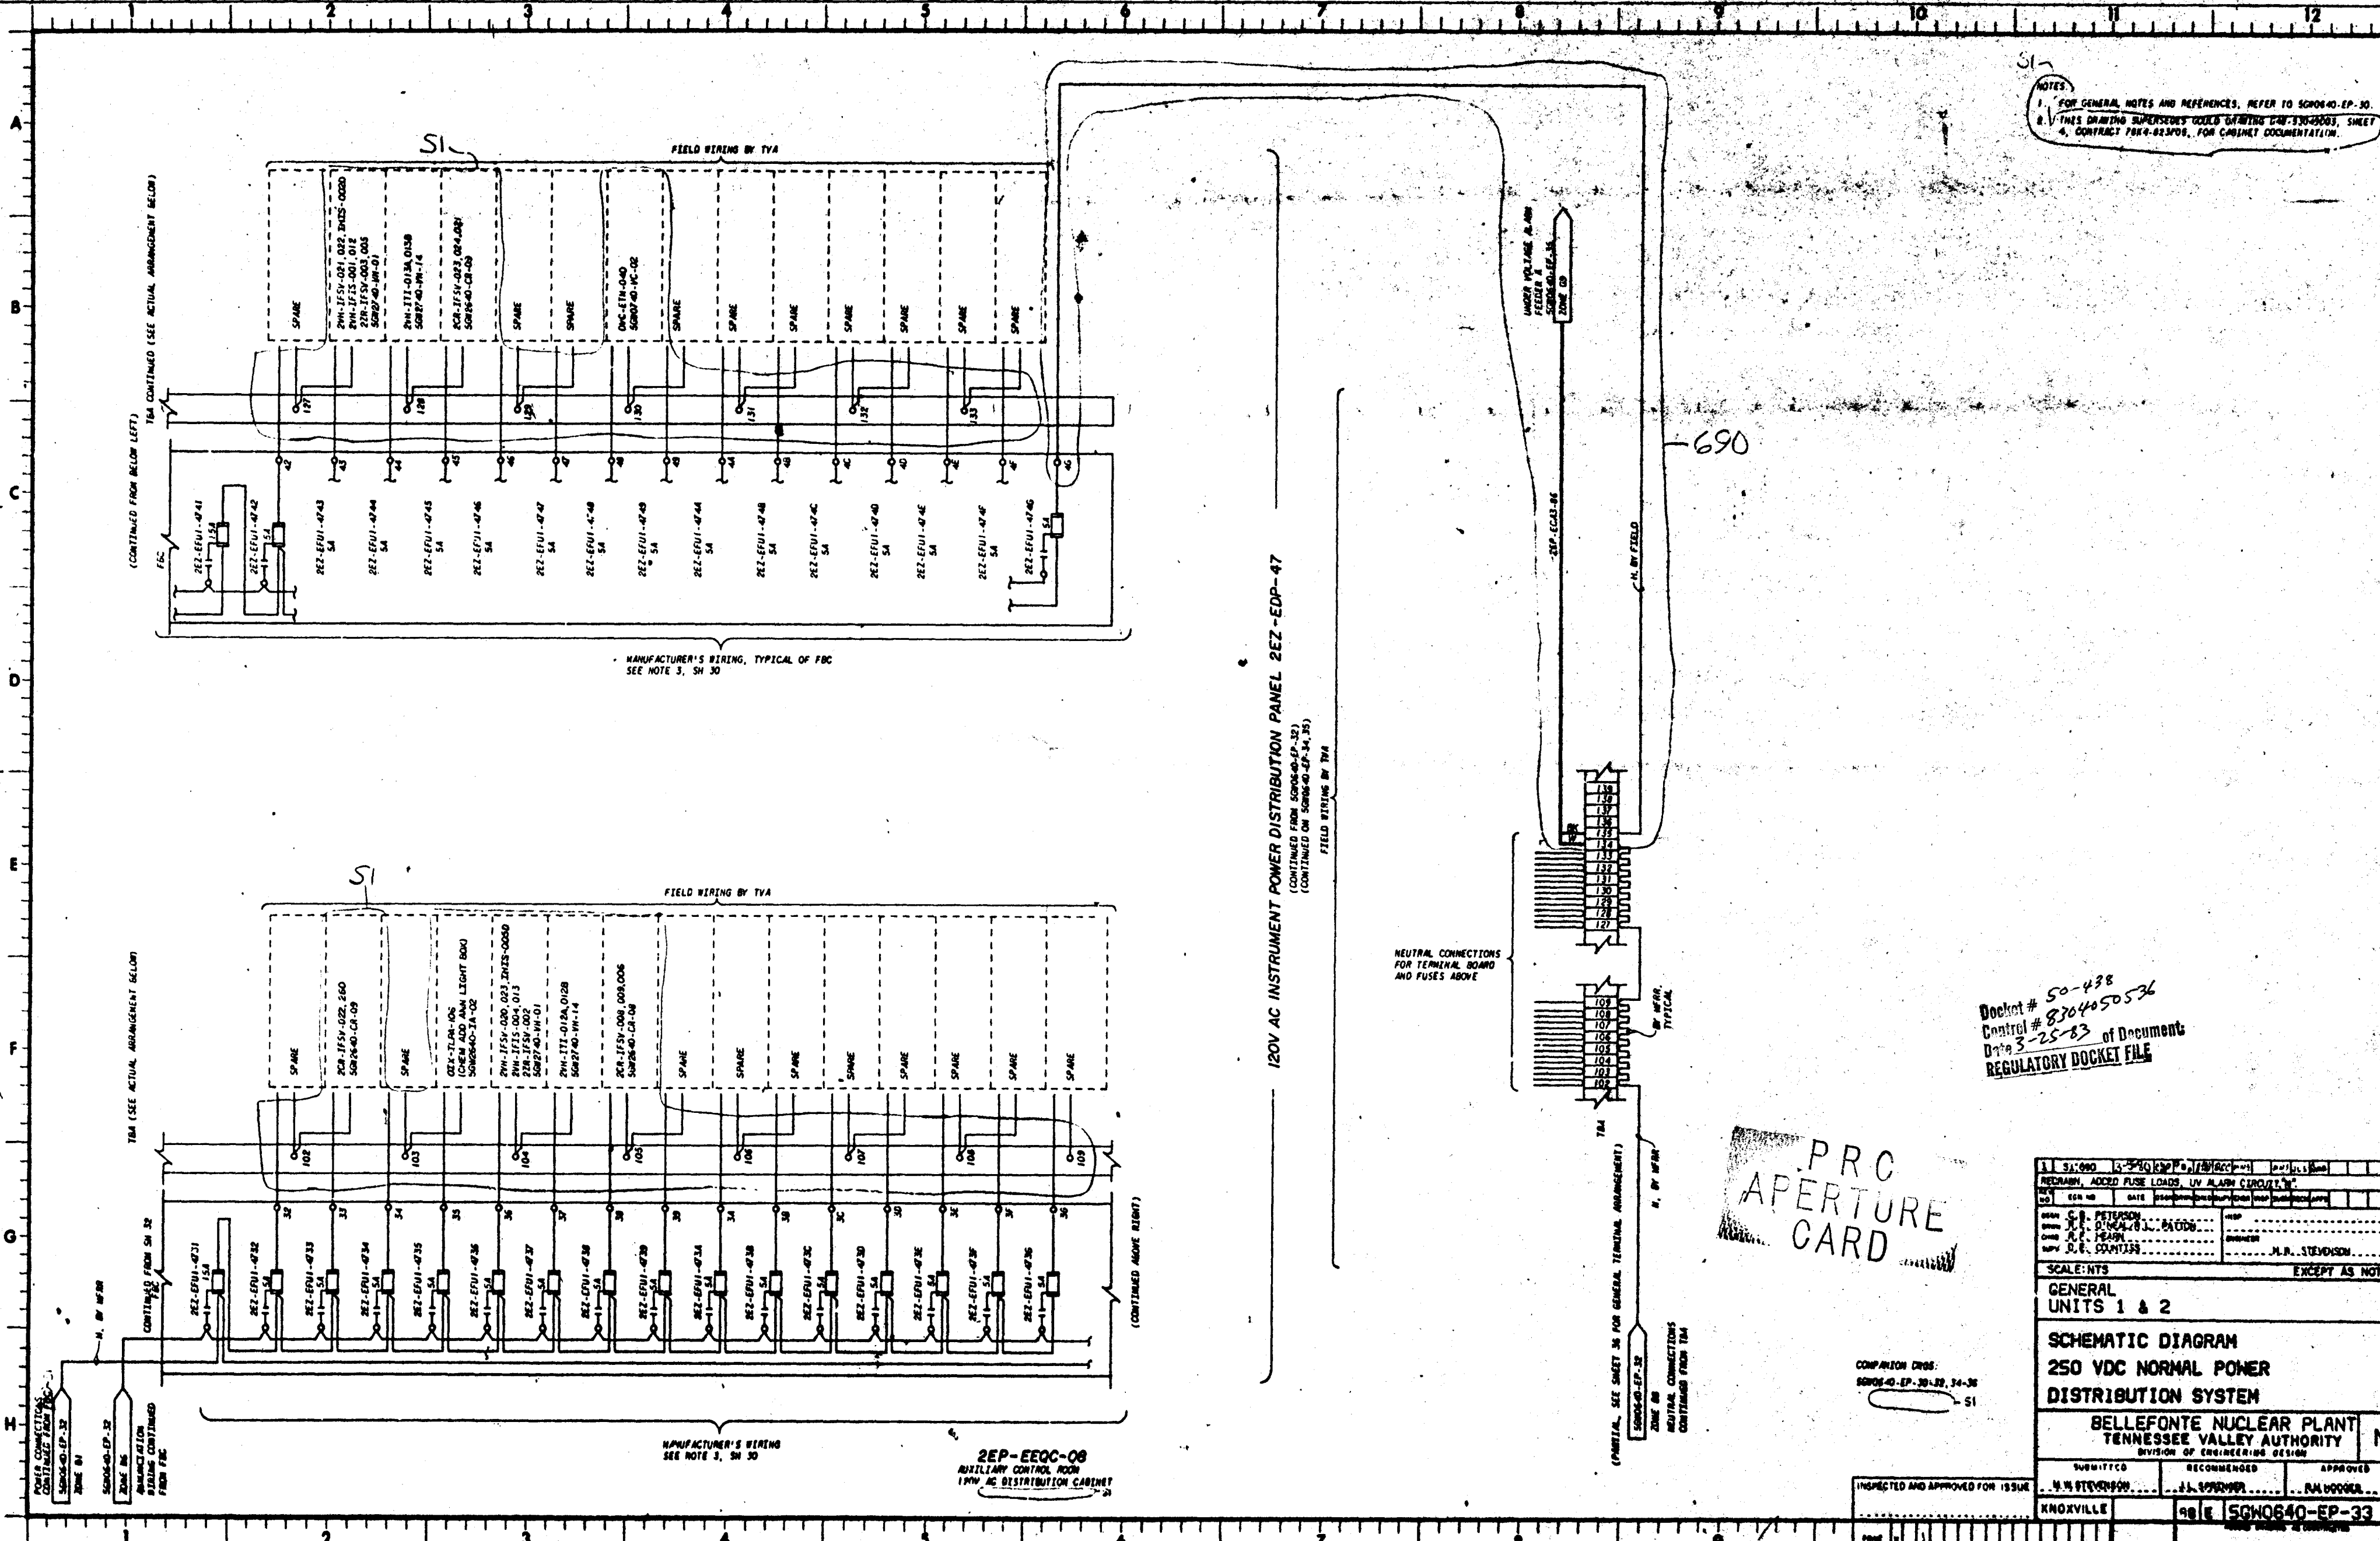

120V AC INSTRUMENT POWER DISTRIBUTION PANEL 2EZ-EDP-47
 (CONTINUED FROM 5GMO640-EP-32)
 (CONTINUED ON 5GMO640-EP-34, 35)

Docket # 50-438
 Control # 8304050536
 Date 3-25-83 of Document
 REGULATORY DOCKET FILE

PRC
 APERTURE
 CARD

REV	DATE	DESCRIPTION	BY	CHKD
1	3-25-83	REVISED TO REFLECT CHANGES TO THE PANEL	J. R. PETERSON	M. R. STEVENS
2	4-15-83	REVISED TO REFLECT CHANGES TO THE PANEL	J. R. PETERSON	M. R. STEVENS
3	5-15-83	REVISED TO REFLECT CHANGES TO THE PANEL	J. R. PETERSON	M. R. STEVENS

SCALENTS EXCEPT AS NOTED

GENERAL UNITS 1 & 2

SCHMATIC DIAGRAM
 250 VDC NORMAL POWER
 DISTRIBUTION SYSTEM

BELLEFONTE NUCLEAR PLANT
 TENNESSEE VALLEY AUTHORITY
 DIVISION OF ENGINEERING DESIGN

SUBMITTED: J. R. PETERSON
 RECOMMENDED: J. L. STEVENS
 APPROVED: M. R. STEVENS

INSPECTED AND APPROVED FOR ISSUE: J. L. STEVENS
 KNOXVILLE

5GMO640-EP-33